

8720 PINE TREE CR

11319606

1/8/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

ACL pmt #1763 chk #100 9/24/03 CK

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

David's

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102 5384B

Date: 9/22/03

PERSON FILING APPLICATION:
NAME: Lominac (last) Linda (first) H (mi)
ADDRESS: 8728 Pinetree Cr PHONE: 704 697-9889
CITY: Charlotte STATE: NC ZIPCODE: 28278

PROPERTY OWNER:
NAME: Hyatt (last) Dorothy Thad (first) (mi)
ADDRESS: 8720 Pinetree Cr. PHONE: 704 399-3889
CITY: Charlotte STATE: NC ZIPCODE: 28278

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 113-196-06
STREET ADDRESS: 8720 Pine Tree Circle
ZONING:
SUBDIVISION OR MOBILE HOME PARK NAME: Dixie

Township (check one):
☒ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

LOT NUMBER: 11 6A LOT SIZE (in acres):

TYPE APPLICATION (check one):
[redacted] 1964
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
☐ COMMERCIAL OR INDUSTRIAL (N)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 2

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☐ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☒ MODULAR HOME (M) ☐ OTHER _____ (O)

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☒ Shared Well (S)
☐ Municipal (N) ☐ Other 'spring' (O)
☐ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☒ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Linda Lominac Date: 9/22/03

NOTICE: Inspect Current Septic system for New Home to be built

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...this permit is not transferable.

...O.K. TO USE EXISTING SYSTEM FOR NEW HOME WITH 3 BEDROOMS

☐ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

[signature] 9/29/03
Environmentalist Date

WATER : 122791

Mr & Mrs Hyatt are my parents and are aware of and approve of the inspection. Her phone# is 704-399-3889

0705

Not
in
LD
11/25/03

Linda Lominac
8728 Pinetree Circle
Charlotte NC
28278

Berryhill Sheet # 46A
7-21-1959
64F

PROPOSED PLOT PLAN


COPY

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 53848

TC: 113-156-06

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

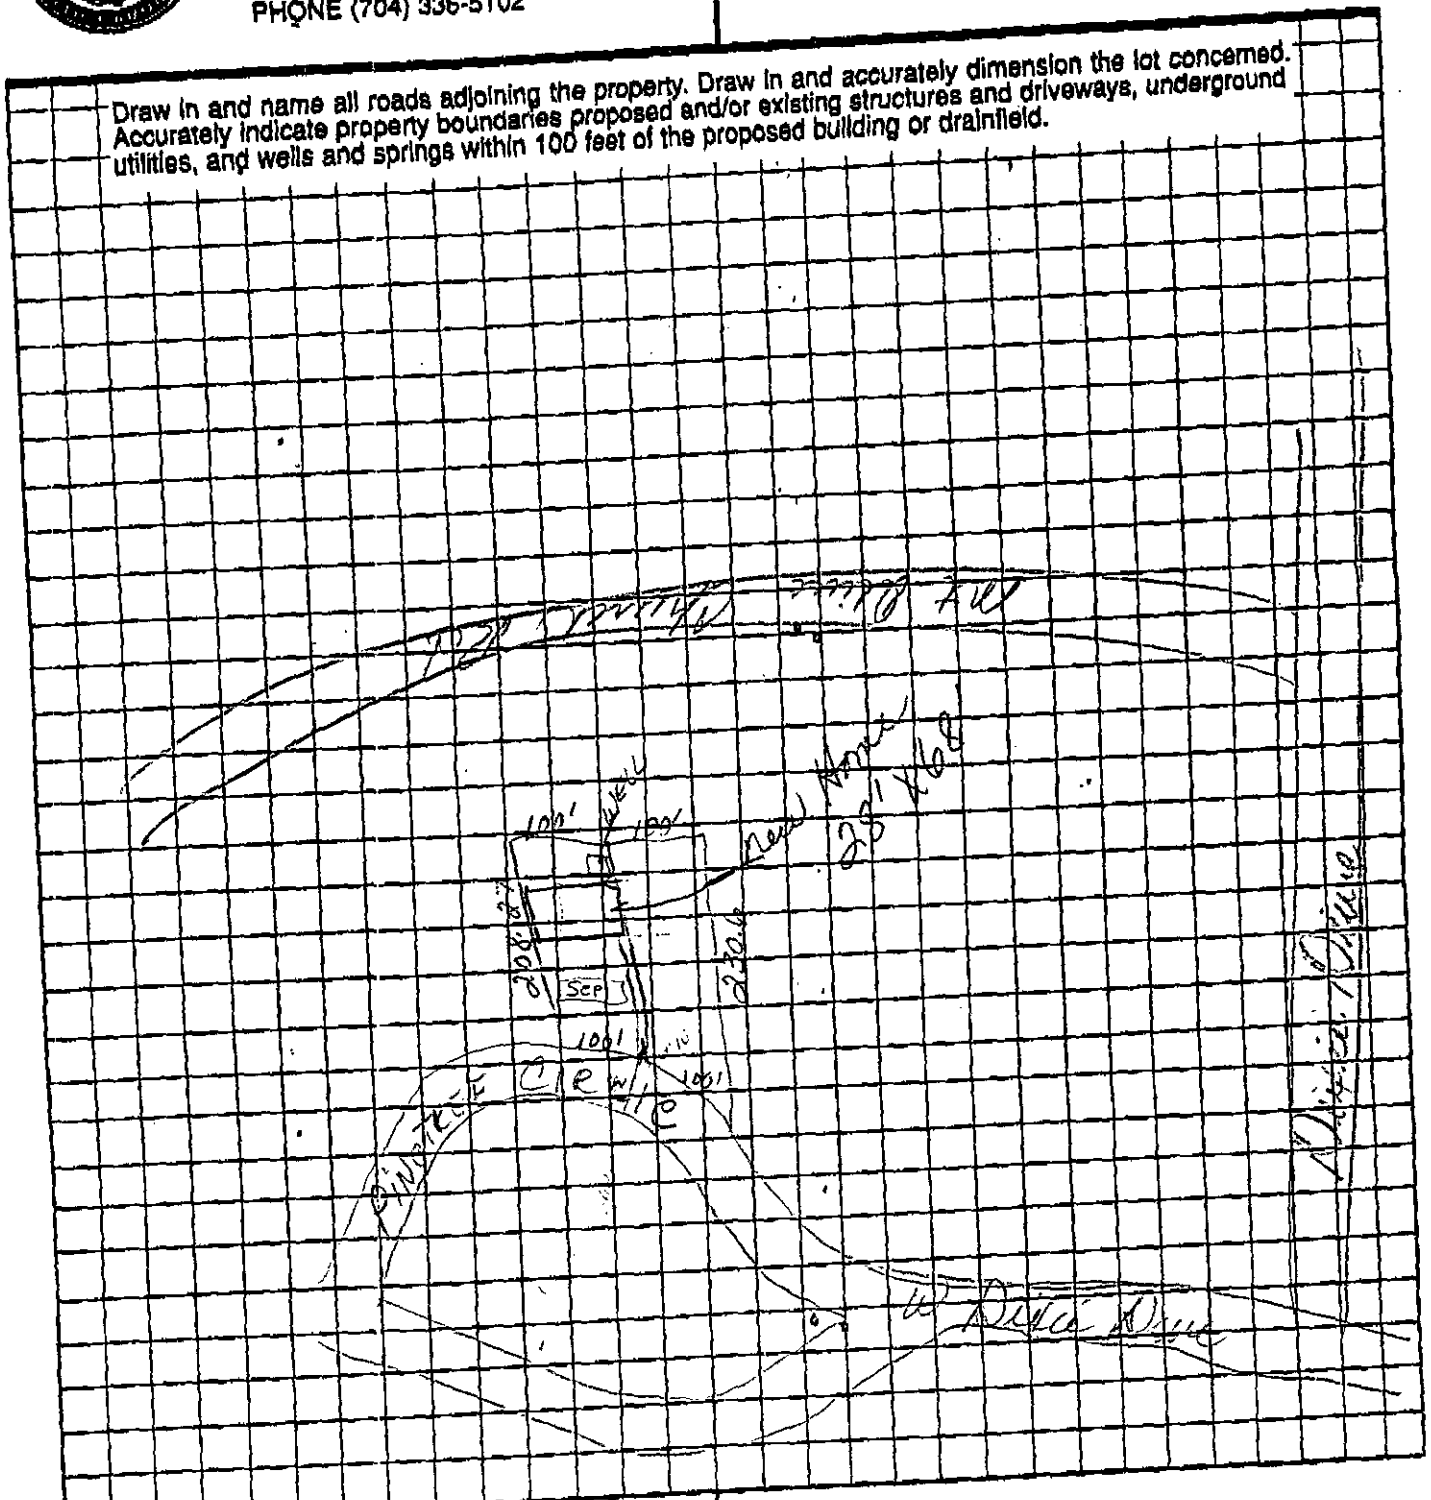

APPROVAL DATE

OWNER/AGENT SIGNATURE

DATE

Canary - E.H.S. Copy

Pink - Owner's Copy

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 5384B Permit #: _____ Tax Parcel #: 113 196 06

Property Owner: Linda Hominac

Job Location Address: 8720 Pine Tree Cr

City: Charlotte State: NC Zip Code: 28278

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIa

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☑

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☑ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Repair, Replace septic tank only
Installed 1000 gal Dellinger septic tank

DENR Authorized Agent: Philo Walker Date: 3/6/15

Signature: Philo Walker REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT/CONSTRUCTION AUTHORIZATION for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 5384B Permit #: _____ Tax Parcel #: 113 196 06

Property Owner: Linda Lominac

Job Location Address: 8720 Pine Tree Cir

City: Charlotte State: NC Zip Code: 28278

Improvement Permit Issuance Date: 3/6/15 **Construction Authorization Issuance Date** 3/6/15

Permission is hereby given to ☐ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This permit is granted based upon the application information submitted to our office. This permit expires 5 years from the date it was issued. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD

Site LTAR: NA GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1000 gallons

Liquid Capacity of Dosing Tank: NA gallons

Drainfield Design ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: >50 feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

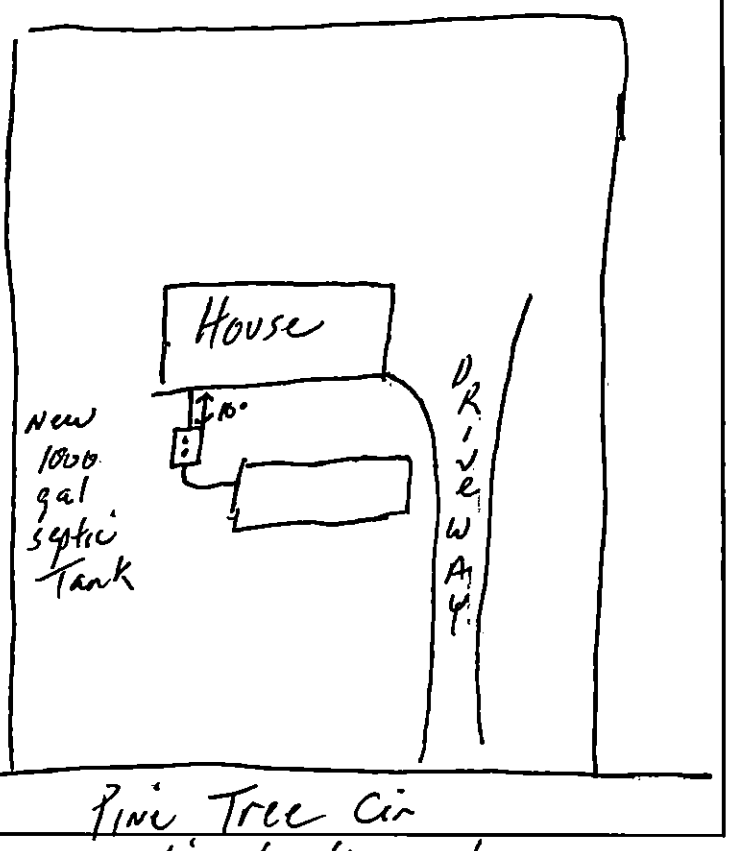

Comments: System Classification & Type: IIa - Replace septic tank only
Dellinger 1,000 gal septic tank installed

DENR Authorized Agent: Philo Walker Signature: Philo Walker REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

Septic System Pre-Construction Meeting Checklist

File # 5384B - App #_____ Tax Parcel # 113 196 06

Property Owner: Linda Lominac

Job Location Address: 8720 Pine Tree Cr

City: Charlotte State: NC Zip Code: 28278

1. **Does System design match facility, flow & wastewater characteristics?**

   ☑ YES ☐ NO

   Comments:_____

2. **Is there sufficient available space for the septic systems initial and repair areas?**

   ☑ YES ☐ NO

   Comments:_____

3. **Can the septic system be installed per the permit conditions and drawing on file?**

   ☑ YES ☐ NO

   Comments: Installing 1000 Gal septic tank only

*** If "NO" is checked for any of the above the existing permit may need to be revoked.**

Permission is hereby given to ☑ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. System shall not be installed while soils are in wet condition.

Phil Walker
Authorized Agent

3/6/15
Date

Steve Autry
Others Present

5384B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

113 19606 App#7449

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ○ NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ○ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT Tank replacement

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 113 196 06

STREET ADDRESS: 8728 Pine Tree Cir

CITY: Charlotte

STATE: NC ZIP: 28278

SUBDIVISION NAME: _____

LOT #: _____ LOT SIZE (acres): _____

TOWNSHIP:

☑ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:

BUILDING TYPE:

○ SINGLE MOBILE HOME ○ MODULAR HOME
☒ DOUBLE WIDE ○ MULTIPLE FAMILY
○ HOUSE ○ OTHER _____

HEATED SQUARE FOOTAGE: _____

NUMBER OF BEDROOMS: 3

NUMBER OF OCCUPANTS: 1

FOUNDATION TYPE:

○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
☑ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ○ MUNICIPAL ☑ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ○ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER ✓

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ○ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ○ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ○ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ○ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ○ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ○ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ○ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ○ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ○ NO
WASTE STORAGE	○ YES ○ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ○ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☐ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☐ N/A

12. PROPERTY OWNER:

NAME: W. M. Lorenac

ADDRESS: 8728 Pine Tree Cir

CITY: Charlotte

STATE: N. C. ZIP: 28278

WORK PHONE: 704 697 9889

MOBILE PHONE: _____

FAX: _____

E-MAIL: _____

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME: _____

ADDRESS: _____

CITY: _____

STATE: _____ ZIP: _____

WORK PHONE: _____

MOBILE PHONE: _____

FAX: _____

E-MAIL: _____

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

William M. Tomison — Property Owner's or Owner's Legal Representative Signature

3/6/15 — Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

Subdivision Name: _____ Lot #: _____

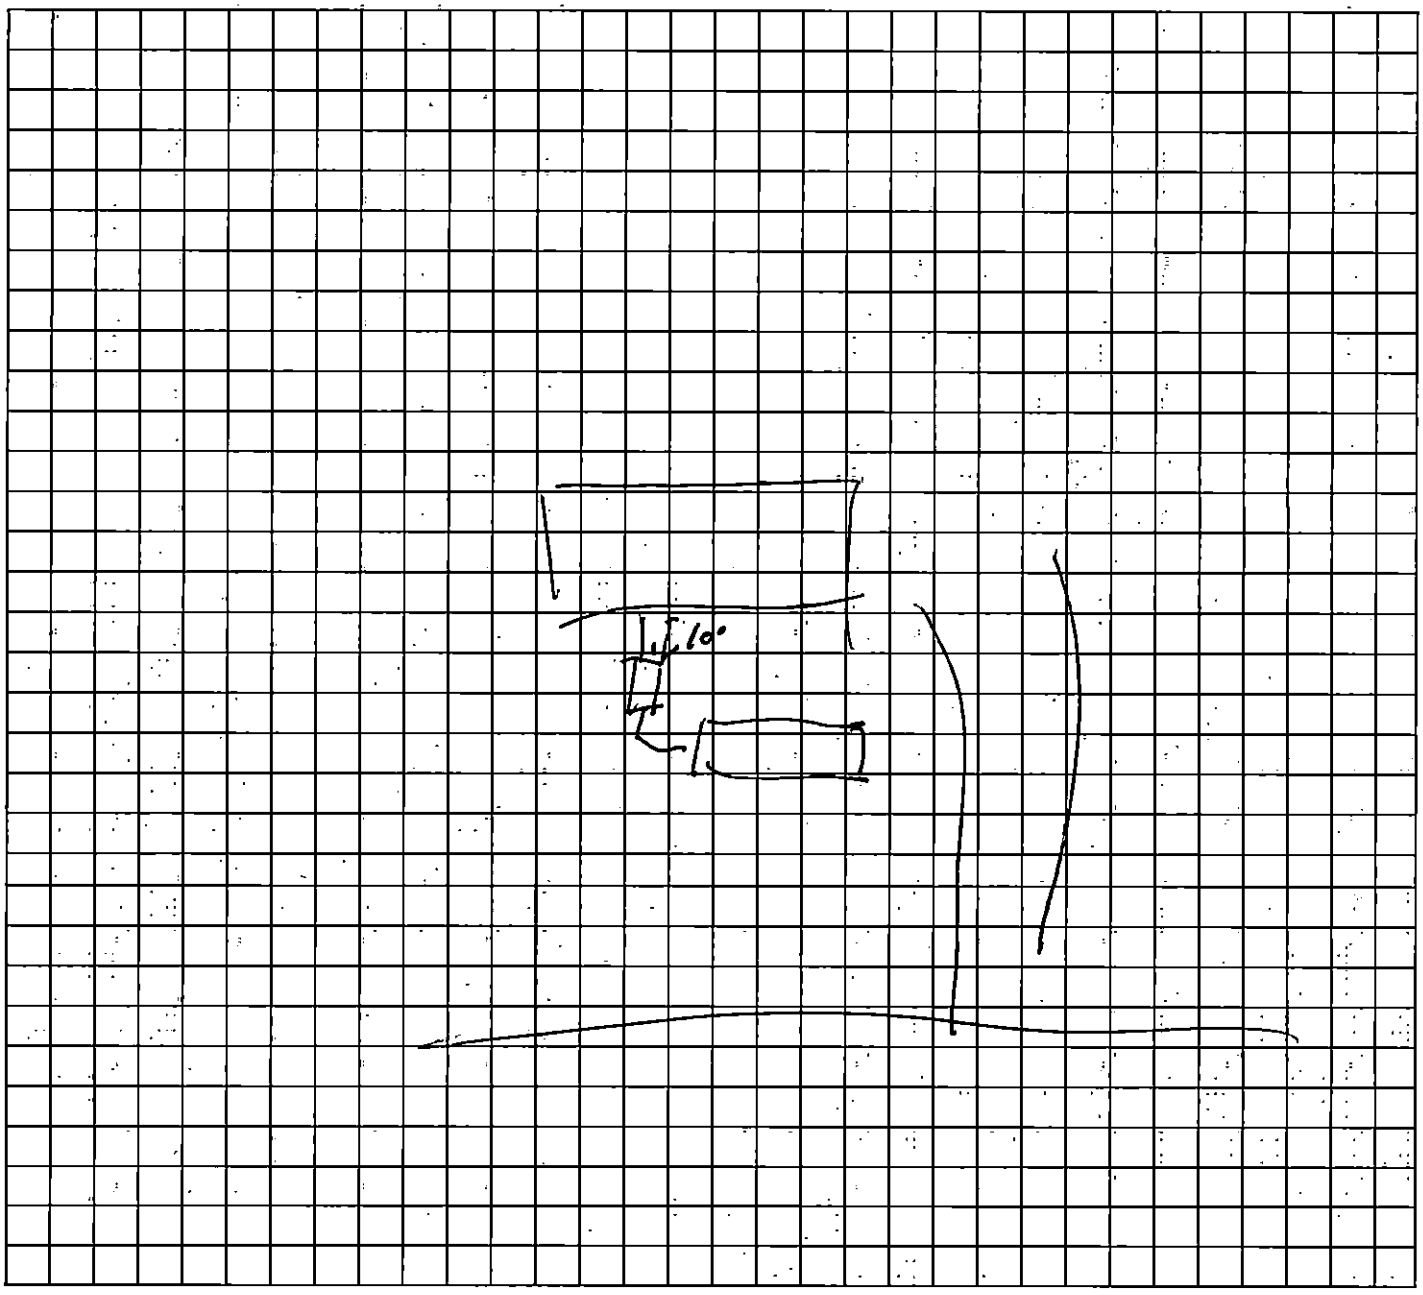

_____ _____

Property Owner's or Owner's Legal Representative Signature Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10