

1/4/2008

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

FEE: NA

DATE: _____

0

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

REPAIR

[ ] CRT

TYPE APPLICATION: __ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM X REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 40278

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 061-191-03

STREET ADDRESS: 3037 I-85 ~~Service Rd~~ ~~Hwy~~

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TOWNSHIP (CHECK ONE):

__ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

CLOSING DATE_____

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
__ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

HEATED SQUARE FOOTAGE: employees 30

~~NUMBER OF BEDROOMS:~~ NUMBER OF ~~OCCUPANTS:~~

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
__ ON SLAB
__ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES __ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

__ COMMUNITY (C)
__ MUNICIPAL (M)
__ PRIVATE WELL (P)
__ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	__ YES __ NO	WELL, SPRINGS OR WATERLINES	__ YES __ NO
EXISTING WASTEWATER SYSTEMS	__ YES __ NO	DESIGNATED WETLANDS	__ YES __ NO
EASTMENTS OR RIGHT-OF-WAYS	__ YES __ NO		

PROPERTY OWNER: The Earthgrains Co.

NAME: (LAST) (FIRST) (MI)

ADDRESS: 3037 I-85 ~~Service Rd~~ Hwy.

CITY: Charlotte STATE: NC ZIP: 28208

DAYTIME PHONE: (704 -392-1783 Fax # 399 5471

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) -

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Kimberly Williams DATE: 07/14/99

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4027B DATE: 7/16/99

TC: 061-13-03 L

SERIAL No: 17847

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 7/16/99. All work shall be completed on or before 8/16/99, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

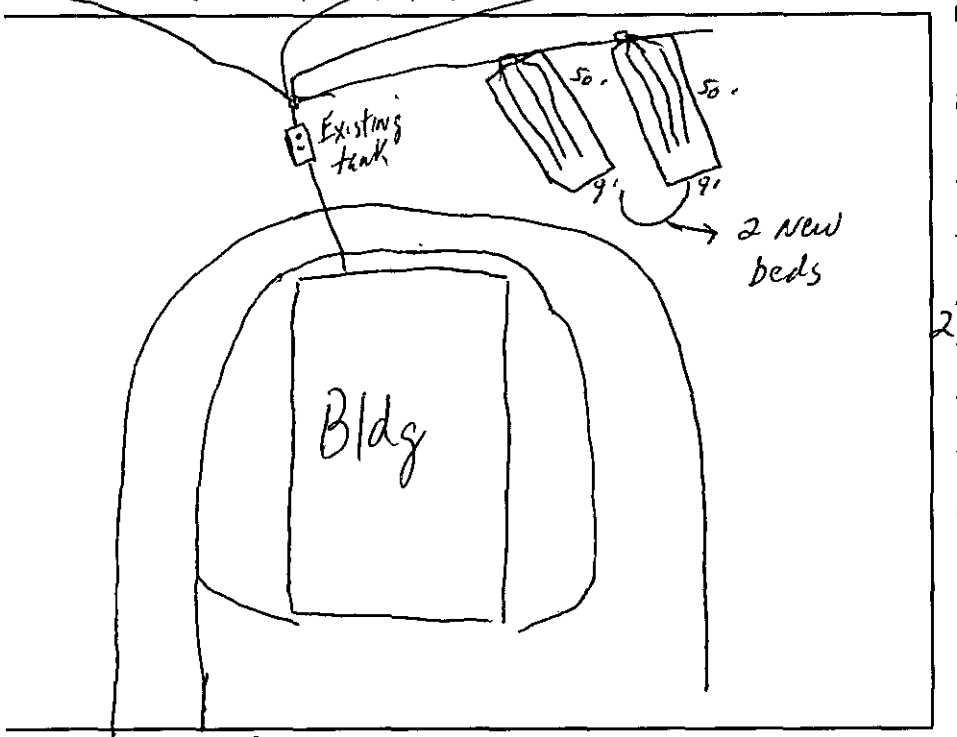

PLOT OF SYSTEM

Liquid Capacity of Septic Tank Existing gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction Existing

Trench Depth 36"

Absorption and/or Nitrification Lines:

2 Beds (2) Trench Width 9' feet

Trench Walls Scored and Porous Yes

Total Line Length 150 + 150' 300' Total feet

Number of Lines 3+3

Depth of Stone 18" Stone inches

Distance from House 5' feet

Distance from Property Line 10' feet

Distance from Well Municipal feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER The Earthgrain Co.

LOCATION OF PROPERTY 3037 I 85 ~~Service Rd~~ ~~Hwy~~

Comments: Bed system repair 2 beds 9'wd x 50'long x 18"Stone

Philo S. Walker R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY