#10772

3570B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR APPROVAL TO USE AN EXISTING
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL

APPLICATION TYPE: ✓ SEPTIC ONLY ○ WELL ONLY ○ SEPTIC & WELL
✓ ADDITION OR RENOVATION WITH OCCUPANCY INCREASE ○ EXCHANGE MOBILE HOME (SAME # BEDROOMS)
✓ ADDITION OR RENOVATION WITH NO OCCUPANCY INCREASE ○ COMMERCIAL OR INDUSTRIAL

PERSON FILING APPLICATION:
NAME: Angelo Tillman / All Bro Builders
ADDRESS: 3557 N. Sharon Amity Rd ste 201
CITY: Charlotte
STATE: N.C ZIP: 28205
PHONE: 704-605-3047.
ALTERNATE PHONE: 704-556-8117
E-MAIL: angelotillman@bellsouth.net

PROPERTY OWNER: ☐ SAME AS PERSON FILING APPLICATION
NAME:
ADDRESS:
CITY:
STATE: ZIP:
PHONE:
ALTERNATE PHONE:
E-MAIL:

JOB LOCATION INFORMATION
TAX PARCEL #: 03131161
STREET ADDRESS: 1524 MT Holly Huntersville Rd
CITY: Charlotte
STATE: NC **ZIP:** 28214

SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #:

WATER SUPPLY:
✓ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER

RESIDENTIAL PROPERTY TYPE: ○ N/A
✓ HOUSE ○ MODULAR HOME ○ MULTIPLE FAMILY
○ SINGLE MOBILE HOME ○ DOUBLE WIDE
○ OTHER

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 3 ~~including~~ existing
NUMBER OF OCCUPANTS: 4
includes occupancy increase

COMMERCIAL / INDUSTRIAL PROPERTY TYPE: ☐ N/A
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:

INDUSTRIAL WASTES? ○ YES ○ NO
UNDERGROUND STORAGE TANKS? ○ YES ○ NO

ADDITION/RENOVATION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☐ OTHER upfit of garage to bedroom, new count will be 3 bedrooms

ADDITION/RENOVATION TYPE DETACHED FROM EXISTING STRUCTURE:
☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☐ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature

Oct 3 2019
Date

A PROPOSED PLOT PLAN (see page 2) is required to be submitted with each application.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


Revised on: 01/03/11

File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 1524 MT Holly Huntersville Rd Tax Parcel #: _____

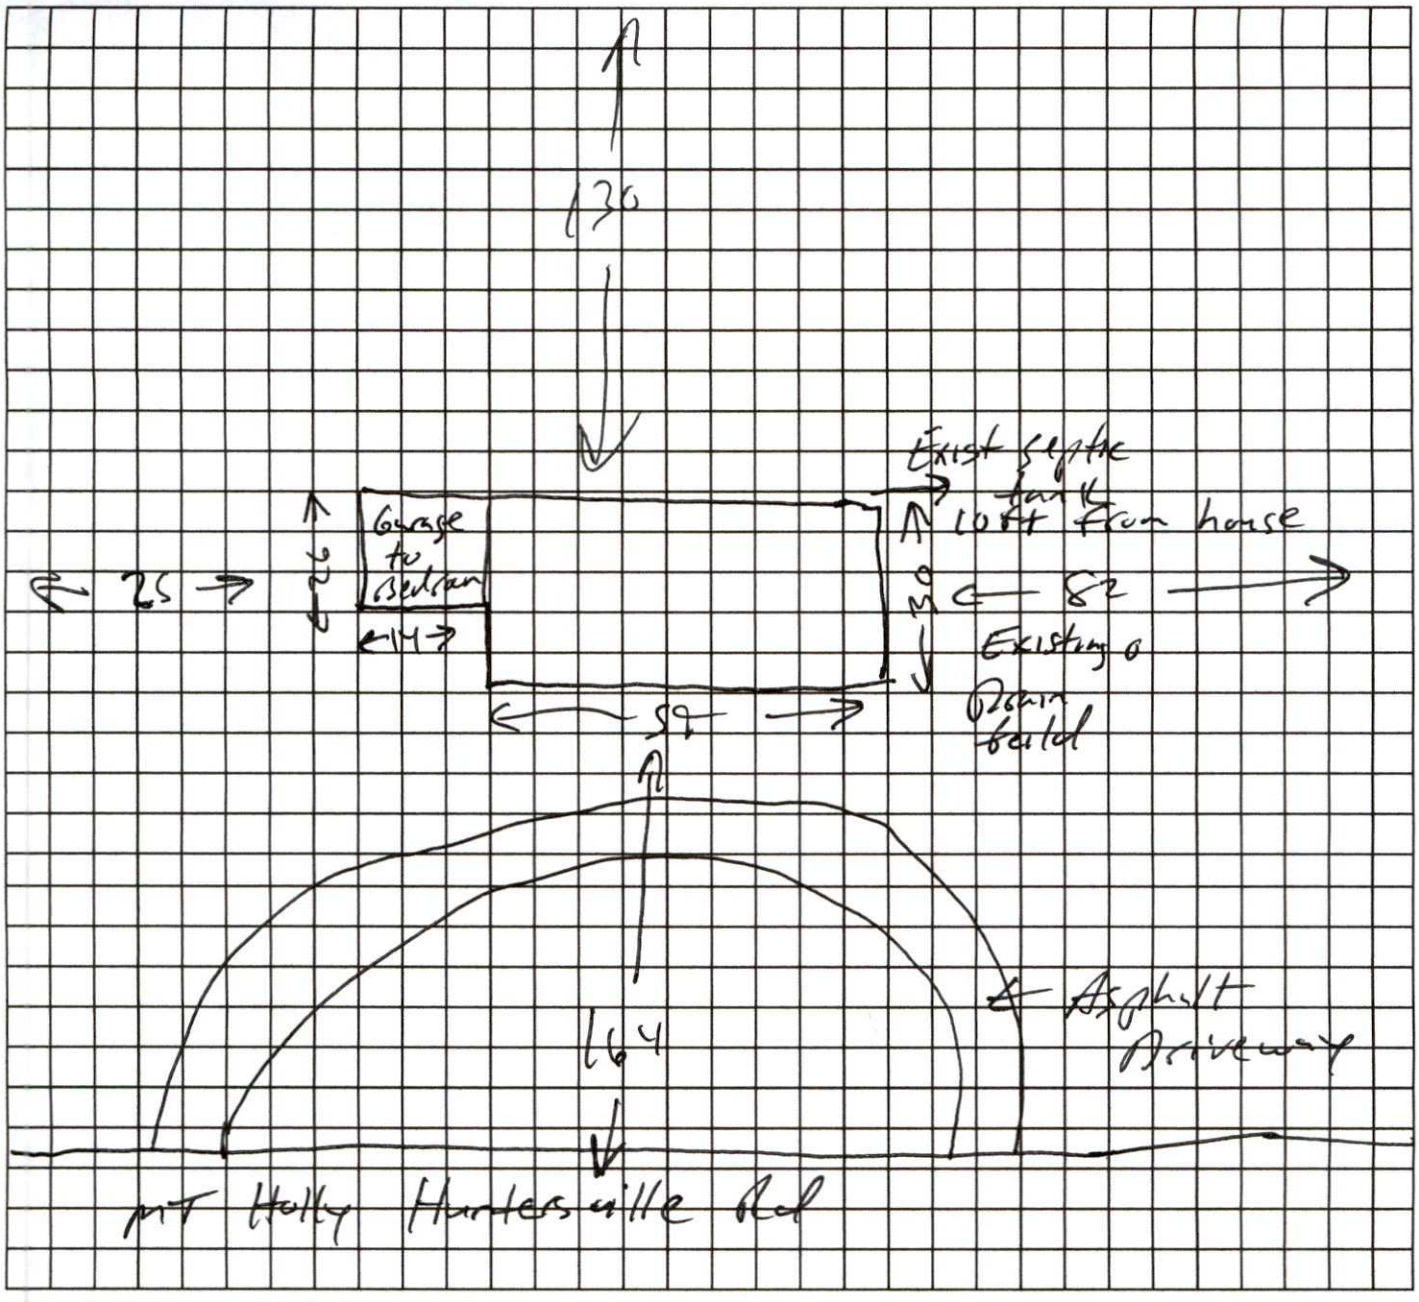

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- This permit is not transferable.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

OK to USE TO UPFIT The garage to a bedroom. The existing bedroom will be converted to a Church library.

REHS Signature Date

House will remain 3 Bedrooms

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11

Jenny Neal REHS 10/16/19

MECKLENBURG COUNTY
Health Department

E. Winters Mabry, MD
Director

(704) 432-3199

Addendum to Application for
New Well or Septic System Installation
Abandonment or Repair of Existing Well or Septic System

Your signature below confirms the following:

1. The information on the application is true, complete and accurate.
2. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliances with applicable laws and rules.
3. I acknowledge that Angelo C. Tillman is acting as my legal representative (agent) in the submittal of the application for a water supply well or septic permit located at

1524 MT Holly Huntersville Rd Charlotte
Number Street Town
(Or Parcel Number)

Dorothy Ponton
Property Owner (print name)

Dorothy Ponton
Property Owner (signature)

10/3/19
Date

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	10/04/19	**Amount:**	100.00
Receipt #:	118879	**Tendered:**	100.00
Check / Auth #:	CHECK 6592	**Returned:**	0.00
Received By:	GOULDOE		

Account Information


Account #: 200000
Contractor: ALL PRO BUILDERS
Attn:
Address: N SHARON AMITY RD
Address:
City/State/Zip: CHARLOTTE, NC 28205

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	Use Existing System 1524 MT H H RD		1	100.00	100.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

X _____
Signature

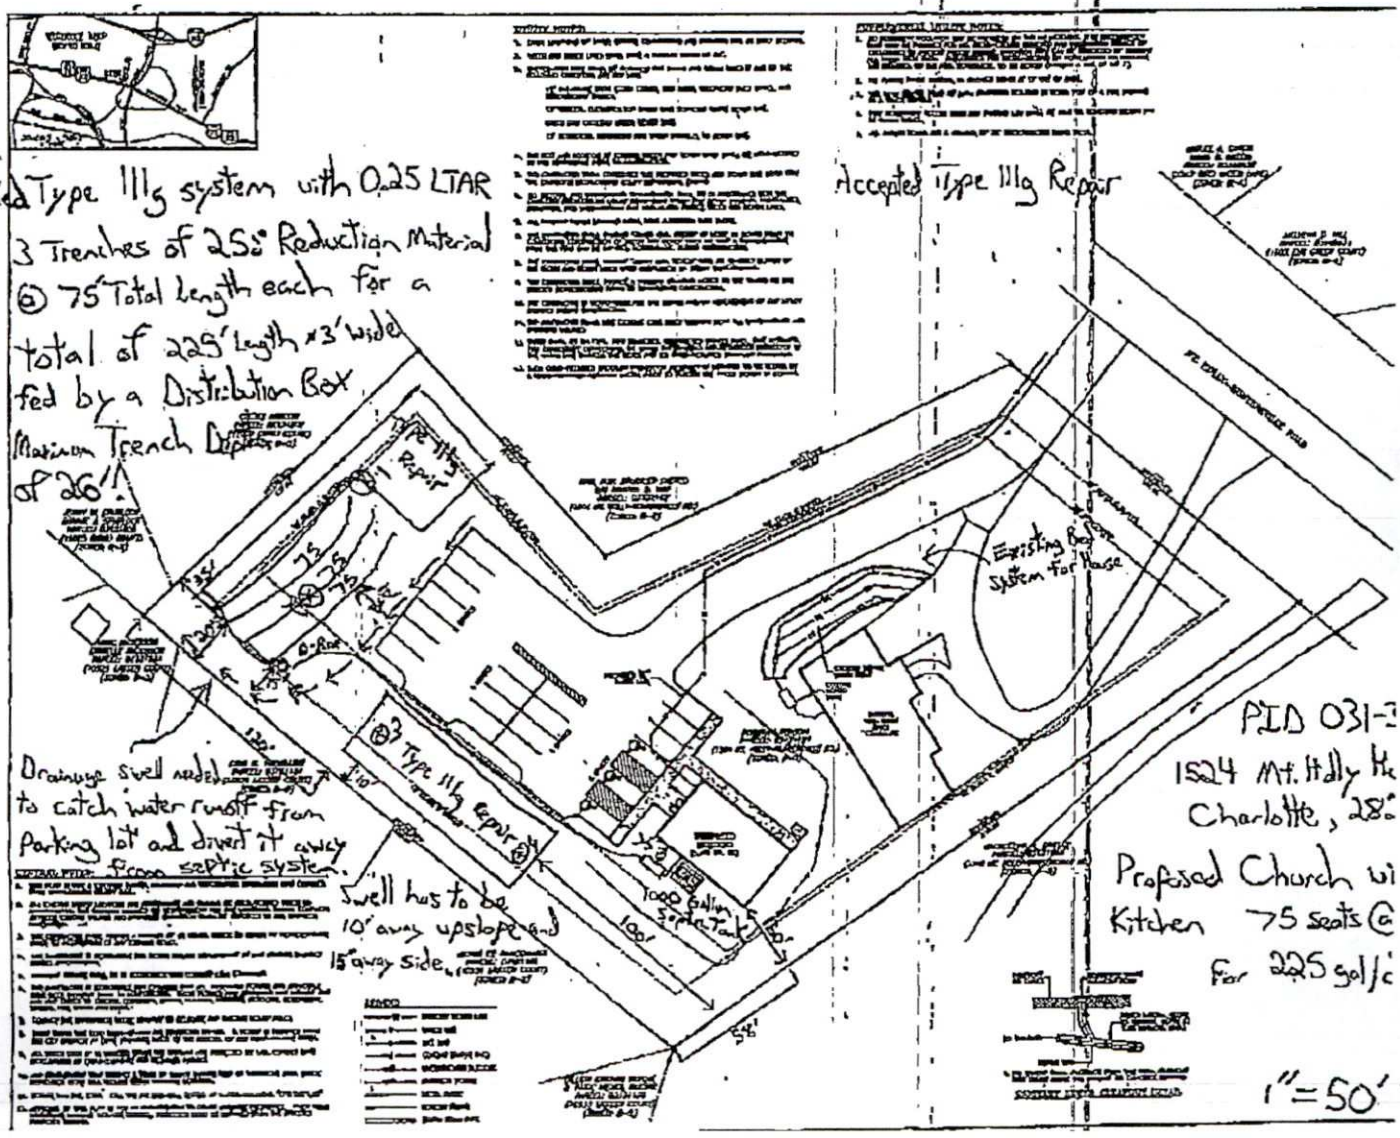
Accepted Type IIIg system with 0.25 LTAR
3 Trenches of 25% Reduction Material
@ 75' Total Length each for a
total of 225' Length x 3' Wide
fed by a Distribution Box
Maximum Trench Depth of 26"
Accepted Type IIIg Repair
Existing Septic System for House
Drainage Swell needed to catch water runoff from parking lot and divert it away from septic system.
Swell has to be 10' away upslope and 15' away side
1000 Gallon Septic Tank
PID 031-
1524 Mt. Holly
Charlotte, 28
Proposed Church w
Kitchen 75 seats @
For 225 gal/
1" = 50'