Date Received 5-31-83

MECK COUNTY DEPARTMENT OF
RECEIVED
[illegible]
ENVIRONMENTAL HEALTH

APT No. 19756 ✓

T. C. No. P0053-143-13

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER REEVES (LAST) DOMER (FIRST) — (MIDDLE)

2) ADDRESS OF OWNER ROUTE 10 BOX 300 Wildwood DR. ZIP 28208

3) PHONE NO. Home _____ Office 394-1905


4) LOCATION OF PROPERTY 3514 PERFORMANCE RD (STREET OR COUNTY ROAD)

5) SUBDIVISION Separate lot LOT NO _____ BLOCK NO. _____

MAP BOOK NO DEED REF 46 61 - 0340 PAGE NO _____

6) DEED REFERENCE DEED BOOK _____ PAGE NO _____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation or an on-site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface soil absorption effluent discharge.

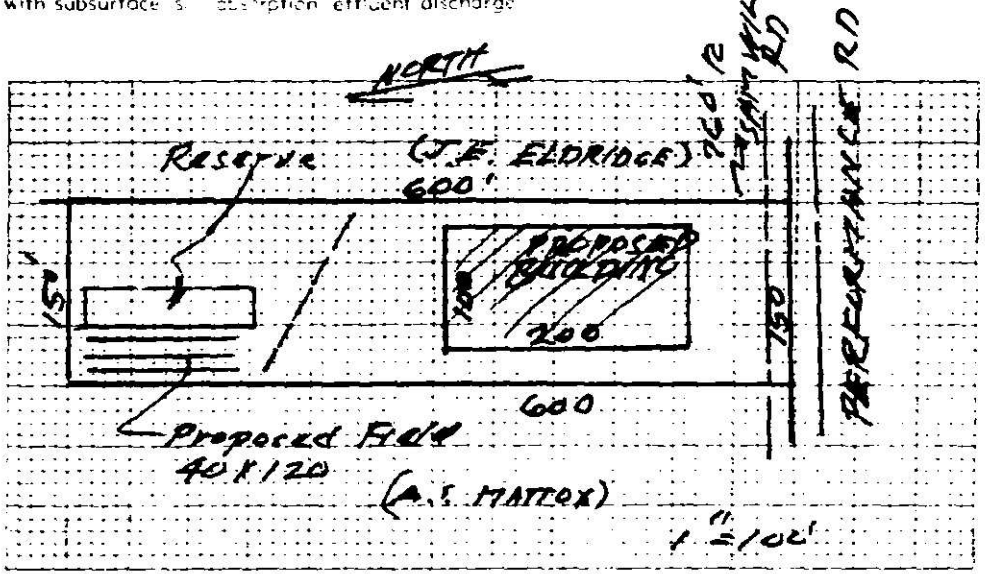

7) ACCURATELY DIAGRAM & DIMENSION LOT

K. Dawn Reeves
by Dawn M Ducar
OWNER

527-6626
6555 B PRESSLEY RD
CHAR NC 28210

EHD-5-76

Environmental Health Department's Copy

Serial No. 5062

SIR No. 19756

PO 053-143-13
T C. No.

Date Issued 6-13-83

Map Date


MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
SOIL INVESTIGATION REPORT

NAME OF OWNER Reeves (LAST) Domer (FIRST) (MIDDLE)

ADDRESS OF OWNER Route10, Box 300 Charlotte, NC ZIP - 28208

LOCATION OF PROPERTY 3514 Performance Road (STREET OR COUNTY ROAD)

SUBDIVISION separate lot LOT NO BLOCK NO.

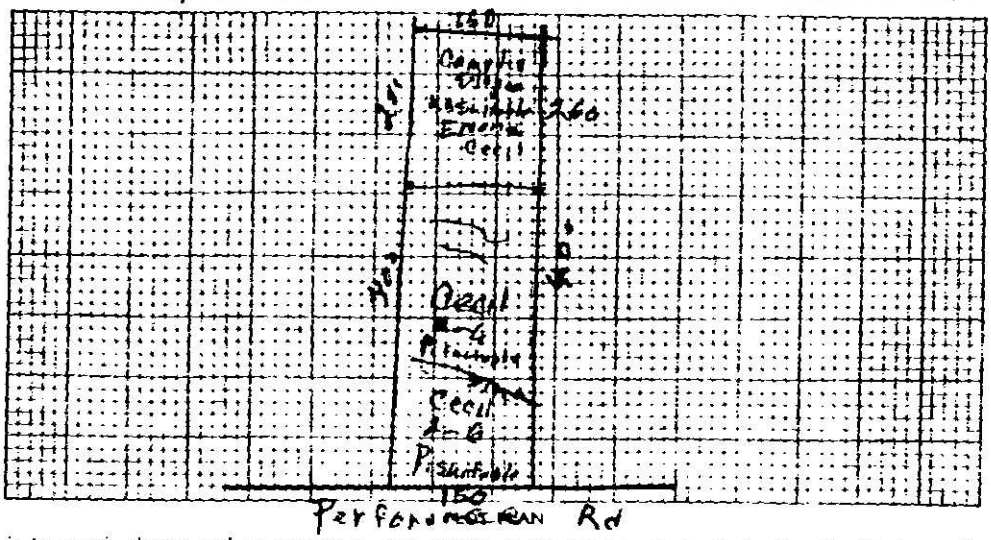

This is to certify that a soil investigation and on-site investigation was made by the Mecklenburg County Department of Environmental Health on the lot described above. The soil investigation was conducted on that portion of the lot as indicated on the above plot. The permeability rate determined by the investigation was **Provisionally Suitable** The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install a septic tank wastewater treatment system shall be obtained from the Mecklenburg County Department of Environmental Health prior to the beginning of any construction of buildings that the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater treatment system which must be installed will be determined by the Mecklenburg County Department of Environmental Health at the time of application for a permit and is based on the permeability rate obtained above and on the size and type of building to be constructed thereon.
3. This approval is valid only for the system installed in the immediate area indicated as acceptable for system installation on the above plot.
4. This approval is void if any grading, filling or construction, including the placing of sand, is performed on the lot which in the opinion of the Mecklenburg County Department of Environmental Health reduces the area indicated as acceptable for system installation unsuitable for same prior construction, alteration and or repair of septic system.

Approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina Department of Human Resources, Division of Health Services and the Mecklenburg County Health Commission which were in effect on the date of issuance and is void if at any time prior to completion of the system, these laws, rules and regulations are changed such that it would not have been granted had the new or revised laws, rules, and regulations been in effect.

Dixie D. Hardister
Environmental Health Director or Authorized Section Head

Sanitarian

Environmental Health Department's Copy

DEPARTMENT OF ENVIRONMENTAL HEALTH
MECKLENBURG COUNTY, NORTH CAROLINA

SITE EVALUATION

S.I.R. NO. 19756

T.C. NO. PO 053-143-13

(Ground Absorption Sewage Disposal)

OWNER: DONIER Reeves
ADDRESS: R-19 Box 306 Wildwood Drive 28208
LOCATION OF SITE: Performance Rd
PLAT NO:
LOT SIZE: 2A+

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S (PS) U — 2-4	S PS (U) — complex slopes	S PS U	S PS U
2. SOIL TEXTURE (12-36 inches) Sandy, Loamy, Clayey (Note 2-1 Clay)	S (PS) U — clayey	S PS (U) — Mixed clay	S PS U	S PS U
3. SOIL STRUCTURE (12-36 inches)	S (PS) U — Blocky	S PS (U) — Weak Blocky	S PS U	S PS U
4. SOIL DEPTH (inches)	S (PS) U — 48"	S PS (U) — 36 HD	S PS U	S PS U
5. RESTRICTIVE HORIZONS (Inches) (Impervious strata, Rock)	S (PS) U — None	S PS (U) — clay	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (external and internal)	S (PS) U — Adequate	S PS (U) — Slow	S PS U	S PS U
7. OTHER (Specify)	S PS U	S PS U	S PS U	S PS U
8. SOIL GROUP	IVa	IVb		
9. SITE CLASSIFICATION	Suitable	Unsuitable		
10. SOIL SERIES	Cecil	ENON IN Complex Slopes		

S - Suitable PS - Provisionally Suitable U - Unsuitable


**See Diagram on Back (includes: soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slopes)

Recommendations/Comments:

Described by: W. H. Kennedy
Title: Soil Scientist

Date: 6-9-83

EHD 539 (Revised: 6/82)

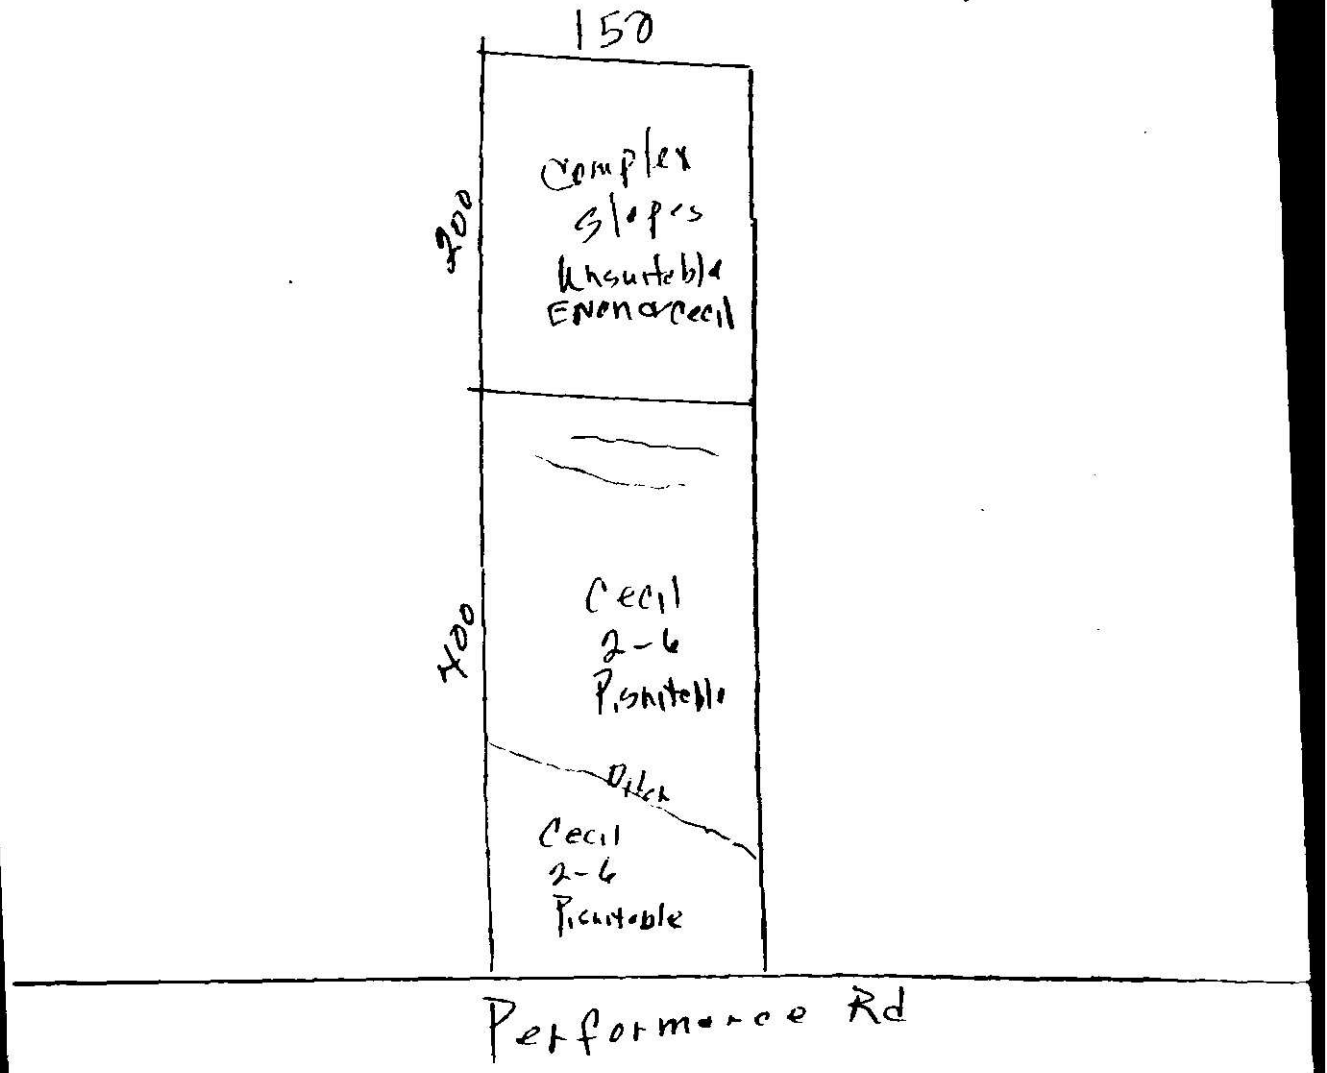
150
200
Complex
Slopes
Unsuitable
Enon & Cecil
400
Cecil
2-6
Picnitable
Cecil
2-6
Picnitable
Performance Rd

Date Received 9-27-93

SEP 27 1993

ENVIRONMENTAL HEALTH

ICAR(S) Application No 19756

T C. No PO 05-3-143-13


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to wholesale produce

1) ✓ Install or Construct 2) Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption effluent discharge

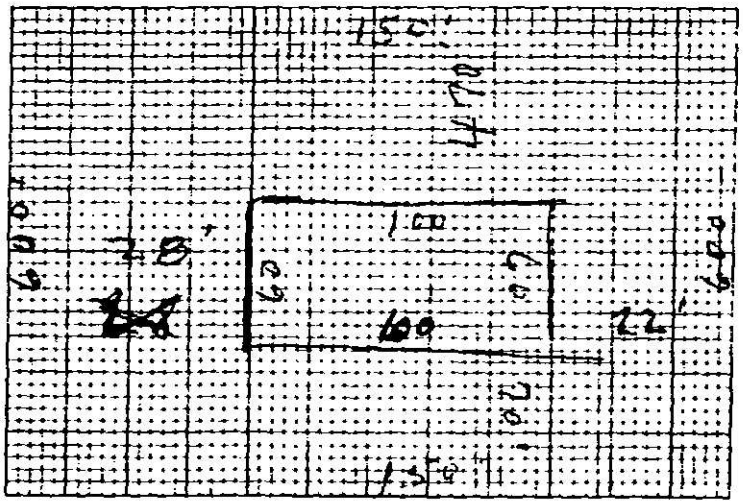

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___Yes___No
Residence ___Yes___No

4) No of Bedrooms _____
5) Business Use -- Max No Employees 4
6) Washing Machine ___Yes ___No
7) Garbage Disposal ___Yes ___No
8) Dishwasher ___Yes ___No
9) Water Supply
A) Individual Well ✓
B) Governmental System _____
C) Community System
1 Well source _____
2 Governmental source _____
10) Sewage System
House located within 200 feet of public sewer ___Yes ___No
House located within 200 feet of community sewer ___Yes ___No
11) FHA Case No _____
12) VA Case No _____

13) NAME OF OWNER Rogers Dorton
LAST FIRST MIDDLE

14) ADDRESS OF OWNER RT. 10 Box 300 CHARLOTTE NC

15) PHONE NO. Home 704-199-5 Office 393-6302

16) LOCATION OF SYSTEM 3415 Performance Road
STREET OR COUNTY ROAD

17) SUBDIVISION Private Lot Lot No. _____ Block No. _____

Map Book No _____ Page No. _____

18) DEED REFERENCE — DEED BOOK _____ AT PAGE _____

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES ___ NO DATE RUN 6-13-83

20) PTR NUMBER (See Instructions) 19756

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

Sept. 27-93
DATE OF APPLICATION

Ray Helms Const & Agent for Owner
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY


Date Issued 9/29/83

Serial No. 6642

ICAR(S) Permit No. 19755
T. C. No. 057-1473
Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, ___ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 19755, dated 9/27/83 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 10/29/83, after which date this permit shall be null and void.

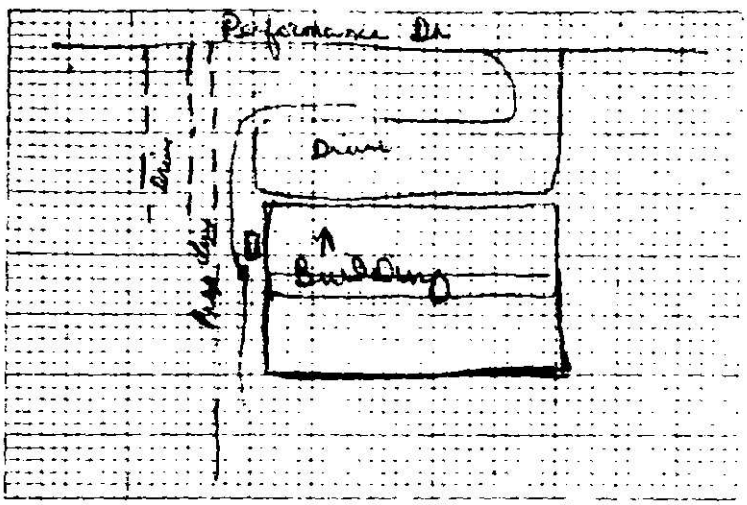

Permeability Rate PS

Septic Tank Capacity of 1000 gal

Type Construction pc concrete

Absorption and/or Nitrification Line

Total Line Length 200'

Number of Lines 2

Distance from House ≥5'

Distance from Property Line ≥10'

Distance from Well ≥50

PLOT OF SYSTEM

NAME OF OWNER [redacted] Domer

LOCATION OF PROPERTY 34[redacted] Performance Rd

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

2) 3' wide x 100' long x 12" stone

Comments: divert water from building and hillside

B. Hendrix
Division or Section Head

Randy C Roberts
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

END-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY