MECKLENBURG COUNTY HEALTH DEPARTMENT
RECEIVED
SEP 19 1990
ENVIRONMENTAL HEALTH

SEE INSTRUCTIONS ON BACK

Date Received 9/19/90

ICAR(S) Application No. 14549

T. C. No. 113-105-09


Map Date

MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an Installation, Construction, Alteration, and/or Repair Permit (Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1) Install or Construct 2) ✓ Alter or Repair on individual septic tank wastewater treatment system with a subsurface soil absorption, effluent discharge

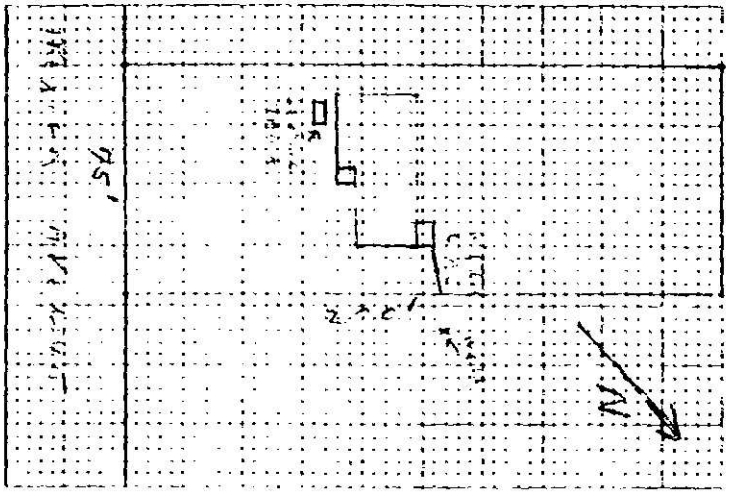

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes X No
Residence ✓ Yes ___ No
4) No. of Bedrooms 3
5) Business Use ___ Max. No. Employees ___
6) Washing Machine ✓ Yes ___ No
7) Garbage Disposal ___ Yes X No
8) Dishwasher ___ Yes X No
9) Water Supply
A) Individual Well ___
B) Governmental System ___
C) Community System
1) Well source ___
2) Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___ Yes X No
House located within 200 feet of community sewer ___ Yes X No
11) EHA Case No. ___
12) ZA Case No. ___

13) NAME OF OWNER PRICE (LAST) BLAKE (FIRST) C. ALVIN (MIDDLE)

14) ADDRESS OF OWNER AT 4 BOX 541-D1 TREXLER DR., CHARLOTTE, N.C., 28215

15) PHONE NO. Home 392-2294 Office 366-5522

16) LOCATION OF SYSTEM 4 BOX 541-D1 TREXLER DR. (STREET OR COUNTY ROAD), CHARLOTTE, N.C., 28215

17) SUBDIVISION Rivermere Acres Lot No. 24 + PART OF 25 Block No. E

Map Book No. ___ Page No. 561

18) DEED REFERENCE - DEED BOOK 3389 AT PAGE 352

19) WAS A SOIL EVALUATION PERFORMED? YES ___ NO DATE RUN

20) SITE NUMBER (For Health Dept. Use)

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true

12 SEPT 1990
DATE OF APPLICATION

Blake C. Price
OWNER

Environmental Health Department's Copy

Date Issued 9-28-78

Serial No. 1970


ICAR(S) Permit No. 14549

T. C. No. 113-105-09

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to Install or Construct ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 14549, dated 9-19-78 and this permit shall be void and of no effect if the information provided in the application is not true and correct. All work shall be completed on or before 10-25-78, after which date this permit shall be null and void.

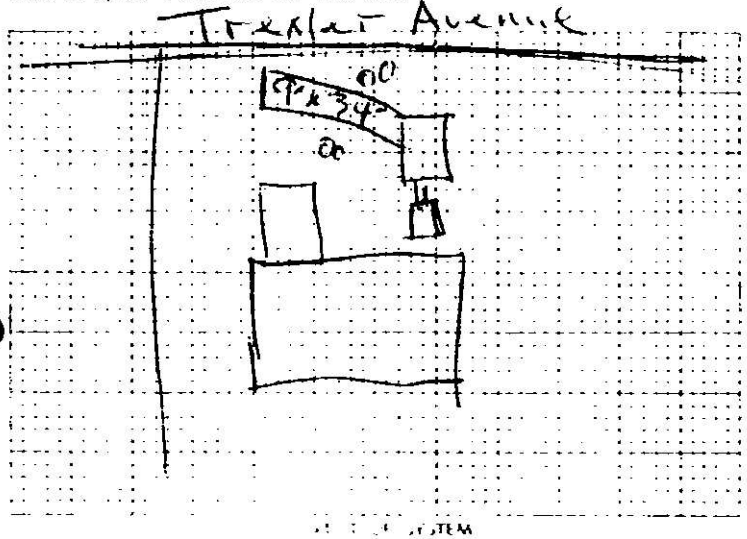

SYSTEM

Permeability Rate slow

Length of Lines —

Type Construction —

Absorption Trench or Lateral Lines

Total Length 100'

Number of Lines 3

Distance from Structure 15'

Distance from Property Lines 10' minimum

Distance from Well —

NAME OF BANK Price, Blake Calvin

LOCATION OF PROPERTY Trexler Avenue

This [illegible] set forth in the Regulations of the Mecklenburg [illegible] for granting of this permit. A certificate of operation [illegible] before any system [illegible] covered up or otherwise [illegible]. **The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

pump the tank - check tank + distribution box for crack - replace if cracked - if not cracked add 9' x 34' x 17" pit with aggregate and

Michael H. Sexton
Environmentalist

* If this permit is for the construction of a new system, it must be signed by the division or a section head from the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required if an existing system is being altered or repaired.

EHP-26

Environmentalist to Be Department's Copy


Date Issued Oct 16, 1978 **Serial No. 2051** ICAR(S) Permit No. 14549

T C No. 113-105 09

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 1454-1, dated 9-19-78. This permit shall be void and of no effect if the information provided in the application is not true and correct as issued. All work shall be completed on or before 11-16-78, after which date this permit shall be null and void.

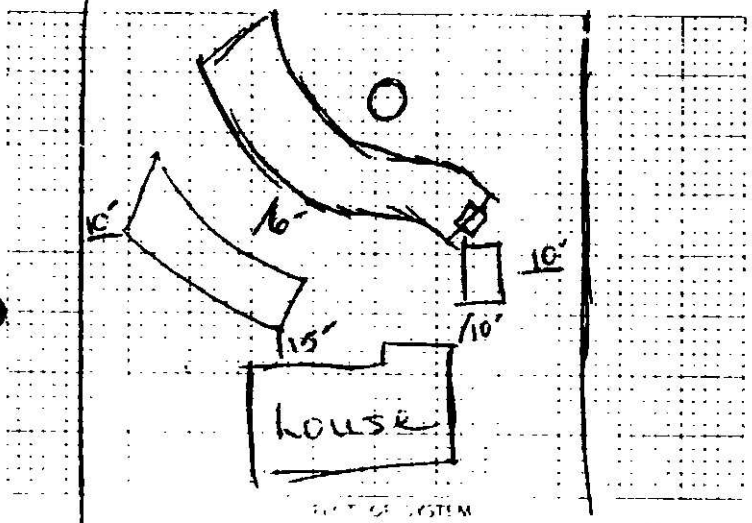

PLOT OF SYSTEM

Permit for: REPAIR

Tank Capacity: 1000gal. S

Tank Construction: pre-conc.

Absorption Line Length: 330' + 125'

Number of Lines: 4 + 4

Trench Width: 10'

Trench Depth: 10'

Distance from Well: 50'+

NAME OF OWNER: Hice, Blake Colvin

LOCATION ADDRESS: Trent Ave.

This permit is issued subject to the requirements set forth in the Regulations of the Mecklenburg County Board of Health governing the granting of this permit. A certificate of approval will be issued for each system after it has been covered up or otherwise rendered inaccessible. **The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.** 12'x33'x17" w/aeration pit

Comments: 12'x32'x17' wash pt

Environmentalist Michael C. Sexton

* If this permit is for the repair or alteration of a system, or the use of a new system, it must be signed by the division or a section chief of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

Form 24

Department's Copy

Date Issued 6 Feb 79 Serial No. 2322 C of A (s) No. 14549

T C No 113-105-09

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner PRICE, BLAKE C. (LAST, FIRST, MIDDLE)

Location of Property TREXLER Ave

Application Number 14549 Permit Number 14549

Inspection Date:

Liquid Capacity of Tank 1000 gal Tank Material Precast Concrete

Total Length of Drain Tile 330+125' Number of Lines #5 ; 4

Depth of Filter Material 17" ; 34" w m. Cover Depth

Water Supply Source well Distance from Water Source 50'+


Excavation Inspected 6 Feb 79 (DATE) Tank Inspected 6 Feb (DATE)

Nitrification Field Inspected 6 Feb 79 (DATE)

Washing Machine Line Inspected, If Applicable 6 Feb (DATE)

This certifies good for use of the Individual Septic Tank System with subsurface soil absorption of effluent discharge on soil as shown and it has been ~~tested~~ inspected and found to be in accordance with the permit issued and the regulations of the Mecklenburg County Health Department governing the same on the date of issuance of the permit. This Certificate of Approval does not in any way guarantee that the system will operate satisfactorily, nor relieve any person now or hereafter owning or using said property or using such system from any claim for damages resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to the restrictions and conditions shown on the permit in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is incorrect or if any additions are made to the present system which would increase the requirements for said system.

Comments good repair - in V. poor soil



Steve Wood
Environmentalist

EHD-S-76

Environmental Health Department's Copy