

4012 CENTRAL AV

13101215

1/9/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

FEE: _____

DATE: _____

APPLICATION FOR IMPROVEMENT PERMIT
~~FOR RESIDENTIAL SITE~~ COMMERCIAL
INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: __ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM ✓ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 57288

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 131-012-15

STREET ADDRESS: 4012 CENTRAL AVENUE

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
__ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
X OTHER (O)
CHURCH

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS:

NUMBER OF OCCUPANTS:

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
__ ON SLAB
__ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

TOWNSHIP (CHECK ONE):

__ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

CLOSING DATE_____

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES __ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

__ COMMUNITY (C)
✓ MUNICIPAL (M)
__ PRIVATE WELL (P)
__ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	✓ YES __ NO	WELL, SPRINGS OR WATERLINES	__ YES __ NO
EXISTING WASTEWATER SYSTEMS	✓ YES __ NO	DESIGNATED WETLANDS	__ YES __ NO
EASTMENTS OR RIGHT-OF-WAYS	__ YES __ NO		

PROPERTY OWNER:

NAME: (LAST) MEMORIAL (FIRST) METHODIST (MI) CHURCH.

ADDRESS: 4012 CENTRAL AVENUE.

CITY: CHARLOTTE STATE: NC ZIP: 28205

DAYTIME PHONE: ( ) –

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) Bingham (FIRST) Keith (MI) W.

DAYTIME PHONE: 704 537-2060

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Keith W. Bingham DATE: 9-30-04

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 57288 DATE: 9-30-04

TC: 131-012-15 ☒ L

SERIAL 19829

Permission is hereby given to _____ Install or Construct, ✓ Alter or (Repair) the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 9-30-04. All work shall be completed on or before 10-2-04, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

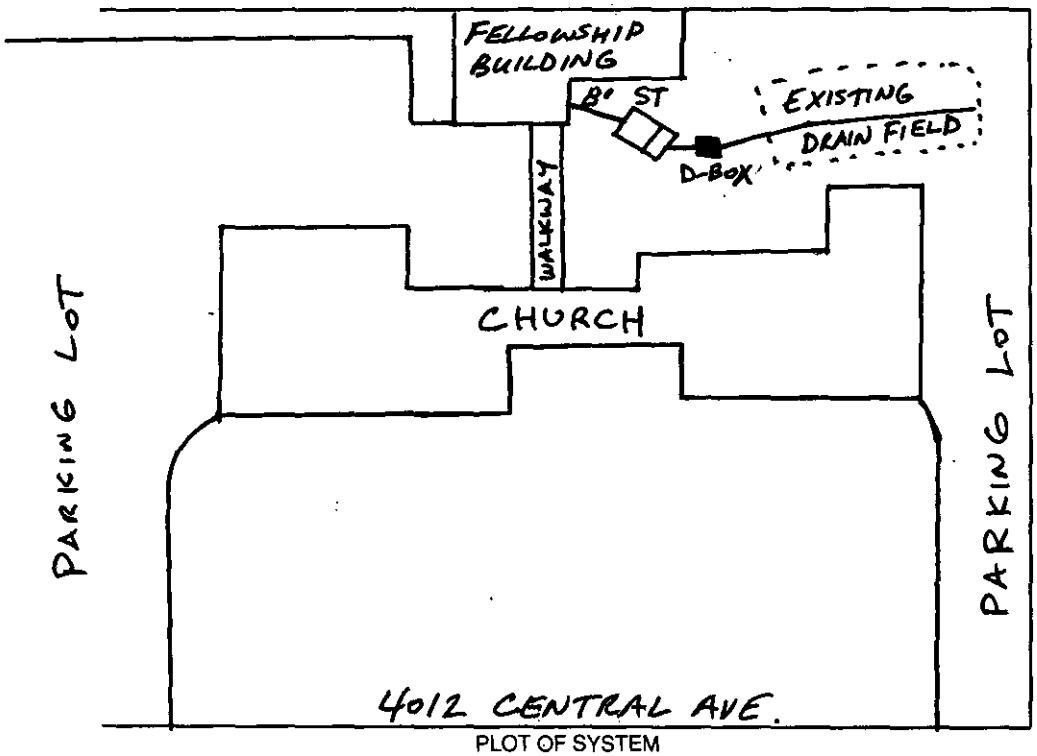

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank N/A gallons

Tank Construction PCC

Trench Depth N/A

Absorption and/or Nitrification Lines:

Trench Width N/A feet

Trench Walls Scored and Porous N/A

Total Line Length N/A feet

Number of Lines N/A

Depth of Stone N/A inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well 750 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER MEMORIAL METHODIST CHURCH

LOCATION OF PROPERTY 4012 CENTRAL AVE.

Comments: SEPTIC TANK DAMAGED AND REQUIRED REPLACEMENT. INSTALL NEW 1500 GAL SEPTIC TANK W/ EFFLUENT FILTER. INSTALL D-BOX AND RECONNECT TO EXISTING DRAINFIELD.

_____ Tom Thomas, REHS 10/01/04

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 5728B DATE: 10-1-04

TC: 131-012-15 ☐ L ☐ CRT

SERIAL 19682

Name of Owner MEMORIAL METHODIST CHURCH Juris.: _____

Address of Property 4012 CENTRAL AVE.

Inspection Data:

Tank Material PCC

Total Length of Drainfield N/A

Number of Lines / @ /

Cover Depth N/A

Water Supply Source MUNICIPAL

Distance to Water Source N/A

Excavation Inspected N/A

Tank(s) Inspected 9-30-04

Wash Line Inspected N/A

High Water Alarm Inspected N/A

SEE REPAIR APPROVAL
FOR DRAWING.
19829

PLOT

Design 2004 / REPAIR / INSTALLED NEW SEPTIC TANK CTR# STEVE AUTRY

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ altered or repaired

☑ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☑ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: INSTALLED NEW 1500 GALLON SEPTIC TANK W/ EFFLUENT FILTER. INSTALLED NEW D-BOX AND RECONNECTED TO EXISTING DRAIN FIELD.

1959

Tim Thomas, RSI 10-1-04
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.