D cornelius

FILE NUMBER: 4634B

APPLICATION NUMBER: 3637

SEPTIC FEE: 300.00
DATE: 6-24-08
CK# 5900

Revised On: August 31, 2007

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____
DATE: _____

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☐ NEW SYSTEM ☑ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☐ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 13928140
STREET ADDRESS: 9711 ARLINGTON OAKS DR.
CITY: CHARLOTTE
STATE: NC ZIP: 28227
SUBDIVISION NAME:
LOT #: 8 LOT SIZE (acres): .9 acres
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☑ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:

BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☑ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE: 3500 ?
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☑ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☐ MUNICIPAL ☐ PUBLIC WELL ☑ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☑ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☑ YES ☐ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES ☑ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☑ YES ☐ NO	JURISDICTIONAL WETLANDS	☐ YES ☑ NO
WELLS, SPRINGS, OR WATER LINES	☑ YES ☐ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES ☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES ☑ NO

10. PROPERTY OWNER:

NAME: Philip B. and Karin Boling
ADDRESS: 9711 Arlington Oaks Dr.
CITY: Charlotte
STATE: NC ZIP: 28227
HOME PHONE: (704) 545-2827 WORK PHONE: ____
MOBILE PHONE: (704) 219-7510 FAX:

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____

14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

Philip B. Boling 6/24/08
Property Owner's or Owner's Legal Representative Signature Date

15. WELL PERMIT APPLICATION SIGNATURE SECTION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

_____
Property Owner's or Owner's Legal Representative Signature Date

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

MECKLENBURG COUNTY-GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211, CHARLOTTE, NC 28202 PHONE: (704) 336-5103 FAX: (704) 336-6894


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 4634B

TC: 13928140

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

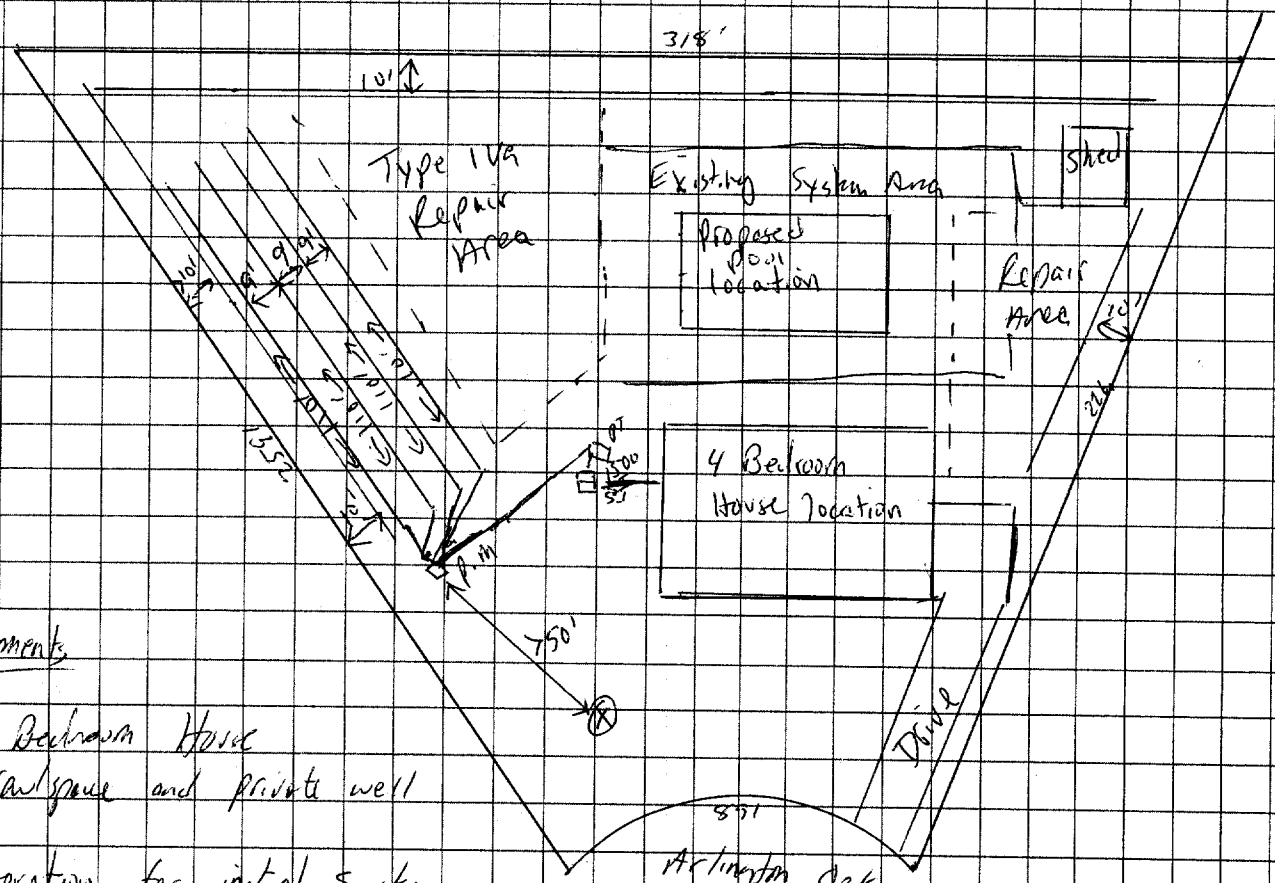

Comments

4 Bedroom House
Crawlspace and private well

Alteration for initial System for Swimming pool
Approved Septic System pump to 25% Reduction system.
to 4 lines @ 110' length each

- Keep system > 50' from well
  > 25' from structure of house

APPROVAL DATE 10/26/08

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy

Canary - E.H.S. Copy

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 4634B Permit #: 3631 Tax Parcel #: 139 281 40

Property Owner: Phillip Boling

Job Location Address: 9711 Arlington Oaks Dr.

City: Charlotte State: NC Zip Code: 28227

Installation Approval Issuance Date: 6/25/08

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 6/25/13, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD

Site LTAR: .275 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 437 feet

# of Lines: 4 @ 110 feet

Depth of Media: 12 inches (Type) Approved 111b

Distribution Device: Pressure Manifold

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: >10 feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >50' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

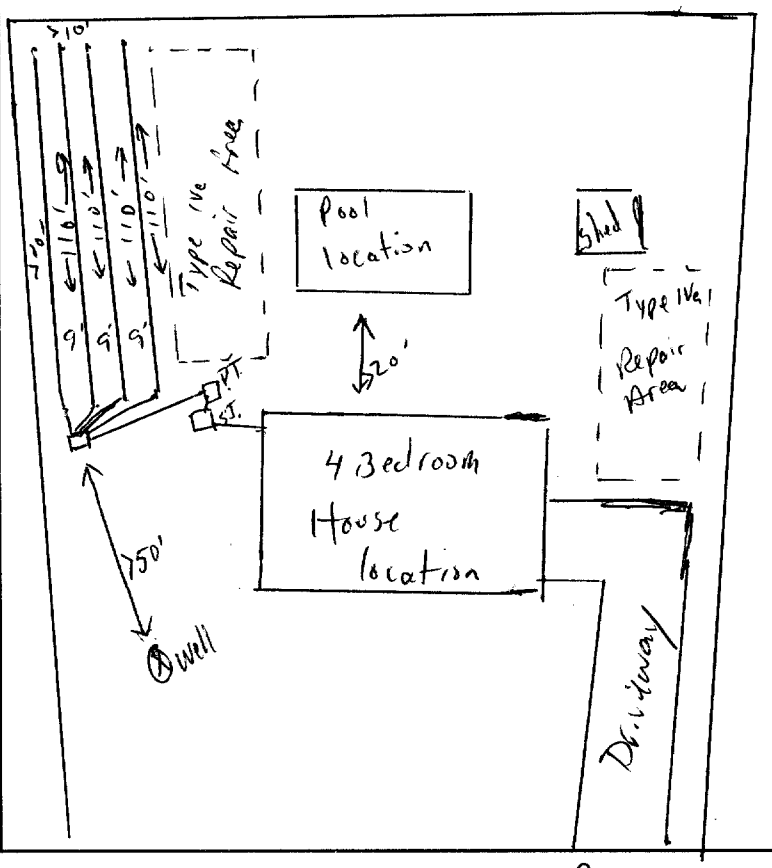

Comments: System Classification & Type: Pump to approved 111b system. type IVa Repair Area
* Keep system >50' away from well and >10' off property line.

DENR Authorized Agent: Jason Jackson Signature: Jason Jackson

FEE: 100.00 Check #2448
DATE: 9/4/03

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

Change in Ownership & Change in Plot Plan
[ ] CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #:

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 139-281-~~10~~ 40

STREET ADDRESS: 9711 Arlington Oaks Dr

SUBDIVISION OR MOBILE HOME PARK NAME: Arlington Oaks

LOT NUMBER: 8

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
✓ HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

TOWNSHIP (CHECK ONE):

X 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS: NUMBER OF OCCUPANTS:

CLOSING DATE _____

FOUNDATION FOR RESIDENCE:

___ WITHOUT BASEMENT ON SLAB
✓ CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

___ COMMUNITY (C)
___ MUNICIPAL (M)
✓ PRIVATE WELL (P)
___ SHARED WELL (S)
___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES ✓ NO
EXISTING WASTEWATER SYSTEMS ___ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS ___ YES ✓ NO
WELL, SPRINGS OR WATERLINES ___ YES ✓ NO
DESIGNATED WETLANDS ___ YES ✓ NO

PROPERTY OWNER:

NAME: Boling Phil
(LAST) (FIRST) (MI)

ADDRESS: 1421-D Orchard Lake Dr

CITY: CHAR STATE: NC ZIP: 28270

DAYTIME PHONE: (704) 545-2827

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: WARD Robert S.
(LAST) (FIRST) (MI)

DAYTIME PHONE: (704) 634-9917

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? ~~12~~ 12/14/01

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: [signature] DATE: 9/4/03

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

Permit Number: 4634B

Tax Number: 139-281-16 40

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	X No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	X Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
1,225 Long-term acceptance rate	480 Max gallons/day wastewater flow	1245 Absorption Area (sq ft)	9' Trench spacing (min. on centers)
YES Serviced by private well	1500 Gallon septic tank	581 Total trench length (ft)	30" Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
4 Bedrooms in residence	___ Gallon pump tank	12" Depth of stone	
Any surface waters present:	Type:	Minimum separation distance:	
Site modifications required:			
Additional Conditions:			
Repair Area System Type Type (circle one): I (II) III IV V VI	X Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
1245 Absorption Area (Sq ft) 581 Total Trench Length (Ft)	12" Depth of Stone Trench	9' Trench spacing (min. on centers)	30" Maximum Trench Depth
For existing system, enter the year originally installed:			

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department
- This Improvement permit is transferable.

DEHNR Authorized Agent — Date 10/22/01

Jeff Casey agent — Owner/Agent Signature — Date 12-14-01

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4634B

TC: 139-281-1640

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

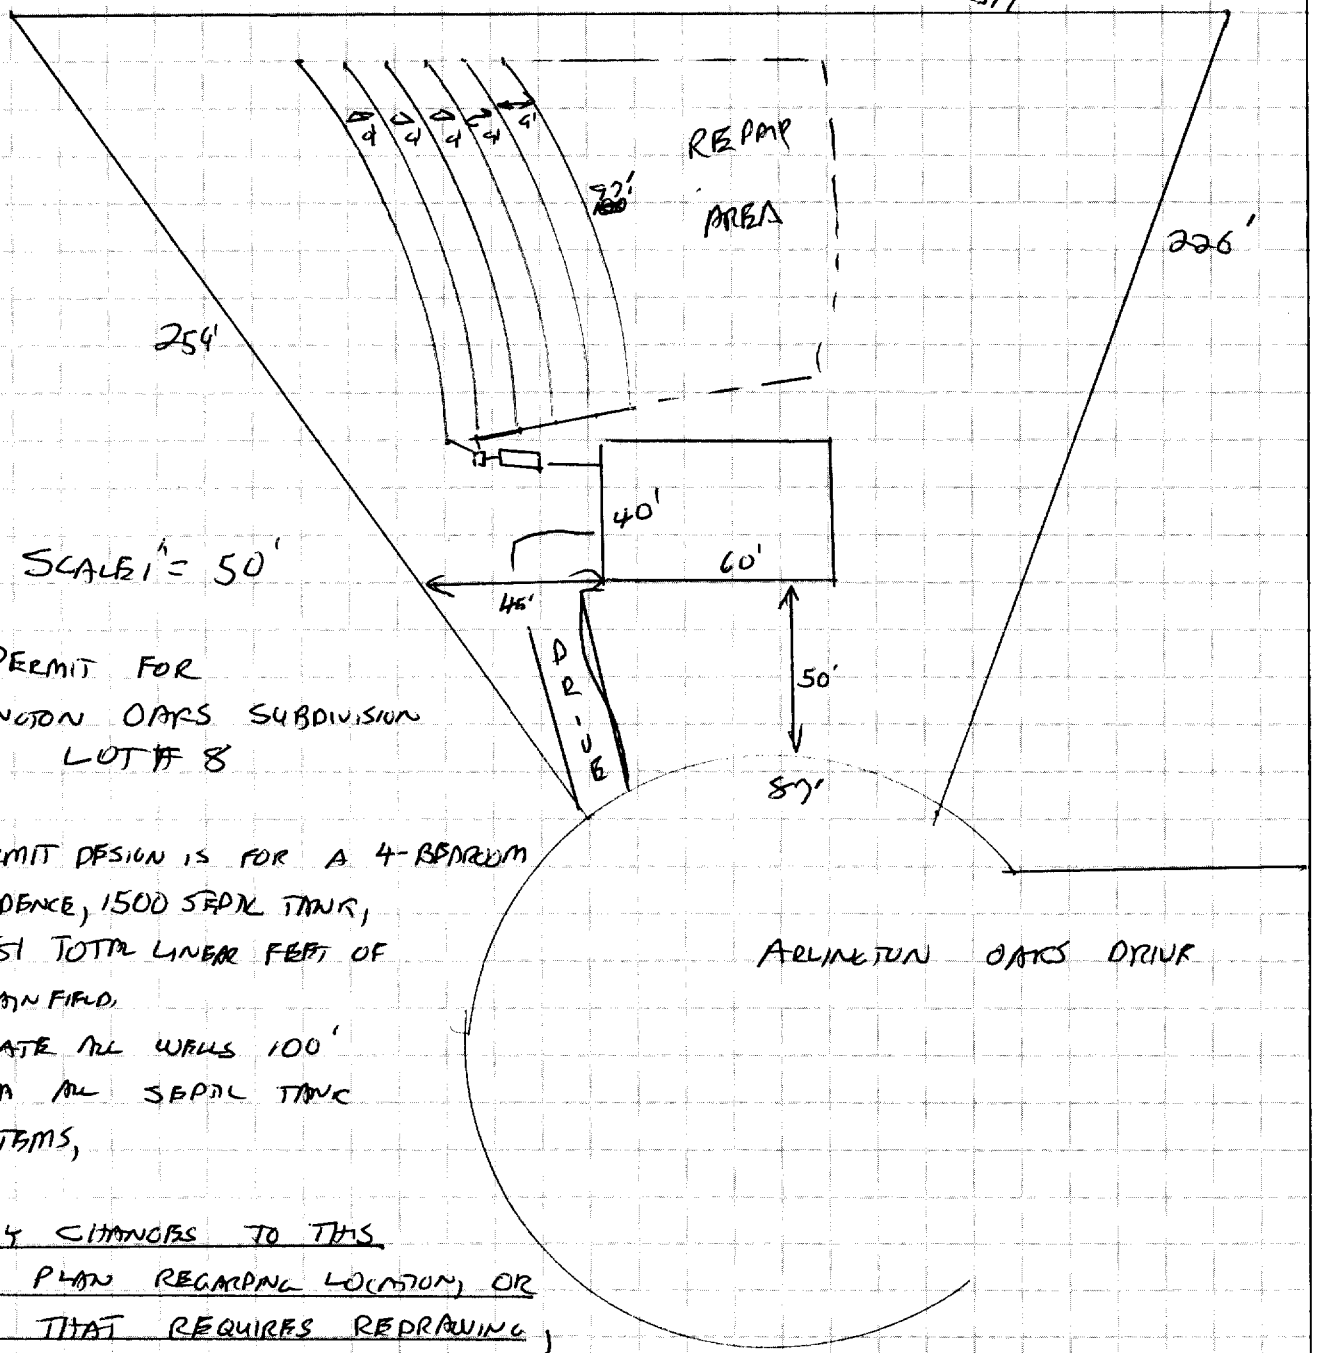

SCALE 1" = 50'

PERMIT FOR
ARLINGTON OAKS SUBDIVISION
LOT # 8

(1) PERMIT DESIGN IS FOR A 4-BEDROOM RESIDENCE, 1500 SEPTIC TANK, 551 TOTAL LINEAR FEET OF DRAINFIELD.

(2) LOCATE ALL WELLS 100' FROM ALL SEPTIC TANK SYSTEMS.

(3) ANY CHANGES TO THIS PLOT PLAN REGARDING LOCATION, OR SIZE THAT REQUIRES REPLANNING, MAY BE SUBJECT TO 100.00 FEE.

(4) INSTALL DRAINLINES SHALLOW 30" AND ON CONTOUR.

APPROVAL DATE 10/22/01

Jeff Cordey agent 12-14-01

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy


FILE # 46348

COMMENTS 100% Repair

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR
R-RIDGE	I	S-SAND	1.2-0.8
S-SHOULDER SLOPE		LS-LOAMY SAND	
L-LINEAR SLOPE			
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6
N-NOSE SLOPE		L-LOAM	
H-HEAD SLOPE			
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM	
T-TERRACE		CL-CLAY LOAM	
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM	
	IV	SC-SANDY CLAY	0.4-0.1
		SIC-SILTY CLAY	
		O-ORGANIC	

CONSISTENCE	
MOIST	WET
VFR-VERY FRIABLE	NS-NON-STICKY
FR-FRIABLE	SS-SLIGHTLYSTICKY
FI-FIRM	S-STICKY
VFI-VERY FIRM	VS-VERY STICKY
EFI-EXTREMELY FIRM	NP-NON-PLASTIC
	SP-SLIGHTLYSTICKY
	P-PLASTIC
	VP-VERY PLASTIC

STRUCTURE	MINERALOGY
SG-SINGLE GRAIN	SLIGHTLY EXPANSIVE
M-MASSIVE	
CR-CRUMB	EXPANSIVE
GR-GRANULAR	
SBK-SUBANGULAR BLOCKY	
ABK-ANGULAR BLOCKY	
PL-PLATY	
PR-PRISMATIC	

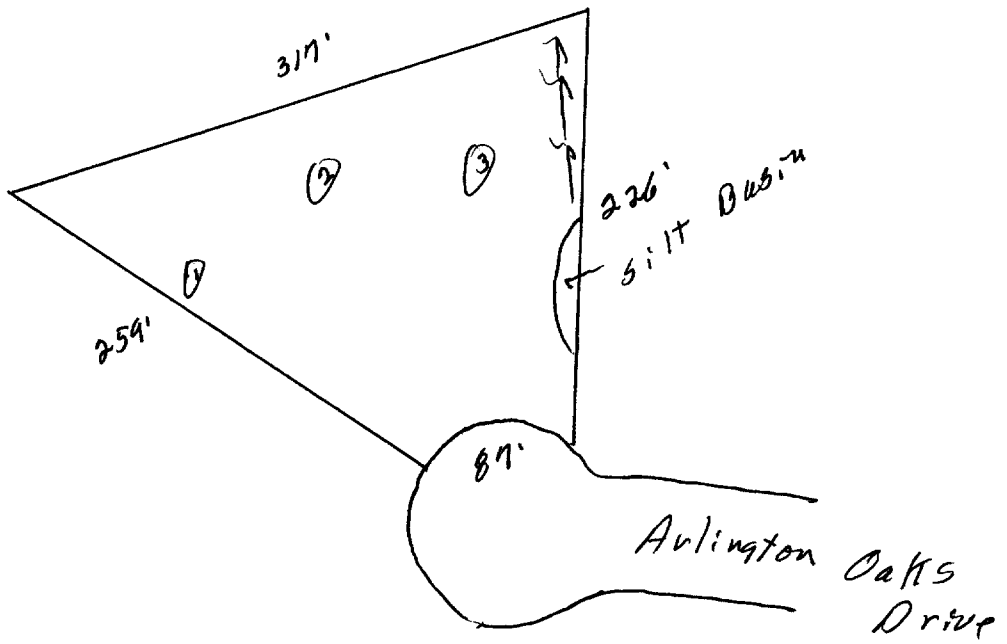

FEE: _____

DATE: _____

APPLICATION FOR IMPROVEMENT PERMIT
FOR RESIDENTIAL SITE
INDIVIDUAL WATER AND WASTEWATER
SYSTEMS PROGRAM

paid 5/7/01 CK#862
200- RK

[ ] CRT

TYPE APPLICATION: ___ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 46348

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: out of 139-281-09

STREET ADDRESS: not assigned yet

SUBDIVISION OR MOBILE HOME PARK NAME: Arlington Oaks

LOT NUMBER: 8

TOWNSHIP (CHECK ONE):

___ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
X 7 MINT HILL

CLOSING DATE After evaluation

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
X HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

HEATED SQUARE FOOTAGE: Approx. 2400

NUMBER OF BEDROOMS: 3

NUMBER OF OCCUPANTS:

FOUNDATION FOR RESIDENCE:

___ WITHOUT BASEMENT
___ ON SLAB
X CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES X NO TYPE: _____

WATER SUPPLY (CHECK ONE):
___ COMMUNITY (C)
___ MUNICIPAL (M)
X PRIVATE WELL (P)
___ SHARED WELL (S)
___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES X NO
EXISTING WASTEWATER SYSTEMS ___ YES X NO
EASTMENTS OR RIGHT-OF-WAYS X YES ___ NO
WELL, SPRINGS OR WATERLINES ___ YES X NO
DESIGNATED WETLANDS ___ YES X NO

PROPERTY OWNER:

NAME: Medlin Farms, Inc.
(LAST) (FIRST) (MI)

ADDRESS: 5201 Monroe Road

CITY: Charlotte STATE: NC ZIP:28205

DAYTIME PHONE: (704) 567 – 9820

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) –

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? To be deeded after evaluation

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Jeff Cases agent DATE: 5-7-01

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4634B

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

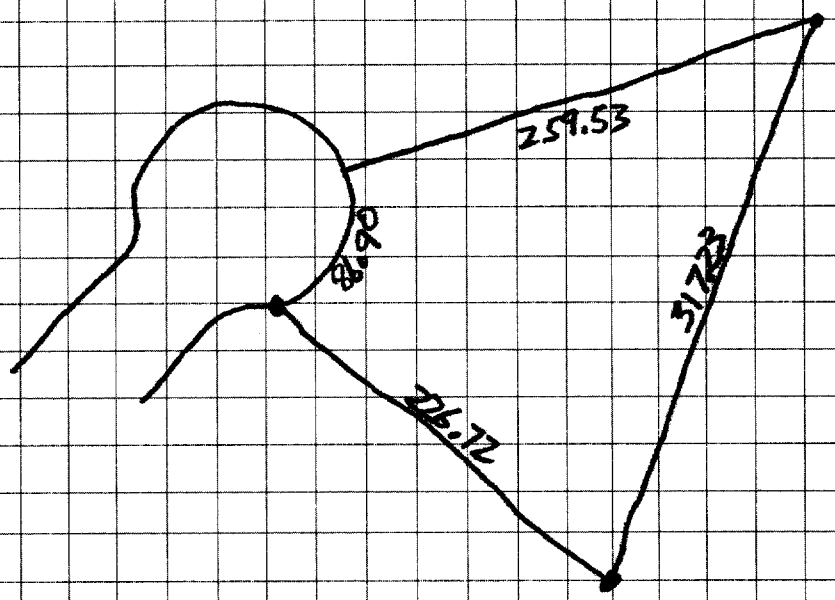

Jeff Casey agent
OWNER/AGENT SIGNATURE

DATE 5-7-01

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1
Property ID: PO 139-281-16
Lot #: 8
File #: 4634B
Code: 1

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Medlin Farms, Inc.
Applicant:
Address: 5201 Monroe Road, Charlotte, N. C. 28205
Date Evaluated: 8/3/01
Proposed Facility: residence
Design Flow (.1949): 360gpd
Property Size: .9a
Location of Site: Arlington Oaks Drive
Property Recorded:
Water Supply: [ ] Public [x] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [ ] Augur Boring [x] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
	2-10								
1	LS	0-2	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL SETNESS	48	N/A	NONE	PS, IV .275G/FT^2/DAY
		2-6	SBK/CL	FR/SEXP/SS/SP					
		6-31	ABK/C	FI/SEXP/S/P					
		31-42	SBK/C	FI/SEXP/S/P					
		42-48	SBK/CL	FR/SEXP/SS/SP					
2	LS	0-3	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	"	"	"	PS, IV .275G/FT^2/DAY
		3-7	SBK/CL	FR/SEXP/SS/SP					
		7-37	ABK/C	FI/SEXP/S/P					
		37-48	SBK/C	FI/SEXP/S/P					
3	LS	0-3	GR/CL	FR/SEXP/SS/SP	>48 TO SOIL WETNESS	"	"	"	PS, IV .275G/FT^2/DAY
		3-17	SBK/C	FI/SEXP/S/P					
		17-30	ABKI/C	FI/SEXP/S/P					
		30-48	SBK/C	FI/SEXP/S/P					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)		
Site LTAR	.275G/FT^2/DAY	.275G/FT^2/DAY

Other Factors (.1946): _____
Site Classification (.1948): PROVISIONALLY SUITABLE
Evaluated By: W. R. Marlin, LSS, 8/16/01, W.R. Marlin
Others Present: J. Casey


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 46343

TC: 139 - 281 - 40

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

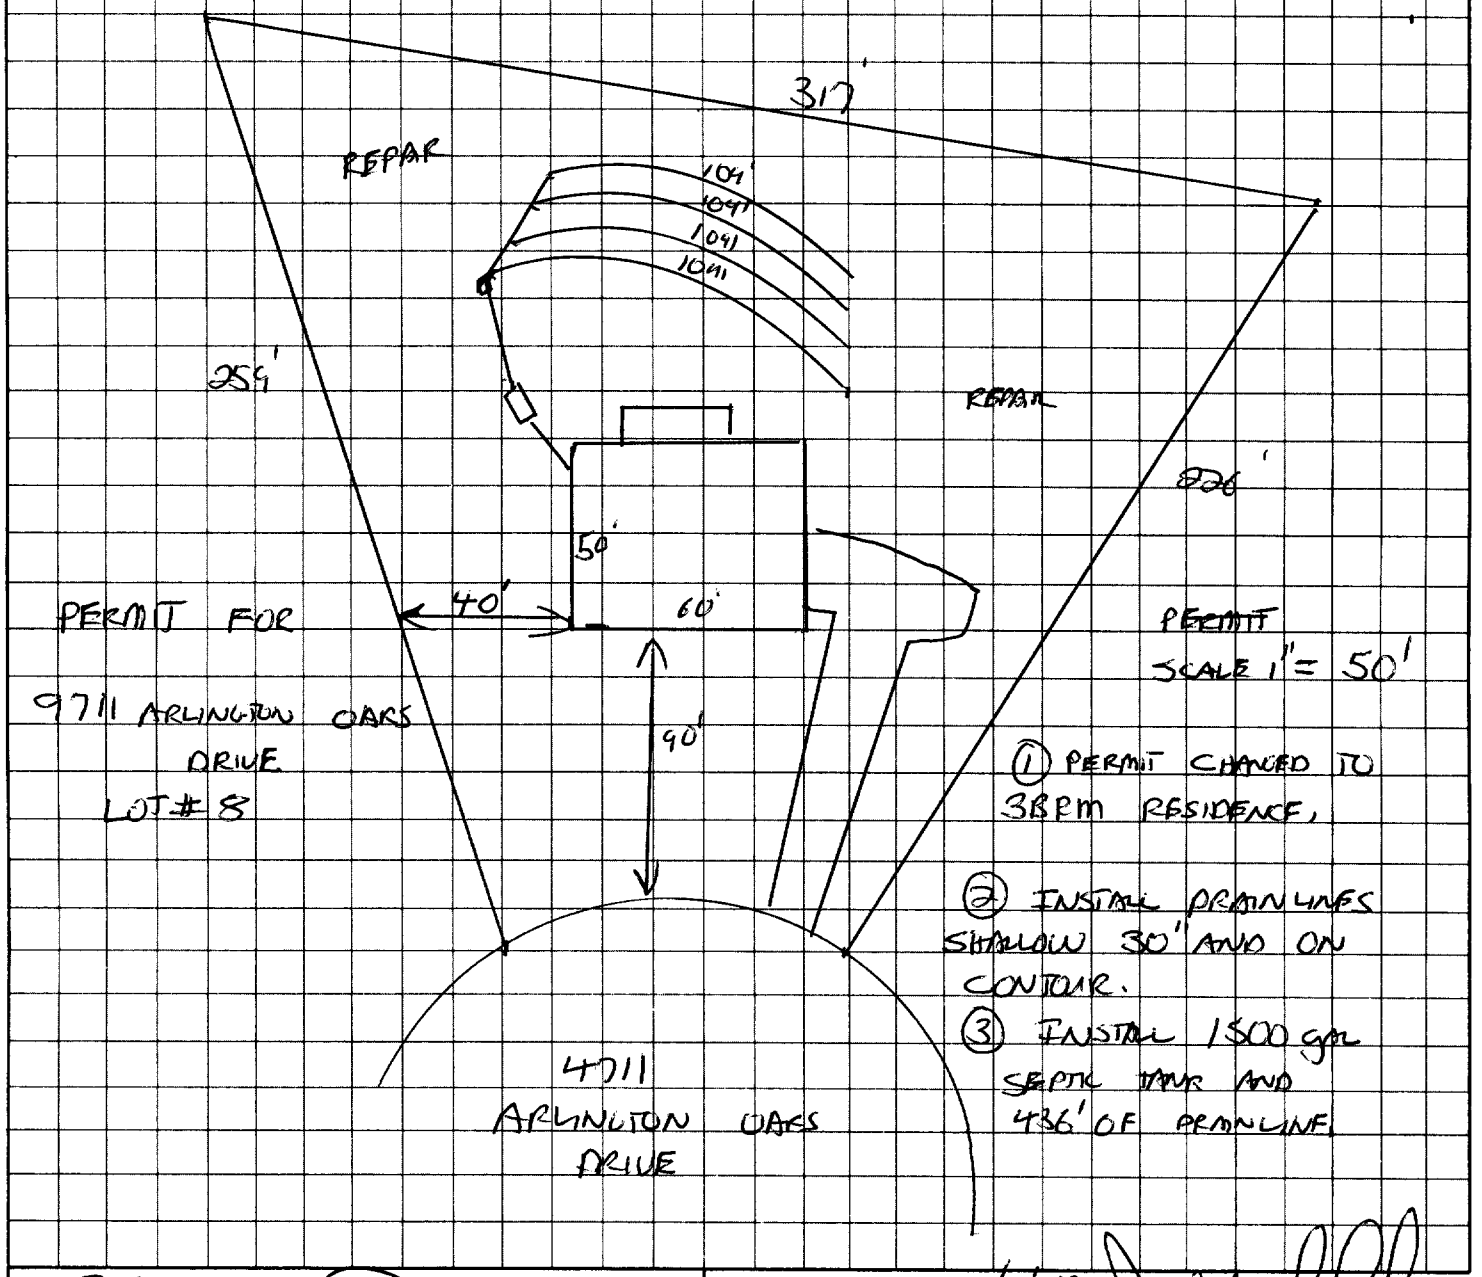

OWNER/AGENT SIGNATURE

DATE 9-4-03

APPROVAL DATE 9/8/03

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 46348 DATE: 1-21-04

TC: 135-251-40 X L

SERIAL 19614

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 5-7-01. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of I5A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

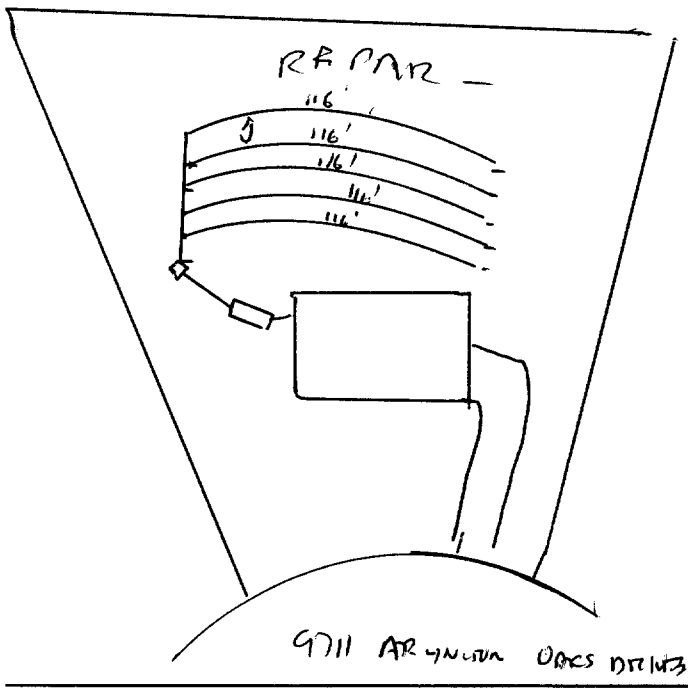

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank NA gallons

Tank Construction PC

Trench Depth 30"

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Trench Walls Scored and Porous yes

Total Line Length 580 feet

Number of Lines 5

Depth of Stone 12" inches

Distance from House 5' feet

Distance from Property Line 10' feet

Distance from Well >50 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER RISHER-WARD CONSTRUCTION

LOCATION OF PROPERTY 9711 ARLINGTON OAKS DRIVE

Comments:

FAX TO RCS 289-5562

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4634B DATE: 2-19-04

TC: 139 281 40 ☒ L ☐ CRT

SERIAL 19470

Name of Owner PHILLIP BOLING Juris.: _____

Address of Property 9711 ARLINGTON OAKS DRIVE

Inspection Data:

Tank Material PCC 1500

Total Length of Drainfield 581

Number of Lines 5 @ 116'

Cover Depth 12"

Water Supply Source WELL


Distance to Water Source 56'

Excavation Inspected 2-19-04

Tank(s) Inspected 2-19-04

Wash Line Inspected _____

High Water Alarm Inspected _____

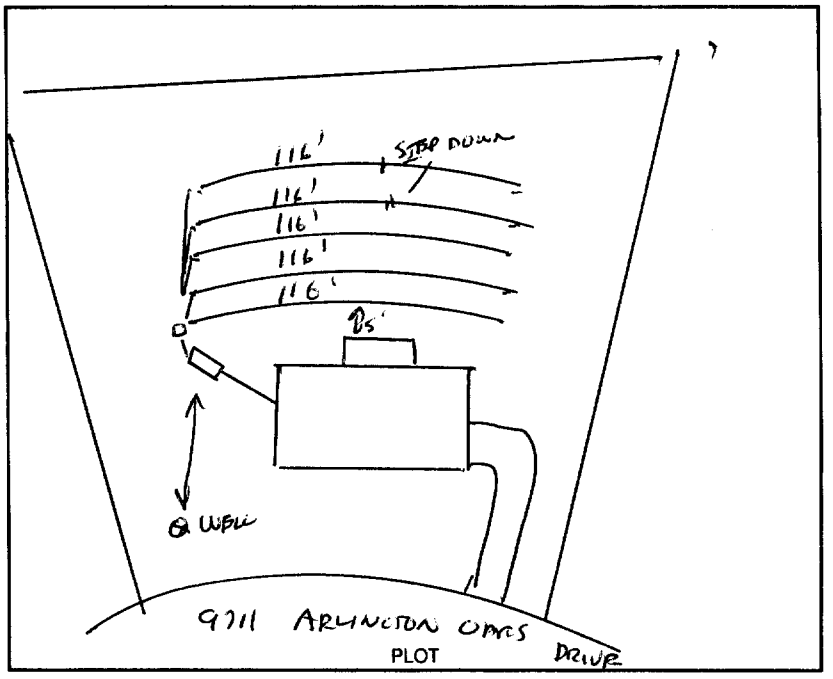

Design 1500 ST 1145 SFT CONV. 12G CTR# RCS

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☐ in accordance with the permit issued ☒ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: TYPE II

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

check # 2448

FEE: 300.00 **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION**
DATE: 9/4/03 **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE** ACS 508016

DATE: 9/8/03

PERMIT NO: 4634B
PARCEL NO: 139-281-40

JOB LOCATION ADDRESS: 9711 ARLINGTON OAKS DRIVE
PROPERTY OWNER:
BUILDING CONTRACTOR: RESIDE-WARD CONSTRUCTION
SUBDIVISION NAME: ARLINGTON OAKS LOT #8
AUTHORIZATION ISSUED BY: DEHNR AUTHORIZED AGENT
DATE: 9/8/03

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 4634B, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED **PRIOR** TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS:

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE

9/4/03
DATE

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: **3637** Tax Number: **13928140**

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

.275 Long-term acceptance rate (GPD/ft^2)	480 Max gallons/day wastewater flow	1745 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☒ Yes ☐ No	1500 Gallon septic tank	437 Total trench length (ft)	30 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
4 Bedrooms in residence	1000 Gallon pump tank	12 Depth of media (in)	

Any surface water present: **No** Type: Minimum separation distance (ft):

Additional conditions:

Repair Area System

Type: ☐ I ☐ II ☐ III ☒ IV ☐ V ☐ VI

☐ Conventional
☒ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

1745 Absorption Area (ft^2) 291 Total trench length (ft)	24 Depth of media (in)	9 Trench spacing (min. on centers) (ft)	42 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.

6/21/08

DENR Authorized Agent Date

Owner/Agent Signature Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION



9711 ARLINGTON OAKS DR

13928140

1/7/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

2008 REVISION OK

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 4634 B WASPS App #: 3631

Primary ES assigned to project: JJ

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☑ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☐	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 62508

OP issued date: _____

Review performed by: IR Date performed: _____

D cornelius

FILE NUMBER: 4634B

Revised On: August 31, 2007

APPLICATION NUMBER: 3637

SEPTIC FEE: 300.00
DATE: 6-24-08
CK# 5900

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____
DATE: _____

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☐ NEW SYSTEM ☑ ALTERATION ☐ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☐ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 13928140
STREET ADDRESS: 9711 Arlington Oaks Dr.
CITY: Charlotte
STATE: NC ZIP: 28227
SUBDIVISION NAME:
LOT #: 8 LOT SIZE (acres): .9 acres
TOWNSHIP:
☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☐ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☑ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:
BUILDING TYPE:
☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☑ HOUSE ☐ OTHER _____
HEATED SQUARE FOOTAGE: 3500 ?
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☑ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☐ MUNICIPAL ☐ PUBLIC WELL ☑ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:
☑ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____
8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☑ YES ☐ NO		GRADING/SOIL REMOVAL PERFORMED	☐ YES ☑ NO	
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☑ YES ☐ NO		JURISDICTIONAL WETLANDS	☐ YES ☑ NO	
WELLS, SPRINGS, OR WATER LINES	☑ YES ☐ NO		APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES ☑ NO	
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☑ NO		WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES ☑ NO	

10. PROPERTY OWNER:
NAME: Phillip B. and Karin Boling
ADDRESS: 9711 Arlington Oaks Dr.
CITY: Charlotte
STATE: NC ZIP: 28227
HOME PHONE: (704) 545-2827 WORK PHONE: ____
MOBILE PHONE: (704) 219-7510 FAX:

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____
13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____

14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

Property Owner's or Owner's Legal Representative Signature — Date: 6/24/08

15. WELL PERMIT APPLICATION SIGNATURE SECTION:
If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

Property Owner's or Owner's Legal Representative Signature — Date


☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File #_____
Date_____

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

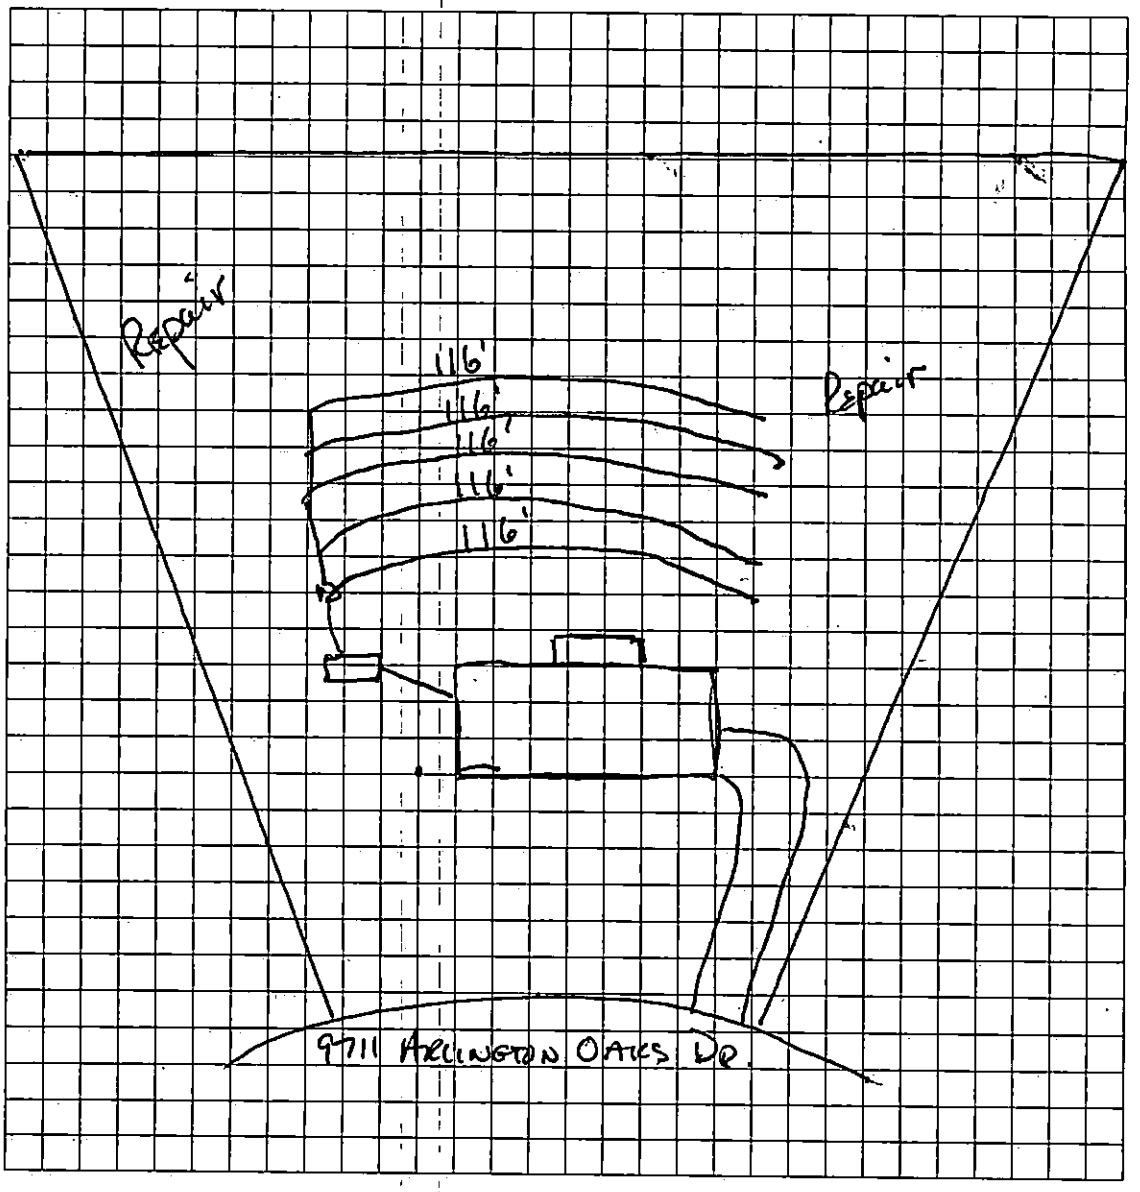

Owner/Agent Signature	Patty B Bolt
Date	6/24/08

LBC 12/15/04

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 46348 DATE: 2-19-04

TC: 139 281 40 ☒ L ☐ CRT

SERIAL 19470

Name of Owner PHILLIP BOLING Juris.:

Address of Property 9711 ARLINGTON OAKS DRIVE

Inspection Data:

Tank Material PCC 1500

Total Length of Drainfield 581

Number of Lines 5 @ 116'

Cover Depth 12"

Water Supply Source WELL


Distance to Water Source 56'

Excavation Inspected 2-19-04

Tank(s) Inspected 2-19-04

Wash Line Inspected

High Water Alarm Inspected

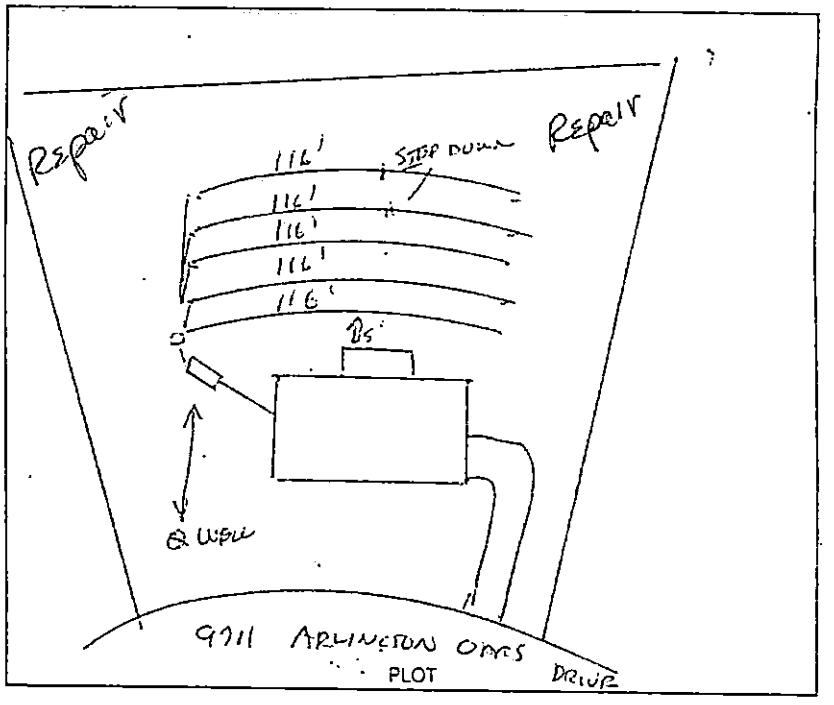

Design 1500 ST 1745 SFT CONV. 12G CTR# RCS

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☑ installed or constructed ☐ altered or repaired

☐ in accordance with the permit issued ☑ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: TPR II

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	06/24/08	**Amount:**	300.00
Receipt #:	57939	**Tendered:**	300.00
Check / Auth #:	CHECK 5900	**Returned:**	0.00
Received By:	GLADNAG		

Account Information

Account #: 200000
Contractor: BOLING PHILLIP B. & KARIN
Attn:
Address: 9711 ARLINGTON OAKS DR
Address:
City/State/Zip: CHARLOTTE, NC 28227

Item	Description	Permit#	Quantity	Unit Price	Total Price
0706	MH Exc/Add/Repl w/System Mod 9711 ARLINGTON OAKS DR		1	300.00	300.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

FEE: 0.00

DATE:6/26/2008

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY

GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 4634B

PERMIT NUMBER: 4634B

PARCEL NUMBER: 13928140

JOB LOCATION INFORMATION

ADDRESS: 9711 ARLINGTON OAKS DR

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28227

ISSUED TO: PHILLIP B & KARIN BOLING

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 6/26/2008

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER , AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   *CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 6/26/2013

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: 3637

Tax Number: 13928140

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

.275 Long-term acceptance rate (GPD/ft^2)	480 Max gallons/day wastewater flow	1745 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☒ Yes ☐ No	1500 Gallon septic tank	437 Total trench length (ft)	30 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
4 Bedrooms in residence	1000 Gallon pump tank	12 Depth of media (in)	

Any surface water present: No Type: Minimum separation distance (ft):

Additional conditions:

Repair Area System

Type: ☐ I ☐ II ☐ III ☒ IV ☐ V ☐ VI

☐ Conventional
☒ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

1745 Absorption Area (ft^2) 291 Total trench length (ft)	24 Depth of media (in)	9 Trench spacing (min. on centers) (ft)	42 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.

6/21/08

DENR Authorized Agent Date

Owner/Agent Signature Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 4634B Permit #: 3631 Tax Parcel #: 139 281 40

Property Owner: Phillip Boling

Job Location Address: 9711 Arlington Oaks Dr.

City: Charlotte State: NC Zip Code: 28227

Installation Approval Issuance Date: 6/25/18

Permission is hereby given to [X] install [ ] alter [ ] repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge; as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 7/25/18, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Site LTAR: .275 GPD/ft² (For new installations only.)

Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design [ ] N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 437 feet

# of Lines: 4 @ 110 feet

Depth of Media: 12 inches (Type) Approved 11.b

Distribution Device: Pressure Manifold

Bed Design *(For Repair Installations ONLY.)* [X] N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

[ ] Municipal [X] Private Well [ ] Community Well

[ ] Other _____


Minimum System Setbacks

Distance from Building Foundation: >10 feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >50' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

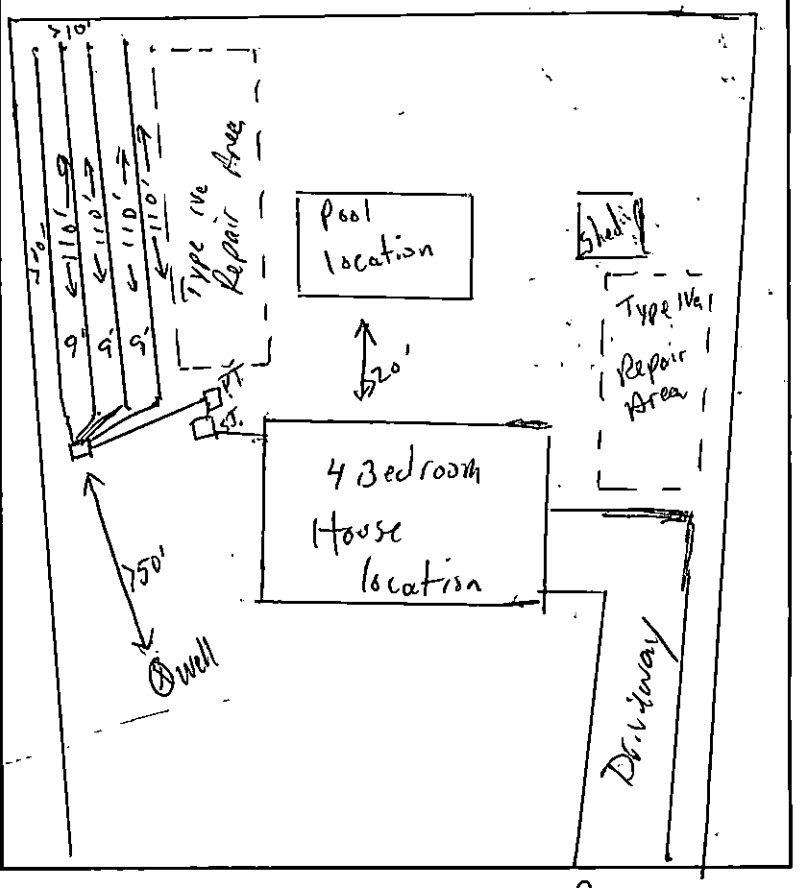

Comments: System Classification & Type: Pump to approved 11.b system. type IVa Repair Area
* Keep system >50' away from well and >10' off property line.

DENR Authorized Agent: Jason Jackson Signature: _____