Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 72288 WASPS App #: 2929

Primary ES assigned to project: Jeremy Michelone

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☐ Repair ☑ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☐	No ☑	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☐	No ☑	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☐	No ☑ Existing House	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☑	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☑
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 1 pit			
	Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR 0.2 Rule 1961(c) used for soil conditions.	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☑
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑ BD	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐ Existing.

Operation Permit

.1937(i)	System type as described in table V(a) of rule .1961	Yes ☑	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☑	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

IA issued date: 1-14-16

OP issued date: 1-15-16

Review performed by: JAM Date performed: 1-19-16

MECKLENBURG COUNTY
HEALTH DEPARTMENT

7228B #8879

4 NOV '15 PM 1:27

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ○ N/A ○ NEW SYSTEM ○ ALTERATION ⊗ REPAIR ○ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ⊗ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. **JOB LOCATION INFORMATION:**
TAX PARCEL NUMBER: 02322105
STREET ADDRESS: 11823 ARTHUR AUTON RD
CITY: Huntersville
STATE: NC ZIP: 28036
SUBDIVISION NAME: _____
LOT #: _____ LOT SIZE (acres): 5 Acres
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ⊗ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. **BUILDING INFORMATION:**
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
⊗ HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 11000
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 8
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
⊗ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☒ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. **WATER SUPPLY:** ○ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ⊗ SHARED WELL ○ OTHER _____

7. **PROPOSED USE OF WELL:** ○ N/A ○ IRRIGATION ⊗ POTABLE (DRINKING WATER) ○ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED):*
☒ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** ____ ____ ____ ____ ____

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ⊗ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ⊗ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ⊗ NO	JURISDICTIONAL WETLANDS	○ YES ⊗ NO
WELLS, SPRINGS, OR WATER LINES	⊗ YES ○ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ⊗ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ⊗ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ⊗ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ⊗ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ⊗ NO
WASTE STORAGE	○ YES ⊗ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ⊗ NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☒ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☒ N/A

12. **PROPERTY OWNER:**
NAME: Yer Vang Thao
ADDRESS: 11823 ARTHUR Auton RD
CITY: Huntersville
STATE: NC ZIP: 28078
WORK PHONE: (704) 241-2220
MOBILE PHONE: SAME ↑
FAX: _____
E-MAIL: peterth peter.thao@cca irco.com

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**
NAME: _____
ADDRESS: _____
CITY: _____
STATE: _____ ZIP: _____
WORK PHONE: _____
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

YT (initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

YerVang Thao
Property Owner's or Owner's Legal Representative Signature

11/4/15
Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

Subdivision Name: _____ Lot #: _____

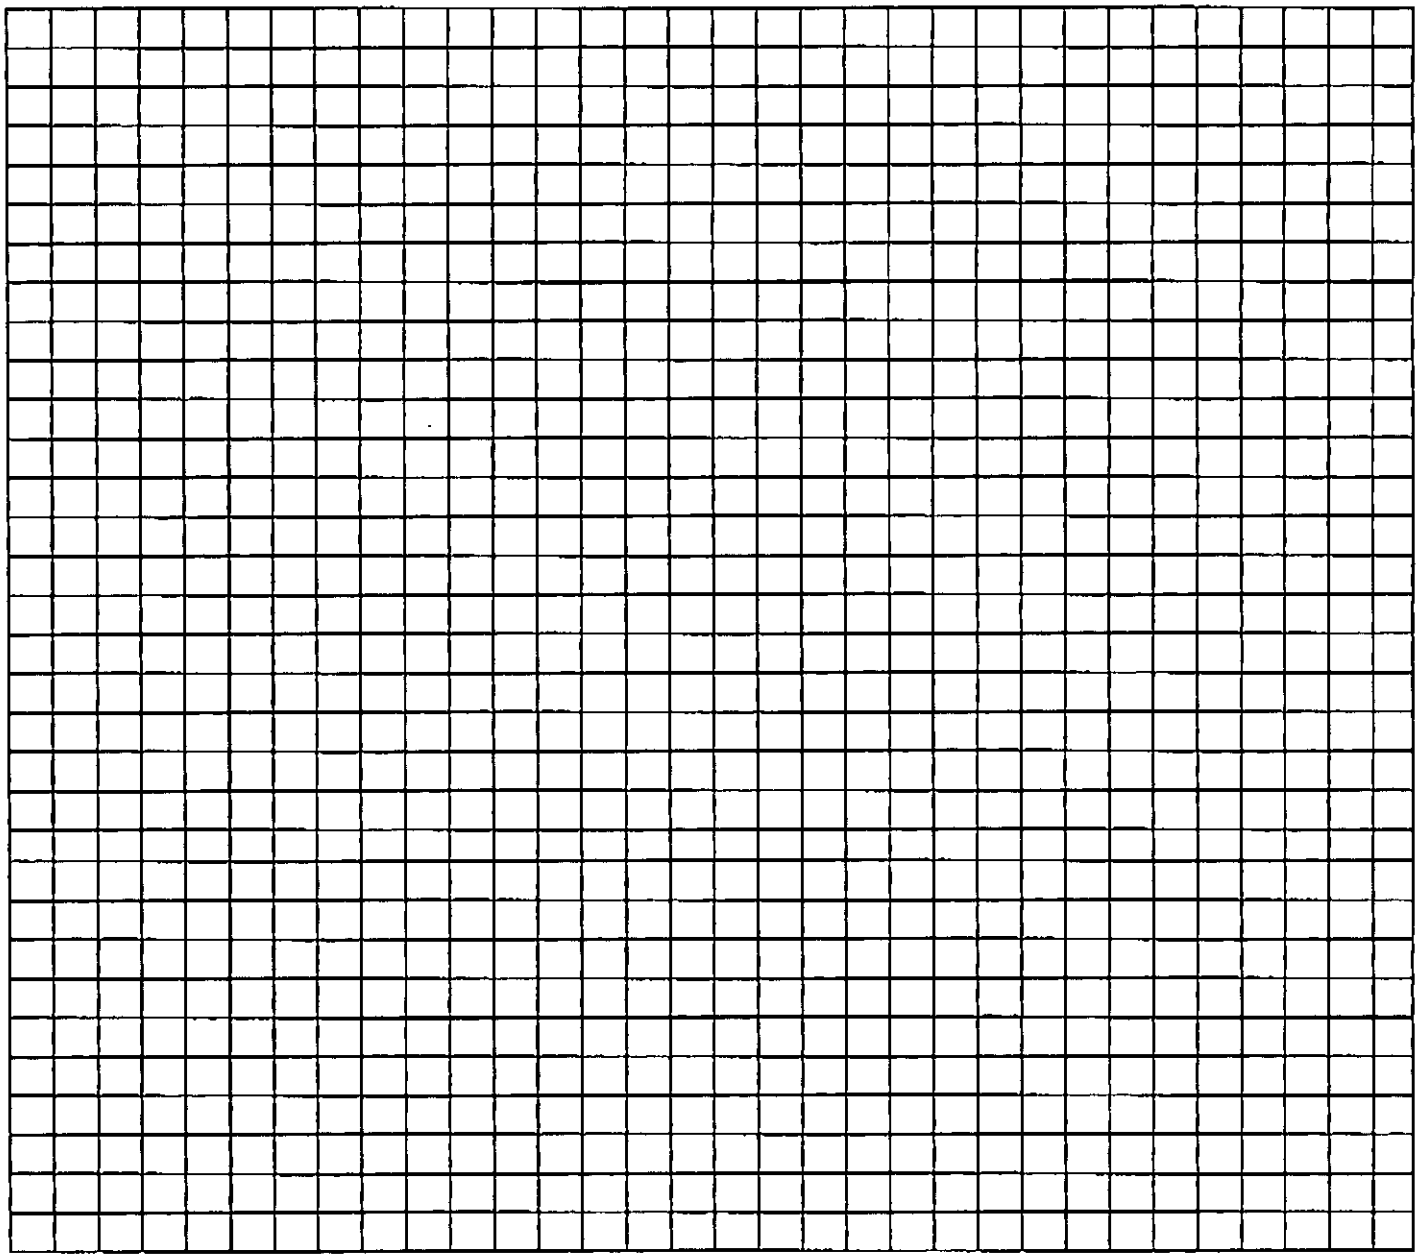

_____ _____

Property Owner's or Owner's Legal Representative Signature Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-Site Wastewater Section

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Page 1
Property ID: 023-.221-05
Lot #:
File #: 72288
AppID: 7879
Applicant: York Haven THMD
Date Evaluated:
Property Size:
Property Recorded:

Design Flow: (1949) 360

[ ] Public [x] Individual


[ ] Auger Boring [x] Well [x] Pit

[x] Sewage [ ] Industrial Process

[ ] Spring [ ] Other
[ ] Cut
[ ] Mixed

b

VICTORS

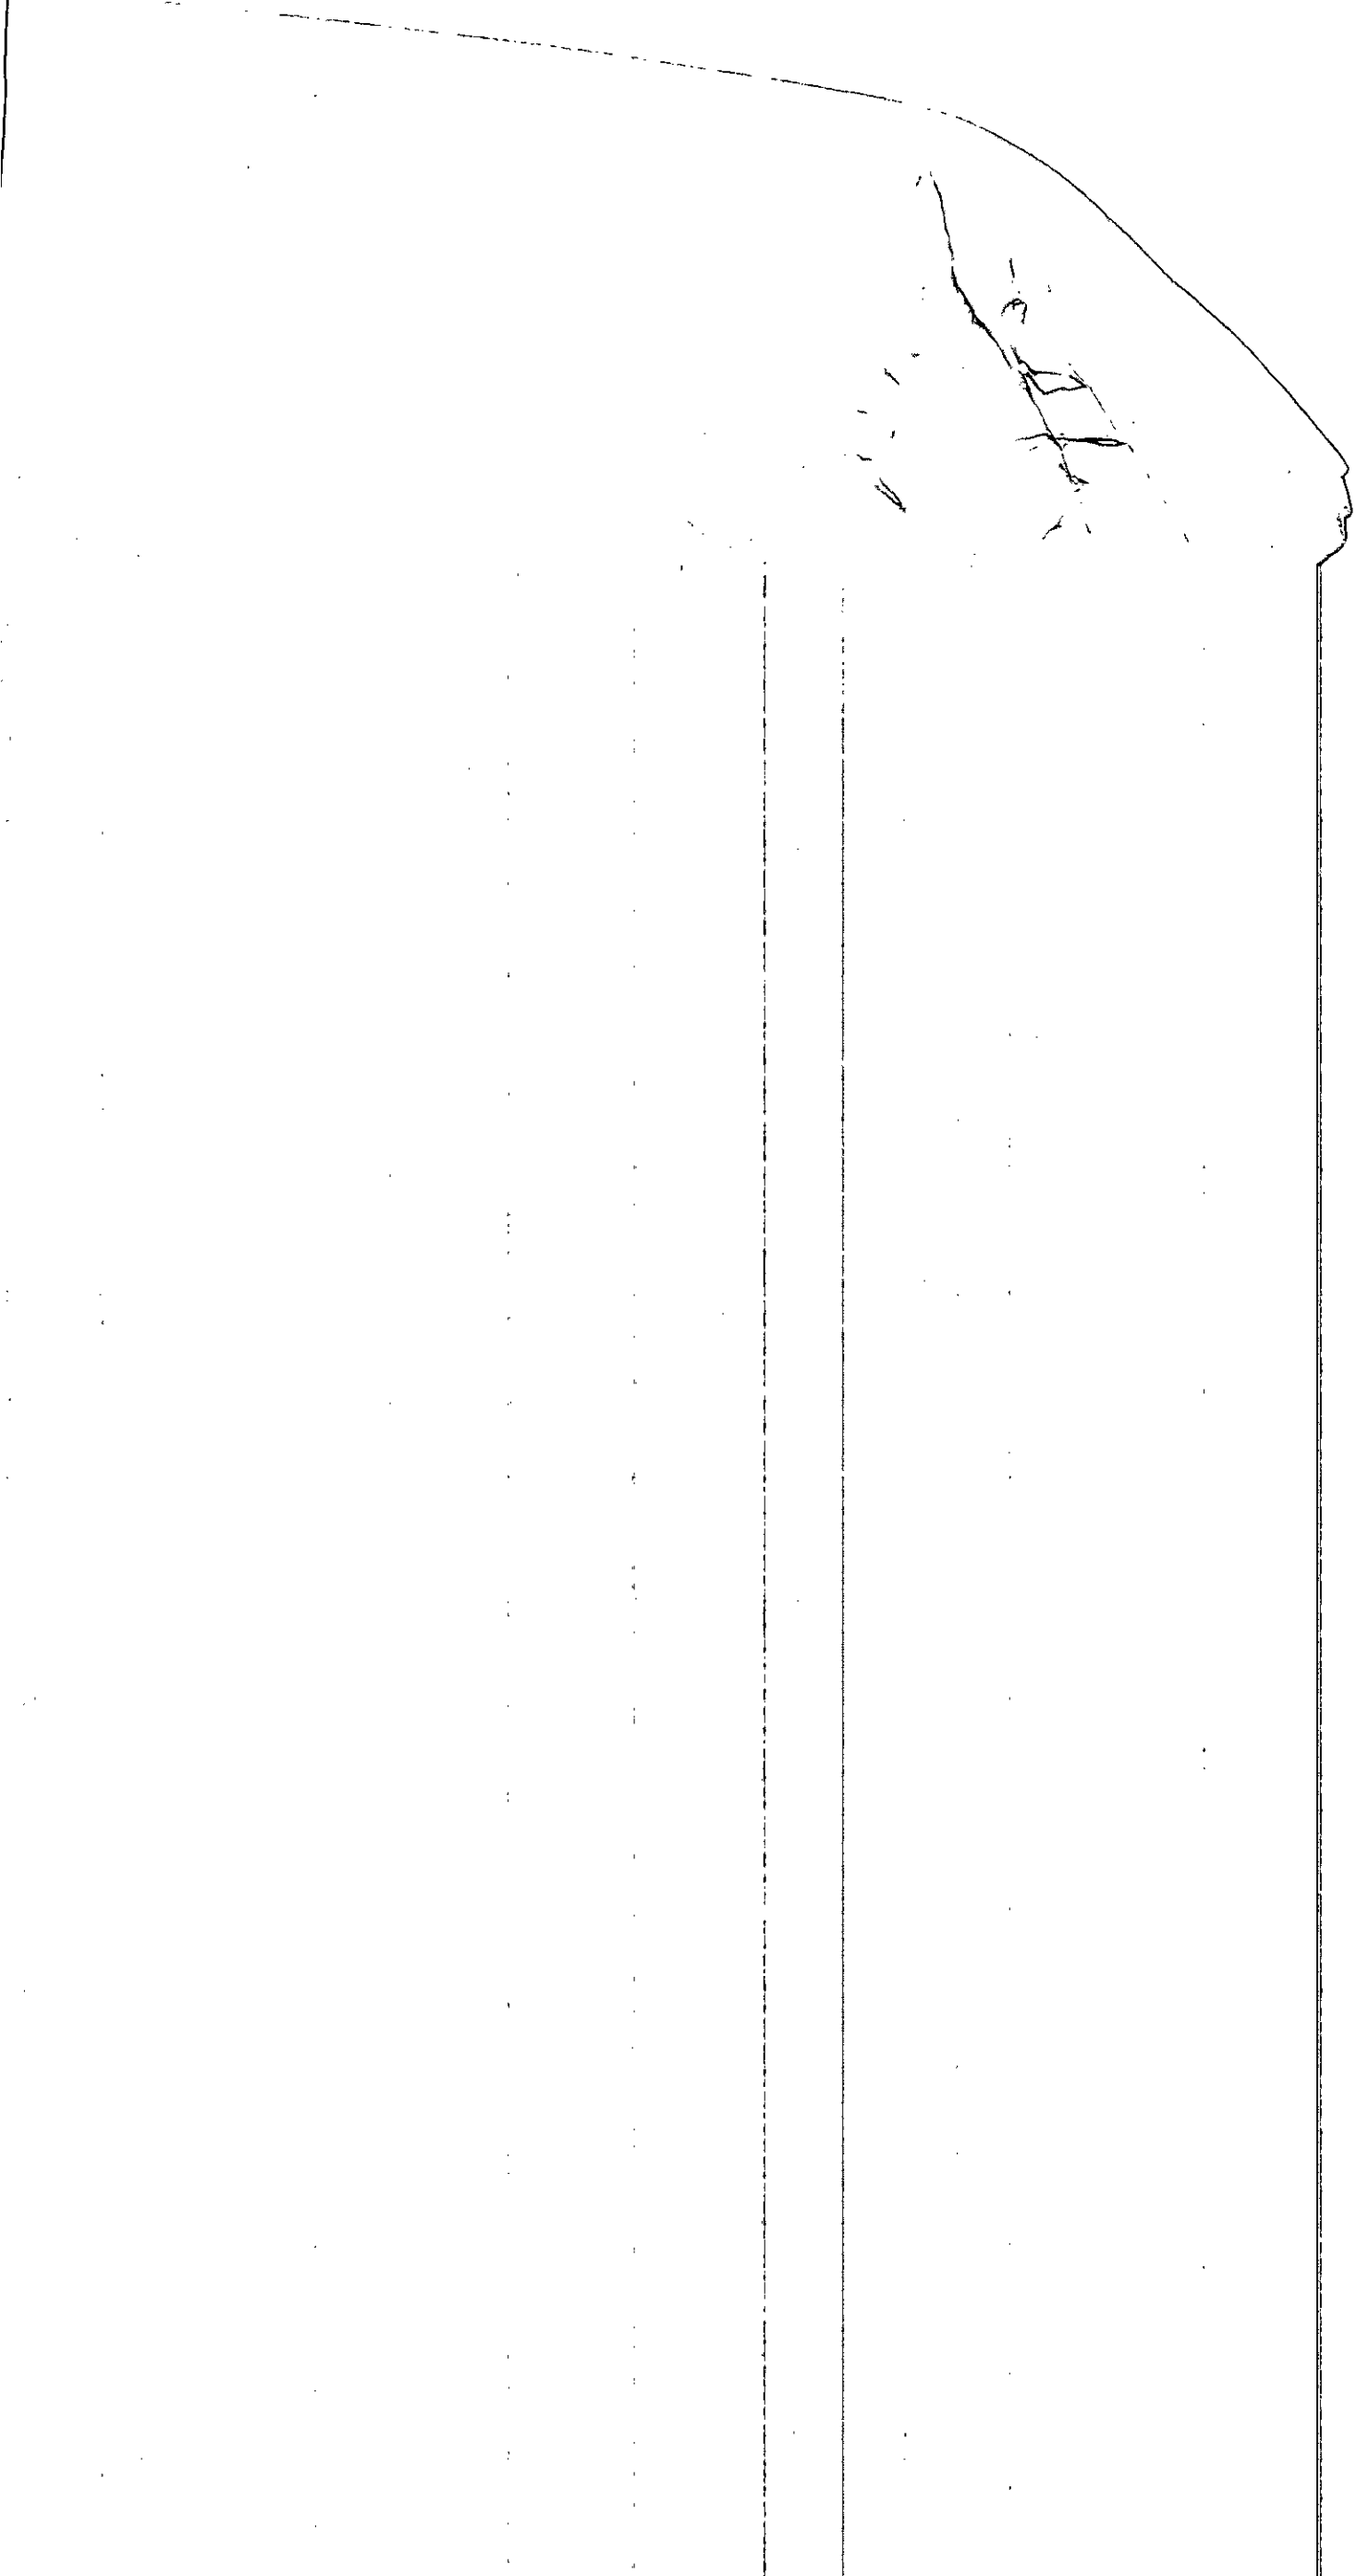

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-Site Wastewater Section

Property ID: 023-221-05
Lot #:
File #: 7228B
AppID: 7879

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: YOR VANG THAO
Address: 11823 Arthur Autry Road
Proposed Facility: Residence
Design Flow (.1949) 360
Location of Site: 11823 Arthur Autry Road
Water Supply: [ ] Public [x] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [ ] Auger Boring [x] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

Applicant: Yor Vang Thao
Date Evaluated:
Property Size:
Property Recorded:

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 Structure/ Texture	1941 Consistence Mineralogy	b PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	CS 4%	0-28	SBk/c	VFI/s/p/scxp	>60" TO SOIL WETNESS	60"	NA	N.A	PS IV 0.2 com
		28-48	SBk/c	VFI/s/p/scxp					
		48-60	wSBk/cl	FI/s/p/scxp					


Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IIa	IIa
Site LTAR	0.2	0.2

Other Factors (.1946):
Soil Evaluation By: Jerry Mark Reid
Others Present: STANLEY SEPTIC
Site Classification (.1948): P.S.
Site Evaluation By: Jerry Mark Reid
Others Present: STANLEY Environmentalist

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

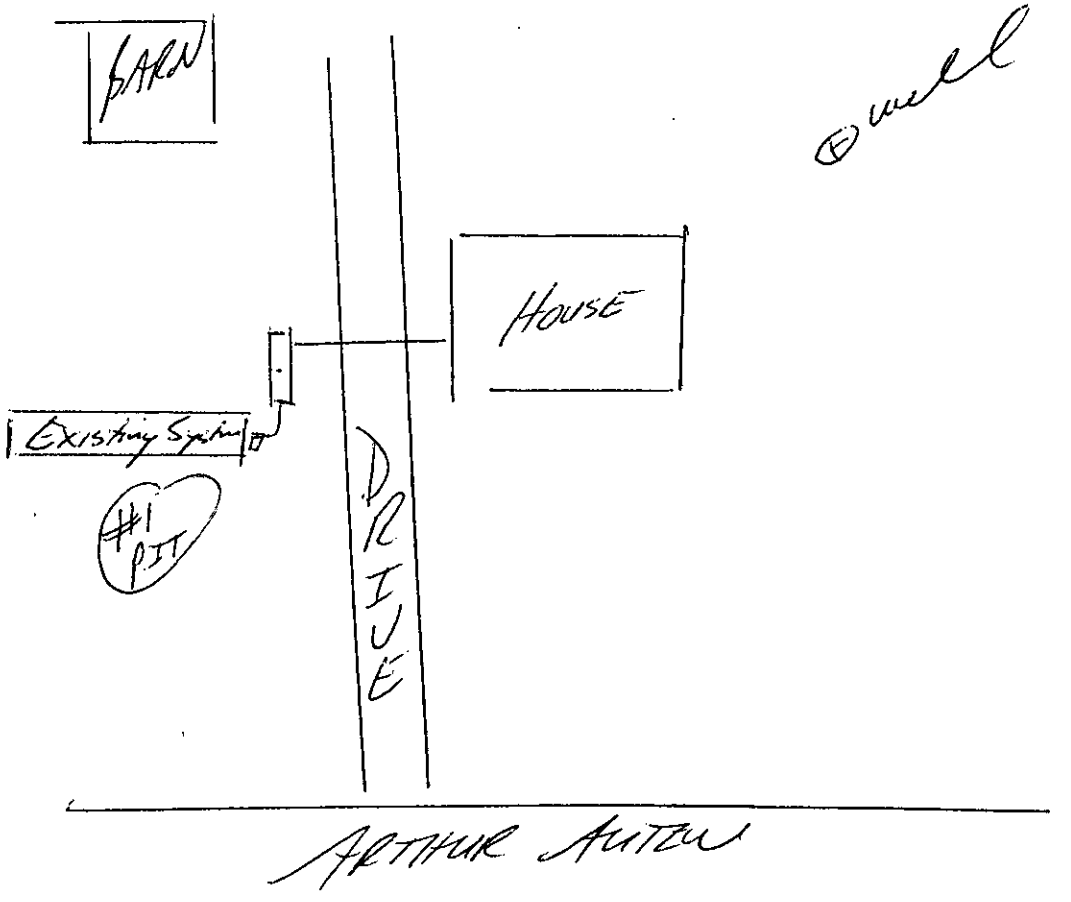

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT/CONSTRUCTION AUTHORIZATION
for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 72288 Permit #: 7879 Tax Parcel #: 023-221-05

Property Owner: YER VANG THAO

Job Location Address: 11823 ARTHUR AUTEN ROAD

City: Huntersville State: NC Zip Code: 28036

Improvement Permit Issuance Date: 11/19/15 **Construction Authorization Issuance Date** 11/19/15

Permission is hereby given to ☐ install ☐ alter ☒ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This permit is granted based upon the application information submitted to our office. This permit expires 5 years from the date it was issued. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD Site LTAR: 0.2 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: Existing gallons Liquid Capacity of Dosing Tank: N/A gallons

Drainfield Design ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 40 inches

Bed Width: 12 feet

Total line length: 200 feet

# of Lines: 4 @ 50 feet

Depth of Media: 24 inches (Type) Stone

Distribution Device: D-Box

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: >5' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >100 feet

SKETCH OF SYSTEM LAYOUT

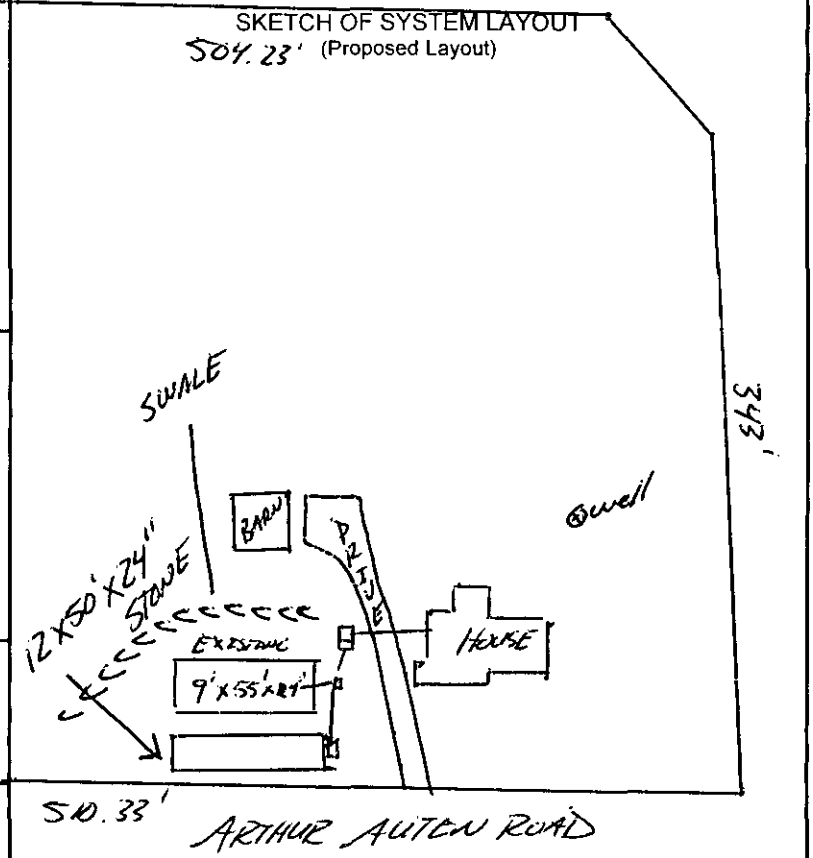


Comments: System Classification & Type: IIa Conventional System

→ Pit Risers on Tank / SWALE ABOVE DRAINFIELD

Authorized Agent: Jeremy Michelle Reiss Signature: _____

Owner Signature: Jeremy Michelle Reiss Date: 11/19/15

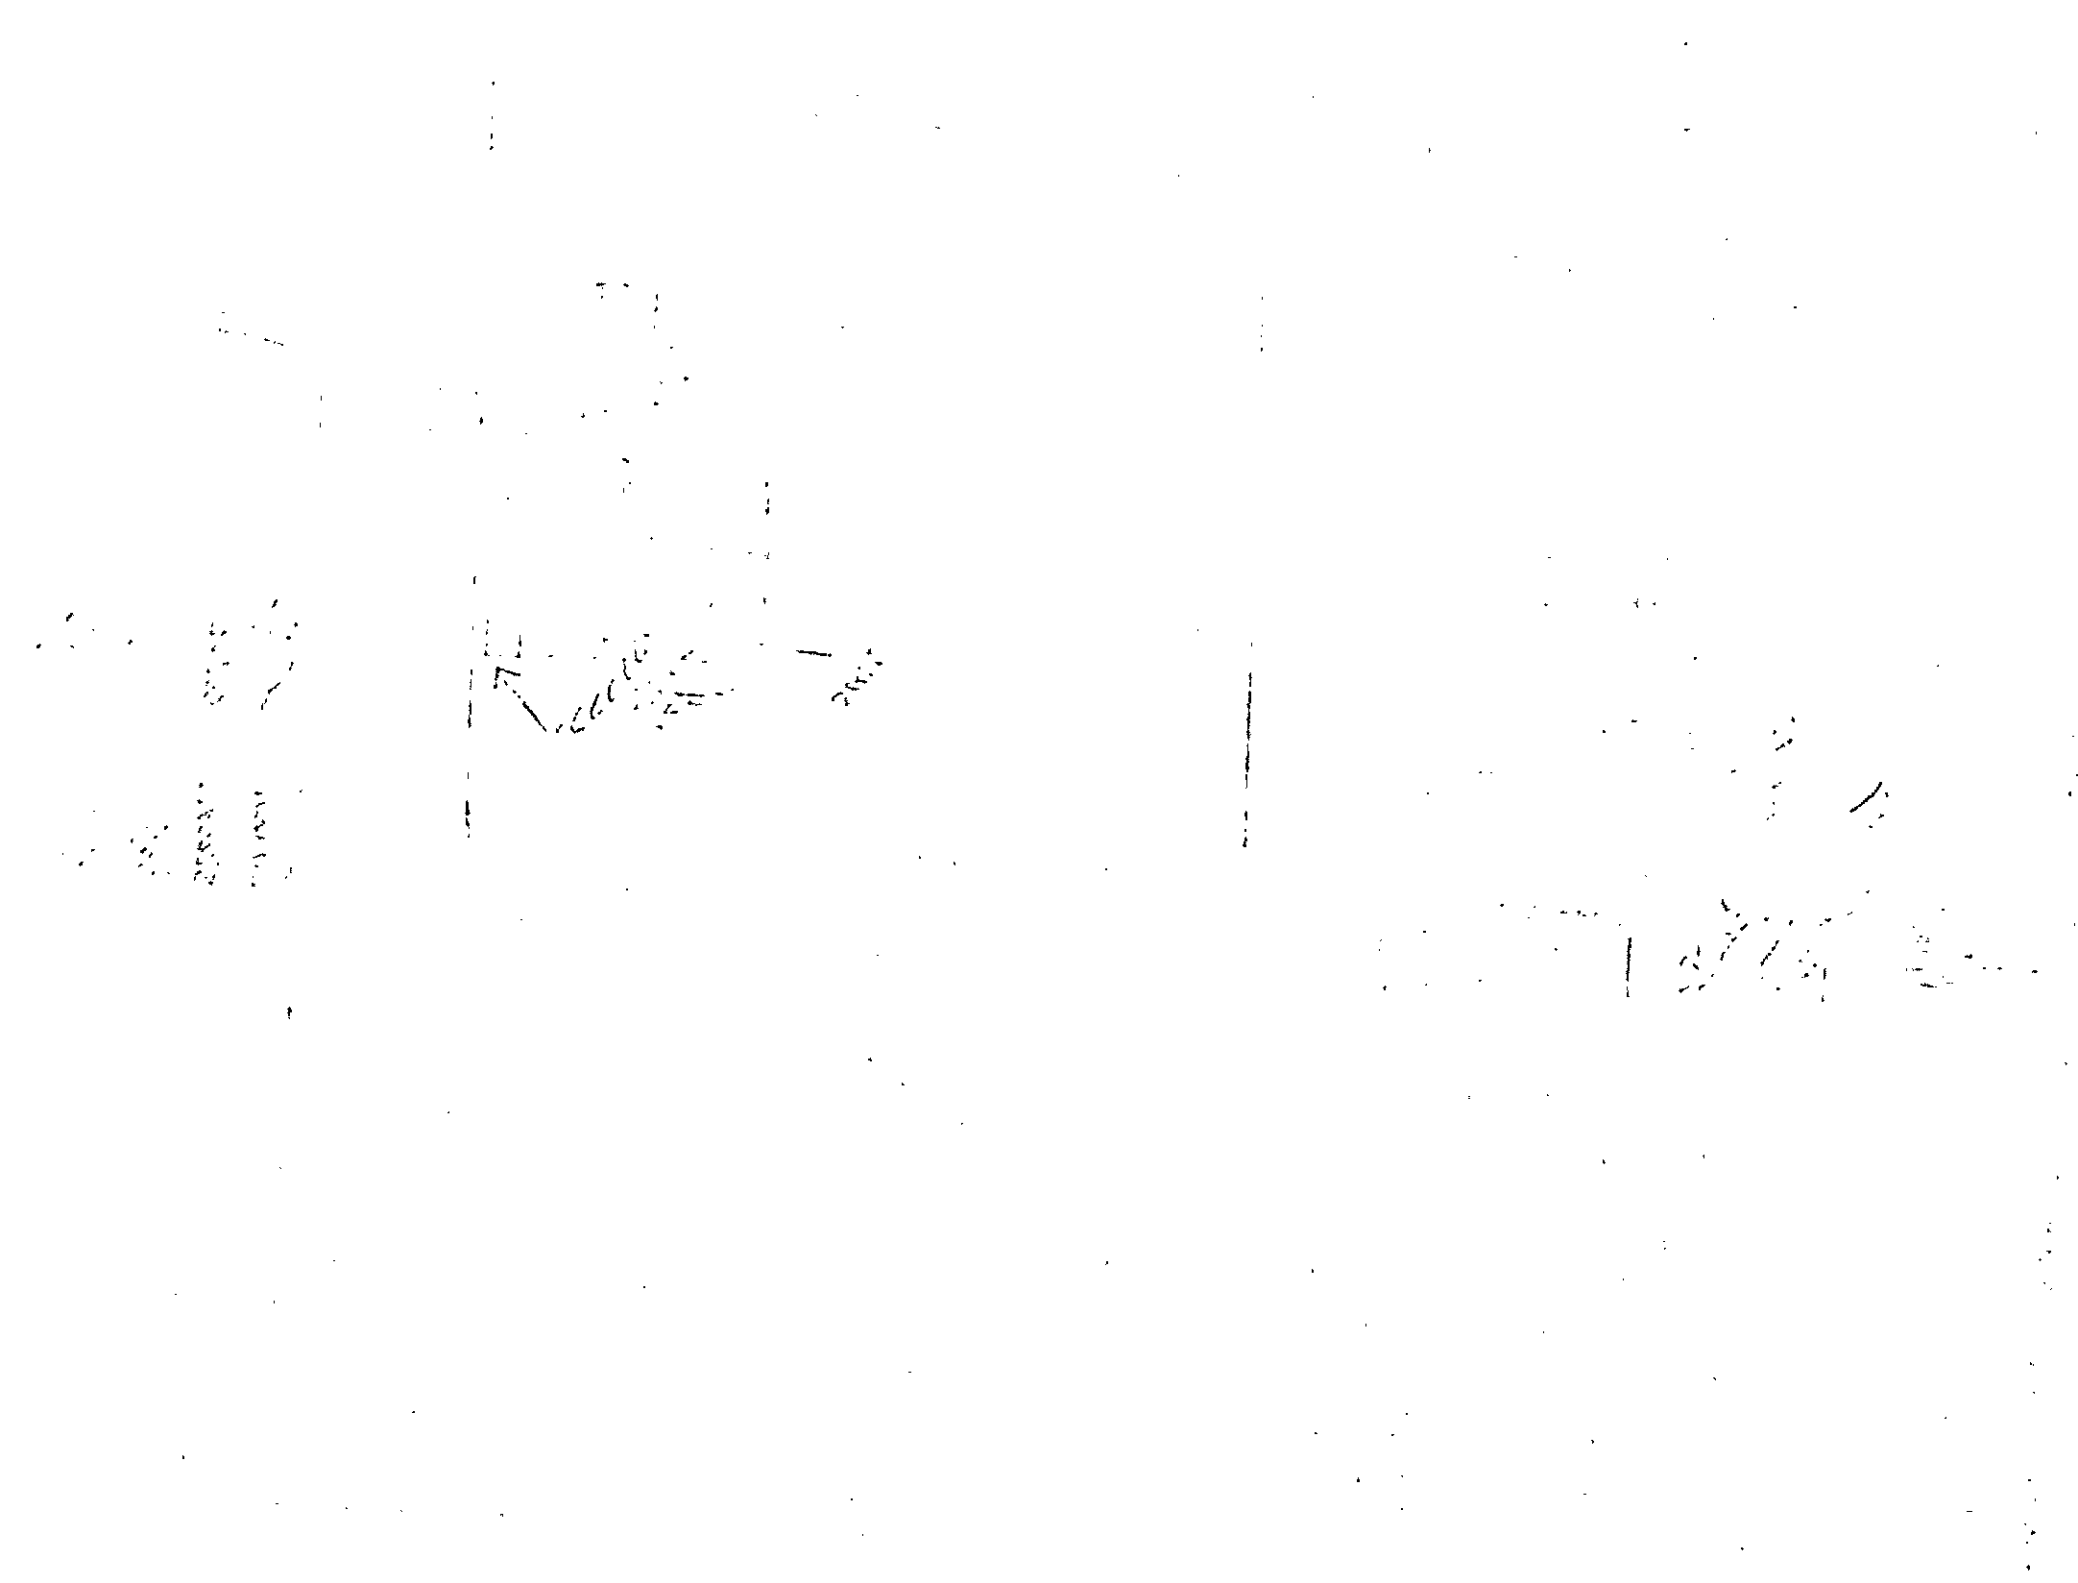

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

Septic System Pre-Construction Meeting Checklist

File # 7228B App # 7879 Tax Parcel # 023-221-05

Property Owner: YER VANG THAO

Job Location Address: 11823 ARTHUR AUTEN ROAD

City: Huntersville State: NC Zip Code: 28036

1. Does System design match facility, flow & wastewater characteristics?

   ☒ YES ☐ NO

   Comments: _____

2. Is there sufficient available space for the septic systems initial and repair areas?

   ☒ YES ☐ NO

   Comments: _____

3. Can the septic system be installed per the permit conditions and drawing on file?

   ☒ YES ☐ NO

   Comments: FIX THE LEAKING TOILET

* If "NO" is checked for any of the above the existing permit may need to be revoked.

Permission is hereby given to ☐ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. **System shall not be installed while soils are in wet condition.**

Authorized Agent — Date 1/14/16

Others Present

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 72288 Permit #: 7879 Tax Parcel #: 023-221-05

Property Owner: Yer Vang Thao

Job Location Address: 11823 Arthur Austin Road

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: 1/15/10 Contractor Name: STANLEY

Permitted Design Flow: 360 GPD Liquid Capacity of Dosing Tank: — gallons

Liquid Capacity of Septic Tank: Existing gallons Manufacture Existing Effluent Pump Model: —

Drainfield Installation ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Inspection Dates

Tank(s) Inspected: —

Excavation Inspected: _____

Pump & Controls Inspected: —

Bed Installation *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 40 inches

Bed Width: 12 feet

Total line length: 200 feet

# of Lines: 4 @ 50 feet

Depth of Media: 24 inches (Type) TCHP

Depth of Cover: 18 inches

Distribution Device: D-Box

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


System Installation Setbacks

Distance from Building Foundation: 38' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >100' feet

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

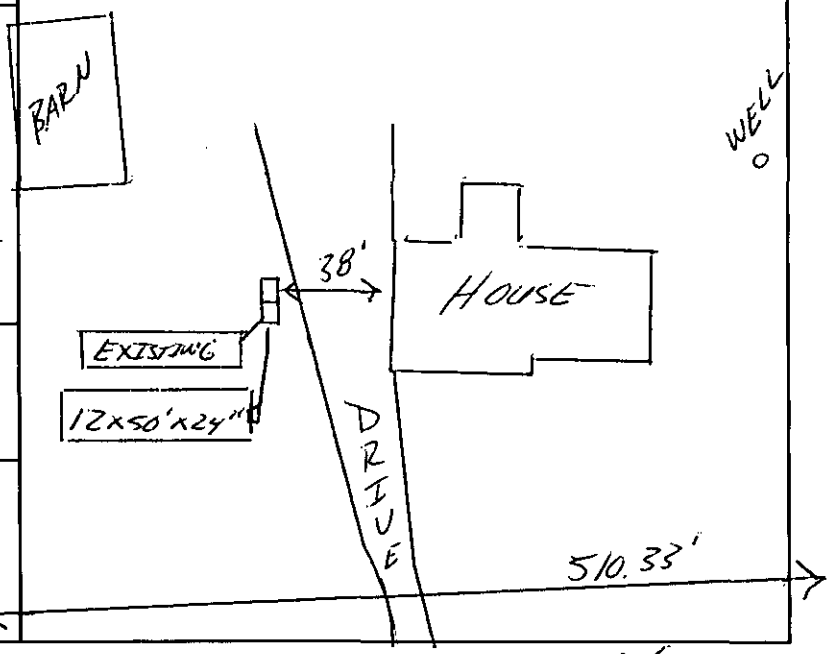

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☐ altered ☒ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIa, GRAVITY, TCHP, N/A, N/A

Repair leaking toilets to prevent failures

DENR Authorized Agent: Jeremy Mickelson, REHS Signature: Jeremy Mickelson, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 72208 Permit #: 7879 Tax Parcel #: 023-221-05

Property Owner: Ur Vang Thao

Job Location Address: 11823 Arthur Austin Road

City: Huntersville State: NC Zip Code: 28078

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIa

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

2016 Repair
→ Repair or replace the leaks in the household plumbing (toilets)

DENR Authorized Agent: Jeremy Mecklenburg REHS Date: 1/15/16

Signature: Jeremy Mecklenburg REHS

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 7228B WASPS App #: 2502

Primary ES assigned to project: Jeremy Michelone

Secondary ES assigned to project:

Project Type: New System ☐ Alteration ☐ Repair ☑ Modified Plot Plan ☐

I. File Review:

Rule or Law				
	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), 1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☑
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☑
1937(g)	System components shown – Initial	Yes ☑	No ☐	N/A ☑
1945(b)				
1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☑
1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☑
1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☑
1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☑
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☑

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☑
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☑	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☑	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☑	N/A ☐
	Operation Permit			
1937(i)	System type as described in table V(a) of rule .1961	Yes ☑	No ☐	N/A ☐
1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☑	No ☐	N/A ☐

H. WASPS Review:

Construction authorization issued	Yes ☑	No ☐	N/A ☐
Installation approval issued	Yes ☑	No ☐	N/A ☐
Operation permit issued	Yes ☑	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: 7/2/07

OP issued date: 7/11/07

Review performed by: Phil Walker Date performed: 7/19/07



FILE NUMBER: 7228B

Revised On: January 3, 2007

APPLICATION NUMBER: 2562

SEPTIC FEE: _____
DATE: _____

MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES
APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

WELL FEE: _____
DATE: _____

1. SEPTIC / TYPE APPLICATION: ☐ NONE ☐ NEW SYSTEM ☐ ALTERATION ☒ REPAIR ☐ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ☐ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 07 L 3 - 22(-05

STREET ADDRESS: 11823 ARTHUR AUTEN Rd.

CITY: HUNTERSVILLE,

STATE: NC ZIP: 28078

SUBDIVISION NAME: N/A

LOT #: LOT SIZE (acres): 5 1979

TOWNSHIP:

☐ 0-MECKLENBURG ☐ 3-CORNELIUS ☒ 6-HUNTERSVILLE
☐ 1-CHARLOTTE ☐ 4-PINEVILLE ☐ 7-MINT HILL
☐ 2-DAVIDSON ☐ 5-MATTHEWS

4. BUILDING INFORMATION:

BUILDING TYPE:

☐ SINGLE MOBILE HOME ☐ MODULAR HOME
☐ DOUBLE WIDE ☐ MULTIPLE FAMILY
☐ HOUSE ☐ OTHER _____

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS:

NUMBER OF OCCUPANTS:

FOUNDATION TYPE:

☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☐ CRAWL SPACE ☐ BASMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☒ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ☐ MUNICIPAL ☐ PUBLIC WELL ☑ PRIVATE WELL ☐ SHARED WELL ☐ SPRING

7. PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES ☑ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES ☑ NO
EXISTING WASTEWATER SYSTEMS	☑ YES ☐ NO	JURISDICTIONAL WETLANDS	☐ YES ☑ NO
WELLS, SPRINGS, OR WATER LINES	☑ YES ☐ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	☐ YES ☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☑ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	☐ YES ☑ NO

10. PROPERTY OWNER:

NAME: JOUAKAO THAO

ADDRESS: 11823 ARTHUR AUTEN Rd.

CITY: HUNTERSVILLE

STATE: NC ZIP: 28078

HOME PHONE: 704 947 9785 WORK PHONE:

MOBILE PHONE: 704 241 2220 FAX:

11. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME:

ADDRESS:

CITY:

STATE: ZIP:

HOME PHONE: WORK PHONE:

MOBILE PHONE: FAX:

12. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

13 WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____

14. SEPTIC SYSTEM PERMIT APPLICATION SIGNATURE SECTION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either 60 months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ 6/12/07

Property Owner's or Owner's Legal Representative Signature Date

15. WELL PERMIT APPLICATION SIGNATURE SECTION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of 12 months from the date of issuance.

_____

Property Owner's or Owner's Legal Representative Signature Date

☐ SURVEY PLAT TO SCALE SUBMITTED ☐ SCALED SITE PLAN SUBMITTED ☐ UN-SCALED SITE PLAN SUBMITTED

MECKLENBURG COUNTY-GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211, CHARLOTTE, NC 28202 PHONE: (704) 336-5103 FAX: (704) 336-6894

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7288 Permit #: _____ Tax Parcel #: 023-221-05

Property Owner: SOUAKAO THAO

Job Location Address: 11823 Arthur Auten Road

City: Huntersville State: NC Zip Code: 28078

Installation Approval Issuance Date: 6/12/07

Permission is hereby given to ☐ install ☐ alter ☒ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 7/2/07, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An ***Operation Permit*** *must be obtained from the* Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD

Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: Existing gallons

Liquid Capacity of Dosing Tank: ——— gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 300 feet OR 400' Conventional

# of Lines: 4 @ 75 feet

Depth of Media: 12 inches (Type) 25% Red.

Distribution Device: D-Box

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 5' feet

Distance from Property Line: 10' feet


Distance from Water Supply Source: >100' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

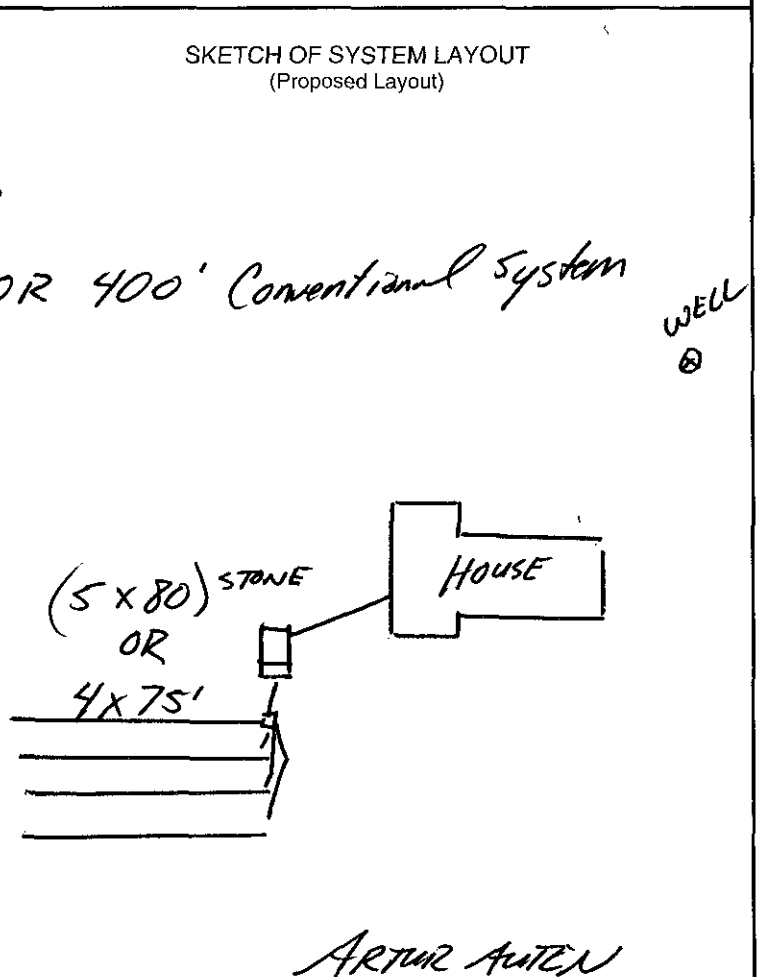

Comments: System Classification & Type: III g 25% Red. OR
TYPE II Conventional System (9 x 50 x 18")

DENR Authorized Agent: Jeremy Michalow, R.S. Signature: Jeremy Michalow, R.S.

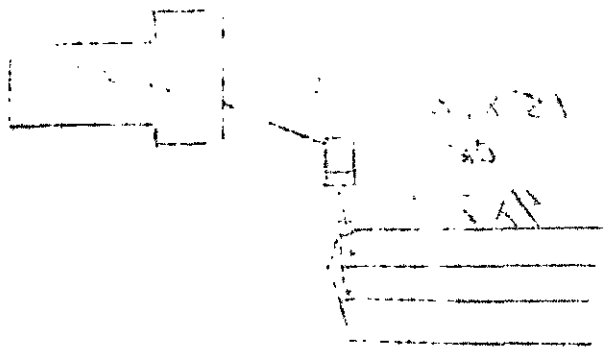

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 12288 Permit #: _____ Tax Parcel #: 023-221-05

Property Owner: SOUKAO THAO

Job Location Address: 11823 Arthur Austen Road

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: 7/11/07 Contractor Name: Dirt CHEAP Backhoe Service

Permitted Design Flow: 360 GPD

Liquid Capacity of Septic Tank: existing gallons

Liquid Capacity of Dosing Tank: — gallons

Effluent Pump Model: —

Drainfield Installation ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Inspection Dates

Tank(s) Inspected: existing

Excavation Inspected: 7/11/07

Pump & Controls Inspected: —

Bed Installation *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 36 inches

Bed Width: 9 feet

Total line length: 150 feet


# of Lines: 3 @ 55 feet

Depth of Media: 24 inches (Type) stone

Depth of Cover: 12 inches

Distribution Device: D-Box

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

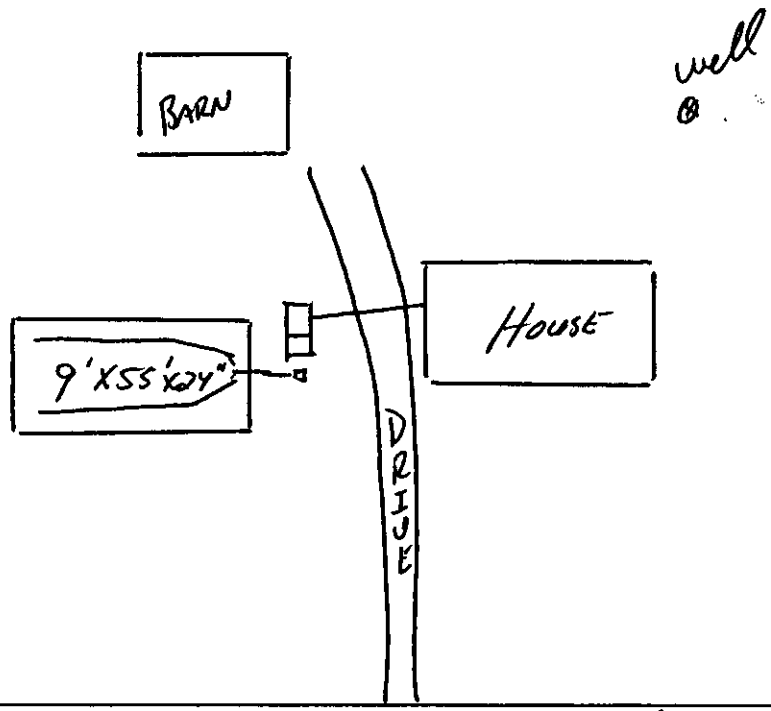

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 40 feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >100' feet


The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☐ altered ☒ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIa Conventional System

Recomend pumping tank on routine schedule

ENR Authorized Agent: Jeremy Nicholson, R.S. Signature: Jeremy Nicholson, R.S.

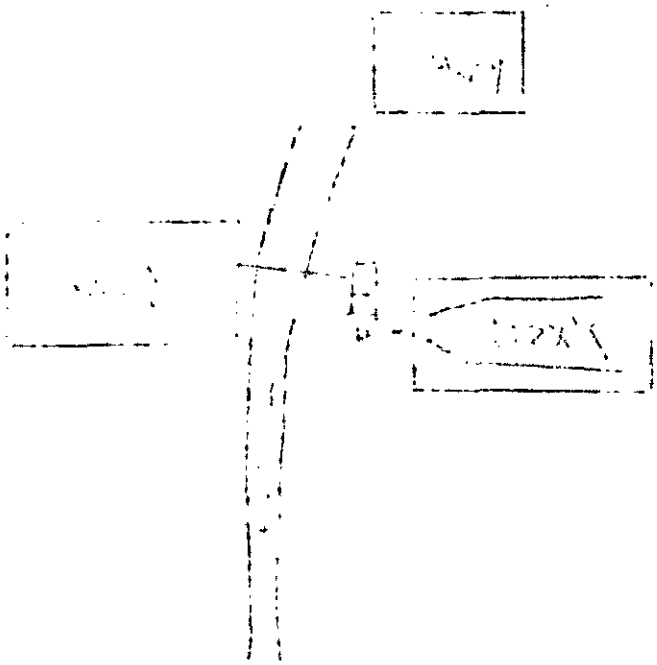

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 72286 Permit #: _____ Tax Parcel #: 023-221-05

Property Owner: JOUAKAO THAO

Job Location Address: 11823 ARTHUR ARTEN ROAD

City: Huntersville State: NC Zip Code: 28078

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIa

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Recommend pumping tank on routine schedule

DENR Authorized Agent: Jeremy Mecklem, R.S. Date: 7/11/07

Signature: Jeremy Mecklem R.S.

N.C. Department of Environment & Natural Resources / Division of Environmental Health

NOTICE OF VIOLATION
ON-SITE WASTEWATER SYSTEM

☐ Certified Mail (Return Receipt) ☒ First Class Mail ☐ Hand Deliver

Owner: Jouakao Thao

Mailing Address: 11823 Arthur Auten Road
Huntersville, NC 28078

Occupant: Same

Location: 11823 Arthur Auten Road
Huntersville, NC 28078

☒ Residence ☐ Business ☐ Other

You are hereby notified that you are violating the Rules adopted by the North Carolina Commission for Health Services or Article 11 of Chapter 130A of the General Statutes of North Carolina by owning or controlling a residence, place of business, or place of public assembly which is not provided with an approved wastewater system. Your wastewater system is not in compliance.

On May 31, 2007 an inspection of the wastewater system by the Mecklenburg County Health Department indicated the following violations:

Violation/s

Observed a discharge of sewage to the surface of the ground or surface water.
[G.S. 130A-335(a) 15A NCAC 18A. 1961(a)(1)(A)]

You are hereby ordered to bring your wastewater system into compliance by completing the following:

☒ Install / Repair wastewater system. You must obtain a repair permit from the local health department prior to the repair of your system.

☐ Other Repairs *(Specify):*

☐ Eliminate wastewater discharge and connect to an approved wastewater system.

☐ Perform Maintenance *(Specify):*

If the wastewater violation is not brought into compliance by **July 2, 2007** appropriate legal action will be taken.

Failure to comply with laws, rules, and this notice will subject you to the following legal remedies; Injunction Relief [G.S. 130A-18], Administrative Penalties [G.S. 130-22 (c)], Suspension or Revocation of Permits [G.S. 130-23], and Criminal Penalties [G.S. 140-25].

For questions regarding this notice you should contact Jeremy Michelone at (704)336-5572.

Notice Issued: 6/4/07 (Date) — DENR/DEH Authorized Agent

Compliance: 7/16/07 (Date) — DENR/DEH Authorized Agent

Mecklenburg County – Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

W.O.# 73317

SERVICE REQUEST

Request Number: 10125 Section: GWS Associated WO Number:
Nature of Request: Sewage Complaint Description: Sewage Complaint

REQUESTING PARTY INFORMATION

Call	Name	Home Address	Home Phone	Work Phone	Other Phone
10130	ANONYMOUS UNKNOWN				

Call	Questions	Answers
10130	Describe the problem.	sewage on surface of ground, yellow tape around problem by mail box 10 feet directly behind
10130	Is the problem on your property?	NO
10130	Where is the problem located in reference to your property?	property on same road as residence
10130	Is sewage visible on the surface of the ground?	YES
10130	Is sewage backing up into the structure?	UNKNOWN
10130	Is there an odor?	UNKNOWN
10130	What type of wastewater system serves the property?	Septic System

FACILITY INFORMATION

Problem Address: 11823 ARTHUR AUTEN RD, HUNTERSVILLE 28078
Town:

Initiated Date: 5/30/07 2:12:18 PM Priority:3 Submitted To: MICHELONE, JEREMY
Intitiated By: CRAIG, GWENDOLYN Project: Status: IP

ACTIVITIES

Details:	Come out Neck Road & turn left on to Arthur Auten, first house on the right, brick house.

Comments: