0746A
#1000

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ○ N/A ○ NEW SYSTEM ○ ALTERATION ● REPAIR ○ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ● N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. **JOB LOCATION INFORMATION:**
TAX PARCEL NUMBER: 139-152-40
STREET ADDRESS: 15322 MILLVIEW TRACE LN.
CITY: MINT HILL
STATE: NC ZIP: 28227
SUBDIVISION NAME: CONNELL MILLS
LOT #: _____ LOT SIZE (acres): 1.03
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. **BUILDING INFORMATION:**
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
● HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: _____
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
● CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. **WATER SUPPLY:** ○ MUNICIPAL ● PRIVATE WELL ● PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. **PROPOSED USE OF WELL:** ○ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED)*:
☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** ____ ____ ____ ____ ____

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ● NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ● NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	● YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ● NO
WELLS, SPRINGS, OR WATER LINES	● YES ○ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ● NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ● NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ● NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ● NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ● NO
WASTE STORAGE	○ YES ● NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ● NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☑ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☑ N/A

12. **PROPERTY OWNER:**
NAME: BEN TYSON
ADDRESS: 15322 MILLVIEW TRACE LN
CITY: MINT HILL
STATE: NC ZIP: 28227
WORK PHONE: _____
MOBILE PHONE: 704-975-8181
FAX: _____
E-MAIL: tysontrk@gmail.com

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**
NAME: _____
ADDRESS: _____
CITY: _____
STATE: _____ ZIP: _____
WORK PHONE: _____
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

BT (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

Ben Tyson
Property Owner's or Owner's Legal Representative Signature

12/13/18
Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

Subdivision Name: _____ Lot #: _____

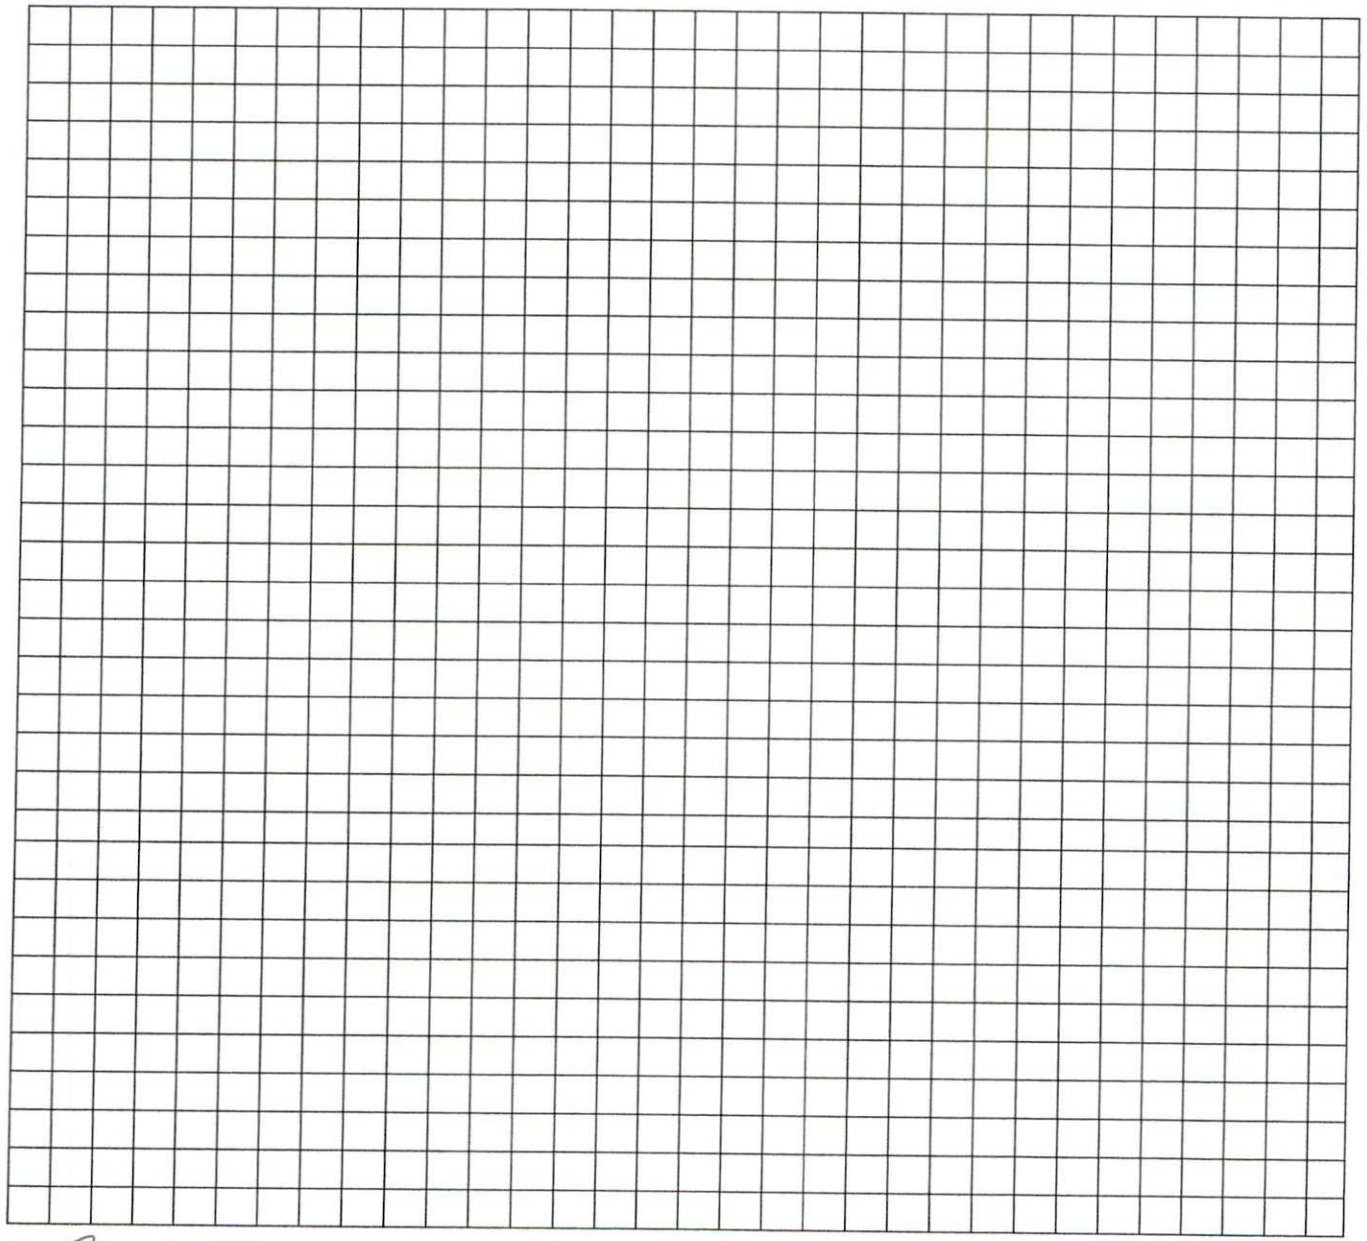

Ben Tyson
Property Owner's or Owner's Legal Representative Signature

12/13/18
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 139-152-40
Lot #: NA
File #: 6746A
AppID:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Property Owner: Ben Tyson
Address: 15322 Millview Trace Ln
Proposed Facility: 3 Bedroom House
Design Flow (.1949): 360 GPD
Location: 15322 Millview Trace
Water Supply: [ ] Public [] Individual [X] Well
Evaluation Method: [X] Auger Boring [ ] Pit
Type of Wastewater: [X] Sewage [ ] Industrial Process

Applicant: Rich Carr A royal Touch
Date Evaluated: 12/13/18
Property Size: .772ac
Property Recorded: Unknown
[ ] Spring [ ] Municipal
[ ] Cut
[ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
Boring #1	3% CC	0-3	Cl, Gr	VFR, SS,SP,SEXP		NA	NA	NA		ps	
		3-48	C, ABK	FR,S,P,SEXP		NA 48	NA	NA	24" ROCK INCLUSIONS	.3	36
Boring #2	2% LS	0-18	c,sbk	FR,S,P,SEXP		NA	NA		40" lateral water movement		
		18-40	SC,SBK	FR,S,P,SEXP	30" 10YR4/2	NA 48	NA	NA		.25	36
Boring #3	2% LS	0-20	cl, gr	FR,SS,SP,SEXP		NA	NA	NA		ps	
		20	ROCK/ROOT			48				u	36
Boring #4	2% LS								46"	ps	36
		0-4	CL,GR	VRF,SS,SP,SEXP		NA	NA	NA	lateral water movemnet	.25	
		4-48	C,SBK	F,S,P,SEXP		48					
Boring #5	CC 2% NS	0-3	cl, gr	VRF,SS,SP,SEXP		na	na	na			
		3-48	c,sbk	fr,ss,sp,sexp		48			lateral water movement 48"	.25	36
Boring 6											

Description	Initial System	Repair System
Available Space (.1945)	na	ps
System Type(s)	na	IIIb
Site LTAR (gpd/sq ft)	**na**	**.25**

Other Factors (.1946): NA
Soil Evaluation By: Heather Ray, REHS
Others Present:
Site Classification (.1948): PS
Site Evaluation By: Eli Freese, REHS
Others Present:
used best professional judgement for soil depth

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	sg-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		mass-Massive
LS-Linear Slope				cr-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	gr-Granular
NS-Nose Slope		L-Loam		sbk-Subangular Blocky
HS-Head Slope				abk-Angular Blocky
CC-Concave Slope	III	Si-Silt	0.6 - 0.3	pl-Platy
		SiCL-Silty Clay Loam		
CV-Convex Slope				pr-Prismatic
T-Terrace				Sap-Saprolite
FP-Flood Plain		CL-Clay Loam		**Structure Prefixes**
D-Drainage Way		SCL-Sandy Clay Loam		w-weak m-moderate s-strong f-fine m-medium c-coarse
		Silt		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SiC-Silty Clay		
		C-Clay		

Consistence	Consistence	Mineralogy
Moist	**Wet**	SEXP-Slightly Expansive
VFR-Very Friable	SS-Slightly Sticky	EXP-Expansive
FR-Friable	S-Sticky	
FI-Firm	VS-Very Sticky	**Classification**
VFI-Very Firm	NP-Non-Plastic	US-Unsuitable
EFI-Extremely Firm	SP-Slightly Plastic	PS-Provisionally Suitable
	P-Plastic	S-Suitable
	VP-Very Plastic	NA-Not Applicable

Soil Boring Location Sketch



Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT/CONSTRUCTION AUTHORIZATION for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 6746A Permit #: 10061 Tax Parcel #: 139-152-40

Property Owner: Ben Tyson

Job Location Address: 15322 Millview Trace Ln

City: Charlotte State: NC Zip Code: _____

Improvement Permit Issuance Date: 12-13-18 **Construction Authorization Issuance Date** _____

Permission is hereby given to ☐ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This permit is granted based upon the application information submitted to our office. This permit expires 5 years from the date it was issued. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD

Site LTAR: .25 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: ~~1500~~ 1000 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 36 inches

Bed Width: 9 feet

Total line length: 100 feet

# of Lines: _____ @ _____ feet

Depth of Media: 24 inches (Type) Stone 3 Chip??

Distribution Device: Dbox

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____

Minimum System Setbacks

Distance from Building Foundation: 10 feet


Distance from Property Line: 10 feet

Distance from Water Supply Source: 50 feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

Option 1: Install interrupter drain

Option 2: Install interrupter drainfield

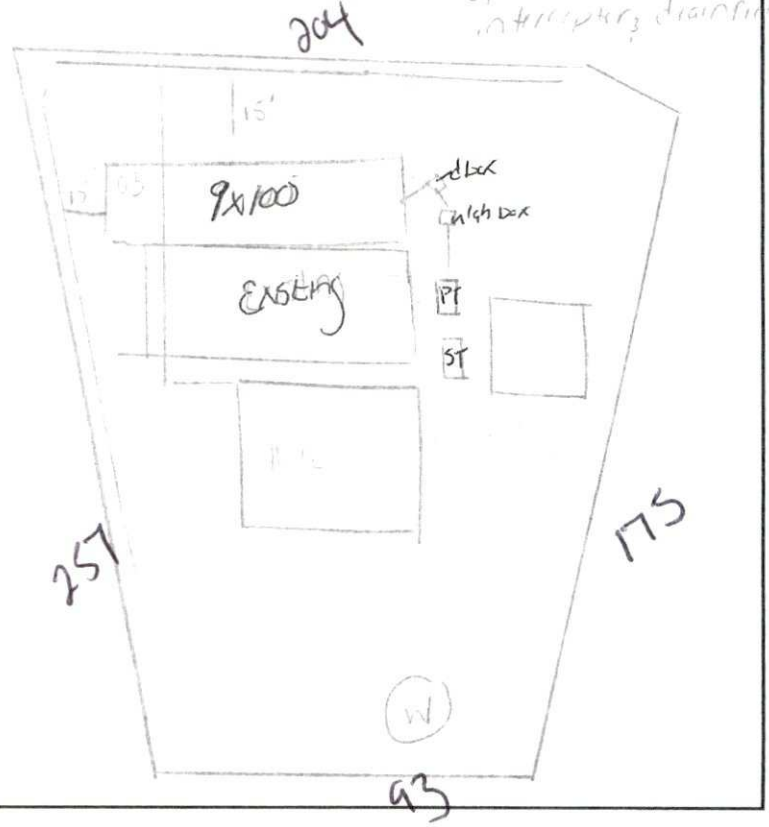

Comments: System Classification & Type: _____

Call before installing repair for Preconstruction

Authorized Agent: Heather Ray Signature: _____

Owner Signature: _____ Date: 12/13/18