SEE INSTRUCTIONS ON BACK

Date Received 5/4/78

ICAR(S) Application No. 14675

T C No. 137-109-11

Map Date


MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1) Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption effluent discharge

N.

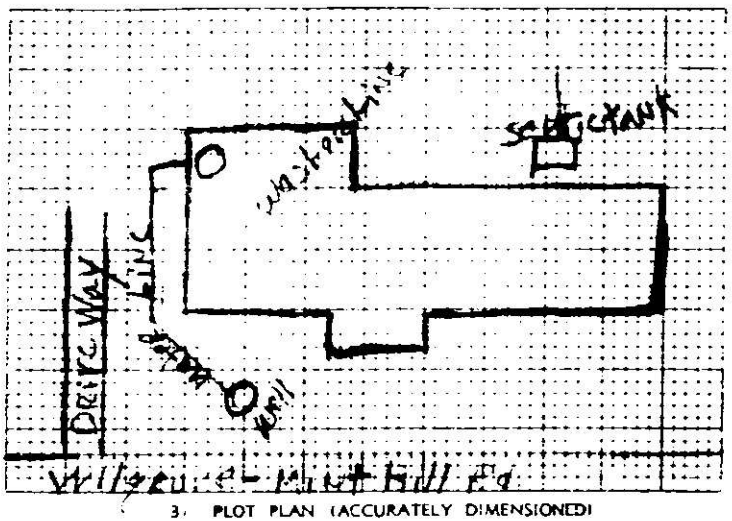

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___Yes ___No
Residence ✓Yes ___No
4 No of Bedrooms 4
5 Business Use - Max No Employees ___
6 Washing Machine ✓Yes ___No
7 Garbage Disposal ___Yes ___No
8 Dishwasher ✓Yes ___No
9 Water Supply
A Individual Well ✓
B Governmental System ___
C Community System
1 Well source ___
2 Governmental source ___
10 Sewage System
House located within 200 feet of public sewer ___Yes ✓No
House located within 200 feet of community sewer ___Yes ✓No
11 FHA Case No ___
12 VA Case No ___

13) NAME OF OWNER [illegible] (LAST) [illegible] (FIRST) [illegible] (MIDDLE)

14) ADDRESS OF OWNER [illegible] Mint Hill - Charlotte, N.C.

15) PHONE NO Home 545-[illegible] Office 399-5661

16) LOCATION OF SYSTEM [illegible] Mint Hill Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. ___ Block No. ___

Map Book No ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

5-8-78
DATE OF APPLICATION

[signature]
OWNER

EHD-5-76

Environmental Health Department's Copy

Date Issued May 17, 1978 Serial No. 1620


ICAR(S) Permit No. 19075

T. C. No. 137-109-11

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 19075, dated and this permit shall be void and of no effect if the information provided in the application is not true and accurate. All work shall be completed on or before , after which date this permit shall be null and void.

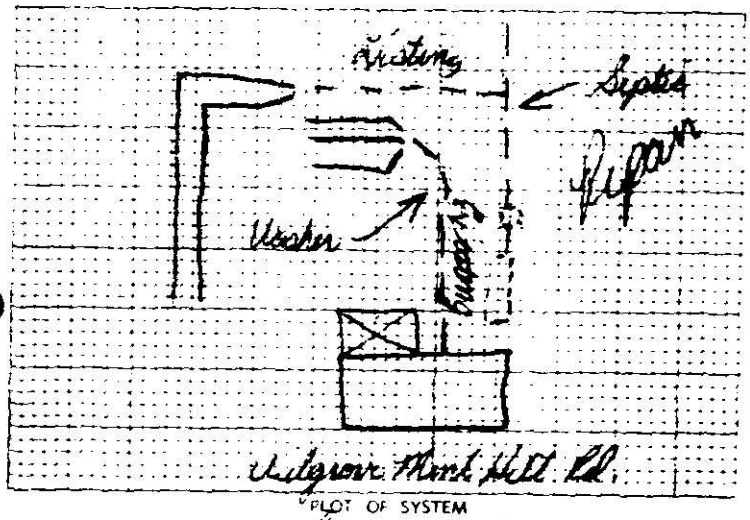

PLOT OF SYSTEM

Permeability Rate

Liquid Capacity of Tank

Tank Construction

Absorption and or Nitrification Lines

Total Line Length 100'/Ft. & 200'/Ft.

Number of Lines 3 & 2

Distance from House 50'

Distance from Property Line 10'

Distance from Well 50'

NAME OF OWNER Lewis A. Welch

LOCATION OF PROPERTY Wilgrove Mint Hill Rd.

The system shall meet all pertinent construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or put in use. **The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Comments

(9'x33') washer

(6'x100') septic

Repair

Division or Section Head

Eddie Reynolds
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Date Issued June 15, 1978 Serial No. 1631

C of A (s) No. [illegible]

T C No. 137-104

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Welch Lewis 11
LAST FIRST MIDDLE

Location of Property 5232 Wilgrace Mint Hill Rd.

Application Number 14075 Permit Number 14075

Repair
Inspection Data:

Liquid Capacity of Tank —
Tank Material —

Total Length of Drain Tile 200' & 100'
Number of Lines 4 & 3

Depth of Filter Material 34" & 17"
Cover Depth 18"

Water Supply Source Well
Distance from Water Source 75'

Excavation Inspected — DATE
Tank Inspected — DATE

Nitrification Field Inspected 6-15-78 DATE
Washing Machine Line Inspected, If Applicable 6-15-78 DATE

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments Repair - Lines from existing washer tied together and run into new bed. — Lines taken from existing septic line and run into new bed crossing old lines. Stone on septic bed double depthed.

Eddie Reynolds
Environmentalist

Environmental Health Department's Copy

BHD-S-76