THOMPSON ENVIRONMENTAL CONSULTING, INC.
WATER ♦ WASTEWATER ♦ WETLANDS

October 22, 2012

Mr. Philo Walker, RS
Mecklenburg County Groundwater and Wastewater Services
700 N. Tryon Street, Suite 211
Charlotte, NC 28202

Dear Ms. Dunphy,

The purpose of this letter is to inform you that I have performed an inspection of the wastewater treatment and disposal system installed for Lot 118 in the Fairington Oaks subdivision. I am satisfied that the installation meets the intent of the original proposal submitted to your office.

Please feel free to call on me if you have any further questions or concerns regarding this project.

Sincerely,

Larry B. Thompson, Jr.

114 ORCHARD RIDGE ROAD• LOCUST, NC • 28097-8748
PHONE: 704-301-4881 • FAX: 704-888-1496
E-MAIL: LARRY@THOMPSONENV.COM
WEB: WWW.THOMPSONENV.COM

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 8522B Permit #: 5699 Tax Parcel #: 195 213 49

Property Owner: True Homes

Job Location Address: 6505 Northern Red Oak Dr Lot 118

City: Mint Hill State: NC Zip Code: 28227

Operation Permit Issuance Date: 10/22/12 Contractor Name: Chris Stevens

Permitted Design Flow: 480 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1500 gallons

Effluent Pump Model: Gould WE 0311

Drainfield Installation ☐ N/A

Trench Depth: 36 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 268 feet

# of Lines: 4 @ 67' feet

Depth of Media: NA inches (Type) PPBPS

Depth of Cover: 8 inches

Distribution Device: Manifold

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 10 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10 feet


Inspection Dates

Tank(s) Inspected: 10/11/12

Excavation Inspected: 10/11/12

Pump & Controls Inspected: 10/22/12

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

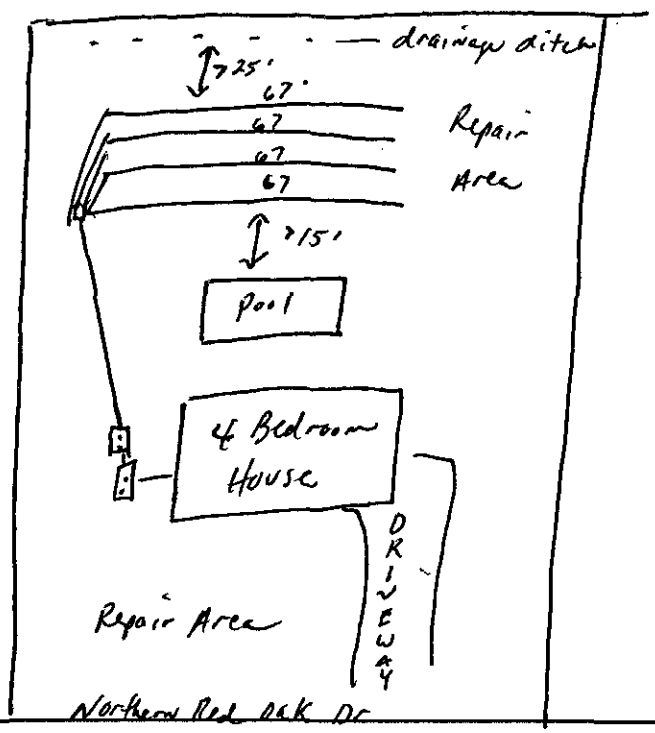

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☐ altered ☐ repaired ☐ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: Type IVa, Pump to PPBPS PPBPS / P / NA / NA

DENR Authorized Agent: Philo Walker Signature: Philo Walker REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 8572B Permit #: 5699 Tax Parcel #: 195 213 49

Property Owner: Trve Homes

Job Location Address: 6505 Northern Red Oak Dr Lot 118

City: Mint Hill State: NC Zip Code: 29227

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IVa

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☒ No ☐

☒ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☒ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other: Pump to PPBPS

DENR Authorized Agent: Philo Walker Date: _____

Signature: Philo Walker REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 8522B Permit #: 5699 Tax Parcel #: 195 213 49

Property Owner: True Homes

Job Location Address: 6505 Northern Red Oak Dr Lot 118

City: Mint Hill State: NC Zip Code: 28227

Installation Approval Issuance Date: 8/22/12

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 9/22/12, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD

Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design ☐ N/A

Trench Depth: 36 inches max

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 267 feet

# of Lines: 4 @ 67 feet

Depth of Media: NA inches (Type) PPBPS

Distribution Device: manifold

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

Minimum System Setbacks

Distance from Building Foundation: 10 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 10' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

Install in accordance w/ consultants approved plan.

Comments: System Classification & Type: Type IVa

Install in accordance with consultants plan.

DENR Authorized Agent: Philo Walker Signature: Philo Walker REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St. Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-5894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30005699 GWS File #: 8522B Tax Parcel #: 195-213-49

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 8/1/2017

Type of Installation: Residential - Modified Plot Plan Lot Number: 118

Structure Type: SINGLE MOBILE HOME Size (ft^2): 4008 # Bedrooms: 4 # Occupants: 6

Building Foundation: Concrete Slab Water Supply: Community

II. Initial System Type: PPBPS (pressurized) **System Classification:** IVa

Initial System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1500
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	801	Total Trench Length (ft):	267
Maximum Trench Depth (in):	36	Depth of Media (in):	N/A	Distribution Device:	Manifold (LPP Distr		

III. Repair System Type: PPBPS (pressurized) **System Classification:** IVa

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1500
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	800	Total Trench Length (ft):	267
Maximum Trench Depth (in):	36	Depth of Media (in):	N/A	Distribution Device:	Manifold (LPP Distr		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Philo Walker Owner/Legal Agent: Michelle Sturdivant
(Print Name)

Signature: Philo Walker REHS Signature: Michelle Sturdivant

Date Issued: 8/1/2012

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30005699 GWS File #: 8522B

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 3 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- This type of septic system requires a Certified Operator to maintain the system. A system maintenance contract with a Certified Operator must be on file prior to issuance of an Operation Permit.
- The septic system shall be installed in accordance with the plans submitted by the wastewater system design consultant.
- All waterlines must be located a minimum of 10 ft. from any part of the septic system.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- The septic system shall be located at least 10 feet from any foundation drain.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Phillo Walker
Signature: Phillo Walker REHS
Date Issued: 8/1/2012

Owner/Legal Agent: Michelle Sturdivant
Print Name
Signature: Michelle A

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 19521349
Lot #: 118
File #: 8522B
AppID: 5658

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: True Homes
Applicant: True Homes
Address: 2649 Breckonridge Centre Monroe, NC 28110
Date Evaluated: 6/21/2012
Proposed Facility: Residence Design Flow (.1949) 480GPD
Property Size: 30006 Sq. Ft
Location of Site: 6505 Northern Red Oak Drive Charlotte, NC 28227
Property Recorded:
Water Supply: [X] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 1941 Structure/ Texture	1941 Consistence Mineralogy	b PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	LS	0-2	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	5%	2-18	w f sbk SCL	ss sp fr sexp					0.3
		18-48	m m sbk C	ss sp fi sexp					
2	LS	0-2	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	4 %	2-29	m m sbk C	ss sp fr sexp					0.3
		29-48	w f sbk CL	ss sp fr sexp					
3	LS	0-2	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	6%	2-14	w f sbk SCL	ss sp fr sexp					0.3
		14-48	m f sbk C	ss sp fi sexp					
4	LS	0-4	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	6%	4-34	m f sbk C	ss sp fi sexp					0.3
		34-48	w f sbk CL	ss sp fr sexp					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IVa	IIa
Site LTAR	0.3	0.3


Other Factors (.1946):
Soil Evaluation By: Eric Bailey LSS Eric Bailey
Others Present:
Site Classification (.1948): PS
Site Evaluation By: Jeremy Michael REHS.
Others Present: modified plan site evaluation 8/1/12 Philo Walker REHS

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	Si-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SiCL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
D-Drainage Way		SiL- (Silt Loam)		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SiC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	NEXP-(Non-expansive)
FR-Friable	SS-Slightly Sticky	SEXP-Slightly Expansive
FI-Firm	S-Sticky	EXP-Expansive
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

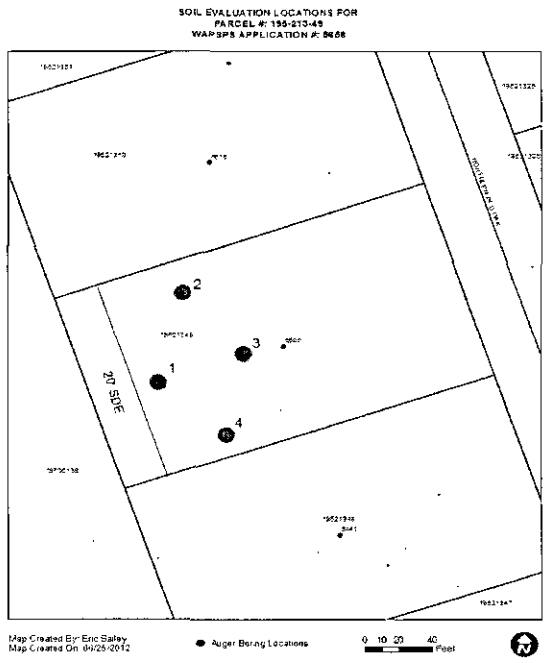


COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	Si-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SiCL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
D-Drainage Way		SiL- (Silt Loam)		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SiC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	NEXP-(Non-expansive)
FR-Friable	SS-Slightly Sticky	SEXP-Slightly Expansive
FI-Firm	S-Sticky	EXP-Expansive
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

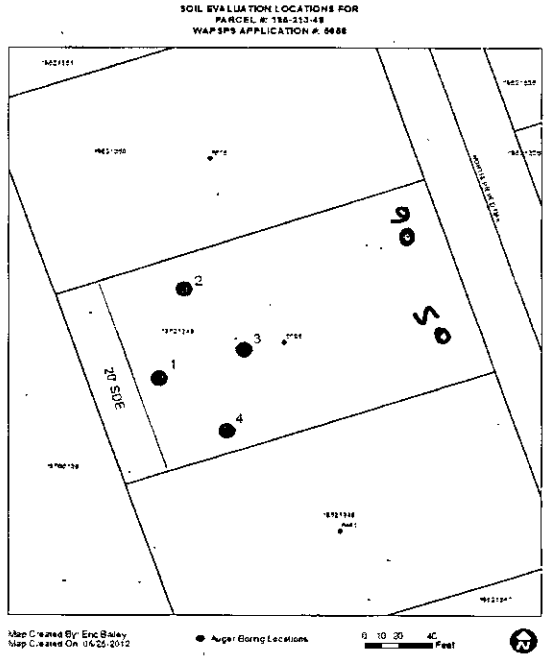

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 3
File #: 8522B

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM
CONTINUED

re-visit site for consultant design

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 Structure/ Texture	SOIL MORPHOLOGY 1941 Consistence Mineralogy	OTHER PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
5	LS	0-1	wfg SL	ss sp fr sexp	>48	48	NA	PS	PS IV
	4%	1-26	mmsbk C	ss sp fi sexp					0.3
		26-48	wfsbk CL	ss sp fr sexp					
6	LS	0-32	mmsbk C	ss sp fi sexp	>48	48	NA	PS	PS IV
	4%	32-48	wfsbk CL	ss sp fr sexp					0.3

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 3
Property ID: 19521349
Lot #: 118
File #: 8522B
AppID: 5658

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: True Homes
Applicant: True Homes
Address: 2649 Breckonridge Centre Monroe, NC 28110
Date Evaluated: 6/21/2012
Proposed Facility: Residence Design Flow (.1949) 480GPD
Property Size: 30006 Sq. Ft
Location of Site: 6505 Northern Red Oak Drive Charlotte, NC 28227
Property Recorded:
Water Supply: [X] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 1941 Structure/ Texture	1941 Consistence Mineralogy	b PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	LS	0-2	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	5%	2-18	w f sbk SCL	ss sp fr sexp					0.3
		18-48	m m sbk C	ss sp fi sexp					
2	LS	0-2	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	4 %	2-29	m m sbk C	ss sp fr sexp					0.3
		29-48	w f sbk CL	ss sp fr sexp					
3	LS	0-2	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	6%	2-14	w f sbk SCL	ss sp fr sexp					0.3
		14-48	m f sbk C	ss sp fi sexp					
4	LS	0-4	w f g SL	ns np fr nexp	>48	48	NA	PS	PS IV
	6%	4-34	m f sbk C	ss sp fi sexp					0.3
		34-48	w f sbk CL	ss sp fr sexp					

Description	Initial System	Repair System
Available Space (.1945)	IVa PS	IVa PS
System Type(s)	IVa	IVa
Site LTAR	0.3	0.3

Other Factors (.1946):
Soil Evaluation By: Eric Bailey LSS
Others Present: PS
Site Classification (.1948): Phil Walker REAS
Site Evaluation By: 8/8/12
Others Present:

8522B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

App # 5699

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION
FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ⊗ NEW SYSTEM ○ ALTERATION ○ REPAIR ● MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ○ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 195-213-49
STREET ADDRESS: 6505 Northern Red Oak Dr.
CITY: Mint Hill
STATE: NC ZIP: 28227
SUBDIVISION NAME: Farrington Oaks
LOT #: 118 LOT SIZE (acres): _____
TOWNSHIP:
● MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:
BUILDING TYPE:
⊗ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
○ HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 4006
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 6
FOUNDATION TYPE:
⊗ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
○ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☒ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ○ MUNICIPAL ○ PRIVATE WELL ⊗ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ○ N/A ⊗ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☐ ANY TYPE ☑ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ⊗ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ⊗ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ⊗ NO	JURISDICTIONAL WETLANDS	○ YES ⊗ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ⊗ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ⊗ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ⊗ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ⊗ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ⊗ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ⊗ NO
WASTE STORAGE	○ YES ⊗ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ⊗ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☒ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☐ N/A

12. PROPERTY OWNER:
NAME: True Homes
ADDRESS: 2649 Brehonridge Centre Dr.
CITY: Monroe
STATE: NC ZIP: 28110
WORK PHONE: 704-238-1229
MOBILE PHONE: _____
FAX: 910-401-1349
E-MAIL: msturdivant@truehomesusa.com

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: _____
ADDRESS: _____
CITY: _____
STATE: _____ ZIP: _____
WORK PHONE: _____
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with *applicable laws and rules*. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring. MS (initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the *application carefully and sign in the space provided below.* A PROPOSED PLOT PLAN is required to be submitted with each application.

Michelle Sturdivant
Property Owner's or Owner's Legal Representative Signature

7-19-12
Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ 180.00 DATE FEE RECEIVED: 7/23/12

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: lws

GWS FILE NUMBER ASSIGNED: 85223

APPLICATION ID NUMBER ASSIGNED: 5699

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 6505 Northern Red Oak Dr. Tax Parcel #: _____

Subdivision Name: Farrington Oaks Lot #: 118

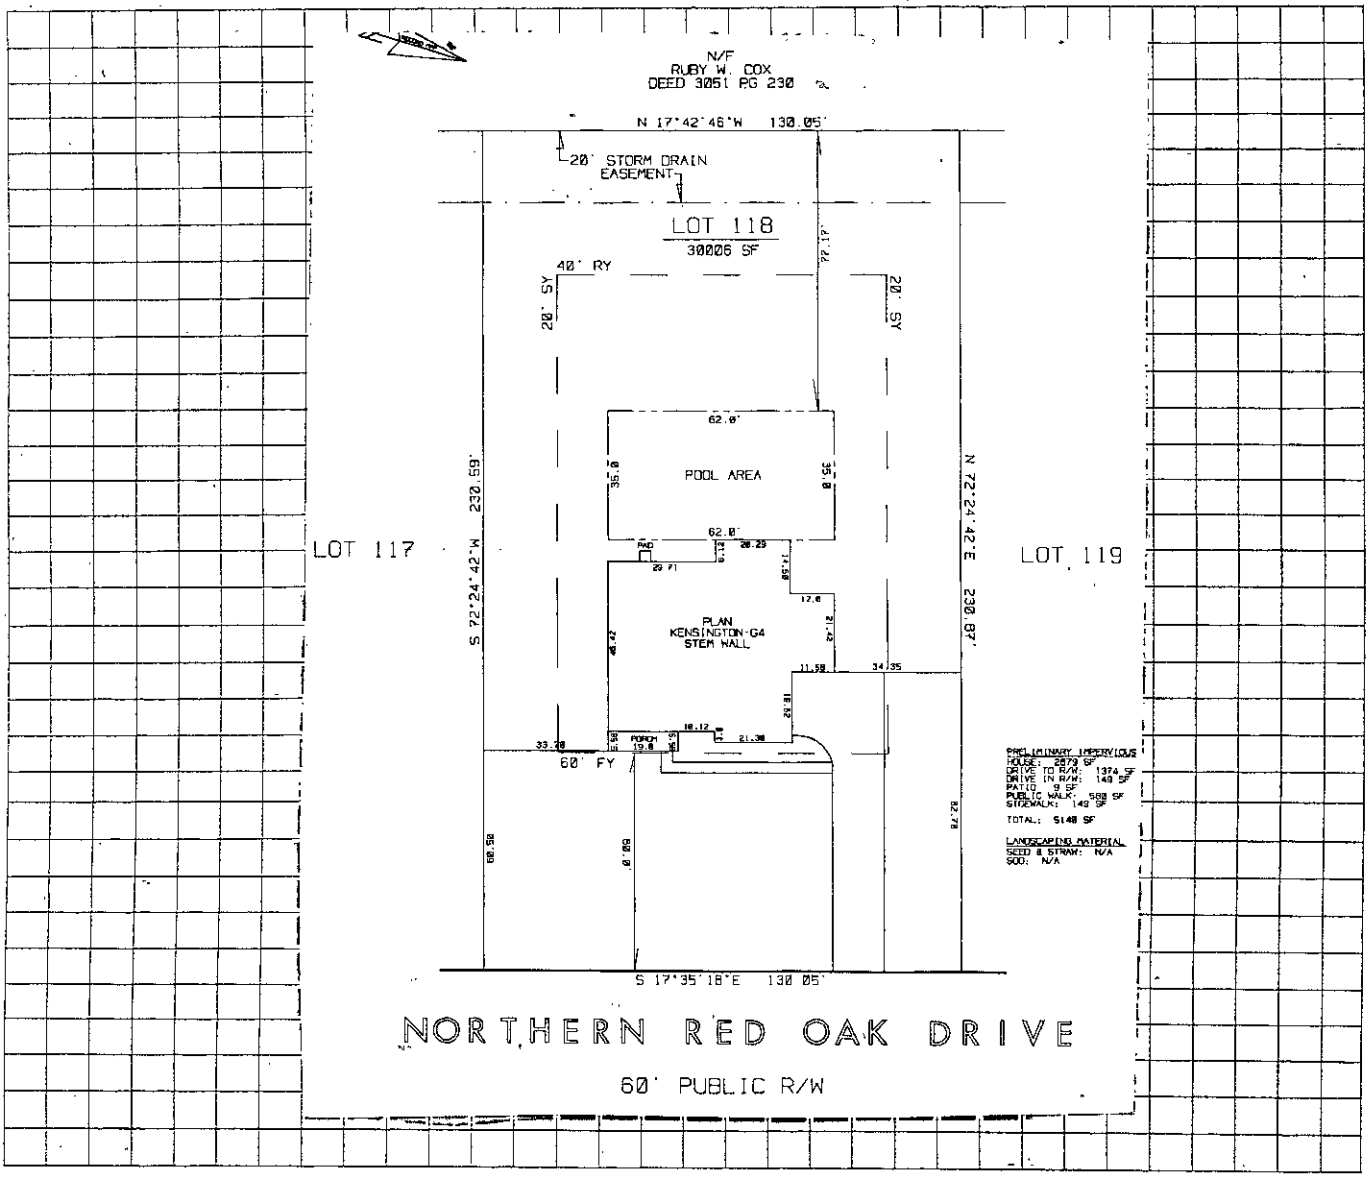

Michelle Sturdivant
Property Owner's or Owner's Legal Representative Signature

7-19-12
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10