

9908 AMAZONA DR

01521502

5/10/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

MECKLENBURG COUNTY

Department of Environmental Health
September 18th, 1987

John Hinton
1622 Northcliff Drive
Charlotte, NC 28216

RE: Property located at Amazon Drive 2-C
FILE: 3906A
PARCEL: 01521502

Dear Sir:

At your request a soils investigation was conducted on the property designated above. Results of this investigation showed the site to be classified as UNSUITABLE under criteria as set forth in Section .1900 of the North Carolina Administrative Code, Title 10, Department of Human Resources, Chapter 10, Division of Health Services; Sanitary Engineering Section, Subchapter 10A, Sanitation. A copy of the Site Evaluation Report (Serial Number 14604) is enclosed.

The soil on this property is not suitable for use with any conventional system, modified or alternative, with which I am aware.

If I can be of assistance, please do not hesitate to call.

Sincerely,

Sylvia D. Daniel, R.S.
Environmental Health Supervisor
Environmental Resources Division

Enclosure

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
SITE EVALUATION REPORT
SERIAL NUMBER 14604

File: 3906A Action 3

Parcel: 01521502 ☐ PC

Location: Amazon Drive


Subdivision:

Lot: 2-C Block: Acres: .60

Owner: John Hinton
Address: 1622 Northcliff Drive
Charlotte, NC 28216

Comments: _____

Described by: W. B. Ramsey
Date: 3-18-87

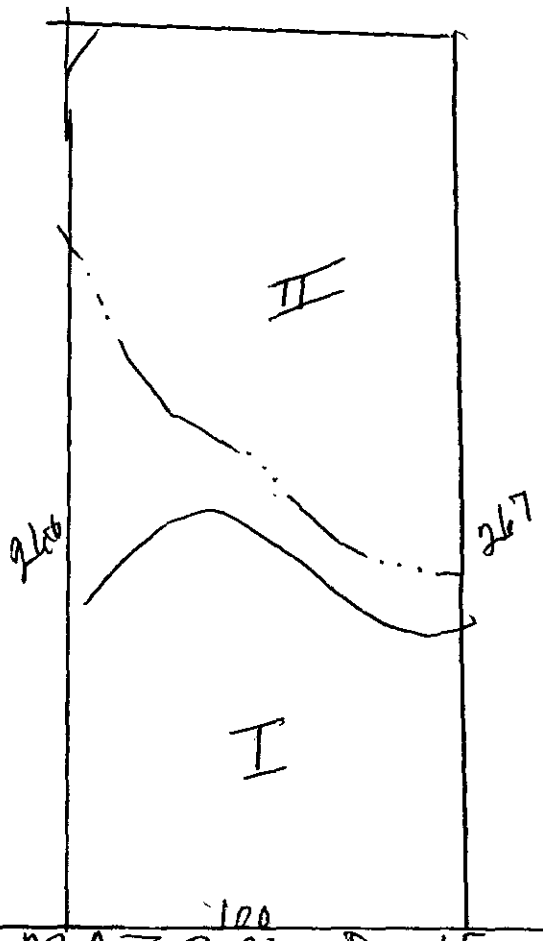

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	S (PS) U 2-6	S (PS) U 2-6	S PS U	S PS U	S PS U	S PS U
Texture	S PS (U)	S PS (U)	S PS U	S PS U	S PS U	S PS U
Structure	S PS (U)	S PS (U)	S PS U	S PS U	S PS U	S PS U
Drainage	S PS (U)	S PS (U) H2O Table 10' Less	S PS U	S PS U	S PS U	S PS U
Depth	S PS (U) 5-15"	S PS (U) 10-30	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	S (PS) U	S (PS) U	S PS U	S PS U	S PS U	S PS U
Available Space	S (PS) U	S (PS) U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	IVe ENON-A-C Profile	IIe Helena				
Area Classification	S PS (U)	S PS (U)	S PS U	S PS U	S PS U	S PS U

MECKLENBURG COUNTY
HEALTH DEPT.

Date Received _____

SEP 8 1987

SIR No. 3906A

T. C. No. 015-215-02

ENVIRONMENTAL HEALTH
DIVISION

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER Hinton (LAST) John (FIRST) (MIDDLE)

2) ADDRESS OF OWNER 1622 Northcliff Dr. Charlotte, NC ZIP 28216

3) PHONE NO. Home 392-2085 Office _____


4) LOCATION OF PROPERTY Amazon Dr. (Brasilia Park) in Long Creek
(STREET OR COUNTY ROAD)

5) SUBDIVISION Brasilia Park LOT NO. 2 BLOCK NO. C

MAP BOOK NO 15 PAGE NO. 49

6) DEED REFERENCE: DEED BOOK 00916 PAGE NO. _____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge.

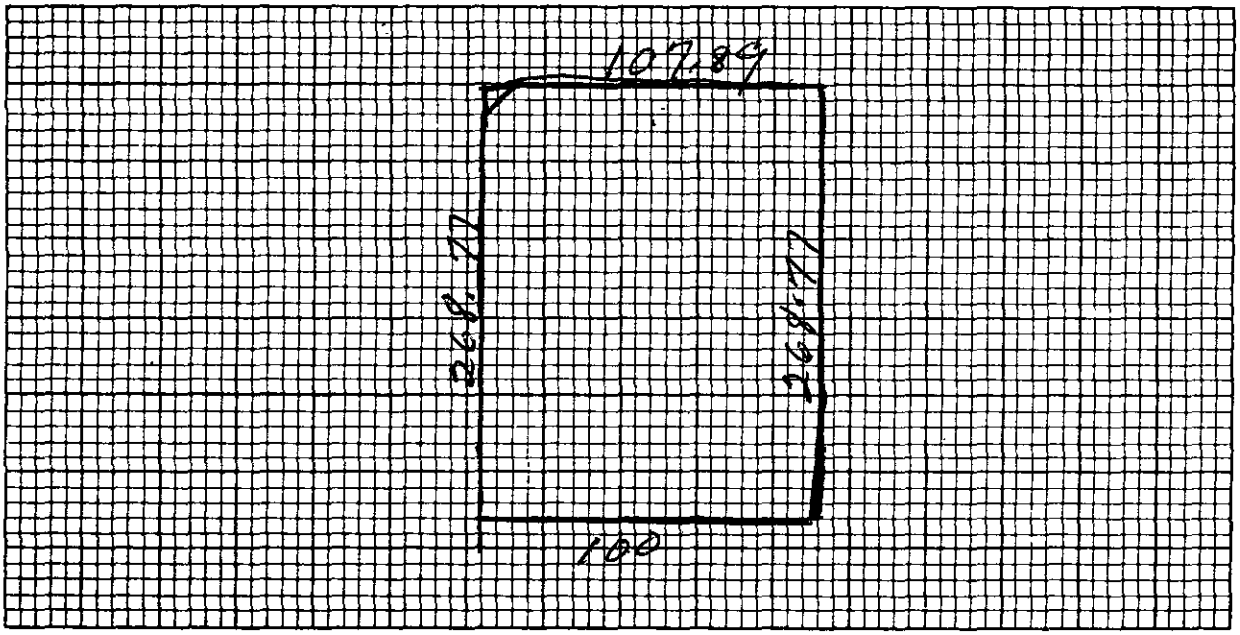

7) ACCURATELY DIAGRAM & DIMENSION LOT

John Hinton
OWNER

EHD-5-76

Environmental Health Department's Copy