Date Received 5-1-73

APT No 6025

T. C. No. 199-021-17

Map Date

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

APPLICATION FOR PERCOLATION TEST

1) NAME OF OWNER McKenna (LAST) Barry (FIRST) Lee (MIDDLE)

2) ADDRESS OF OWNER 2911 Carol Ave. ZIP

3) PHONE NO. Home 392-7696 Office 372-4892


4) LOCATION OF PROPERTY Lands End Road (STREET OR COUNTY ROAD)

5) SUBDIVISION LOT NO 17 BLOCK NO. 211

MAP BOOK NO 199 PAGE NO. 21

6) DEED REFERENCE DEED BOOK .PAGE NO.

Application is hereby made to the Mecklenburg County Health Department for the conduct of a percolation test and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge

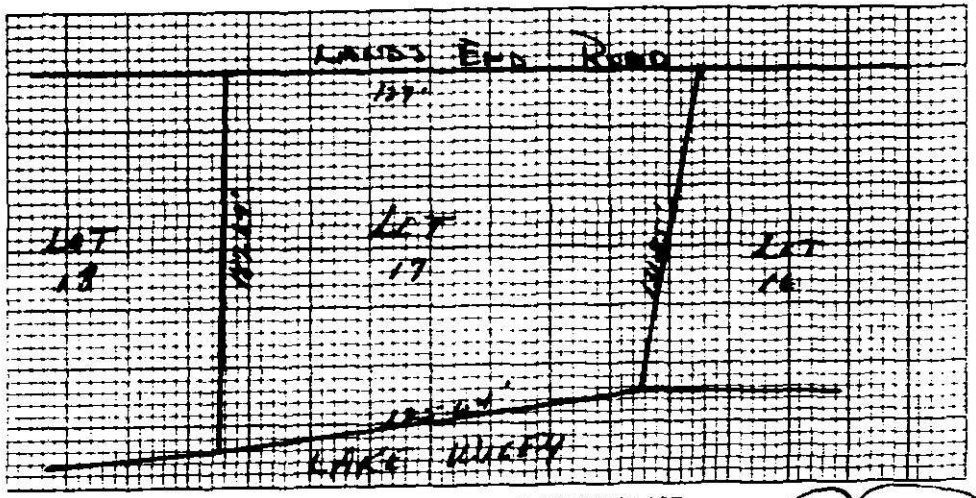

7) ACCURATELY DIAGRAM & DIMENSION LOT

Barry Lee McKenna
OWNER

FORM NO. E-1-9-1-72

HEALTH DEPARTMENT'S COPY

Serial No. [illegible]

PTR No. 6025

T C. No. 199-021-17

Date Issued April 19, 1973

Map Date

Do Not Issue A Building Permit Based On This Form

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION


PERCOLATION TEST REPORT

NAME OF OWNER McKenna (LAST) Barry (FIRST) Lee (MIDDLE)

ADDRESS OF OWNER 2911 Carol Avenue ZIP

LOCATION OF PROPERTY Lands End Road (STREET OR COUNTY ROAD)

SUBDIVISION LOT NO 17 BLOCK NO.

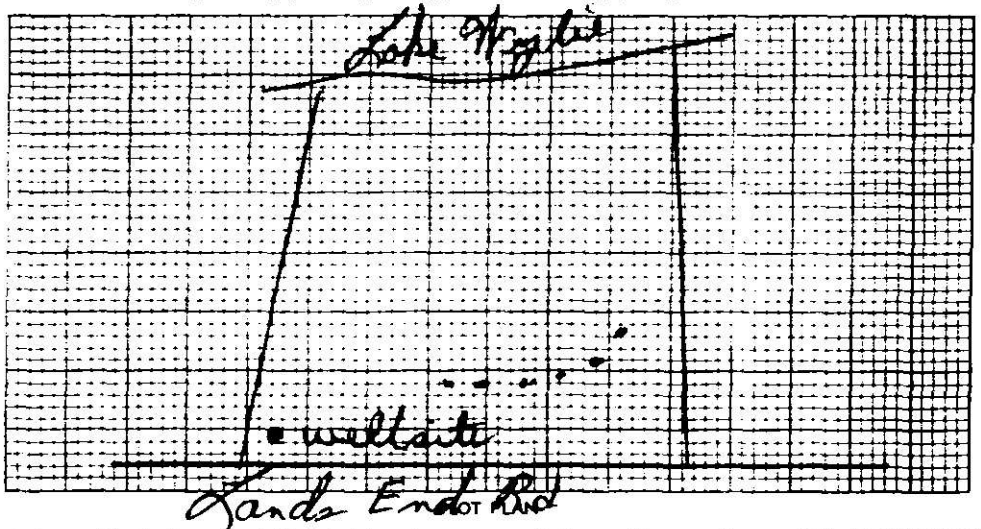

This is to certify that a percolation test has been run and an on-site inspection made by the Mecklenburg County Health Department on the lot described above. The said test was conducted on that portion of the lot as indicated on above plot.

The percolation rate determined by the test was 60 min/in The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install, construct, alter, or repair the specific system shall be obtained from the Mecklenburg County Health Department prior to the beginning of any construction of buildings, or of the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater teratment system which must be installed will be determined by the Health Department prior to installation based on the percolation rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area where the percolation test was run.
4. This approval is void if any grading, filling, or construction (including the drilling of a well) is performed on the lot which, in the opinion of the Health Department, renders the area where the percolation test was run unsuitable for the installation, construction, alteration, and/or repair of such a system.

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina State Board of Health and the Mecklenburg County Board of Health which were in effect on the date of issuance and is void if at any time in the future, prior to the completion of the system, these laws, rules, and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

John S. Dickson

Director Environmental Health Division or Authorized Section Head

FORM NO. E-2-4-1-71

HEALTH DEPARTMENT'S COPY

SEE INSTRUCTIONS ON BACK

Date Received 18 April 1973

ICAR (S) Application No. 6025

T. C. No 199-121-12

Map Date


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to

1) ✓ Install or Construct 2) ___ Alter or Repair an individual septic tank wastewater treatment system with a subsurface soil absorption, effluent discharge

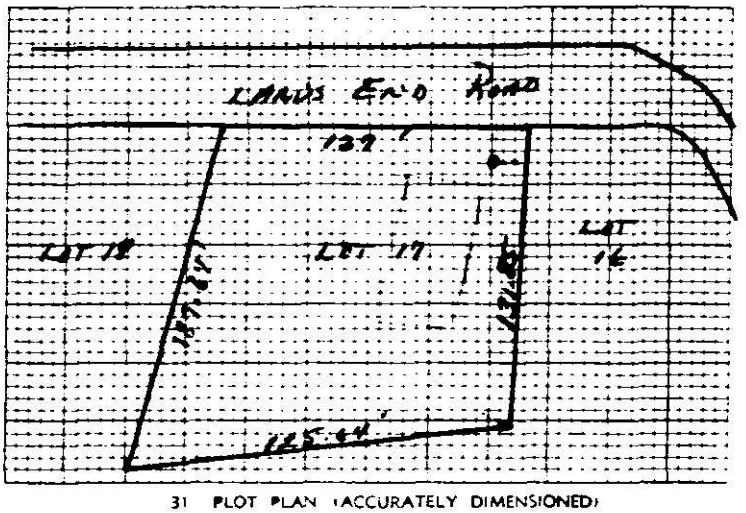

31) PLOT PLAN (ACCURATELY DIMENSIONED)

4) No of Bedrooms 2
5) Business Use — Max No Employees —
6) Washing Machine ✓ Yes ___ No
7) Garbage Disposal ✓ Yes ___ No
8) Dishwasher ✓ Yes ___ No
9) Water Supply:
A) Individual Well ✓
B) Governmental System ___
C) Community System
1 Well source ___
2 Governmental source ___
10) Sewage System:
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11) FHA Case No. ___
12) VA Case No ___

13) NAME OF OWNER McKENNA (LAST) BARRY (FIRST) LEE (MIDDLE)

14) ADDRESS OF OWNER 2911 CAROL AVENUE - CHARLOTTE, N.C.

15) PHONE NO Home 392-7696 Office 372-4892

16) LOCATION OF SYSTEM LANDS END ROAD (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. 17 Block No. 211

Map Book No 199 Page No. 21

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___ 3-17-73 60

19) HAS A PERCOLATION TEST BEEN RUN? ✓ YES ___ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

4-18-73
DATE OF APPLICATION

Barry D. McKenna
OWNER

FORM NO E-4-4-1-73

HEALTH DEPARTMENT'S COPY

Date Issued April 19, 1973

Serial No. 2751

LA No. 6025

T C. No. 199-021-17

Map Date

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER McKenna (LAST) Barry (FIRST) Lee (MIDDLE)

ADDRESS OF OWNER 2911 Carol Avenue ZIP

LOCATION OF LOT Lands End Road (STREET OR COUNTY ROAD)

SUBDIVISION LOT NO 17 BLOCK NO

MAP BOOK NO PAGE NO.

The above specified lot is approved by the Mecklenburg County Health Department for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the percolation test results which yielded a percolation rate of 60 min/in on an on-site inspection of the said lot; and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 6025. This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered, and/or repaired in the same area where the percolation test was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and/or repaired and that the system be installed in accordance with same.

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic-tank system is not being installed, constructed, altered and/or repaired in accordance with a valid installation, Construction, Alteration, and/or Repair Permit

John A Hausson
Environmentalist

L. F. McMillan
Director, Environmental Health Division or Authorized Section Head

FORM NO. E-3-4-1-71

HEALTH DEPARTMENT'S COPY

Date Issued 7/17/23 Serial No. 4039 ICAR(S) Permit No. 6025

T. C No _____

Map Date _____


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

INSTALLATION, CONSTRUCTION, ALTERATION, AND OR REPAIR PERMIT

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to X Install or Construct, ___ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 6025, dated 4/19/23 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 8/10/23, after which date this permit shall be null and void.

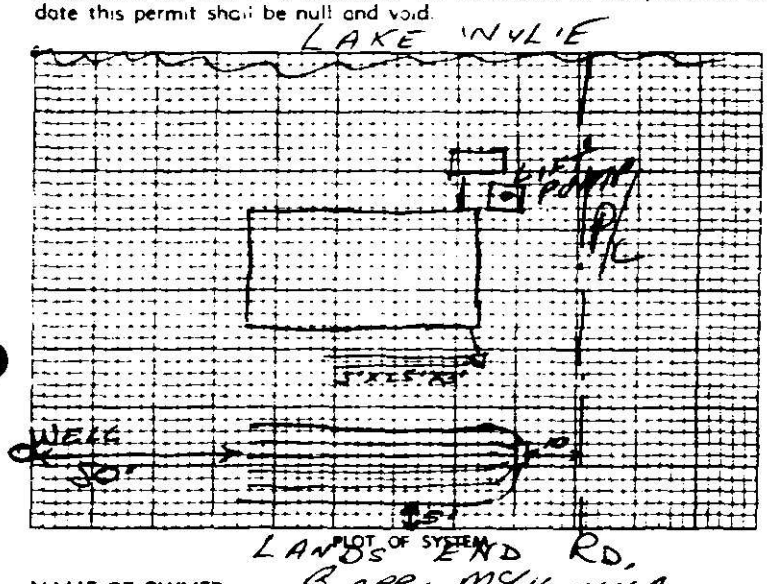

Percolation Rate 60

Liquid Capacity of Tank 1500

Tank Construction PC

Absorption and/or Nitrification Lines: 3T 480 sq'

Total Line Length 2nd R' 140'x3' w/m 5125'x3'(100')

Number of Lines 6

Distance from House 10'

Distance from Property Line 10' - 5' RW

Distance from Well 50' min

NAME OF OWNER Barry McKenna

LOCATION OF PROPERTY Lands End Rd.

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Board of Health which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Health Director before any system can be covered up or otherwise rendered uninspectable or can be used.

Comments: Pit for lift pump sized to give volume of 150 gal./(min) - Pump cycle to be set at 95 gals. R. Staley

JA/Lab

Division or Section Head

L. P. Brummond

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Environmental Health Division in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

FORM NO. E-5-4-1-71

HEALTH DEPARTMENT'S COPY