FEE: 100.00
DATE: 11/23/10
CRT [ ]

~~314156~~

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL
MECKLENBURG COUNTY - GROUNDWATER & WASTEWATER SERVICES
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

GWS – UES.APP 04/10

FILE #: 2120B

TYPE APPLICATION: ☒ SEPTIC ONLY ☐ WELL ONLY ☒ SEPTIC & WELL 4868 JAM
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A / M)
☒ ADDITION - RENOVATION OR GARAGE WITH NO MAJOR CHANGES (X)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ COMMERCIAL OR INDUSTRIAL (N)

PERSON FILING APPLICATION:
NAME:
ADDRESS: Same as owner.
CITY:
STATE: ZIP:
PHONE:
ALTERNATE PHONE:

JOB LOCATION INFORMATION
TAX/PARCEL #: 139-371-05
STREET ADDRESS: Same as owner.
CITY:
STATE: NC ZIP:

PROPERTY OWNER:
NAME: Richard Nadeau
ADDRESS: 9752 Bartlett Rd.
CITY: Mint Hill
STATE: NC ZIP: 28227
PHONE: (704) 545-0591
ALTERNATE PHONE: (954) 520-5714 ← Call this one plea
SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #: 9
139-051-29 plw 1994

WATER SUPPLY:
☐ MUNICIPAL (M) ☐ COMMUNITY (C) ☒ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

RESIDENTIAL PROPERTY TYPE:
☒ HOUSE (H) ☐ MODULAR HOME (M) ☐ MULTIPLE FAMILY (U)
☐ SINGLE MOBILE HOME (S) ☐ DOUBLE WIDE (D)
☐ OTHER (O)

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2

COMMERCIAL / INDUSTRIAL PROPERTY TYPE:
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ☐ YES ☐ NO
UNDERGROUND STORAGE TANKS? ☐ YES ☐ NO

ADDITION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☐ OTHER

ADDITION TYPE DETACHED FROM EXISTING STRUCTURE:
☒ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☐ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Richard Nadeau 11/22/10
Owner's/Agent's Signature Date

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted y this Department.
- This permit is not transferable.

☐ ADDITION / RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE

Attached
Revised Plot Plan to meet required setback off septic.
Jeremy Mulkey 11-23-2010
ES Signature Date


Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 2120B
Date 11/23/2010

PROPOSED PLOT PLAN

Revised Location

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

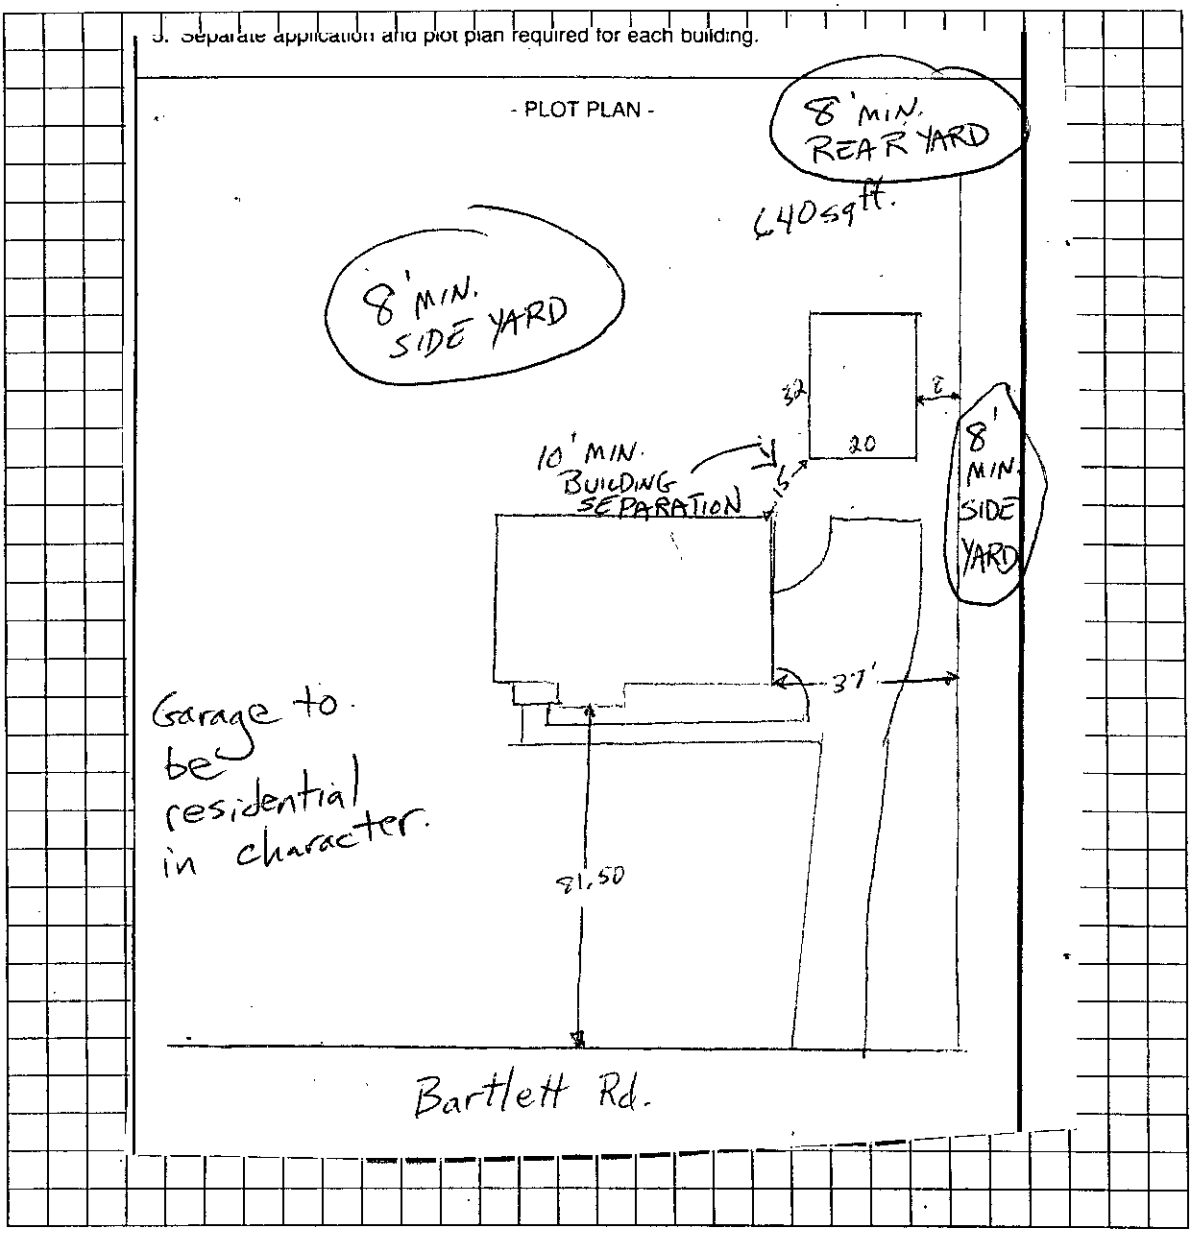

Owner/Agent Signature	Richard Madison
Date	11/23/10


LBC 12/15/04

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 2120B
Date

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

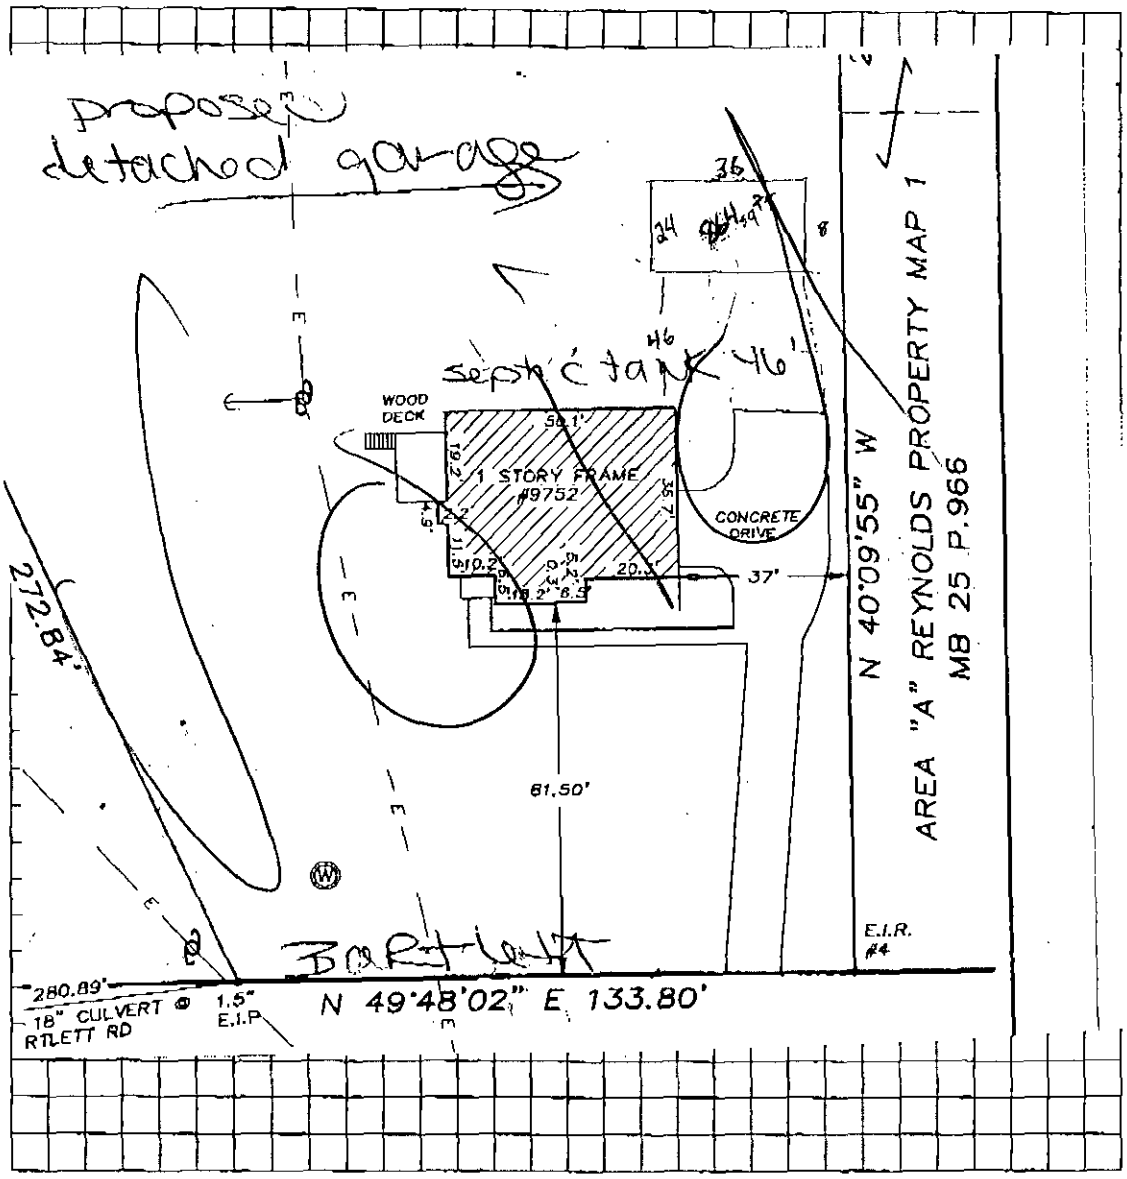

Owner/Agent Signature	Richard Madison
Date	11/22/2010

LBC 12/15/04

File 2128B / 9291A

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$80 + $20 2/9/94 ck # 182 CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

Date: 2-9-94

PERSON FILING APPLICATION:
NAME: Ellington (last) Carl (first) M (mi)
ADDRESS: 6400 Robin Hollow Dr PHONE: (__) 545-5358
CITY: Charlotte N.C. STATE: NC ZIPCODE:

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 139-051-29
STREET ADDRESS: 9752 Banlotte Rd
Charlotte N.C.
ZONING:

PROPERTY OWNER:
NAME: ~~[illegible]~~ Reynolds (last) Norman (first) D (mi)
ADDRESS: 12200 Bain School Rd PHONE: (__) 545-5358
CITY: Charlotte N.C. STATE: NC, ZIPCODE: 28277

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: 9 LOT SIZE (in acres):

[] SOIL TEST - INDIVIDUAL LOT (O)
[X] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [X] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS: 3
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: X Carl Ellington Date: X 2-9-94

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[X] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Kelly Rawell 2-16-94
Environmentalist Date

T. Walker R.S. for L. Powell 2/17/94
Director or Authorized Section Head Date

WWATER : 122791

COPY


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2/20B

TC: 13905-25 pd

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

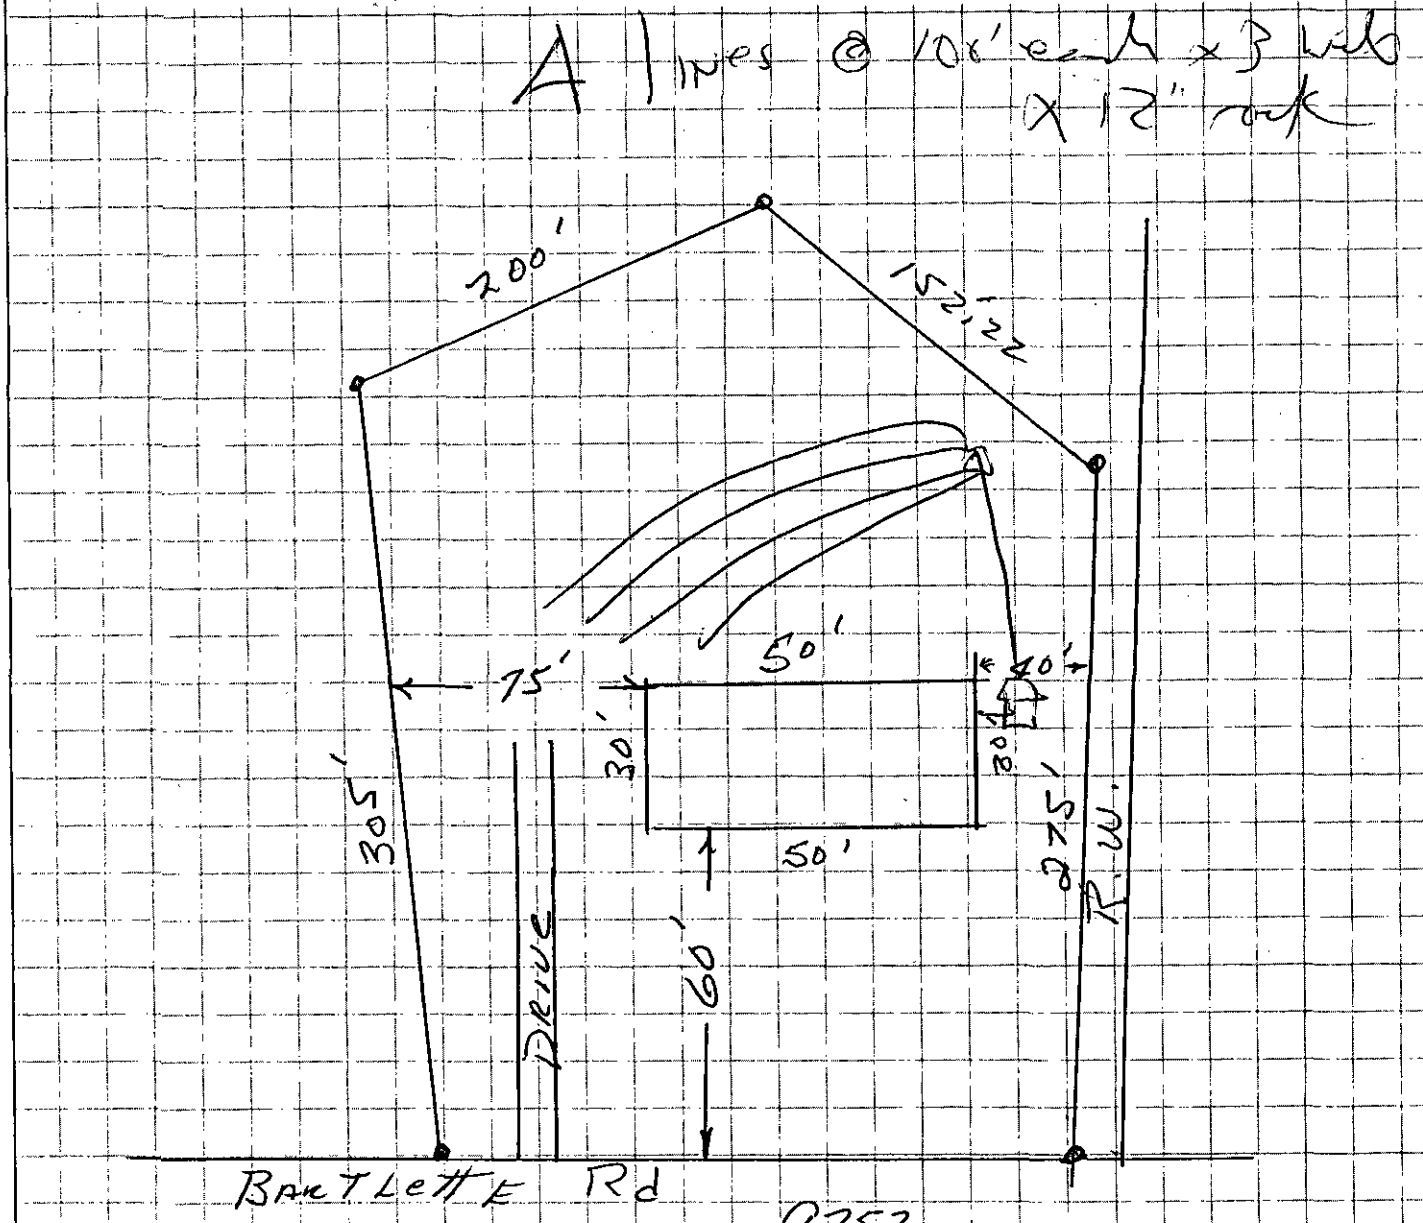

APPROVAL DATE _____

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 2120-B DATE: 7-25-94

TC: 139-051-29 ☐ L

SERIAL Nº 15775

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated _____. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

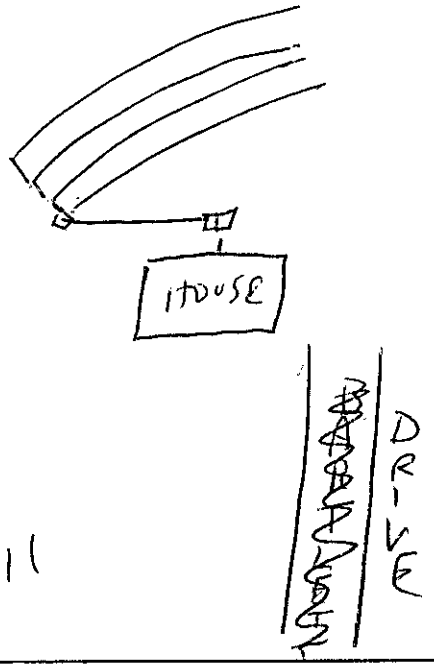

BARTLETT RD. PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction P.C.C.

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 400 feet

Number of Lines 4

Depth of Stone 12 inches

Distance from House 5'+ feet

Distance from Property Line 10'+ feet

Distance from Well 100'+ feet

NAME OF OWNER DENNIS REYNOLDS

LOCATION OF PROPERTY 9752 BARTLETT RD

Comments: 4 lines @ 100'

Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT 2460

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 2120-B DATE: 7-28-94

TC: 139-091-29 ☐ L ☒ CRT

SERIAL № 14299

Name of Owner DENNIS REYNOLDS Juris.:

Address of Property 9752 BARTLETT RD

Inspection Data:

Tank Material PLC

Total Length of Drainfield 400

Number of Lines 4 @ 100

Cover Depth 10"

Water Supply Source well

Distance to Water Source 100'+

Excavation Inspected 7-28-94

Tank(s) Inspected 7-28-94

Wash Line Inspected —

High Water Alarm Inspected —

PLOT

Design: 1994 1500 ST CON 1200SFT 12G CECIL CTR# BOBBY HOWELL

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☑ installed or constructed ☐ altered or repaired

☑ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☑ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS:

W. L. Randall
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

2/208/925A

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$30 pd 1/12/94 [ ] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:
NAME: Reynolds Norman Dennis (last) (first) (mi)
ADDRESS: 12200 Bainbridge Rd PHONE: ( ) 545-3582
CITY: Charlotte STATE: NC ZIPCODE: 28227

Date:

PROPERTY OWNER:
NAME: Same (last) (first) (mi)
ADDRESS: _____ PHONE: ( ) _____
CITY: STATE: ZIPCODE:

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 0139-051-29
STREET ADDRESS: Bartlett Rd
ZONING: _____

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[X] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

LOT NUMBER: 9 LOT SIZE (in acres):

TYPE APPLICATION (check one):
[X] SOIL TEST - INDIVIDUAL LOT (D)
[ ] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[ ] COMMERCIAL OR INDUSTRIAL (N)
[ ] SOIL TEST DEVELOPMENT (P)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[ ] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[ ] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[ ] SINGLE MOBILE HOME (S) [ ] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[ ] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: NUMBER OCCUPANTS:
SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[ ] Municipal (M) [ ] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [ ] None
[ ] Garage [ ] Storage Building [ ] Deck/Patio [ ] Bedrooms [ ] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Norman D Reynolds Date: 1-13-94

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[ ] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

_____
Environmentalist Date

_____
Director or Authorized Section Head Date

WATER : 122791

Lot. #9


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2120B/9291A

TC: 139-051-2990

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

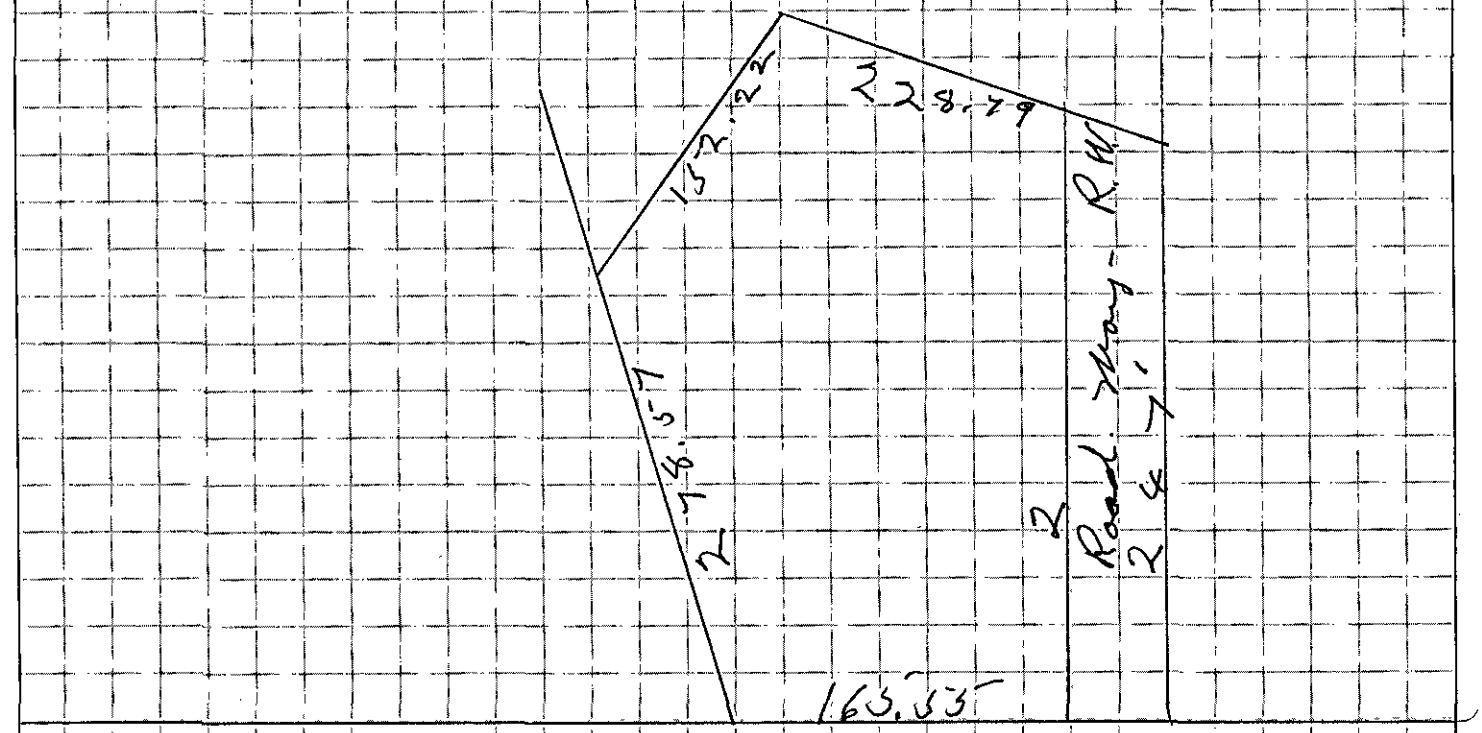

APPROVAL DATE _____

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

MECKLENBURG COUNTY HEALTH DEPARTMENT File: 212013/9291A Action 1

SITE EVALUATION REPORT

SERIAL NUMBER 20172 Parcel: PO 139-05129 ~~PC~~

Location: Bartlett Road

Subdivision:

Lot: 9 Block: Acres: 1.0


Owner: Norman D. Reynolds

Address: 1200 Rhein School Rd. Charlotte, N.C. 28227

Comments: Well Repair, 3 gal/min dug LIAB

Described by: William R. Marlin

Date: 2-2-94

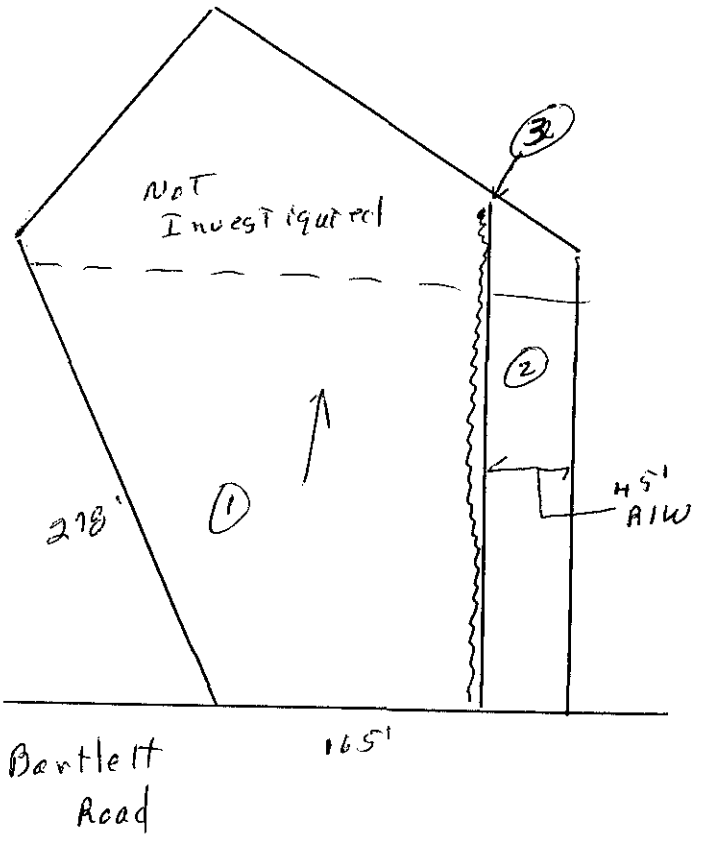

***** EVALUATION KEY *****

S = Suitable U = Unsuitable

PS = Provisionally Suitable

The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	(S) PS U 2-12%	S PS U —	S PS (U) >12' cut	S PS U	S PS U	S PS U
Texture	S (PS) U Slightly Expansive clay	S PS U —	S PS U —	S PS U	S PS U	S PS U
Structure	S (PS) U Sub-Blocky	S PS U —	S PS U —	S PS U	S PS U	S PS U
Drainage	S (PS) U 7 40" to water	S PS U —	S PS U —	S PS U	S PS U	S PS U
Depth	S (PS) U 7 40"	S PS U —	S PS U —	S PS U	S PS U	S PS U
Restrictive Horizons	S (PS) U 7 40"	S PS U —	S PS U —	S PS U	S PS U	S PS U
Available Space	S (PS) U	S PS U —	S PS U —	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS (U) R/W For Drive	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	III Iredell-Lilly	R/W For Drive	>2' cut			
Area Classification	S (PS) U	S PS (U)	S PS (U)	S PS U	S PS U	S PS U

Mecklenburg County

Health Department

February 2, 1994

Betty S. Snow, R.N., M.A.
Health Director

Norman D. Reynolds
12200 Bain School Road
Charlotte, N.C. 28227

RE: Property located on Bartlett Road (Lot #9)
FILE: 2120B/9291A
PARCEL: 139-051-29PO

Dear Mr. Reynolds:

At your request, a field investigation was conducted on the property designated above for the purpose of determining site suitability for the installation of a ground absorption sewage disposal system. The property was found to contain a limited area of soils which were classified as PROVISIONALLY SUITABLE for such an installation. A copy of the Site Evaluation Report (Serial Number 20172) is enclosed for your information.

While this classification indicates the site is acceptable for the installation of a septic tank system, no specific system or plans have been approved. The area available for such an installation may impose limitations on the size and/or type construction permitted on the lot. Specific plan approval will be provided upon submission of an Application for an Improvement Permit with an **ACCURATELY** dimensioned plot plan detailing the location of current and/or proposed buildings, wells and sewage disposal systems and determination that the area is adequate to accommodate the proposed construction.

Please note that this classification may be revoked if any filling, grading or construction (including the drilling of a well) is performed on the lot which in the opinion of this department renders any area previously designated suitable for system installation, unsuitable. Furthermore, this approval may be revoked should any changes occur in the regulations under which it was granted, if such changes would have prevented its approval had they been in effect on the date of issuance.

If there are any questions concerning this matter, please contact Bill Marlin, Soil Scientist at 336-5574.

Sincerely,

Kelly Randall

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems

Enclosure