Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 6496 B Permit #: 0812 Tax Parcel #: 197-131-34

Property Owner: Knotts Builders

Job Location Address: 8216 Civico Ln Lot 23

City: Charlotte State: NC Zip Code: _____

Operation Permit Issuance Date: _____ Contractor Name: Stanley Enu

Permitted Design Flow: 480 gpd GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Effluent Pump Model: _____

Drainfield Installation ☐ N/A

Trench Depth: 36" inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 4 @ 100 feet

Depth of Media: 12" inches (Type) IIIb Arc 36'

Depth of Cover: 12"+ inches

Distribution Device: Press Manifold

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☐ Private Well ☒ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5'+ feet

Distance from Property Line: 10'+ feet

Distance from Water Supply Source: 10'+ feet From line not installed


Inspection Dates

STB 338 1500gal 8/14/14
PT 238 1000gal 8/14/14

Tank(s) Inspected: 9/11/14

Excavation Inspected: _____

Pump & Controls Inspected: _____

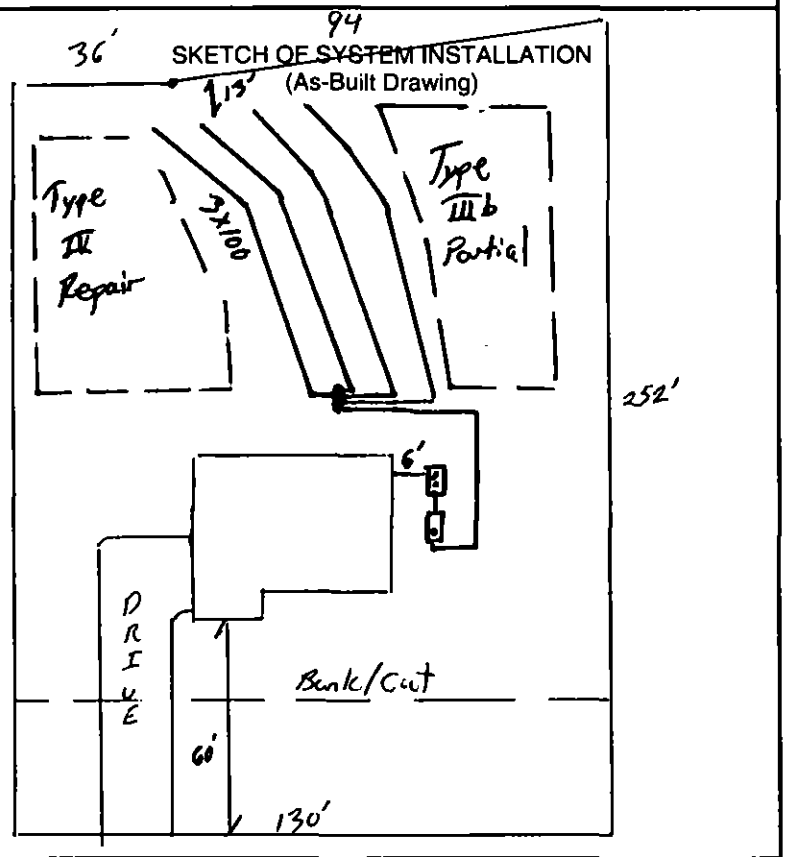

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☐ altered ☐ repaired ☐ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIb ~~Type~~ BiOA 36/P/NA/NA

DENR Authorized Agent: Bradley W. Hallman Signature: _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 6496 B Permit #: 0812 Tax Parcel #: 197-131-34

Property Owner: Knotts Builders

Job Location Address: 8216 Curico Ln Lot 23

City: Charlotte State: NC Zip Code: _____

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIb

**Operation Permits for Type V and VI systems expire five (5) years from the date of* issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

_____

_____

_____

_____

DENR Authorized Agent: Bradley W. Hallman Date: _____

Signature: _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 6496B Permit #: 0812 Tax Parcel #: 197-131-34

Property Owner: Knotts Builders

Job Location Address: ~~8303~~ 8216 Civico Ln Lot ~~45~~ 23

City: Charlotte State: NC Zip Code: _____

Installation Approval Issuance Date: 8/29/14

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before _____, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.
***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 480 GPD
Site LTAR: .3 GPD/ft² (For new installations only.)
Liquid Capacity of Septic Tank: 1500 gallons
Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design ☐ N/A
Trench Depth: 30" inches
Trench Width: 3 feet
Line Spacing: 9 feet (O.C.)
Total line length: 400 feet
# of Lines: 4 @ 100 feet → 5@80'
Depth of Media: 12" inches (Type) IIIb 25%
Distribution Device: Press. Manifold

Bed Design *(For Repair Installations ONLY.)* ☒ N/A
Bed Depth: _____ inches
Bed Width: _____ feet
Total line length: _____ feet
# of Lines: _____ @ _____ feet
Depth of Media: _____ inches (Type) IIIb
Distribution Device: Press. Manifold

Water Supply Source
☐ Municipal ☐ Private Well ☒ Community Well
☐ Other _____

Minimum System Setbacks
Distance from Building Foundation: 5' min feet
Distance from Property Line: 10' feet
Distance from Water Supply Source: 10' from water line feet


SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

- Install system lines as permitted
- Note: Due to grading system will required pump tank with effluent pump
- Pump tank: 1000 gal

Comments: System Classification & Type: IIIb


DENR Authorized Agent: Bradley W. Hallman Signature: _____

On-site Wastewater Improvement Permit Diagram
PARCEL #: 197-131-34
WAPSPS APPLICATION #: 30000812
GWS File # 6496B

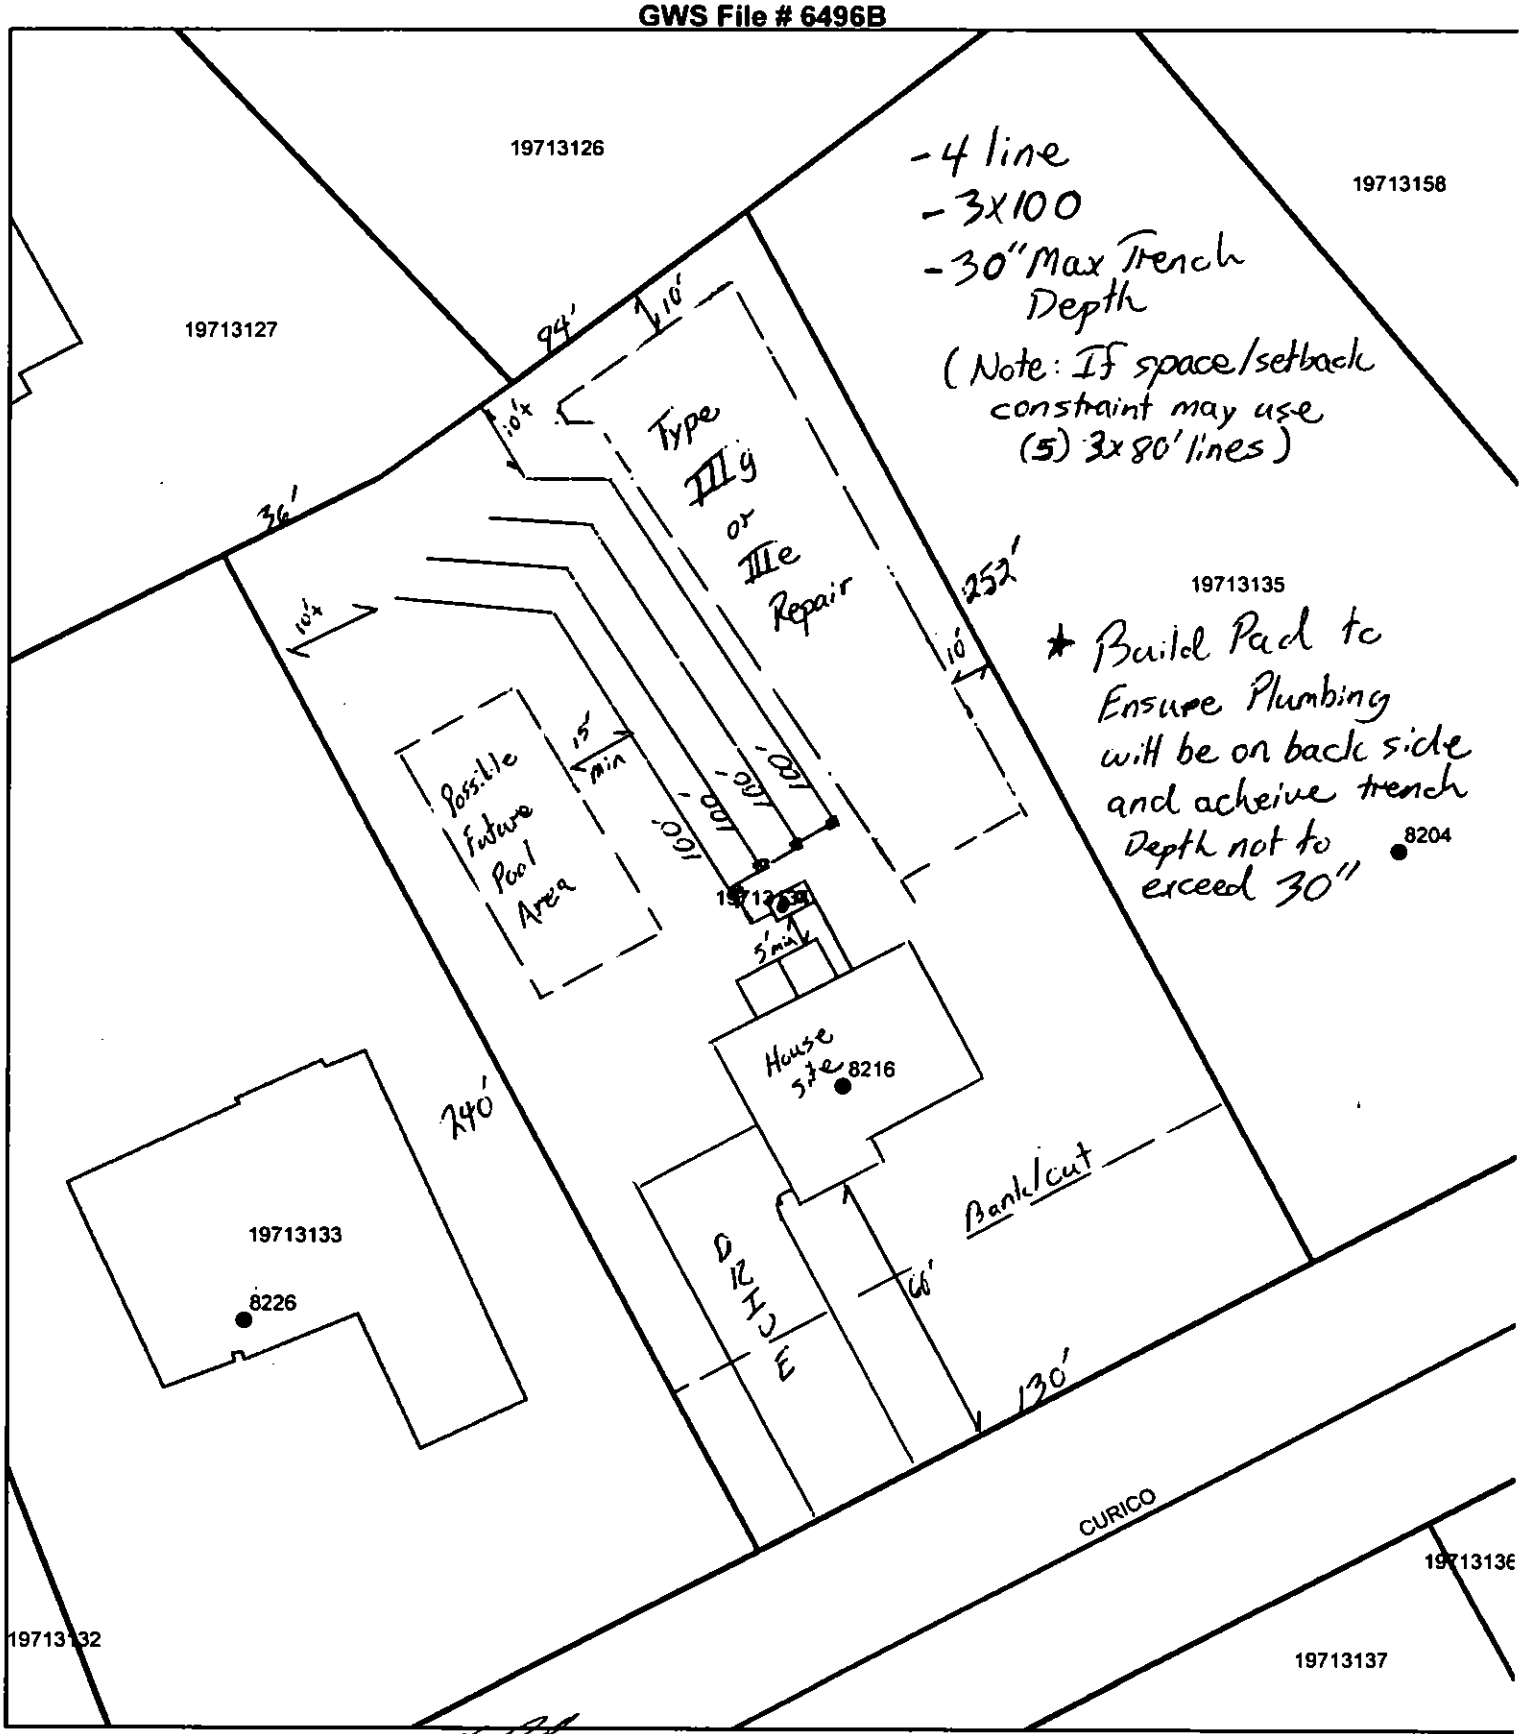

Authorized Agent: _____ 6/2/14

Owner/Legal Agent: _____

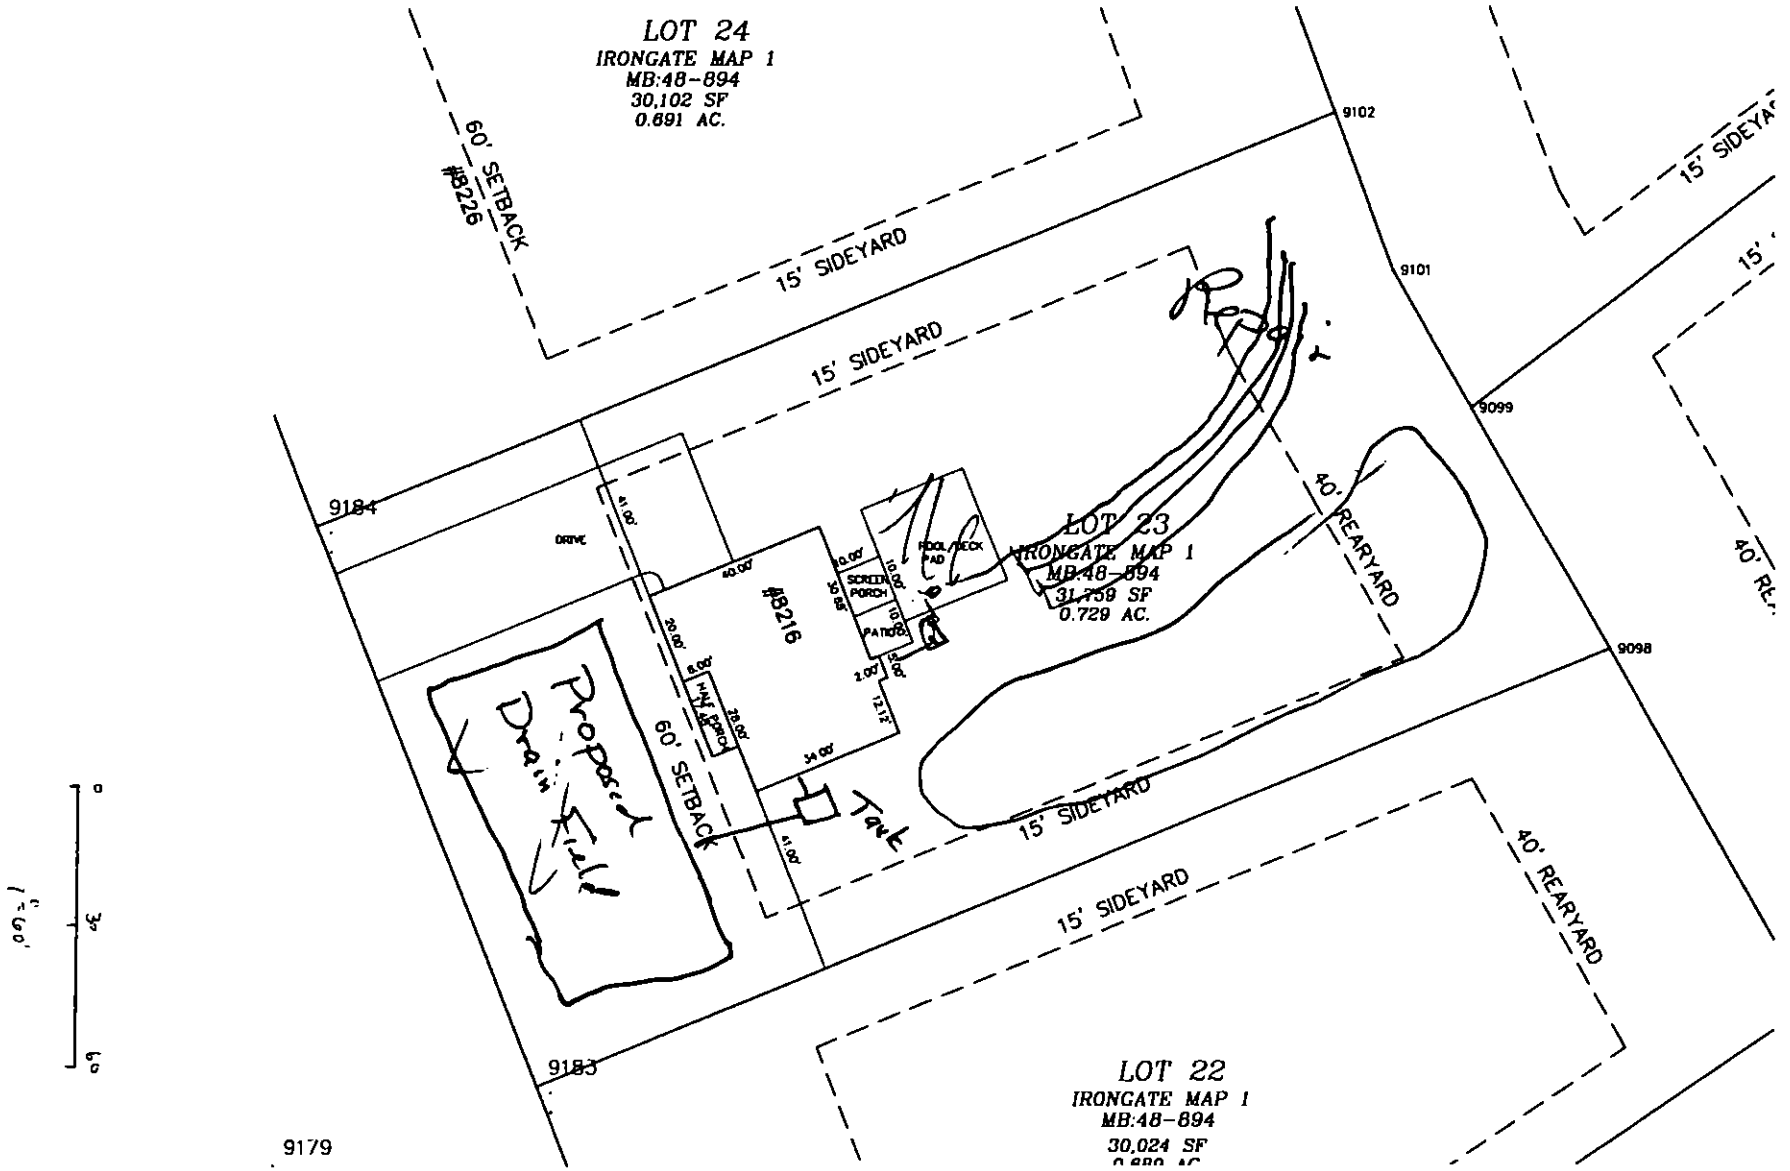
LOT 24
IRONGATE MAP 1
MB:48-894
30,102 SF
0.691 AC.
60' SETBACK
#B226
15' SIDEYARD
15' SIDEYARD
9102
9101
9099
9098
9184
9183
9179
DRIVE
41.00'
40.00'
#B216
20.00'
34.00'
41.00'
60' SETBACK
SCREEN PORCH
PATIO
POOL DECK
PAD
HALF BATH
Property Drain Field
Tank
LOT 23
IRONGATE MAP 1
MB:48-894
31,759 SF
0.729 AC.
40' REARYARD
15' SIDEYARD
15' SIDEYARD
40' REARYARD
LOT 22
IRONGATE MAP 1
MB:48-894
30,024 SF

FEE: 200.00
DATE:9/25/2014

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 6496B

PERMIT NUMBER: 30000812

PARCEL NUMBER: 19713134

JOB LOCATION INFORMATION

ADDRESS: 8216 CURICO LN

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28227

ISSUED TO: Knotts Builders

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 10/27/2006


CONSTRUCTION AUTHORIZATION CONDITIONS


1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30000812, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   *CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 10/27/2011

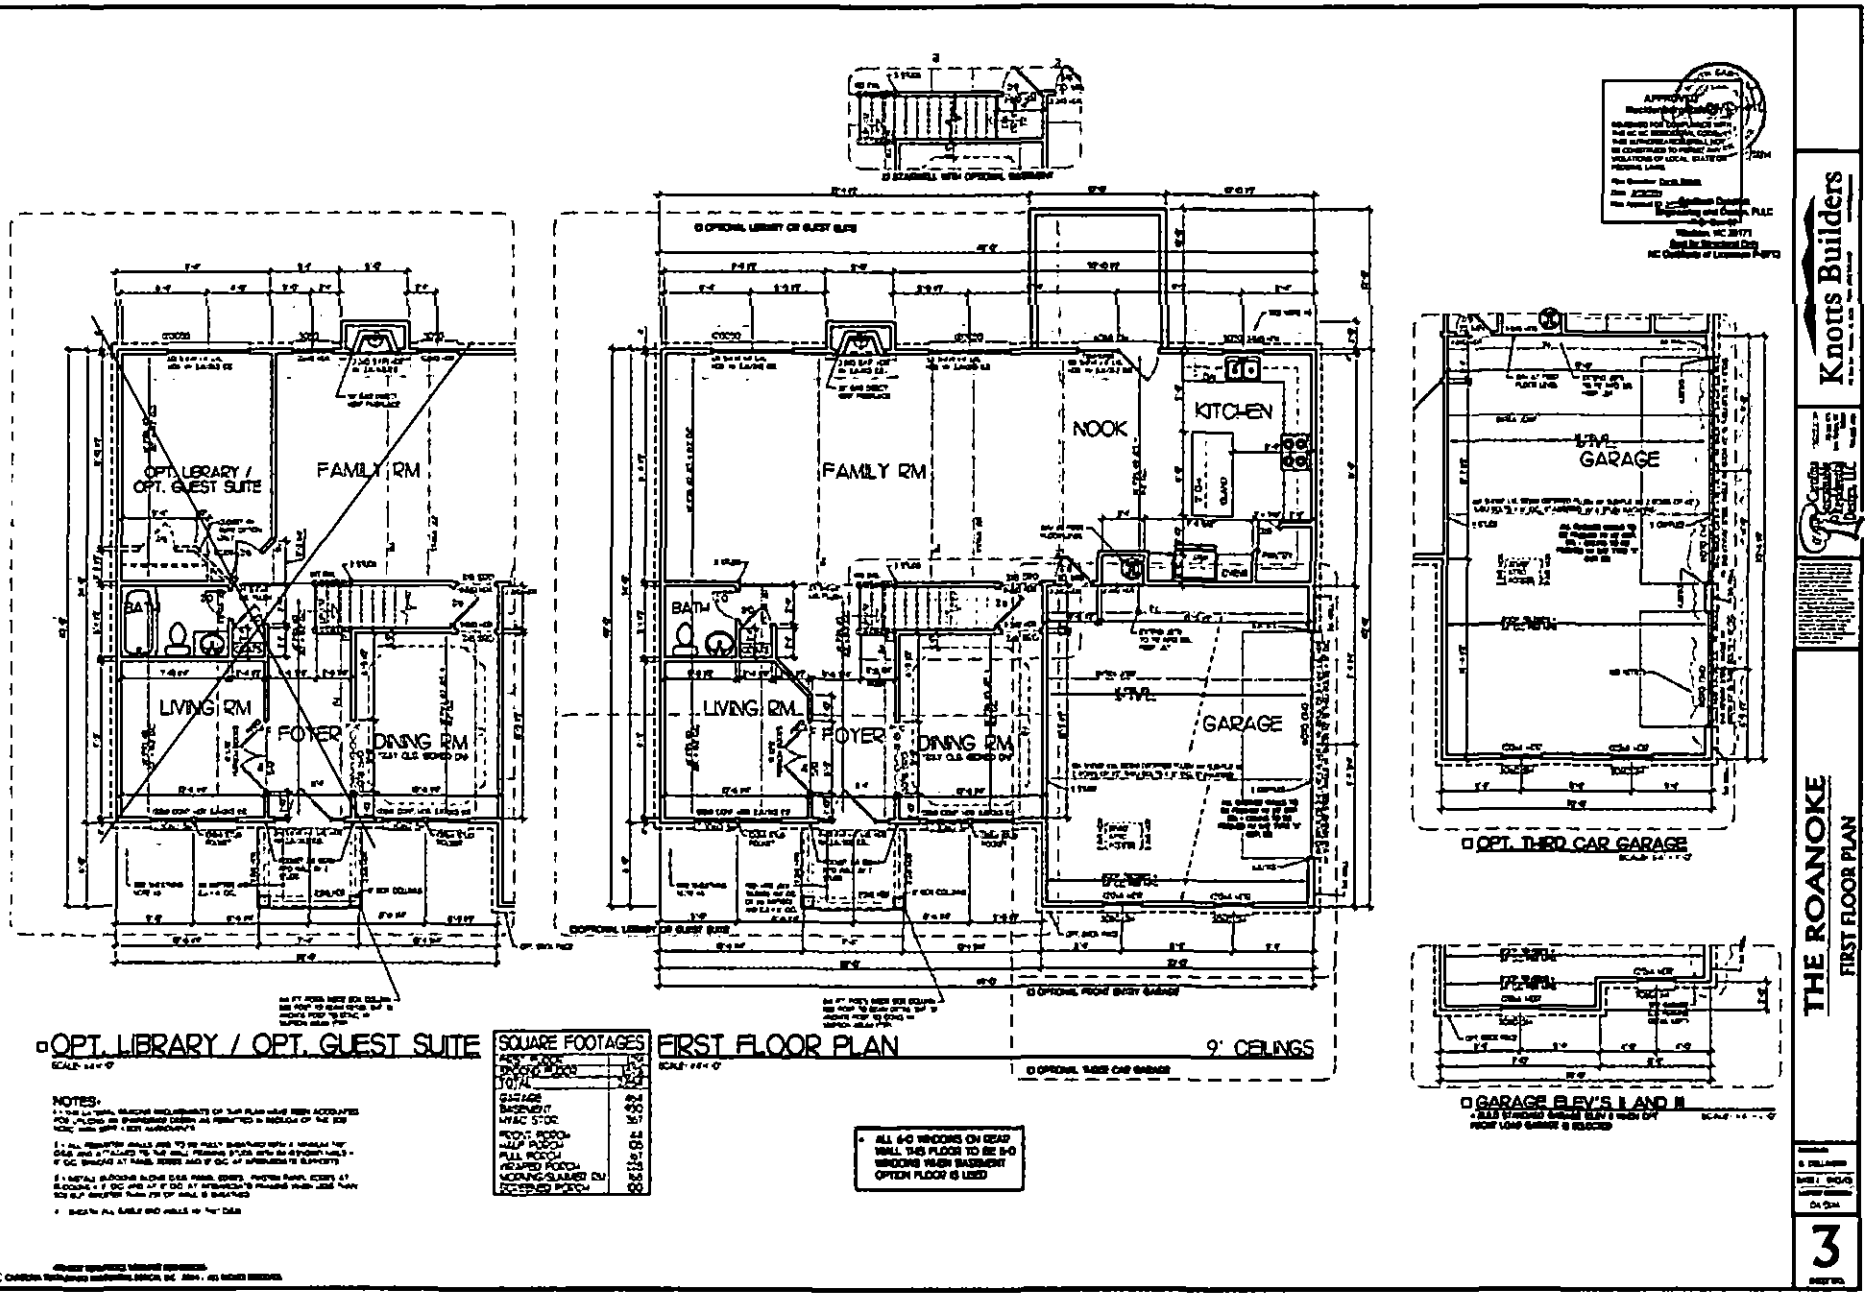

OPT. LIBRARY / OPT. GUEST SUITE
FAMILY RM
BA
LIVING RM
FOYER
DINING RM
OPTIONAL LIBRARY OR GUEST SUITE
FAMILY RM
NOOK
KITCHEN
BATH
LIVING RM
FOYER
DINING RM
1-1/2 GARAGE
OPTIONAL FRONT ENTRY GARAGE
OPTIONAL SIDE CAR GARAGE
1-1/2 GARAGE
OPT. LIBRARY / OPT. GUEST SUITE
FIRST FLOOR PLAN
9' CEILINGS
OPT. THIRD CAR GARAGE
GARAGE ELEV'S I AND III
SQUARE FOOTAGES
NOTES:
ALL 6-0 WINDOWS ON REAR WALL THIS FLOOR TO BE 5-0 WINDOWS WHEN BASEMENT OPTION FLOOR IS USED
Knotts Builders
THE ROANOKE
FIRST FLOOR PLAN
3

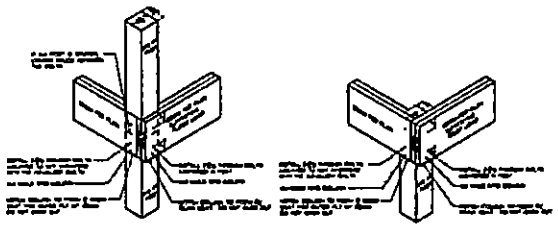



POST / BEAM CONNECTION DETAIL

POST TOP / BEAM CONNECTION DETAIL


CONSTRUCTION NOTES






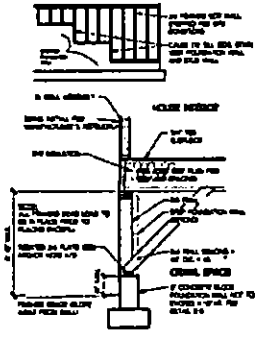

STEPPED DOWN CRAWL FOUNDATION WALL (SIDING)

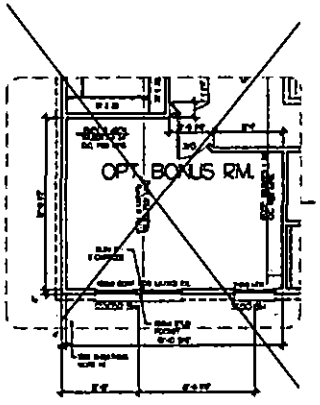


OPTIONAL BONUS ROOM

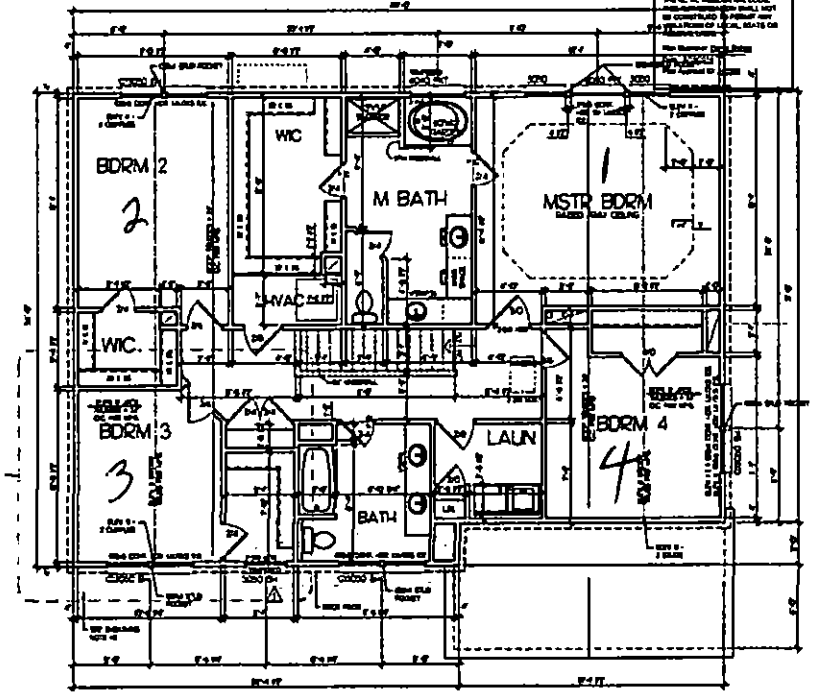


SECOND FLOOR PLAN

TYPICAL STAIR DETAIL






FLASHING DETAIL



DECK EDGE DETAIL



TYPICAL DECK BOLT DETAIL

NOTES:

Knotts Builders

THE ROANOKE

SECOND FLOOR PLAN

3.1

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

34

Permit #: 30000812 GWS File #: 6496B Tax Parcel #: 197-131-05

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 10/27/2011

Type of Installation: Residential - New System Lot Number: 14

Structure Type: HOUSE Size (ft^2): 0 # Bedrooms: 4 # Occupants: 3

Building Foundation: Crawl Space Water Supply: Municipal

II. Initial System Type: Innovative or Experimental **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	30	Depth of Media (in):	N/A	Distribution Device:	Drop Tees		

III. Repair System Type: Innovative or Experimental **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1309	Total Trench Length (ft):	436
Maximum Trench Depth (in):	30	Depth of Media (in):	N/A	Distribution Device:	Drop Tees		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: David Cornelius Owner/Legal Agent: _____
Print Name

Signature: _____ Signature: _____

Date Issued: 10/27/2006

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30000812 GWS File #: 6496B

IV. Permit Conditions/Comments:

- Owner agreement forms for site reclassification shall be on file prior to issuance of Construction Authorization.
- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. *This permit is being* issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the *Department*.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: David Cornelius

Signature: _____

Date Issued: 10/27/2006

Owner/Legal Agent: _____
Print Name

Signature: _____

PROPOSED PLOT PLAN


SCALE
LOT #

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: _____

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

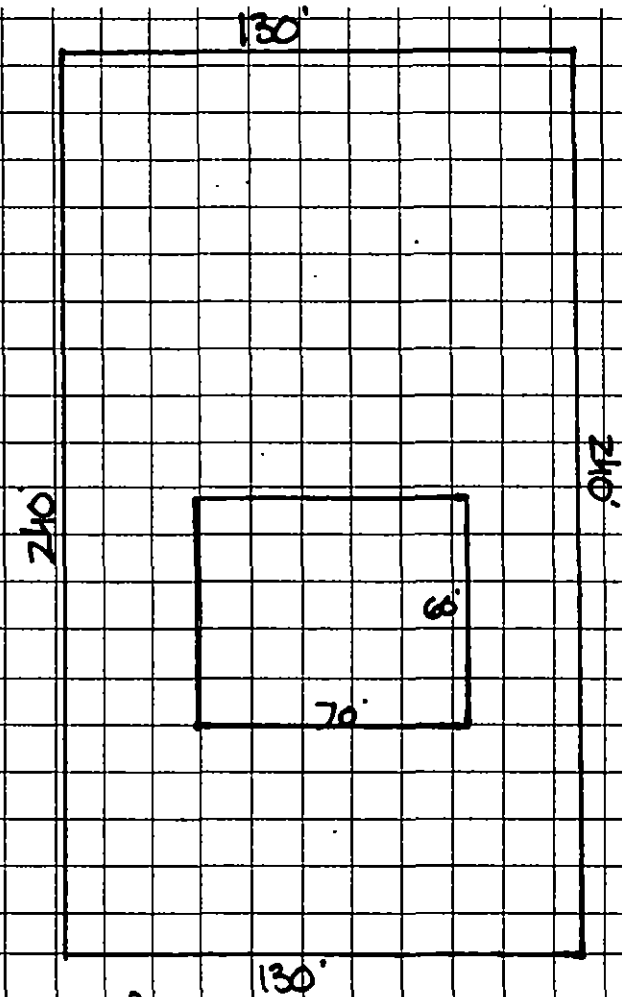

- SEPTIC SYSTEM DESIGN FOR A BEDROOM HOUSE
- GALLONS PER DAY
- LTAR =
- TOTAL LINEAR FT =
- INNOVATIVE, 25% REDUCTION
- TYPE -
- INSTALL -
- PLACE LINES LEVEL, ON CONTOUR & ON 9' CENTERS.
- 1500 GAL SEPTIC TANK
- DISTRIBUTION.
- REPAIR AREA -

SETBACKS:
KEEP ALL PART OF SYSTEM:
> 5' FROM HOUSE FOUNDATION
> 10' FROM PROPERTY LINES

APPROVAL DATE _____

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 197-131-05
Lot #: 14
File #: 6496B
Code: 2

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Angela B. Page
Applicant: J. Scot Collins
Address: 9900 Brief Road, Charlotte, NC 28227
Date Evaluated: 6/7/2006
Proposed Facility: Residence
Design Flow (.1949): 480 gpd
Property Size: .72a
Location of Site: 9820 Brief Road
Property Recorded:
Water Supply: [ ] Public [ ] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS,8	0-10	GR/CL	FR/SS/SP/SEXP	>48" TO SOIL WETNESS	48+	NA	NA	PS,IV
		10-48	SBK/ABK/C	FI/S/P/SEXP					.275 GPD/FT^2
2	"	0-6	GR/CL	FR/SS/SP/SEXP	>30" TO SOIL WETNESS	30	"	"	U
		6-30	SBK/ABK/C	FI/S/P/SEXP					NA
3	"	0-4	GR/CL	FR/SS/SP/SEXP	>48" TO SOIL WETNESS	48+	"	"	PS,IV
		4-48	SBK/C	FI/S/P/SEXP					.3 GPD/FT^2
4	"	0-10	GR/CL	FR/SS/SP/SEXP	"	"	"	"	"
		10-48	SBK/C	FI/S/P/SEXP					

Description	Initial System	Repair System
Available Space (.1945)	PS	U
System Type(s)		
Site LTAR	.3 GPD/FT^2	.275 GPD/FT^2


Other Factors (.1946):
Site Classification (.1948): Unsuitable
Evaluated By: Chris Sherrill, RS, LSS 6/7/06
Others Present:

COMMENTS: 100% Repair Area

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Food Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

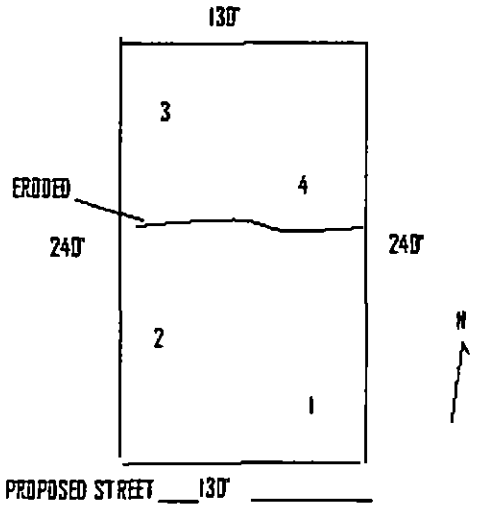


1"=50'

PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

COLLINS-BRIEFRD.
LOT #14
FILE: 64968
TC: ~~197-131-05~~ 197131 34

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

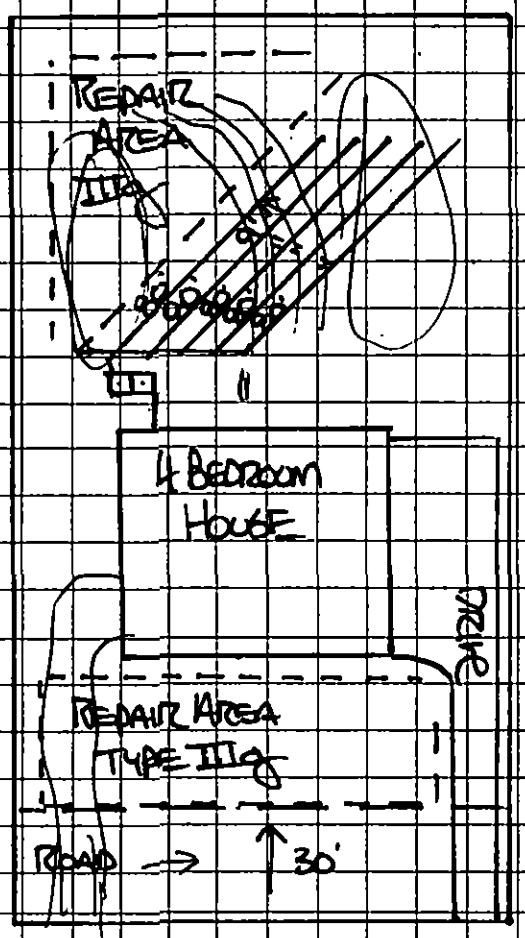

- SEPTIC SYSTEM DESIGN FOR A 4 BEDROOM HOUSE.
- 480 gpd MAX WASTEWATER FLOW
- LTAR = 0.3 gpd/FT²

- INNOVATIVE, 25% REDUCTION TYPE IIIg.
- INSTALL 5 LINES @ 90' EA PLACE LINES LEVEL, ON CONTOUR & ON 9' CENTERS
- 1500 GAL SEPTIC TANK
- UTILIZE DROPTEES FOR SERIAL DISTRIBUTION.
- TYPE IIIg REPAIR AREA.

SETBACKS:
75' FROM HOUSE
10' FROM PROPERTY LINE

* AGREEMENT FORMS REQUIRED BEFORE CO RELEASE.

OWNER/AGENT SIGNATURE

DATE

APPROVAL DATE

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

#812

GWS – RES. APP 07/05

SEPTIC FEE: 200
DATE: 5/15/06
CRT [ ]
JC

PERMIT APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATION FOR ON-SITE WASTEWATER SYSTEM NEW WELL INSTALLATION OR REPAIR OF EXISTING WELL MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES

FILE # 64/36B

WELL FEE: _____
DATE: _____
CRT [ ]

SEPTIC / TYPE APPLICATION: ☐ NONE ☒ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFY PLOT PLAN

WELL / TYPE APPLICATION: ☐ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

JOB LOCATION INFORMATION:

TAX/PARCEL #: Portion of 19713105
STREET ADDRESS: 9820 Brief Road
CITY: Charlotte
STATE: NC ZIP: 28227
SUBDIVISION OR MOBILE HOME PARK NAME: Undecided
LOT #: 14
TOWNSHIP:

☐ 0-MECKLENBURG ☐ 4-PINEVILLE
☐ 1-CHARLOTTE ☐ 5-MATTHEWS
☐ 2-DAVIDSON ☐ 6-HUNTERSVILLE
☐ 3-CORNELIUS ☒ 7-MINT HILL

BUILDING INFORMATION:

TYPE OF BUILDING:

☐ SINGLE MOBILE HOME (S) ☐ MODULAR HOME (M)
☐ DOUBLE WIDE (D) ☐ MULTIPLE FAMILY (U)
☒ HOUSE (H) ☐ OTHER

HEATED SQUARE FOOTAGE: n/a
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: n/a

FOUNDATION FOR RESIDENCE:

☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☒ CRAWLSPACE ☐ BASEMENT WITH NO PLUMBING

IF PLANNING TO EXPAND/ALTER THE EXISTING SYSTEM INDICATE THE FOLLOWING CHANGES:

NUMBER OF BEDROOMS TO BE ADDED: NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE:
WILL THERE BE A HOME BUSINESS IN THE RESIDENCE? ☐ YES ☐ NO TYPE:

WATER SUPPLY:

☐ MUNICIPAL (M) ☐ PUBLIC (C) ☐ PRIVATE WELL (P) ☒ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

ARE ANY OF THE FOLLOWING LOCATED ON THE PROPERTY? IF SO, PLEASE SHOW LOCATION ON SITE PLAN/PLAT.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☒ NO	WELLS, SPRINGS, OR WATER LINES	☐ YES	☒ NO
EXISTING WASTEWATER SYSTEMS	☐ YES	☒ NO	DESIGNATED WETLANDS	☐ YES	☒ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☒ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☒ NO

PROPERTY OWNER:

NAME: Angela B. Page
ADDRESS: 9900 Brief Road
CITY: Charlotte
STATE: NC ZIP: 28227
HOME PHONE: 704.545.6375 WORK PHONE:
MOBILE PHONE: FAX:

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: J. Scot Collins
ADDRESS: 1101 Lester Mullis Road
CITY: Indian Trail
STATE: NC ZIP: 28079
HOME PHONE: 704.248.8493 WORK PHONE: 704.641.4470
MOBILE PHONE: FAX: 704.753.5898

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? n/a
WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? within 30 days

*An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

J. Scot Collins 5/15/06
Owner's/Agent's Signature Date


NORTH CAROLINA DEPARTMENT OF
ENVIRONMENT & NATURAL RESOURCES DIVISION
OF ENVIRONMENTAL HEALTH ON-SITE
WASTEWATER SECTION

*A Well Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202 704-336-5103 / FAX: 704-336-6894

Lot #14

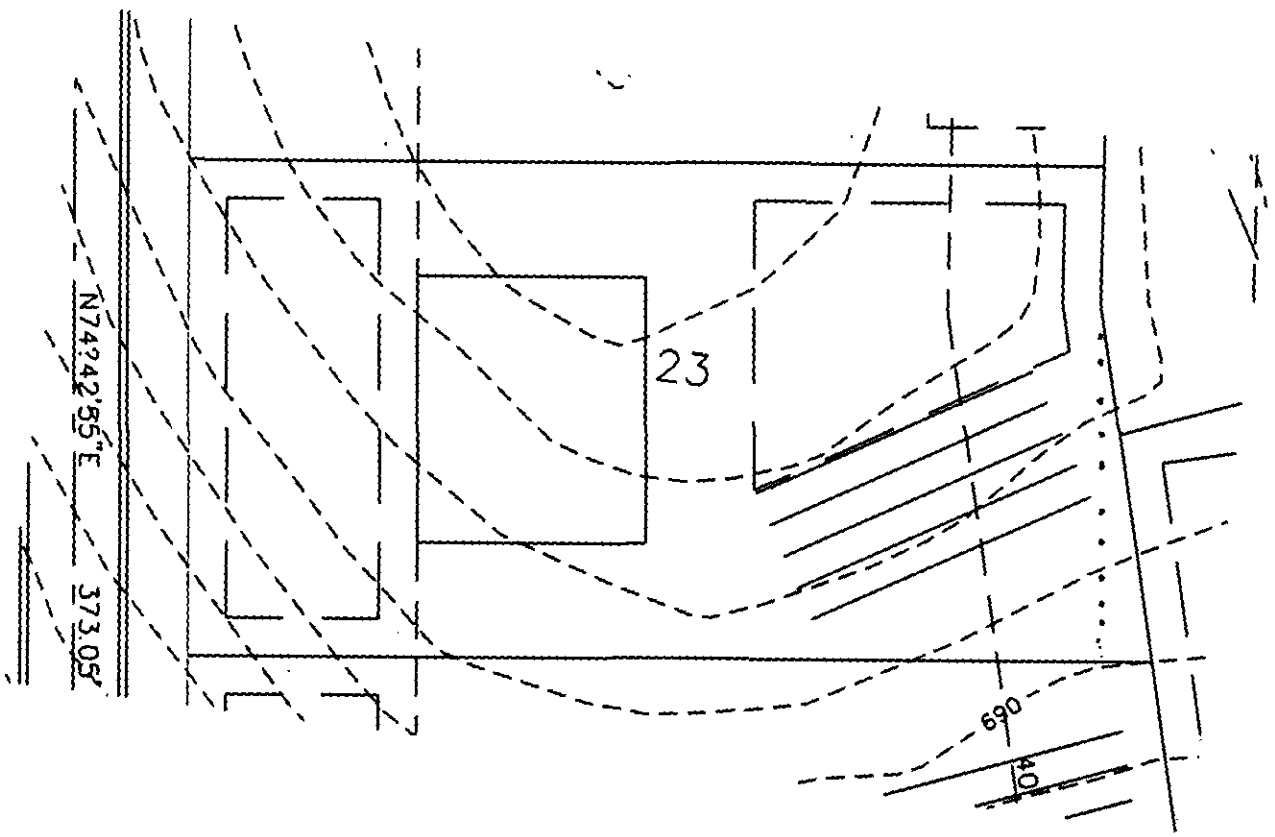


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 64/96B

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

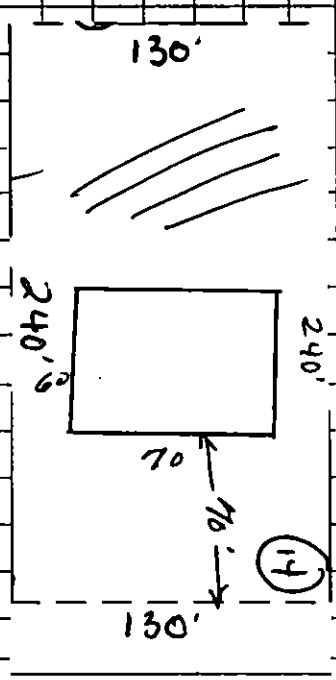

OWNER/AGENT SIGNATURE

DATE

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

Supervisor/Administrative Professional Checklist

New Septic ☑ **New Well** ☐ **Use Existing** ☐ **Alteration** ☐ **Modified Plot Plan** ☐

New Septic Fees Paid:

IP ($250.00) pd _____ Initials/Date

CA ($200.00) lwa 9/25/14 Initials/Date

OP ($200.00) lwa 9/25/14 Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 _____ Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid)_____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☐ Reviewed ☑ JAM 9/2/14

Please generate CA if fees have been paid.

This site is served by septic and well. Verify each is complete before final hold is released. ☐

Septic file completed. ☐ _____ Well file completed. ☐ _____

Send permit for signature. ☑ Signature received. ☐ _____

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: _____ WASPS App #: _____

Primary ES assigned to project: _____

Secondary ES assigned to project: _____

Project Type: New System ☑ Alteration ☐ Repair ☐ Modified Plot Plan ☐

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☐	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☑	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☑	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☑	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☑	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☑	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: 4			
	Were sufficient auger borings made?	Yes ☑	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR 0.3 initial . 225 repair	Yes ☑	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☑	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☑	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☑	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☑	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☑	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☑	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☑	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☑	No ☐	N/A ☑
130A-336(a)(1)	Property line lengths shown?	Yes ☑	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☑	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

Brad redrew plot plan because original would not work

IA issued date: 8/29/14

OP issued date: 10/2/14

Review performed by: JAM Date performed: 10/5/14

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 09/25/14
Receipt #: 90892
Check / Auth #: CHARGE
Received By: SADERLW

Amount: 200.00
Tendered: 200.00
Returned: 0.00

Account Information

Account #: X43281
Contractor: KNOTTS BUILDERS
Attn:
Address: P O BOX 687
Address:
City/State/Zip: PINEVILLE, NC 28134

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Septic Operational Permit 8216 CURICO LN, LOT 23		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
393.71	702.61				

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	09/25/14	**Amount:**	200.00
Receipt #:	90893	**Tendered:**	200.00
Check / Auth #:	CHARGE	**Returned:**	0.00
Received By:	SADERLW		

Account Information

Account #: X43281
Contractor: KNOTTS BUILDERS
Attn:
Address: P O BOX 687
Address:
City/State/Zip: PINEVILLE, NC 28134

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Septic Construction Authorization 8216 CURICO LN, LOT 23		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
593.71	702.61				

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30000812** GWS File #: **6496B** Tax Parcel #: **197-131-05** ~~05~~ 34

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 10/27/2011

Type of Installation: Residential - New System Lot Number: 14

Structure Type: HOUSE Size (ft^2): 0 # Bedrooms: 4 # Occupants: 3

Building Foundation: Crawl Space Water Supply: Municipal

II. Initial System Type: Innovative or Experimental **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	30	Depth of Media (in):	N/A	Distribution Device:	Drop Tees		

III. Repair System Type: Innovative or Experimental **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.275	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1309	Total Trench Length (ft):	436
Maximum Trench Depth (in):	30	Depth of Media (in):	N/A	Distribution Device:	Drop Tees		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: David Cornelius Owner/Legal Agent: _____
Print Name

Signature: _____ Signature: _____

Date Issued: 10/27/2006

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30000812** GWS File #: **6496B**

IV. Permit Conditions/Comments:

- Owner agreement forms for site reclassification shall be on file prior to issuance of Construction Authorization.
- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: David Cornelius

Signature: _____

Date Issued: 10/27/2006

Owner/Legal Agent: _____
Print Name

Signature: _____

On-site Wastewater Improvement Permit Diagram
PARCEL #: 197-131-34
WAPSPS APPLICATION #: 30000812
GWS File # 6496B



Authorized Agent: _____ 6/5/14

X Owner/Legal Agent: _____