SUPERVISOR/ADMINISTRATIVE PROFESSIONAL CHECKLIST

NEW SEPTIC ☐ NEW WELL ☐ USE EXISTING ☐ MODIFIED PLOT PLAN ☐

New Septic Fees Paid

IP ($250.00) _____ Initial/Date

CA ($200.00) _____Initial/Date

OP ($200.00) _____Initial/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fees Paid: $550.00 _____ Initial/Date

Use Existing Fees Paid: $100.00 _____Initial/Date

Alteration Fees Paid: $300 Total $200 3/14/22 LE Initial/Date (If use existing was part of payment)

Modified Plot Plan Fees Paid: $100.00 _____Initial/Date

Generate CA / Approve As Noted AB

Floor plans need to be submitted and reviewed before CA can be issued ☒ Review ☐

This site is served by septic and well. Verify each is complete before final hold is released ☐

Septic file complete ☒ 5/25/23 Well complete ☐ _____

All holds can be released.

Send permit for signature ☒ Signature received ☐ 3/29/22

This septic system requires a certified operation contract before final hold is released ☐

Certified operator contract is on file ☐ _____

Groundwater & Wastewater Services: Septic Project File & D

GWS File #:	7994B
WASPS App #:	12951
Primary ES assigned to project:	Heather
Secondary ES assigned to project:	
Project Type:	Alteration
Site Evaluation Information: .1939(a)(1) - Topography and Landscape Position Recorded?	Yes
Site Evaluation Information: .1940(a-g) - Slope % Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Texture Class Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Structure Type Recorded?	Yes
Site Evaluation Information: .1939 (a)(2) - Consistence Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Mineralogy Recorded?	Yes
Site Evaluation Information: .1939(a)(3) - Soil Wetness Condition Recorded?	Yes
Site Evaluation Information: .1939(a)(4) - Soil Depth to Rock or Parent Material Recorded when Encountered?	Yes
Site Evaluation Information: .1939(a)(5) - Depth to Restrictive Horizons Recorded when Encountered?	Yes
Site Evaluation Information: .1939(a)(6) - Sufficient Available Space Recorded?	Yes
Site Evaluation Information: .1937(m) - Are the Profile Locations Shown?	Yes
Site Evaluation Information: .1939(a) - Are the S/PS Profiles in system & in repair area?	Yes
Site Evaluation Information: .1939(d), .1955, .1956, .1957 - LTAR	Yes
Improvement Permit/Construction Authorization: .1937(g), 130A-336(a) - Proposed System Type stated - Initial	Yes
Improvement Permit/Construction Authorization: .1945(b) - Proposed System Type stated - Repair	Yes
Improvement Permit/Construction Authorization: 130A-336(a)(3) - System location identifiable by setbacks - Initial	Yes
Improvement Permit/Construction Authorization: .1937(g), .1945(b) - System components shown - Initial	Yes
Information Permit/Construction Authorization: .1945(b) - Repair area shown	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Does System design match facility, flow & WW characteristics?	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Is System design consistent with soil/site conditions?	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Is the System located in the approved area?	Yes
Improvement Permit/Construction Authorization: 130A-336(a) - Number of Bedrooms, employees, seats, etc. indicated?	Yes
Improvement Permit/Construction Authorization: .1937 (g) - Trench depth correct?	Yes
Improvement Permit/Construction Authorization: .1937(g) - Trench width correct?	Yes
Improvement Permit/Construction Authorization: .19379(g) - Trench length correct?	Yes

Improvement Permit/Construction Authorization: 130A-336(a)(1) - Proposed/existing well shown?	Yes
Improvement Permit/Construction Authorization: 130A-336(a)(1) - Property line lengths shown?	Yes
Improvement Permit/Construction Authorization: 130A-336(a) - Facility/appurtenance setbacks shown from fixed points?	Yes
Corrections/modifications needed?	Yes
Comments:	Alteration for a new 4 bedroom house.
IA issued date:	
OP Issued date:	
Review performed by:	Michelone
Date performed:	3/28/2022

Created at 3/28/2022 8:38 AM by Michelone, Jeremy
Last modified at 3/28/2022 8:38 AM by Michelone, Jeremy

Close

X41963 !

14 MAR '22 AM 9:55

7994B # 12951

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ○ NEW SYSTEM ● ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ○ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 01304216
STREET ADDRESS: 12720 Allison Ferry Rd
CITY: Huntersville
STATE: NC ZIP: 28078
SUBDIVISION NAME: _____
LOT #: _____ LOT SIZE (acres): _____
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ● HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
● HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 3091
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 4
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
● CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A
NUMBER OF BEDROOMS TO BE ADDED: 1 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ○ MUNICIPAL ● PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ● OTHER Existing Well

7. PROPOSED USE OF WELL: ○ N/A ○ IRRIGATION ● POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE (1-MOST DESIRED 5-LEAST DESIRED):
☐ N/A [3] ANY TYPE [1] CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE [2] ALTERNATIVE ☐ OTHER _____

8A. RANK: 1 2 3 ___ ___

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ● NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ● NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	● YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ● NO
WELLS, SPRINGS, OR WATER LINES	● YES ○ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ● NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ● NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ● NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ● NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ● NO
WASTE STORAGE	○ YES ● NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ● NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☑ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☑ N/A

12. PROPERTY OWNER:
NAME: Justin Foster
ADDRESS: 12700 Allison Ferry Rd
CITY: Huntersville
STATE: NC ZIP: 28078
WORK PHONE: 610-715-9501
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: Burt Ward's Homes of Distinction Inc
ADDRESS: 345 Jericho Rd
CITY: Harmony
STATE: NC ZIP: 28634
WORK PHONE: 704-999-5179
MOBILE PHONE: _____
FAX: _____
E-MAIL: hod724@gmail.com

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

BBW (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

B Ward
Property Owner's or Owner's Legal Representative Signature

3-14-22
Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

File #: _____

PROPOSED PLOT PLAN


A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 12720 Allison Ferry Rd Huntersville NC 28078

Tax Parcel #: _____

Subdivision Name: _____

Lot #: _____

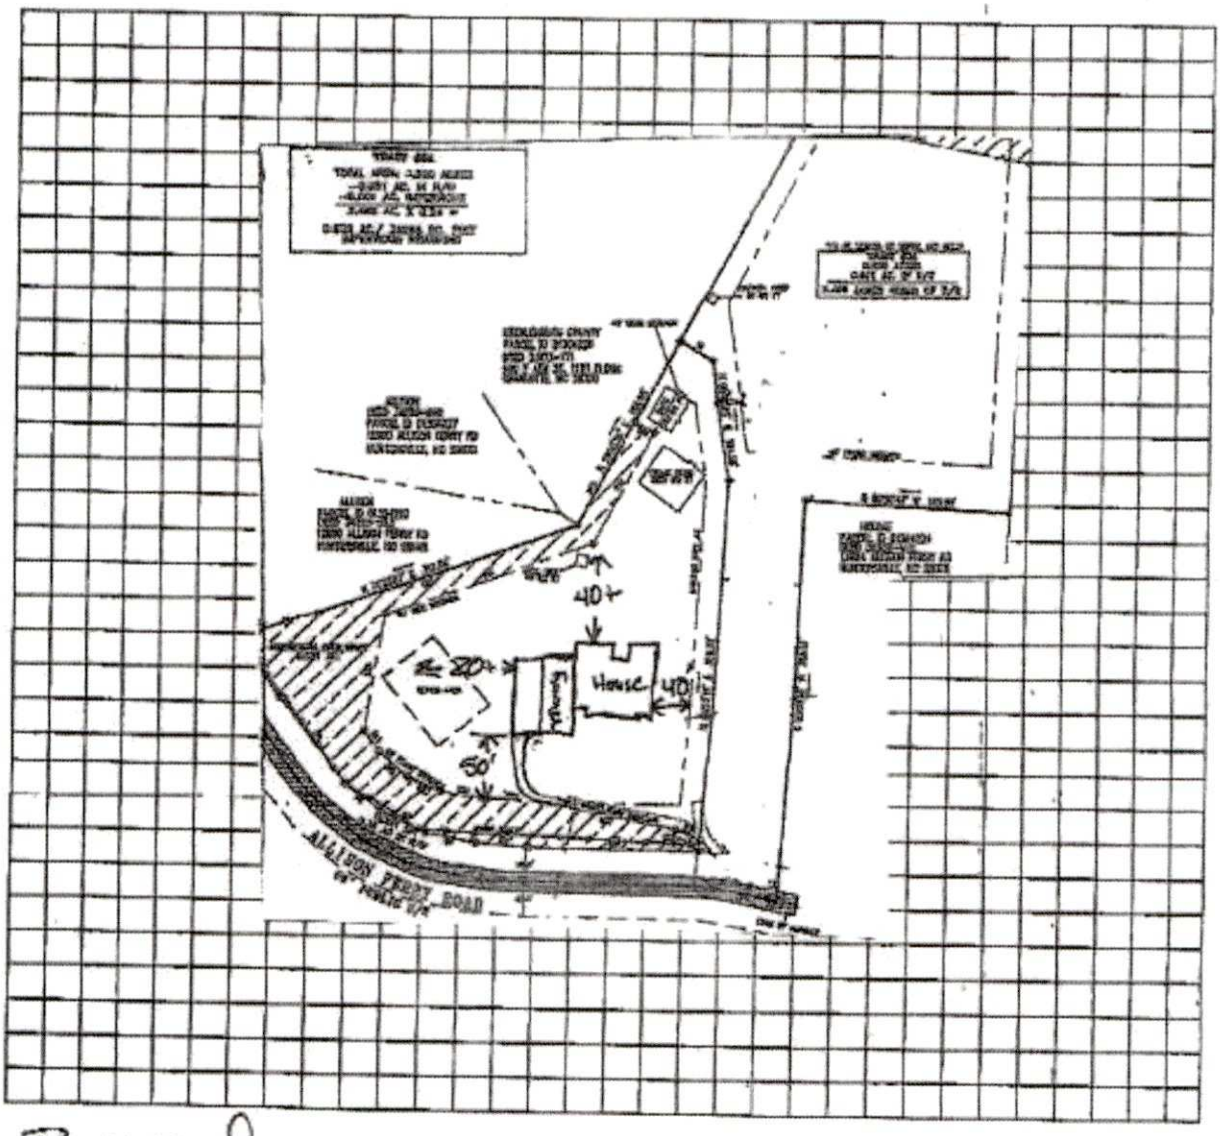

B Ward

Property Owner's or Owner's Legal Representative Signature

3-14-22

Date

MECKLENBURG COUNTY
Health Department

Gibbie Harris, MSPH, BSN
Director

(980) 314-9020

Addendum to Application for
New Well or Septic System Installation
Abandonment or Repair of Existing Well or Septic System

Your signature below confirms the following:

1. The information on the application is true, complete and accurate.
2. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliances with applicable laws and rules.
3. I acknowledge that Burt Ward is acting as my legal representative (agent) in the submittal of the application for a water supply well or septic permit located at

12720 Allison Ferry Rd Huntersville
Number Street Town
(Or Parcel Number)

Wanda V Foster
Property Owner (print name)

Property Owner (signature)

March 14, 2022
Date

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	03/14/22	**Amount:**	300.00
Receipt #:	134674	**Tendered:**	300.00
Check / Auth #:	CHARGE	**Returned:**	0.00
Received By:	ELLISLW		

Account Information

Account #: X41963
Contractor: WARD'S HOME OF DISTIN INC BURT
Attn:
Address: 343 JERICHO ROAD
Address:
City/State/Zip: HARMONY, NC 28634

Item	Description	Permit#	Quantity	Unit Price	Total Price
0706	Septic Alteration Permit 12720 ALLISON FERRY RD		1	300.00	300.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
300.00					

Division of Environmental Health
On-site Wastewater Section

Property ID: 01304216
Lot #: NA
File #: 7994b
AppID: 12765

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Property Owner: Justin Foster
Applicant: Owners
Address: 12720 Allison Ferry Road
Date Evaluated: 3/21/22
Proposed Facility: 1 bedroom addition
Design Flow (.1949): 120 GPD
Property Size:
Location of Site:12720 Allisoin Ferry Road
Property Recorded:
Water Supply: [ ] Public [X] Individual [X] Well [ ] Spring [ ] Municipal
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
	LS	0 - 6	Fill	SS SP FR SEXP						PS IV	
#1	4%	6-48	sbk C	S P FR SEXP	>48"	48	NA	NA		0.3	36"
	LS	0 - 5	sbk CL	SS SP FR SEXP							
#2	4	5-48	sbk C	S P FR SEXP	>48'	48	NA	NA		PS IV 0.3	36"

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	IIIg	IIIg
Site LTAR (gpd/sq ft)	**0.3**	**0.3**

Other Factors (.1946):
Soil Evaluation By: Heather Ray
Others Present:
Site Classification (.1948): Provisionally Suitable
Site Evaluation By: Heather Ray
Others Present:

COMMENTS:

Landscape Position
R-Ridge
SS-Shoulder Slope
LS-Linear Slope
FS-Foot Slope
NS-Nose Slope
HS-Head Slope
CC-Concave Slope
CV-Convex Slope
T-Terrace
FP-Flood Plain
D-Drainage Way

Group	Texture	.1955 LTAR
I	S-Sand	1.2 - 0.8
	LS-Loamy Sand	
II	SL-Sandy Loam	0.8 - 0.6
	L-Loam	
III	Si-Silt	0.6 - 0.3
	SiCL-Silty Clay Loam	
	CL-Clay Loam	
	SCL-Sandy Clay Loam	
	SiL-Silt Loam	
IV	SC-Sandy Clay	0.4 - 0.1
	SiC-Silty Clay	
	C-Clay	

Structure
sg-Single Grain
mass-Massive
cr-Crumb
gr-Granular
sbk-Subangular Blocky
abk-Angular Blocky
pl-Platy
pr-Prismatic
Sap-Saprolite

Structure Prefixes

w-weak
m-moderate
s-strong
f-fine
m-medium
c-coarse

Consistence
Moist

VFR-Very Friable
FR-Friable
FI-Firm
VFI-Very Firm
EFI-Extremely Firm

Consistence
Wet

SS-Slightly Sticky
S-Sticky
VS-Very Sticky
NP-Non-Plastic
SP-Slightly Plastic
P-Plastic
VP-Very Plastic

Mineralogy

SEXP-Slightly Expansive
EXP-Expansive

Classification

US-Unsuitable
PS-Provisionally Suitable
S-Suitable
NA-Not Applicable

Sketch of Soil Evaluation Locations



Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr., Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1650 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30012951 GWS File #: 7994B Tax Parcel #: 013-042-16

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 3/23/2027

Type of Installation: Residential - Alteration Lot Number: 0

Structure Type: HOUSE Size (ft^2): 3091 # Bedrooms: 4 Max. Occup.: 8

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Accepted **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	120	LTAR (gpd/ft^2):	0.5	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	300	Total Trench Length (ft):	100
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

III. Repair System Type: Accepted **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Heather Ray

Signature: [signature]

Date Issued: 3/23/2022

Owner/Legal Agent: Burt Ward
Print Name

Signature: B Ward

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr., Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30012951 GWS File #: 7994B

IV. Permit Conditions/Comments:

- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- The septic system shall be located at least 10 feet from any foundation drain.
- All components of the septic system must be located at least 100 ft. from all private wells.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions.

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN
- This IMPROVEMENT PERMIT is transferable

Authorized Agent: Heather Ray


Signature: [signature]

Date Issued: 3/23/2022

Owner/Legal Agent: Burt Ward
Print Name

Signature: B Ward

On-site Wastewater Improvement Permit Diagram

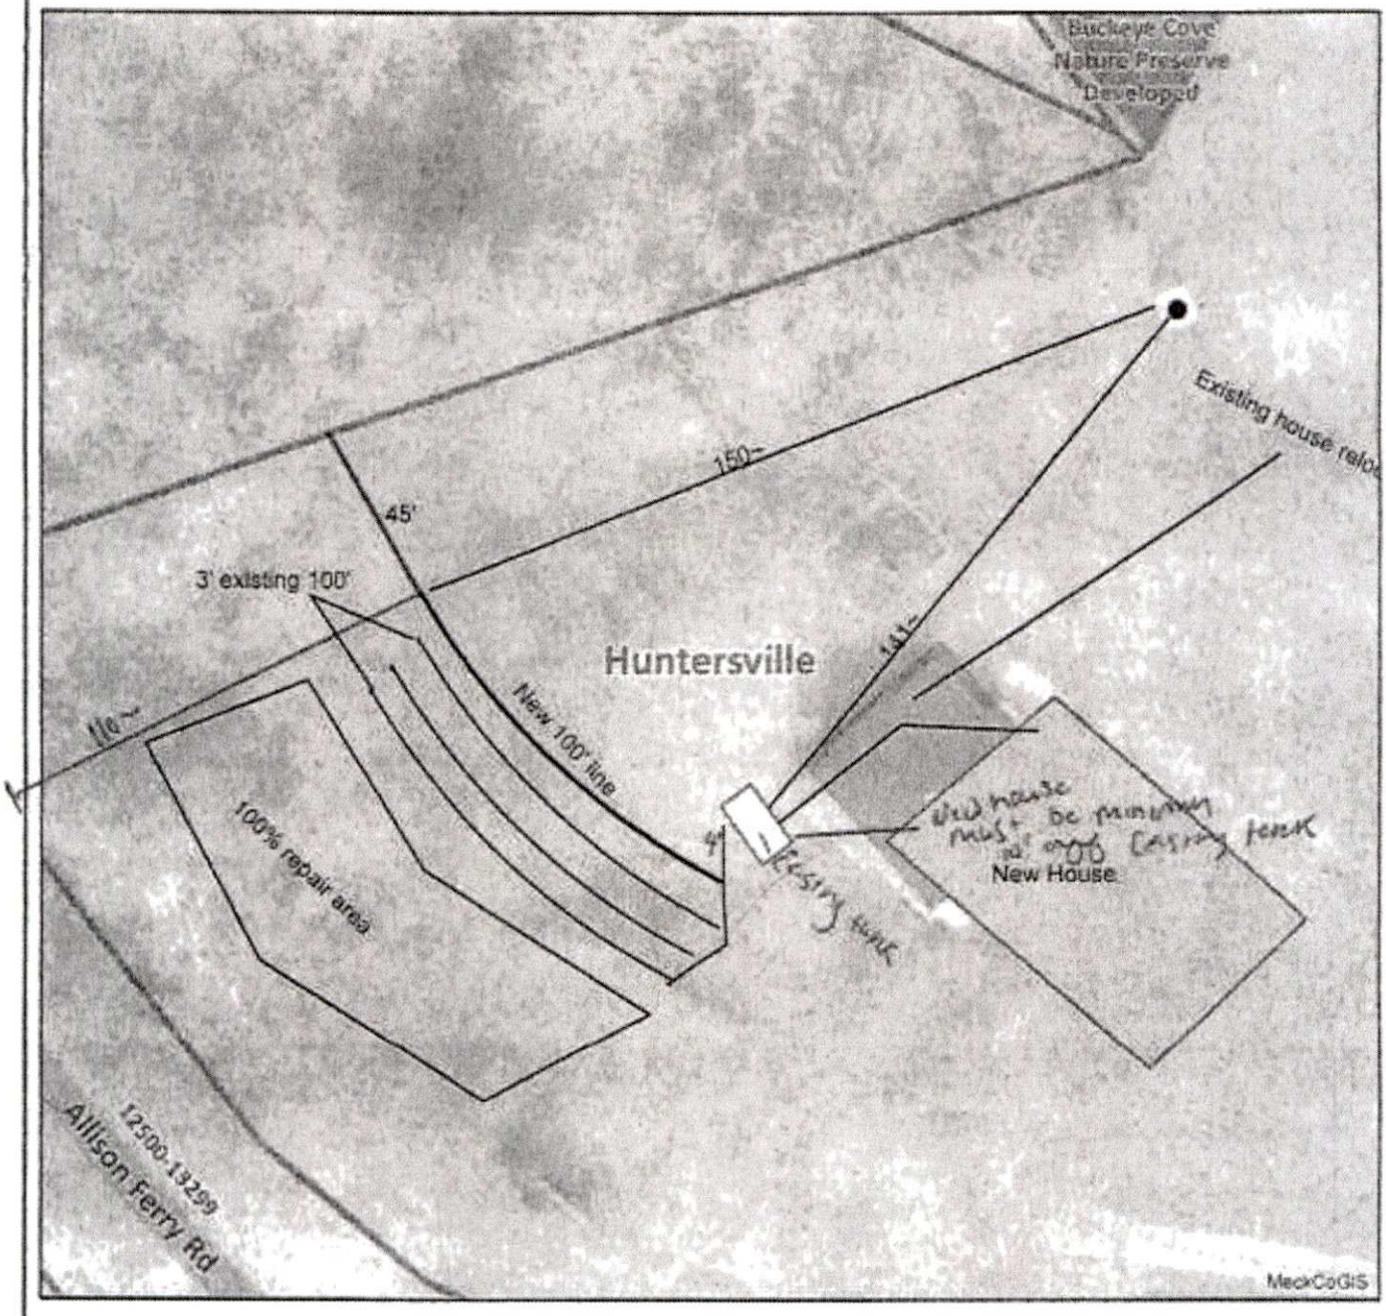

Mecklenburg County Health Department
Environmental Health - Groundwater and Wastewater Services

Permit #:30012951
PID #:01304216
File #:7994B

Authorized Agent: Heather Ray Date: 3/23/2022

Owner/ Legal Agent: B Ward Date: 3/29/22

1 inch = 40 feet

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr., Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30012951** GWS File #: **7994B** Tax Parcel #: **013-042-16**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 3/23/2027

Type of Installation: Residential - Alteration Lot Number: 0

Structure Type: HOUSE Size (ft^2): 3091 # Bedrooms: 4 Max. Occup.: 8

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Accepted **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	120	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	300	Total Trench Length (ft):	100
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

III. Repair System Type: Accepted **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	480	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1200	Total Trench Length (ft):	400
Maximum Trench Depth (in):	36	Depth of Media (in):	12	Distribution Device:	Drop Boxes		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Heather Ray Owner/Legal Agent: _____
Print Name

Signature: _____ Signature: _____

Date Issued: 3/23/2022

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr., Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30012951** GWS File #: **7994B**

IV. Permit Conditions/Comments:

- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.
- The septic system shall be located at least 10 feet from any foundation drain.
- All components of the septic system must be located at least 100 ft. from all private wells

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Heather Ray


Signature: _____

Date Issued: 3/23/2022

Owner/Legal Agent: _____
Print Name

Signature: _____

On-site Wastewater Improvement Permit Diagram

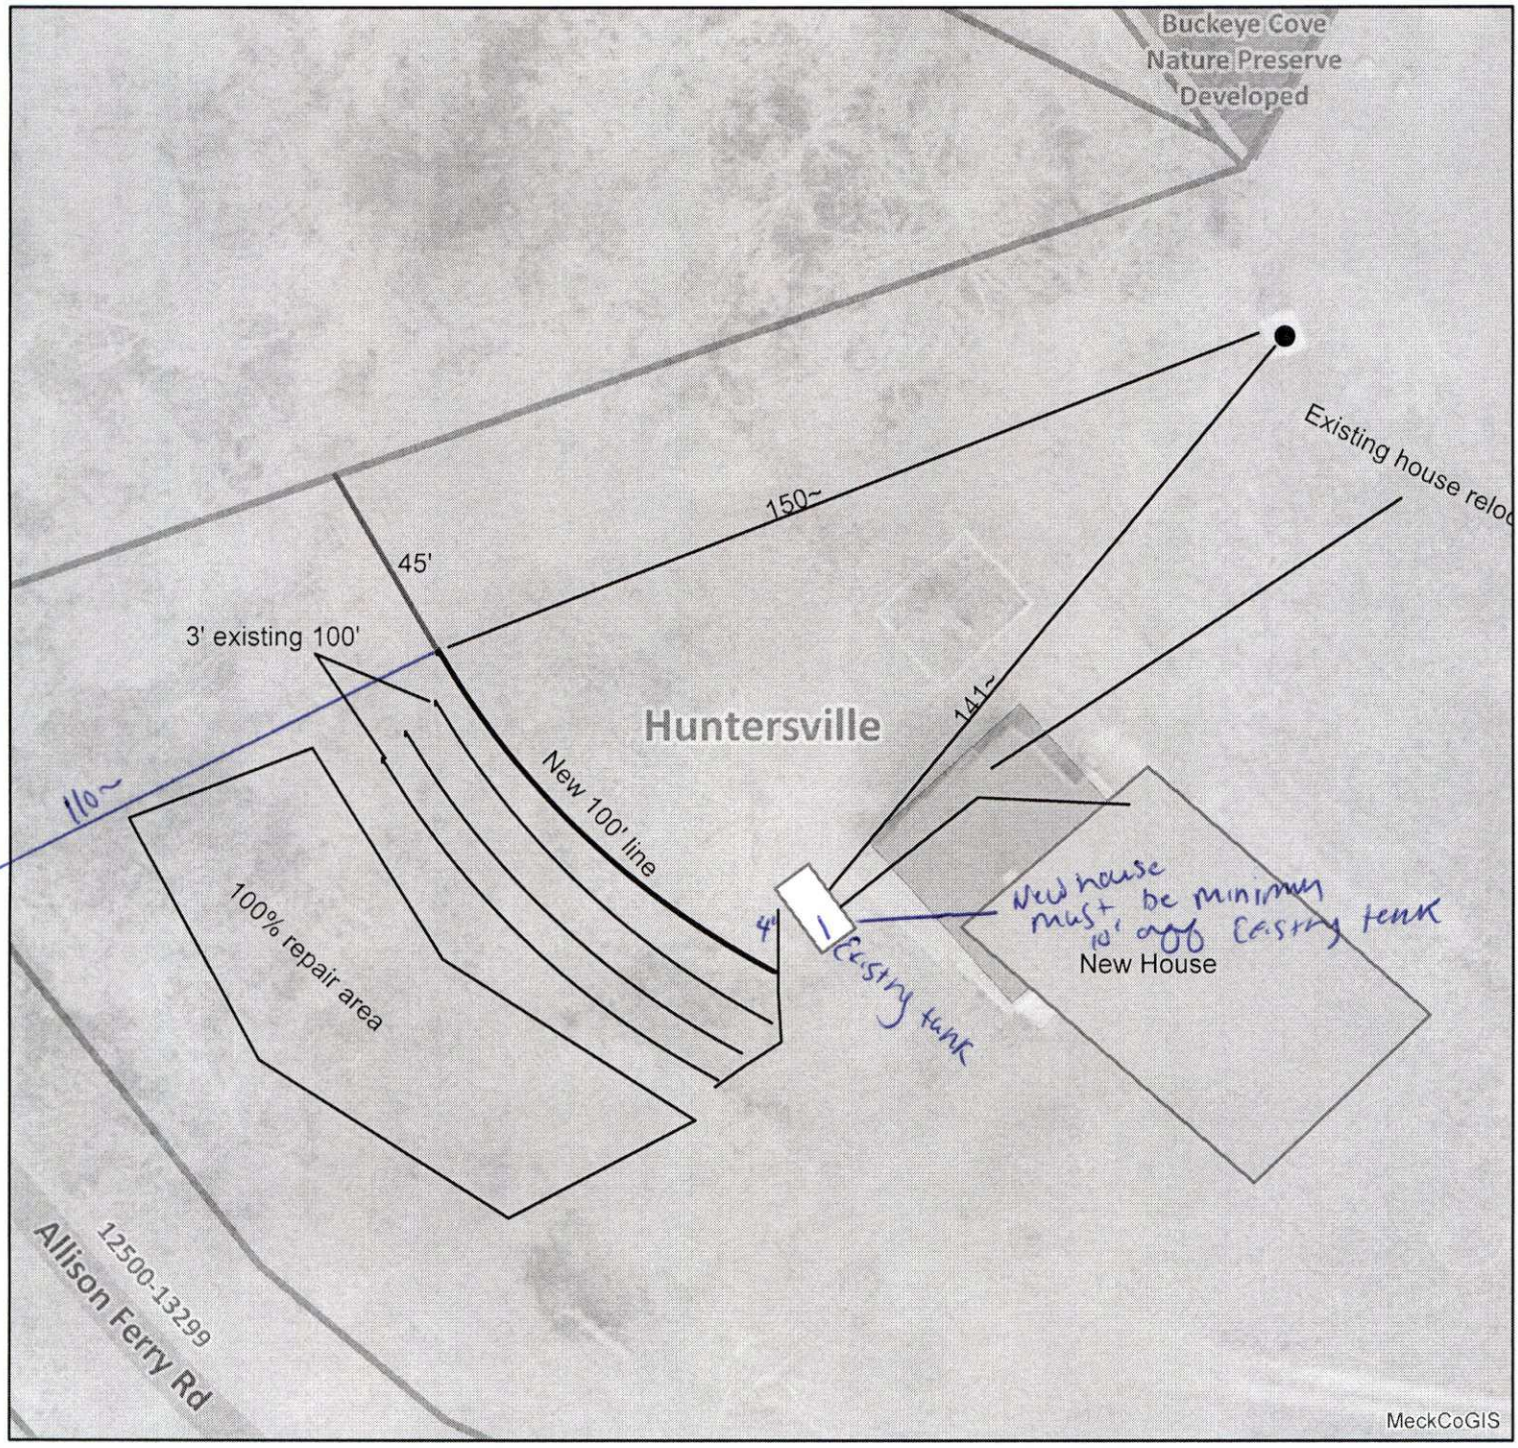

Mecklenburg County Health Department
Environmental Health - Groundwater and Wastewater Services

Permit #:30012951
PID #:01304216
File #:7994B

Authorized Agent: Heather Ray Date: 3/23/2022

Owner/ Legal Agent: _____ Date: _____

1 inch = 40 feet

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7994B Permit #: 8720 Tax Parcel #: 013-042-16

Property Owner: Marc Ritz

Job Location Address: 12726 Allison Ferry Road

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: 3/6/17 Contractor Name: Larry Hinkle

Permitted Design Flow: 360 GPD Liquid Capacity of Dosing Tank: — gallons

Liquid Capacity of Septic Tank: existing 1500 gallons Manufacture Bellinger Effluent Pump Model: —

Drainfield Installation ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 100 feet

# of Lines: 1 @ 100 feet

Depth of Media: 12 inches (Type) I&A w

Depth of Cover: 18 inches

Distribution Device: END-CAP

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 10' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: 150' feet


Inspection Dates

Tank(s) Inspected: —

Excavation Inspected: 3/6/17

Pump & Controls Inspected: —

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

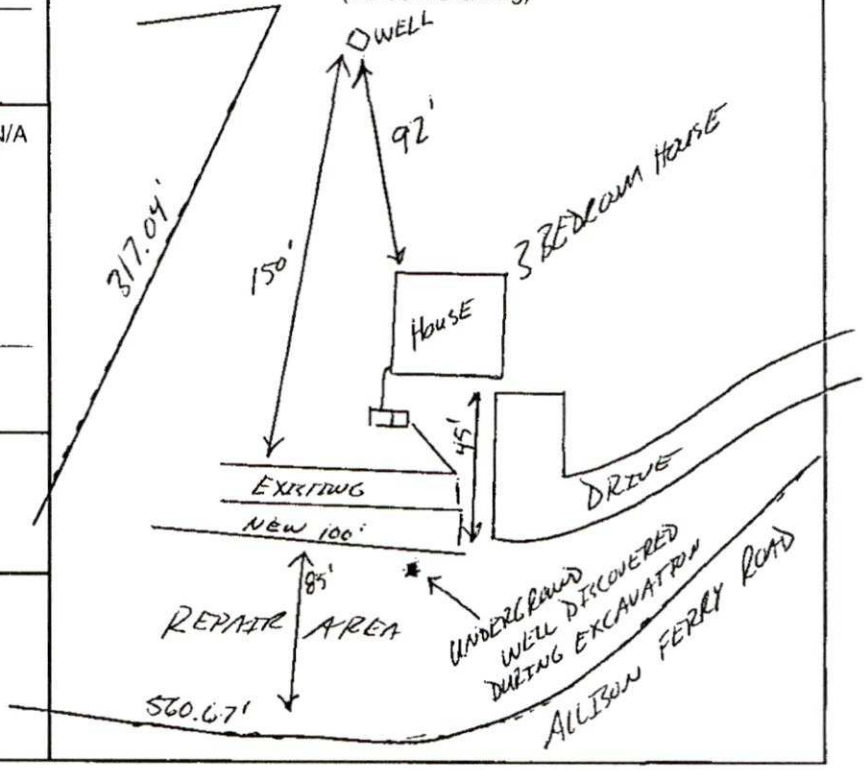

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☒ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: III-g, County, I&A w, NA, NA

* WELL MUST BE ABANDONED IMMEDIATELY w/ Proper Permits

DHHS Authorized Agent: Tommy Mickle, REHS Signature: Tommy Mickle, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7994B Permit #: 4108 Tax Parcel #: 013-042-16

Property Owner: Randy Greene

Job Location Address: 12720 Allison Ferry Road

City: Huntersville State: NC Zip Code: 28078

Installation Approval Issuance Date: 3/16/09

Permission is hereby given to ☐ install ☐ alter ☒ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 4/16/09, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 240 GPD Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons Liquid Capacity of Dosing Tank: ——— gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 200 feet

# of Lines: 2 @ 100 feet

Depth of Media: 12 inches (Type) 25% Rock

Distribution Device: D-Box

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: >5' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >100' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

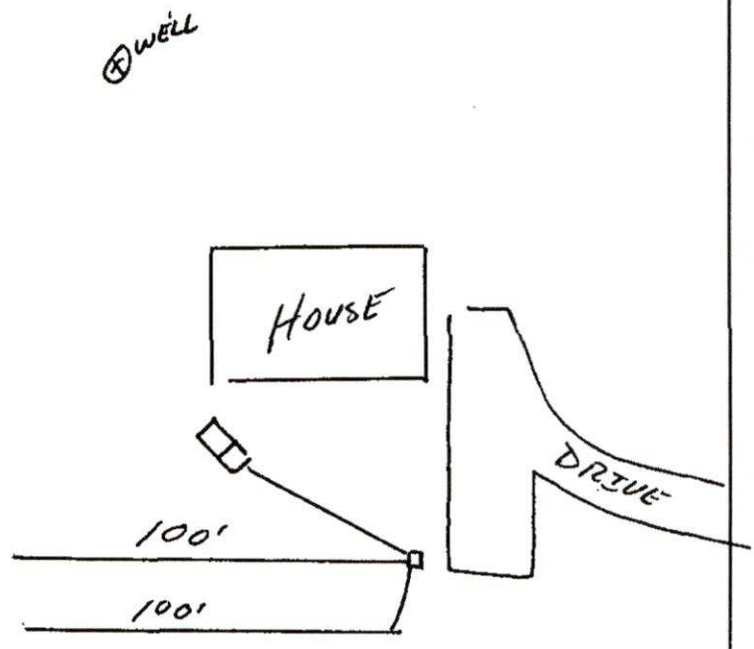

Comments: System Classification & Type: IIIg 25% Rock Repair

DENR Authorized Agent: Jeremy Mickelson R.S. Signature: Jeremy Mickelson, R.S.

FEE: 200.00

DATE: 4/25/2022

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 7994B

PERMIT NUMBER: 7994B

PARCEL NUMBER: 01304216

JOB LOCATION INFORMATION

ADDRESS: 12720 ALLISON FERRY RD

CITY: HUNTERSVILLE **STATE: NC** **ZIP:** 28078

ISSUED TO: JUSTIN FOSTER

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 4/25/2022

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30012951, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. A PRE-CONSTRUCTION MEETING MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A LICENSED SEPTIC TANK CONTRACTOR WITH THE NORTH CAROLINA ONSITE WASTEWATER CONTRACTOR INSPECTOR CERTIFICATION BOARD.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, AND MAY BE ISSUED AT THE SAME TIME THE IMPROVEMENT PERMIT IS ISSUED.

Authorized Agent Signature _____

3205 Freedom Dr. Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

Septic System Pre-Construction Meeting Checklist

File # 7994B App# 12951 Tax Parcel# 01304216

Property Owner: JUSTIN & DANIELLE FOSTER

Job Location Address: 12720 ALLISON FERRY RD

City: Huntersville State: NC Zip Code: 28078

1. Does System design match facility, flow & wastewater characteristics?

   ☑ YES ☐ NO

   Comments: _____

2. Is there sufficient available space for the septic systems initial and repair areas?

   ☑ YES ☐ NO

   Comments: _____

3. Can the septic system be installed per the permit conditions and drawing on file?

   ☑ YES ☐ NO

   Comments: _____

*If "NO" is checked for any of the above the existing permit may need to be revoked.

Permission is hereby given to ☑ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. **System shall not be installed while soils are in wet condition.**

Heather A Ray
Authorized Agent

5/10/2023
Date

Others Present

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr. Suite 8000, Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7994B Permit #: 12591 Tax Parcel #: 01304316

Property Owner: Justin & Danielle Foster

Job Location Address: 12720 Allison Ferry Rd

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: 4/21/23 Contractor Name: Lentz Septic

Permitted Design Flow: 480 GPD Liquid Capacity of Dosing Tank: _____ gallons

Liquid Capacity of Septic Tank: Existing gallons Tank Manufacture Existing Effluent Pump Model: NA

Drainfield Installation ☐ N/A

Trench Depth: 36" inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 100 feet

# of Lines: 1 @ 100 feet 3 existing lines

Depth of Media: 12 inches (Type) CHM 36

Depth of Cover: 12 inches

Distribution Device: End Cap to End Cap

Bed Installation *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 45' feet

Distance from Property Line: 10+ feet

Distance from Water Supply Source: 150 feet


Inspection Dates

Tank(s) Inspected: NA

Excavation Inspected: 4/21/23

Pump & Controls Inspected: _____

SKETCH OF SYSTEM INSTALLATION

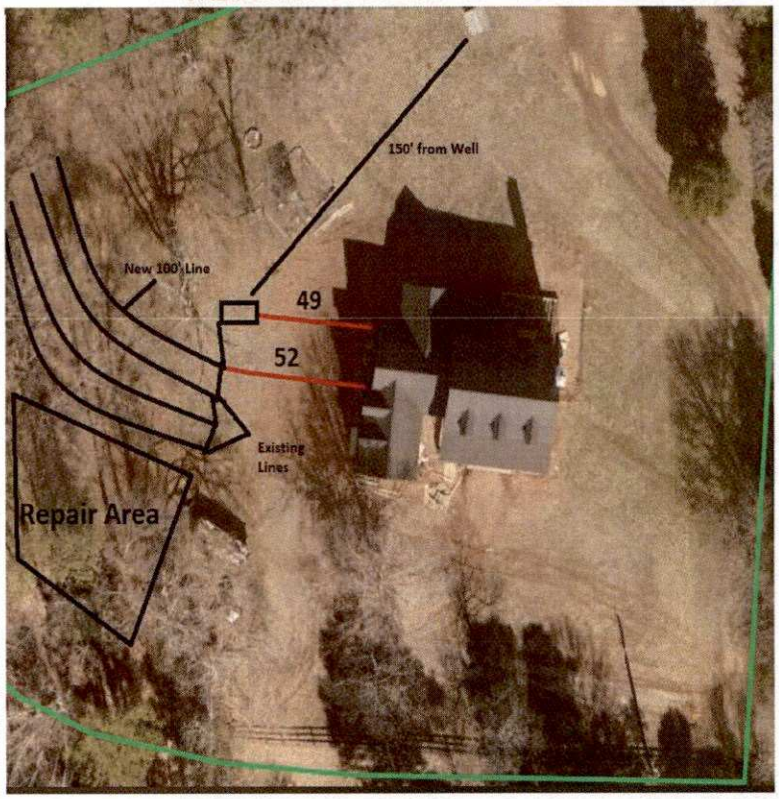

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☑ installed ☐ altered ☐ repaired ☑ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIb/CHM36/g/Na/NA

DENR Authorized Agent: Heather Ray Signature: Heather Ray

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr. Suite 8000, Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 7994b Permit #: 12591 Tax Parcel #: 01304316

Property Owner: Justin & Danielle Foster

Job Location Address: 12720 Allison Ferry Rd

City: Huntersville State: NC Zip Code: 28078

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIG

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☑

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☑ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Heather Ray Date: 5/16/23

Signature: Heather Ray