Supervisor/Administrative Professional Checklist.

New Septic ☐ New Well ☐ Use Existing ☐ Alteration ☐ Modified Plot Plan ☐

☒ Repair

New Septic Fees Paid:

IP ($250.00) _____ Initials/Date

CA ($200.00) _____ Initials/Date

OP ($2.00.00) _____ Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 _____ Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was pa[illegible] _____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued ☐ Reviewed ☐ _____

This site is served by septic and well. Verify each is complete before final hold is released ☐

Septic file completed ☐ _____ Well file completed ☐ _____

Send permit for signature ☒ Signature received ☒ _____

This septic system requires a certified operator contract before final hold is released ☐

Certified operator contract is on file ☐ _____

O.K. to scan / Completed

Groundwater & Wastewater Services: Septic Project File & D

GWS File #:	10134B
WASPS App #:	9961
Primary ES assigned to project:	Kim Garrett
Secondary ES assigned to project:	
Project Type:	Repair
Site Evaluation Information: .1939(a)(1) - Topography and Landscape Position Recorded?	N/A
Site Evaluation Information: .1940(a-g) - Slope % Recorded?	N/A
Site Evaluation Information: .1939(a)(2) - Texture Class Recorded?	N/A
Site Evaluation Information: .1939(a)(2) - Structure Type Recorded?	N/A
Site Evaluation Information: .1939 (a)(2) - Consistence Recorded?	N/A
Site Evaluation Information: .1939(a)(2) - Mineralogy Recorded?	N/A
Site Evaluation Information: .1939(a)(3) - Soil Wetness Condition Recorded?	N/A
Site Evaluation Information: .1939(a)(4) - Soil Depth to Rock or Parent Material Recorded when Encountered?	N/A
Site Evaluation Information: .1939(a)(5) - Depth to Restrictive Horizons Recorded when Encountered?	N/A
Site Evaluation Information: .1939(a)(6) - Sufficient Available Space Recorded?	N/A
Site Evaluation Information: .1937(m) - Are the Profile Locations Shown?	N/A
Site Evaluation Information: .1939(a) - Are the S/PS Profiles in system & in repair area?	N/A
Site Evaluation Information: .1939(d), .1955, .1956, .1957 - LTAR	N/A
Improvement Permit/Construction Authorization: .1937(g), 130A-336(a) - Proposed System Type stated - Initial	N/A
Improvement Permit/Construction Authorization: .1945(b) - Proposed System Type stated - Repair	N/A
Improvement Permit/Construction Authorization: 130A-336(a)(3) - System location identifiable by setbacks - Initial	Yes
Improvement Permit/Construction Authorization: .1937(g), .1945(b) - System components shown - Initial	N/A
Information Permit/Construction Authorization: .1945(b) - Repair area shown	N/A
Improvement Permit/Construction Authorization: .1937(f)(g) - Does System design match facility, flow & WW characteristics?	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Is System design consistent with soil/site conditions?	N/A
Improvement Permit/Construction Authorization: .1937(f)(g) - Is the System located in the approved area?	N/A
Improvement Permit/Construction Authorization: 130A-336(a) - Number of Bedrooms, employees, seats, etc. indicated?	Yes
Improvement Permit/Construction Authorization: .1937 (g) - Trench depth correct?	N/A
Improvement Permit/Construction Authorization: .1937(g) - Trench width correct?	N/A
Improvement Permit/Construction Authorization: .19379(g) - Trench length correct?	N/A
Improvement Permit/Construction Authorization: 130A-336(a)(1) - Proposed/existing well shown?	N/A

Improvement Permit/Construction Authori on: 130A-336(a)(1) - Property line lengths show	Yes
Improvement Permit/Construction Authori on: 130A-336(a) - Facility/appurtenance setbac shown from fixed points?	Yes
Corrections/modifications needed?	No
Comments:	Tank replacement only.
IA issued date:	3/26/2019
OP Issued date:	3/26/2019
Review performed by:	Jeremy Michelone, REHS
Date performed:	4/1/2019

Created at 4/1/2019 3:05 PM by Michelone, e y
Last modified at 4/1/2019 3:05 PM by Michelo Jeremy

Close

10134B
#9901

18 OCT '18 AM10:40

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ○ NEW SYSTEM ○ ALTERATION ◉ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ◉ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 04303920
STREET ADDRESS: 5308 Christenbury Rd
CITY: Charlotte
STATE: NC ZIP: 28269
SUBDIVISION NAME: none
LOT #: _____ LOT SIZE (acres): 0.83
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ◉ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
◉ HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 1020
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
◉ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☑ N/A
NUMBER OF BEDROOMS TO BE ADDED: n/a
NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ○ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ◉ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:
☐ N/A ☐ ANY TYPE ☒ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ◉ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ◉ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	◉ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ◉ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ◉ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ◉ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ◉ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ◉ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ◉ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ◉ NO
WASTE STORAGE	○ YES ◉ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ◉ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☐ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? 9/7/2018 ☐ N/A

12. PROPERTY OWNER:
NAME: Israel Dominguez & Rob Hunnefield
ADDRESS: 5295 Dudley St
CITY: Arvada
STATE: CO ZIP: 80002
WORK PHONE: _____
MOBILE PHONE: _____
FAX: _____
E-MAIL: _____

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: Sue Badman
ADDRESS: 1432 E Main St #154
CITY: Lincolnton
STATE: NC ZIP: 28092
WORK PHONE: _____
MOBILE PHONE: 704-472-1890
FAX: _____
E-MAIL: suebadman@reagan.com

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

Jim Edmonds — 9/21/18

Property Owner's or Owner's Legal Representative Signature — Date

---

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $_____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $_____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 5308 CHELSTENBURY Rd. Tax Parcel #: 04303920

Subdivision Name: _____ Lot #: _____

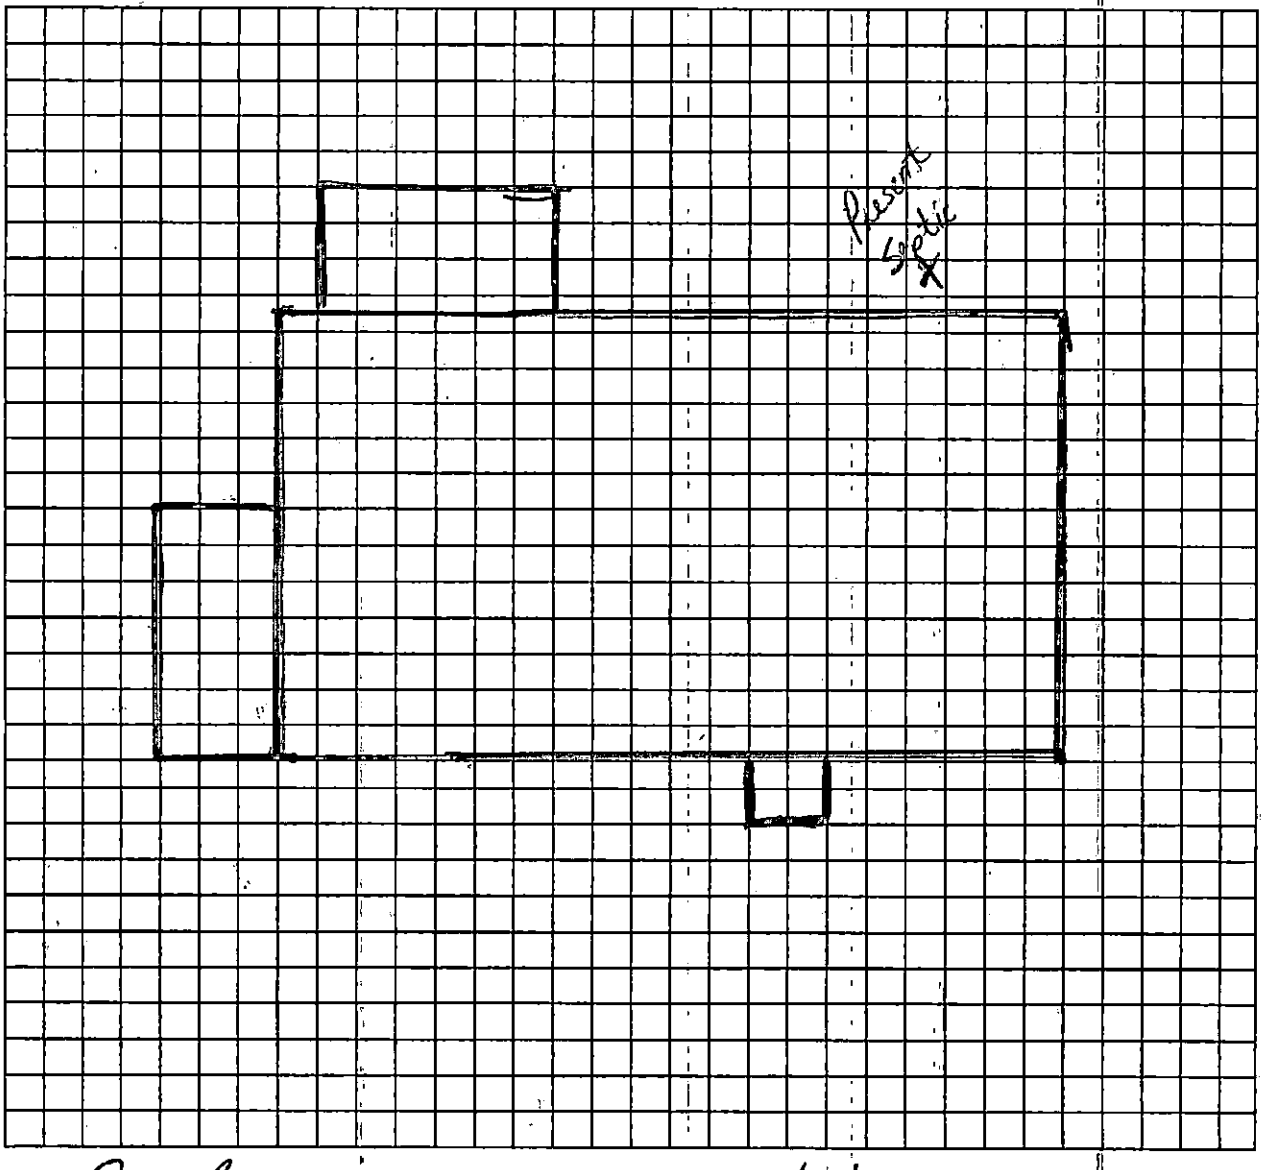

Property Owner's or Owner's Legal Representative Signature

9/21/18
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

DigiSign Verified: 9E6CD4E7-BE5C-4F01-9DD3-5838849ACA9B

MECKLENBURG COUNTY
Health Department

E. Winters Mabry, MD
Director

(704) 432-3199

Addendum to Application for
New Well or Septic System Installation
Abandonment or Repair of Existing Well or Septic System

Your signature below confirms the following:

1. The information on the application is true, complete and accurate.
2. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliances with applicable laws and rules.
3. I acknowledge that JULE BADMAN is acting as my legal representative (agent) in the submittal of the application for a water supply well or septic permit located at 5308 CHRISTENBURY RD CHARLOTTE.
   Number Street Town
   (Or Parcel Number)

ROBERT HUNNEFIELD
Property Owner (print name)

Robert Hunnefield
Property Owner (signature)

10-18-18
Date

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

Septic System Pre-Construction Meeting Checklist

File # 10134 B App # 9961 Tax Parcel # 043-039-20

Property Owner: Israel Dominguez, Robert Homefield

Job Location Address: 5308 Christenbury Rd

City: Charlotte State: NC Zip Code: 28269

1. **Does System design match facility, flow & wastewater characteristics?**

   ☒ YES ☐ NO

   Comments: _____

2. **Is there sufficient available space for the septic systems initial and repair areas?**

   ☒ YES ☐ NO

   Comments: _____

3. **Can the septic system be installed per the permit conditions and drawing on file?**

   ☒ YES ☐ NO

   Comments: _____

*** If "NO" is checked for any of the above the existing permit may need to be revoked.**

Permission is hereby given to ☐ install ☐ alter ☒ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. System shall not be installed while soils are in wet condition.

Kim Gareth REHS — **Authorized Agent**

3/26/19 — **Date**

Robbie Reay — **Others Present**

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 10134 B Permit #: 9961 Tax Parcel #: 043-039-20

Property Owner: Israel Dominguez & Robert Homefield

Job Location Address: 5308 Christenbury Rd

City: Charlotte State: NC Zip Code: 28269

Operation Permit Issuance Date: 3/26/19 Contractor Name: Robbie Ray #1159

Permitted Design Flow: 360 GPD Liquid Capacity of Dosing Tank: n/a gallons

Liquid Capacity of Septic Tank: 1000 gallons Manufacture Ray Effluent Pump Model: n/a

tank stamped 3/26/19

Drainfield Installation ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: >5 feet

Distance from Property Line: >10 feet

Distance from Water Supply Source: >10 feet city water line


Inspection Dates

Tank(s) Inspected: 3/26/19

Excavation Inspected: n/a

Pump & Controls Inspected: n/a

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

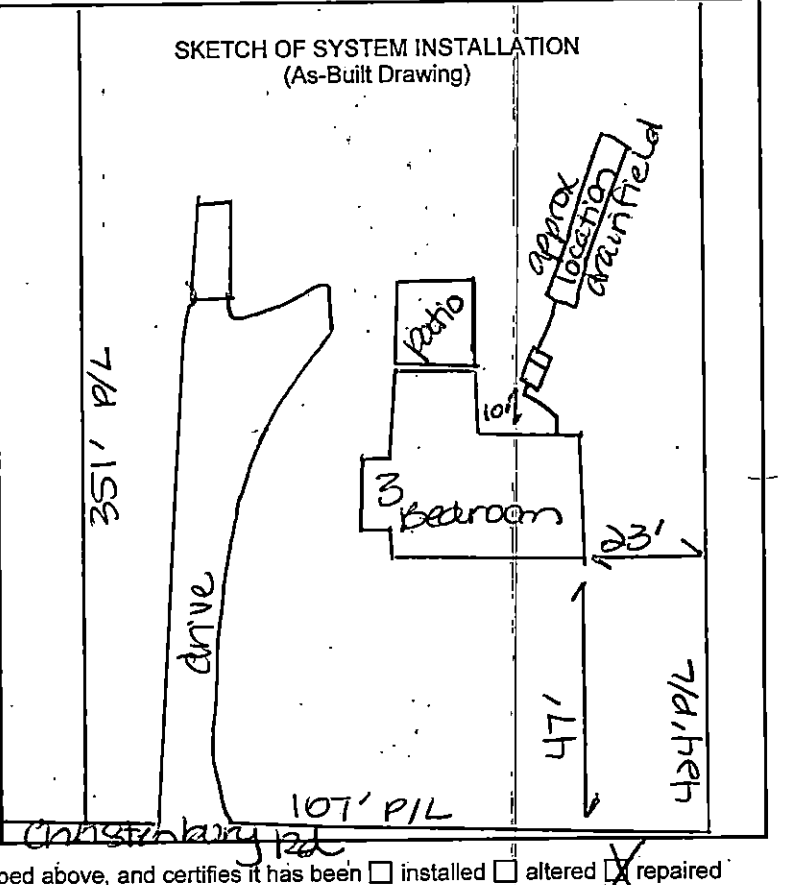

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☐ installed ☐ altered ☒ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: IIIa, gbd, gravity, n/a, n/a

Repair - installed new 1000g tank

DENR Authorized Agent: Kim Garrett, REHS Signature: Kim Garrett

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 10134 B Permit #: 9961 Tax Parcel #: 043-039-20

Property Owner: Israel Dominguez & Robert Homefield

Job Location Address: 5308 Christenbury Rd

City: Charlotte State: NC Zip Code: 28269

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIa

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Kim Garrett, REHS Date: 3/26/19

Signature: Kim Garrett REHS

DigiSign Verified: 62543459-24A9-46D8-BB17-3B5D1E178577

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT/CONSTRUCTION AUTHORIZATION for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 10134 B Permit #: 30099961 Tax Parcel #: 04303420

Property Owner: Israel Dominguez, Robert Homefield

Job Location Address: 5308 Christianbury Rd

City: Charlotte State: NC Zip Code: 28269

Improvement Permit Issuance Date: n/a. **Construction Authorization Issuance Date** 11/14/18

Permission is hereby given to ☐ install ☐ alter ☒ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This permit is granted based upon the application information submitted to our office. This permit expires 5 years from the date it was issued. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD Site LTAR: n/a GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1000 gallons Liquid Capacity of Dosing Tank: n/a gallons

Drainfield Design ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: >51 feet

Distance from Property Line: >10 feet

Distance from Water Supply Source: >10 feet city waterline

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

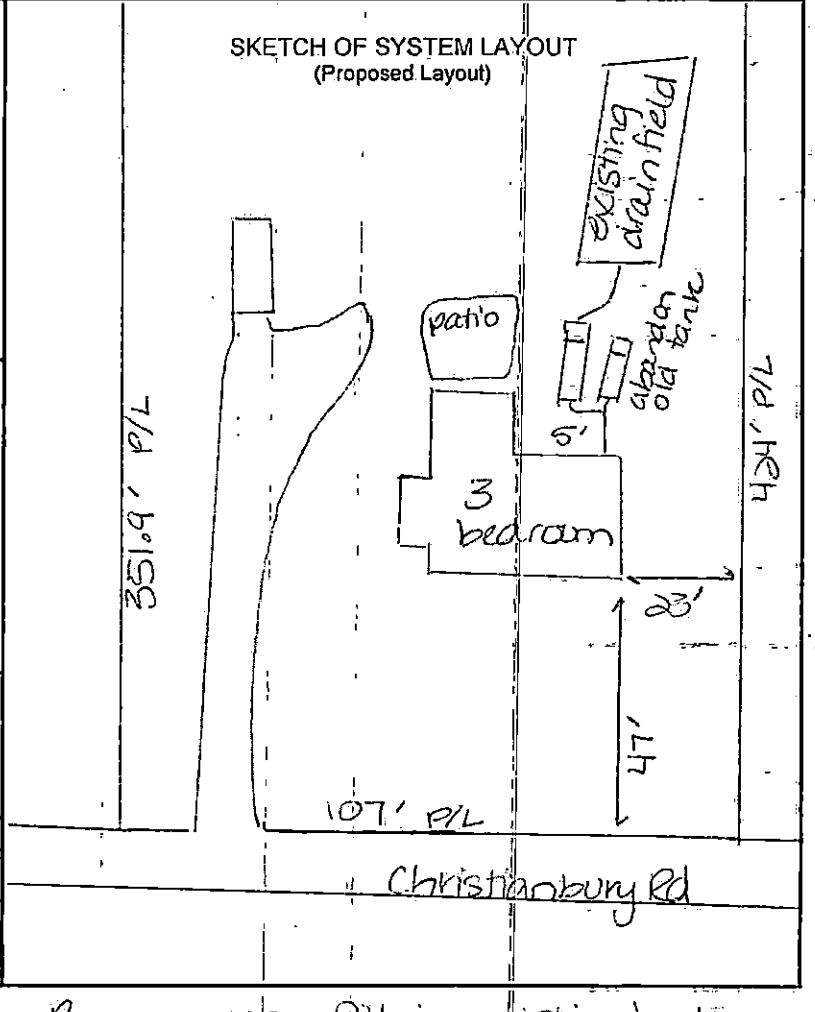

Comments: System Classification & Type: Repair - Pump, crush, fill-in existing tank. Install new 1000g tank and reconnect to existing drainfield.

Authorized Agent: Kim Garrett, REHS Signature: Kim Garrett, REHS

Owner Signature: Susan Bodman Date: 03-27-2019

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT/CONSTRUCTION AUTHORIZATION for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 10134 B Permit #: 30009961 Tax Parcel #: 04303920

Property Owner: Israel Dominguez, Robert Turnefield

Job Location Address: 5308 Christianbury Rd

City: Charlotte State: NC Zip Code: 28269

Improvement Permit Issuance Date: n/a **Construction Authorization Issuance Date** 11/14/18

Permission is hereby given to ☐ install ☐ alter ☒ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This permit is granted based upon the application information submitted to our office. This permit expires 5 years from the date it was issued. The system shall meet all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD

Liquid Capacity of Septic Tank: 1000 gallons

Site LTAR: n/a GPD/ft² (For new installations only.)

Liquid Capacity of Dosing Tank: n/a gallons

Drainfield Design ☒ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☒ Municipal ☐ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: >5 feet

Distance from Property Line: >10 feet

Distance from Water Supply Source: >10 feet city waterline

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

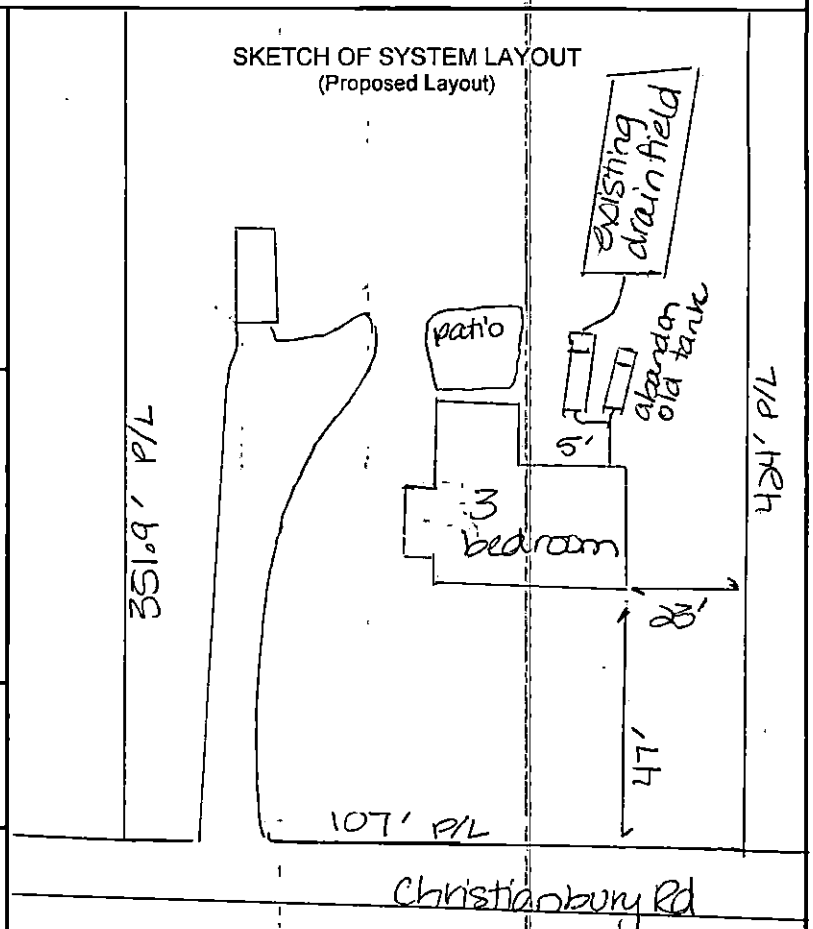

Comments: System Classification & Type: Repair - Pump, crush, fill-in existing tank, Install new 1000g tank and reconnect to existing drainfield.

Authorized Agent: Kim Garrett, REHS Signature: Kim Garrett, REHS

Owner Signature: _____ Date: _____