

3453 MAYHEW FORREST LN

19521131

1/7/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 4528B Permit #: _____ Tax Parcel #: 195-211-31

Property Owner: Tim Liescheidt

Job Location Address: 3453 Mayhew Forrest Lane

City: Charlotte State: NC Zip Code: 28227

Operation Permit Issuance Date: 4-12-06 Contractor Name: Nathan Osborne

Permitted Design Flow: 480 GPD Liquid Capacity of Dosing Tank: N/A gallons

Liquid Capacity of Septic Tank: 1500 gallons Effluent Pump Model: N/A

Drainfield Installation ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 4 @ 100 feet

Depth of Media: 12 inches (Type) Innovative

Depth of Cover: 12 inches

Distribution Device: Drop Boxes

Bed Installation *(For Repair Installations ONLY.)* ☑ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☑ Municipal ☐ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: ≥100 feet

Inspection Dates

Tank(s) Inspected: 4-12-06

Excavation Inspected: 4-12-06

Pump & Controls Inspected: N/A

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

See Installation Permit

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☑ installed ☐ altered ☐ repaired ☐ as detailed in the plot above ☑ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: 2006, Innovative Septic System, 1500ST, Drop Boxes, 1600Ft², Type III-G Designed for 4 Bedroom Residence. Type III G Repair Area

DENR Authorized Agent: Dina Howell Signature: _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 4528B Permit #: _____ Tax Parcel #: 195 211 31

Property Owner: Tim Liescheidt

Job Location Address: 3453 Mayhew Forest Ln Lot 23

City: Charlotte State: NC Zip Code: 28227

Installation Approval Issuance Date: 4/10/06

Permission is hereby given to ☑ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 5/10/06, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

NOTICE: This system shall not be installed while soils are in a wet condition.

Permitted Design Flow: 480 GPD

Site LTAR: .3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: NA gallons

Drainfield Design ☑ N/A

Trench Depth: 30" inches

Trench Width: 3' feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 4 @ 100' feet

Depth of Media: 12 inches (Type) Innovative

Distribution Device: Drop boxes

Bed Design *(For Repair Installations ONLY.)* ☑ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☑ Municipal ☐ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 5' feet

Distance from Property Line: 10' feet

Distance from Water Supply Source: > 100' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

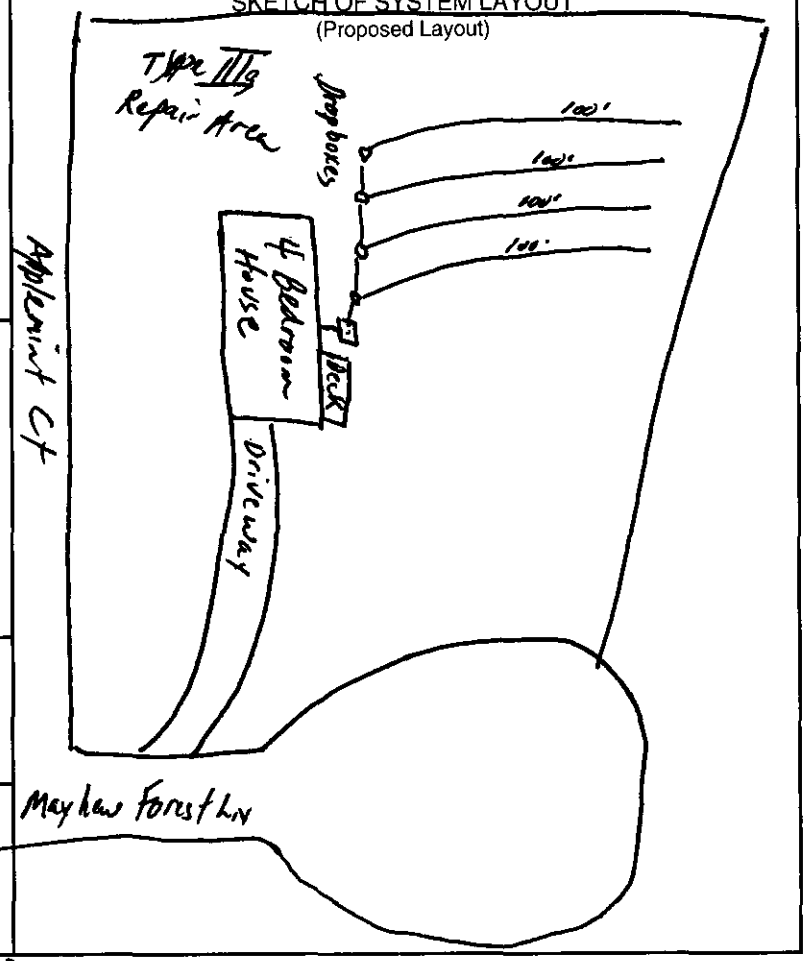

Comments: System Classification & Type: Innovative Septic System, 1500ST, Drop boxes, 4 lines @ 100' long @ 3' wd

DENR Authorized Agent: Philo S. Walker Signature: Philo S. Walker RS

FEE: 300.00

DATE: 4/27/2006

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY

GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 4528B

PERMIT NUMBER: 30000715

PARCEL NUMBER: 19521131

JOB LOCATION INFORMATION

ADDRESS: 3453 MAYHEW FORREST LN

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28227

ISSUED TO: TIM LIERCHEIDT

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: *8/19/2005*

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30000715, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.
   *CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 8/19/2010

Visa Payment AD160313

FEE: $300.00
DATE: 8/25/05 V. Walker

AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION

LD
ASC

PERMIT NUMBER: 4528B
PARCEL NUMBER: ~~195-031-23~~ 195-211-31

JOB LOCATION ADDRESS: 3453 Mayhew Forest Lane
PROPERTY OWNER: Tim Liescheidt
BUILDING CONTRACTOR:
SUBDIVISION NAME: Mayhew Country Estates, Lot 23
AUTHORIZATION ISSUED BY: J. Andrew Walker DATE: 08/19/05

DENR/DEH AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 4528B, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN *INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL* MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.

5. OTHER CONDITIONS:
   Install according to plans on file submitted by S&ME, 7/19/05.
   Lot #146, phase III
   Maintenance agreement with a certified operator must be on file before CO release.

CONDITIONS OF IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATON

195-211-31

Permit Number: **4528B**

Tax Number: ~~195-031-23~~

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

.3 Long-term acceptance rate (GPD/ft^2)	480 Max gallons/day wastewater flow	1600 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☐ Yes ☒ No	1500 Gallon septic tank	400 Total trench length (ft)	36 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
4 Bedrooms in residence	na Gallon pump tank	na Depth of stone (in)	

Any surface water present: Type: Minimum separation distance (ft):

Additional conditions: **Use drop boxes for serial distribution**

Repair Area System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

1600 Absorption Area (ft^2) 400 Total trench length (ft)	na Depth of stone (in)	9 Trench spacing (min. on centers) (ft)	36 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.

*** This Improvement permit is transferable.

8/19/05

DENR Authorized Agent Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

Owner/Agent Signature Date

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

CONDITIONS OF IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATON

195-211-3

Permit Number: 4528B

Tax Number: ~~195-031-23~~

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

.3 Long-term acceptance rate (GPD/ft^2)	480 Max gallons/day wastewater flow	1600 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☐ Yes ☒ No	1500 Gallon septic tank	400 Total trench length (ft)	36 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
4 Bedrooms in residence	na Gallon pump tank	na Depth of stone (in)	

Any surface water present: Type: Minimum separation distance (ft):

Additional conditions: Use drop boxes for serial distribution

Repair Area System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

1600 Absorption Area (ft^2) 400 Total trench length (ft)	na Depth of stone (in)	9 Trench spacing (min. on centers) (ft)	36 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.

*** This Improvement permit is transferable.

DENR Authorized Agent — Date: 5/19/05

Owner/Agent Signature — Date: 8/25/05

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-5894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 4528B

TC: ~~145-031-23~~ 195-211-31

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

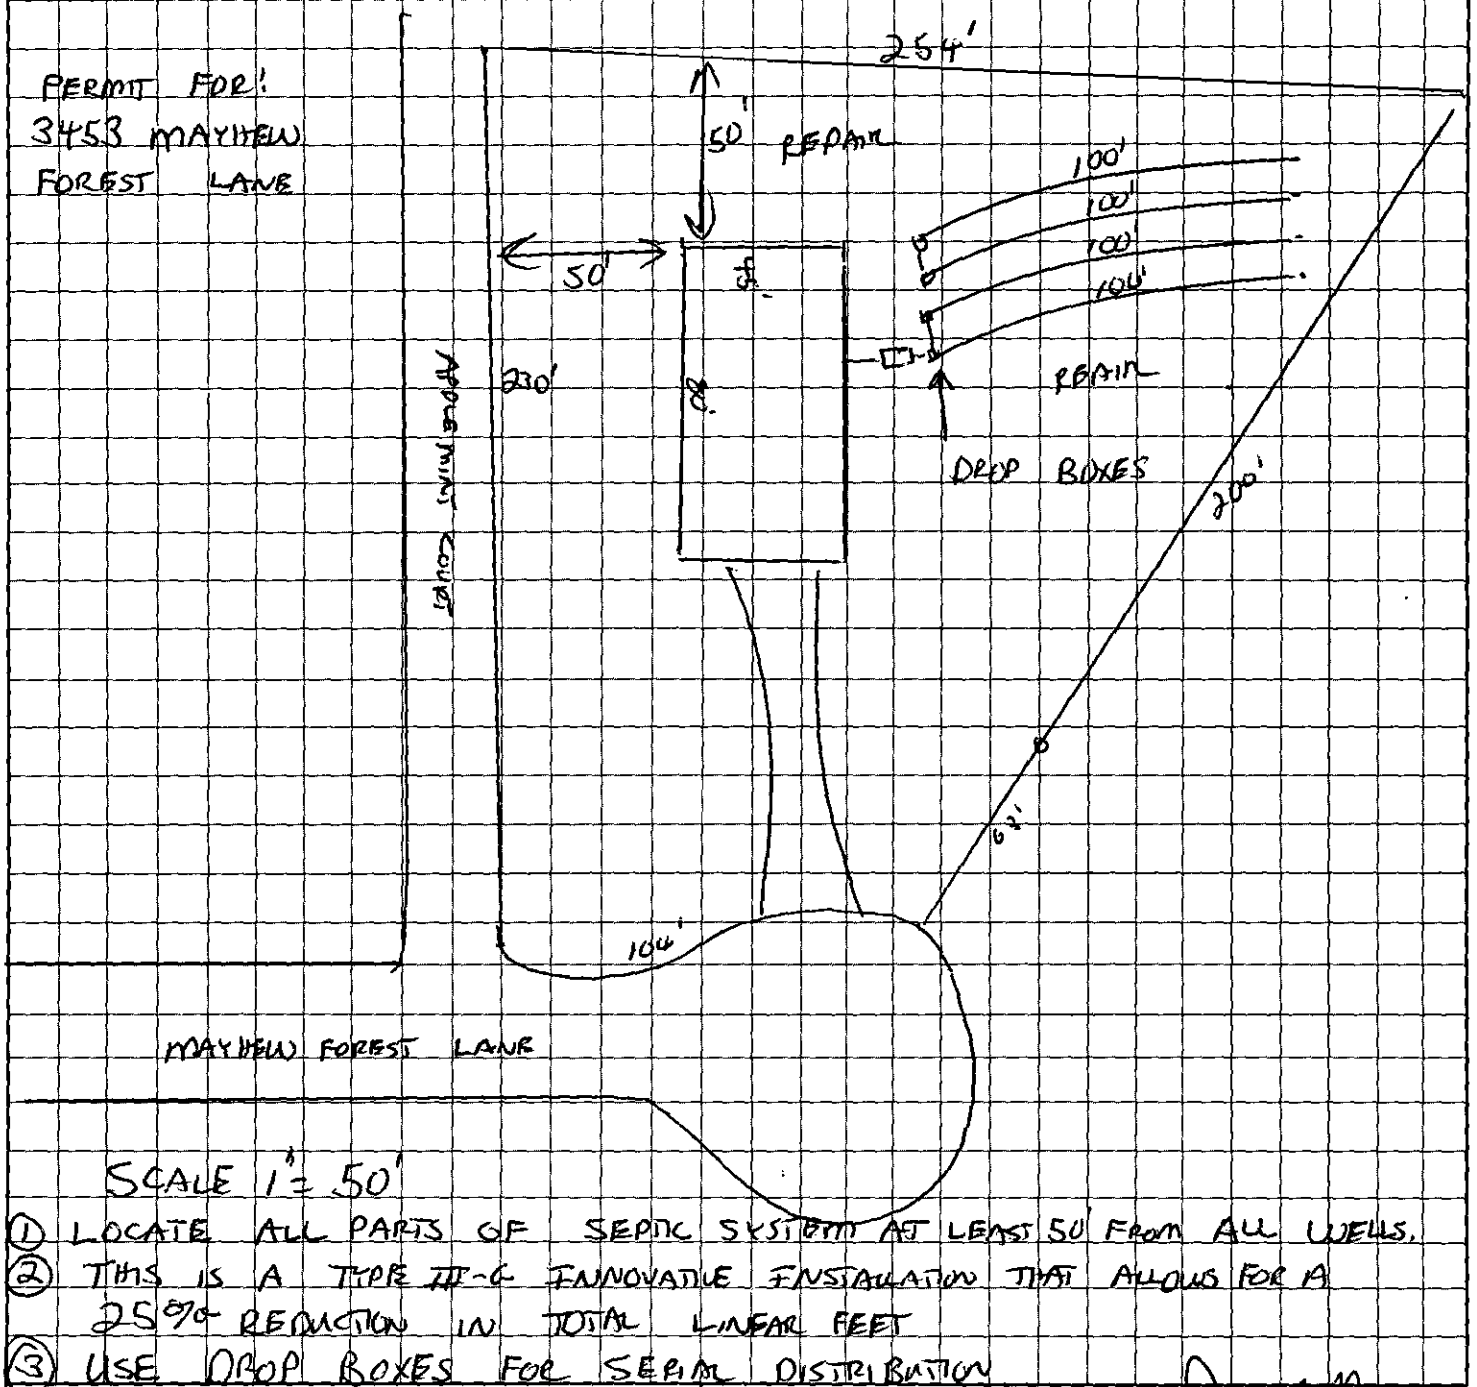

SCALE 1" = 50'

① LOCATE ALL PARTS OF SEPTIC SYSTEM AT LEAST 50' FROM ALL WELLS.
② THIS IS A TYPE III-G INNOVATIVE INSTALLATION THAT ALLOWS FOR A 25% REDUCTION IN TOTAL LINEAR FEET
③ USE DROP BOXES FOR SERIAL DISTRIBUTION

APPROVAL DATE 8-19-05

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

#1 AC

Sheet:
Property ID: 195-211-31
Lot #: 23
File #: 45290

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Kevin O'Quinn APPLICANT:
ADDRESS: 5033 Heron Blvd, Concord, N.C. DATE EVALUATED: 2-3-01
PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949) 480gpd PROPERTY SIZE: .94
LOCATION OF SITE: 3453 Mayhew Forest Lane PROPERTY RECORDED:
WATER SUPPLY: ☐Private ☐Public ☑Well ☐Spring ☐Other
EVALUATION METHOD: ☑Augur Boring ☐Pit ☐Cut
TYPE OF WASTEWATER: ☑Sewage ☐Industrial Process ☐Mixed

PROFILE #	2-8% slopes .1940 Landscape Position/ Slope %	Horizon Depth (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS &LTAR
1	LS	0-2"	gr/scl	Fr/SE XP/ SS/SP	>48" to soil wetness	48"+	N/A	None	PS .391 F2 IV
		2-41"	SBK/C	F:/SE XP/S/P					
		41-48"	SBK/CL	Fr/SE XP/ SS/SP					
2	LS	0-4"	gr/scl	Fr/SE XP/SS/SP	>48" To soil wetness	48"+	N/A	None	PS .391 F2 IV
		4-48"	SBK/C	F:/SE XP/ S/P					
3	LS	0-2"	gr/scl	Fr/SE XP/SS/SP	>48" To soil wetness	48"+	N/A	None	PS .391 F2 IV
		2-48"	SBK/C	F:/SE XP/ S/P					
4	LS	0-3"	gr/scl	Fr/SE XP/SS/SP	>48" To soil wetness	48"+	N/A	None	PS .391 F2 IV
		3-48"	SBK/C	F:/SE XP/ S/P					
5	LS	0-3"	gr/scl	Fr/SE XP/SS/SP	>48" To soil wetness	48"	N/A	None	PS .391 F2 IV
		3-35"	SBK/C	F:/SE XP/S/P					
		35-48"	SBK/CL	Fr/SE XP/ SS/SP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)		
Site LTAR	.391 F2	.391 F2

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Provisionally Suitable
EVALUATED BY: W.A. Mullis LSS 2-5-01
OTHER(S) PRESENT:

FILE # 45298

COMMENTS 100% Repair

LANDSCAPE POSITION	GROUP	TEXTURE	.1955 LTAR
R-RIDGE	I	S-SAND	1.2-0.8
S-SHOULDER SLOPE		LS-LOAMY SAND	
L-LINEAR SLOPE			
FS-FOOT SLOPE	II	SL-SANDY LOAM	0.8-0.6
N-NOSE SLOPE		L-LOAM	
H-HEAD SLOPE			
CC-CONCLAVE SLOPE	III	SI-SILT	0.6-0.3
CV-CONVEX SLOPE		SICL-SILTY CLAY LOAM	
T-TERRACE		CL-CLAY LOAM	
FP-FLOOD PLAIN		SCL-SANDY CLAY LOAM	
	IV	SC-SANDY CLAY	0.4-0.1
		SIC-SILTY CLAY	
		O-ORGANIC	

CONSISTENCE MOIST	WET
VFR-VERY FRIABLE	NS-NON-STICKY
FR-FRIABLE	SS-SLIGHTLYSTICKY
FI-FIRM	S-STICKY
VFI-VERY FIRM	VS-VERY STICKY
EFI-EXTREMELY FIRM	NP-NON-PLASTIC
	SP-SLIGHTLYSTICKY
	P-PLASTIC
	VP-VERY PLASTIC


STRUCTURE

SG-SINGLE GRAIN
M-MASSIVE
CR-CRUMB
GR-GRANULAR
SBK-SUBANGULAR BLOCKY
ABK-ANGULAR BLOCKY
PL-PLATY
PR-PRISMATIC

MINERALOGY

SLIGHTLY EXPANSIVE

EXPANSIVE

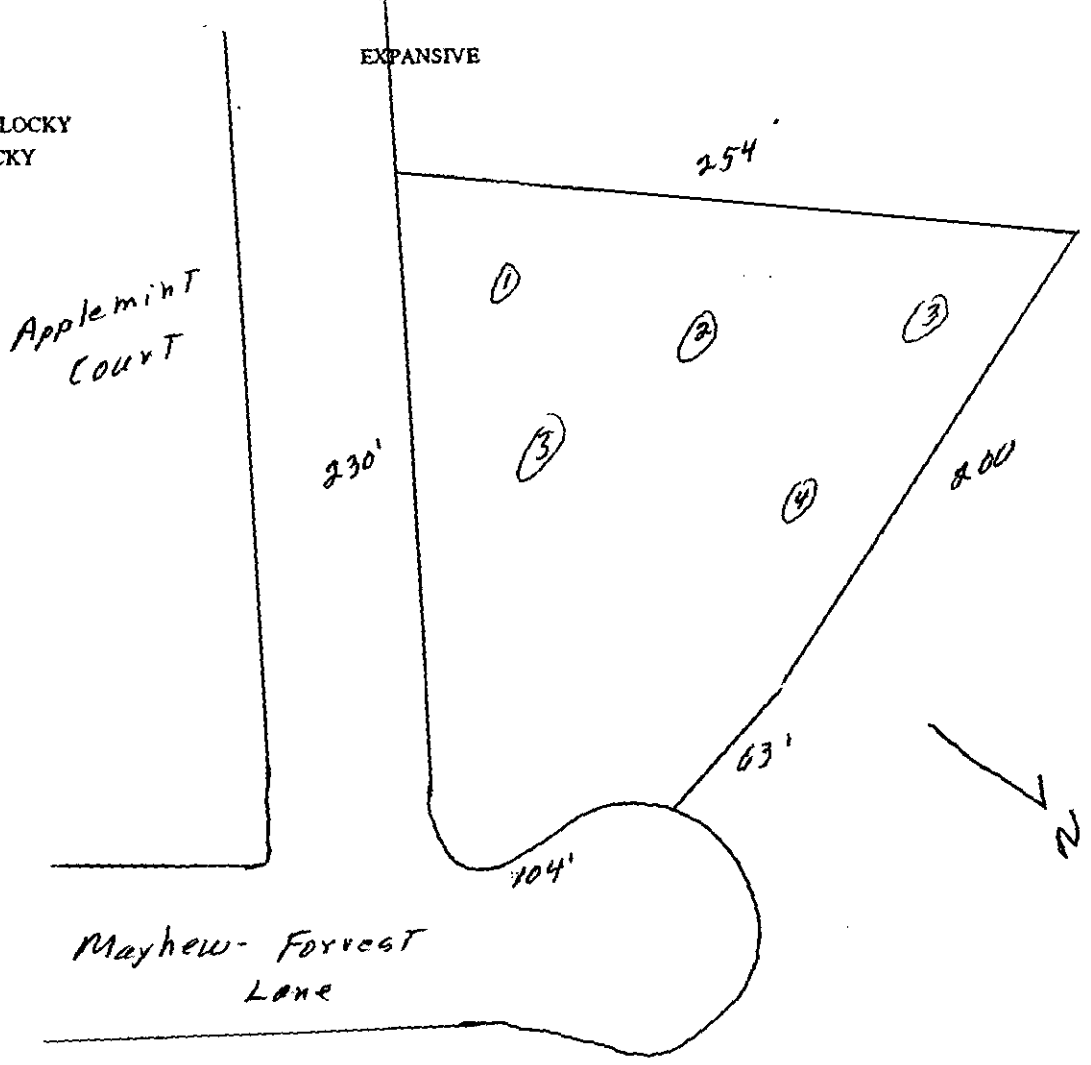

#715

GWS – RES. APP 12/04

SEPTIC FEE: 200.00
DATE: 7/21/05
CRT [ ] Check 868 JKA

PERMIT APPLICATION FOR A RESIDENTIAL SITE
IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATION
FOR ON-SITE WASTEWATER SYSTEM
NEW WELL INSTALLATION OR REPAIR OF EXISTING WELL
MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES

FILE # 45288

WELL FEE:
DATE:
CRT [ ]

SEPTIC / TYPE APPLICATION: ☐ NONE ☒ NEW SYSTEM EXISTING SYSTEM : ☐ EXPANSION/ALTERATION ☐ REPAIR

WELL / TYPE APPLICATION: ☒ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

JOB LOCATION INFORMATION:

TAX/PARCEL #: 19521131
STREET ADDRESS: 3453 Mayhew Forrest Ln
CITY: ~~Char~~ Charlotte
STATE: NC **ZIP:** 28227
SUBDIVISION OR MOBILE HOME PARK NAME: Mayhew Country Est.
LOT #: 23
TOWNSHIP: Mint Hill

☐ 0-MECKLENBURG ☐ 4-PINEVILLE
☐ 1-CHARLOTTE ☐ 5-MATTHEWS
☐ 2-DAVIDSON ☐ 6-HUNTERSVILLE
☐ 3-CORNELIUS ☒ 7-MINT HILL

BUILDING INFORMATION:

TYPE OF BUILDING:

☐ SINGLE MOBILE HOME (S) ☐ MODULAR HOME (M)
☐ DOUBLE WIDE (D) ☐ MULTIPLE FAMILY (U)
☒ HOUSE (H) ☐ OTHER

HEATED SQUARE FOOTAGE: 3329
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 4

FOUNDATION FOR RESIDENCE:

☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☒ CRAWLSPACE ☐ BASEMENT WITH NO PLUMBING

IF PLANNING TO EXPAND/ALTER THE EXISTING SYSTEM INDICATE THE FOLLOWING CHANGES:

NUMBER OF BEDROOMS TO BE ADDED: NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE:
WILL THERE BE A HOME BUSINESS IN THE RESIDENCE? ☐ YES ☐ NO TYPE:

WATER SUPPLY:

☒ MUNICIPAL (M) ☐ PUBLIC (C) ☐ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☐ POTABLE ☐ GEOTHERMAL ☐ OTHER

ARE ANY OF THE FOLLOWING LOCATED ON THE PROPERTY? IF SO, PLEASE SHOW LOCATION ON SITE PLAN/PLAT.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☐ NO	WELLS, SPRINGS, OR WATER LINES	☐ YES	☐ NO
EXISTING WASTEWATER SYSTEMS	☐ YES	☐ NO	DESIGNATED WETLANDS	☐ YES	☐ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☐ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☐ NO

PROPERTY OWNER:

NAME: Tim Liescheidt
ADDRESS: ~~3453 Mayhew Forrest Ln~~ 118 Pine Forest Ln
CITY: ~~Charlotte~~ Locust
STATE: NC ZIP: 28097
HOME PHONE: 704-888-2848 WORK PHONE:
MOBILE PHONE: 616-446-4359 FAX: 704-888-2640

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 10/14/2004
WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?

*An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature 7/20/05 Date

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENT & NATURAL RESOURCES DIVISION
OF ENVIRONMENTAL HEALTH ON-SITE
WASTEWATER SECTION

*A Well Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature N/A Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
704-336-5103 / FAX: 704-336-6894

FEE: 200 ck
DATE: 1-31-01 cw + add

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

TYPE APPLICATION: ✓ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM __ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 45286

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 195-211-31

STREET ADDRESS: 3453 MAYHEW FORREST LN.

SUBDIVISION OR MOBILE HOME PARK NAME: MAYHEW COUNTRY ESTATES

LOT NUMBER: #23

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
✓ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

TOWNSHIP (CHECK ONE):

__ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
X 7 MINT HILL

HEATED SQUARE FOOTAGE: 2500 - 3000

NUMBER OF BEDROOMS: 4 NUMBER OF OCCUPANTS: 2

CLOSING DATE FEB. 28, 2001

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
__ ON SLAB
X CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES X NO TYPE: _____

WATER SUPPLY (CHECK ONE):

__ COMMUNITY (C)
__ MUNICIPAL (M)
✓ PRIVATE WELL (P)
__ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

(BURIED CABLES) LANDFILLS, STUMPHOLES ✓ YES __ NO
EXISTING WASTEWATER SYSTEMS __ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES ✓ NO
WELL, SPRINGS OR WATERLINES __ YES ✓ NO
DESIGNATED WETLANDS __ YES ✓ NO

PROPERTY OWNER:	LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:
NAME: O'QUINN (LAST) KEVIN (FIRST) + LISA (MI)	NAME: HERRING (LAST) MARCIA (FIRST) (MI)
ADDRESS: 5033 NAVION PL	DAYTIME PHONE: 704 502-2039
CITY: CONCORD STATE: NC ZIP: 28025	
DAYTIME PHONE: (704-201-7150	

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 1999

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Marcia Herring DATE: 1/24/01

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

MECKLENBURG COUNTY HEALTH DEPARTMENT
Environmental Health Fees

Requestor (please print): O'Quinn Kevin - LEA Phone #: Date Requested: 1/31/01 Date Filled: 1/31/01

Account Name: Cash Charge Account No.:

I certify that I am authorized to charge this account for this service:

Signature: Printed Name: Date:

T.C.	Qty	Description	Unit Cost	Total Cost
0701	1	Improvement Permit Application - Residential	$ 200.00	200 -
0735		Improvement Permit Application - Commercial	$ 400.00	
0702		Optional Site Evaluations	$ 100.00	
0703		Installation and Final Approval	$ 150.00	
0704		Change in Plot Plan	$ 100.00	
0705		MH Exc/Add/Repl without System Modification	$ 100.00	
0706		MH Exc/Add/Repl with System Modification	$ 300.00	
0707		Site Consultation Visit	$ 100.00	
0734		Authorization for Wastewater System Construction	$ 150.00	
0708		Realty Closing - Conventional	$ 85.00	
0709		Realty Closing - FHA with water	$ 135.00	
0710		Additional Trips	$ 65.00	
0711		Well Water Analysis-Bacteriological with regular parameters	$ 50.00	
0712		Well Water Analysis -Nitrates and Nitrites	$ 15.00	
0714		Well Water Analysis - Organic Analysis	$ 200.00	
0715		Admin. Fee - Field Activity Letter	$ 25.00	
0718		Residential Pool Permit	$ 50.00	
0719		Public Pool Permit - operating	$ 240.00	
0720		Seasonal Pool Permit - operating	$ 120.00	
0736		Pool Late Fee	$ 120.00	
0733		Permit to Construct a Public Pool	$ 200.00	
0721		Home Day Care Evaluation and Permit	$ 70.00	
0722		Home Day Care Evaluation and Annual Fee	$ 40.00	
0723		Eval and Report Non-Permit Facility	$ 50.00	
0724		Private Pool Testing	$ 15.00	
0731		Garbage Hauler Permit - (1-9 vehicles)	$ 30.00	
0736		Garbage Hauler Permit - (each over 9)	$ 20.00	
0725		Document Copies	$ 0.05	

Payment received by: Date: Total: 200 -

3153 Mayhew Forrest Ln, Lot # 23

4/2000

White-AUDIT Canary-CUSTOMER Pink-DIVISION


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: _____

TC: 195-211-31

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

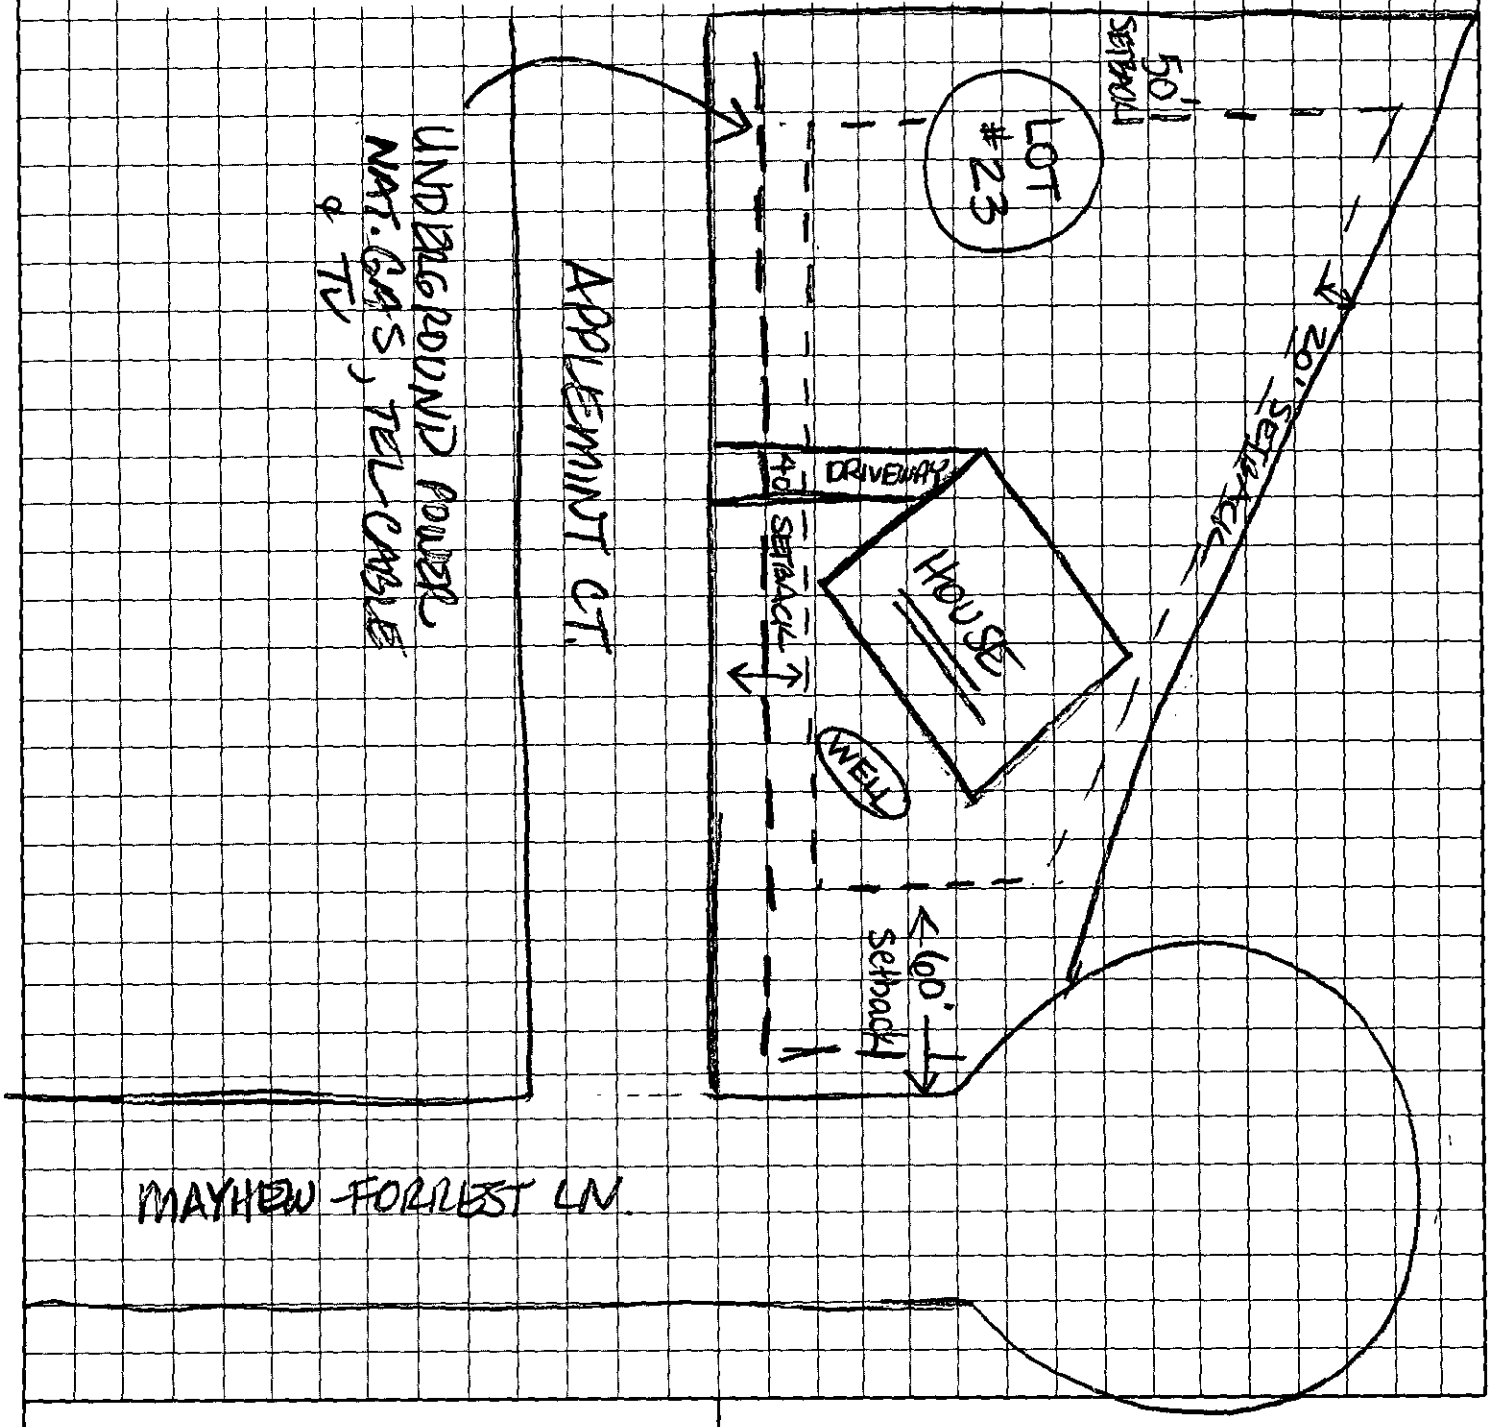

OWNER/AGENT SIGNATURE

DATE

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	08/25/05	**Amount:**	150.00
Receipt #:	36588	**Tendered:**	0.00
Check / Auth #:	VISA 100373	**Returned:**	0.00
Received By:	WALKEVA		

Account Information

Account #: 200000
Contractor: LIESCHEIDT TIM
Attn:
Address: 118 PINE FOREST LANE
Address:
City/State/Zip: LOCUST, NC 28097

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Installation/Final Approval 3453 MAYHEW FOREST LANE		1	150.00	150.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	08/25/05	**Amount:**	150.00
Receipt #:	36589	**Tendered:**	0.00
Check / Auth #:	VISA 100373	**Returned:**	-150.00
Received By:	WALKEVA		

Account Information

Account #:	200000
Contractor:	LIESCHEIDT TIM
Attn:	
Address:	118 PINE FOREST LANE
Address:	
City/State/Zip:	LOCUST, NC 28097

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Auth for Waste Wtr Sys Constr 3453 MAYHEW FOREST LANE		1	150.00	150.00

----------Outstanding Balances----------


Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File # 45288
Approval Date_____

APPROVED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property.

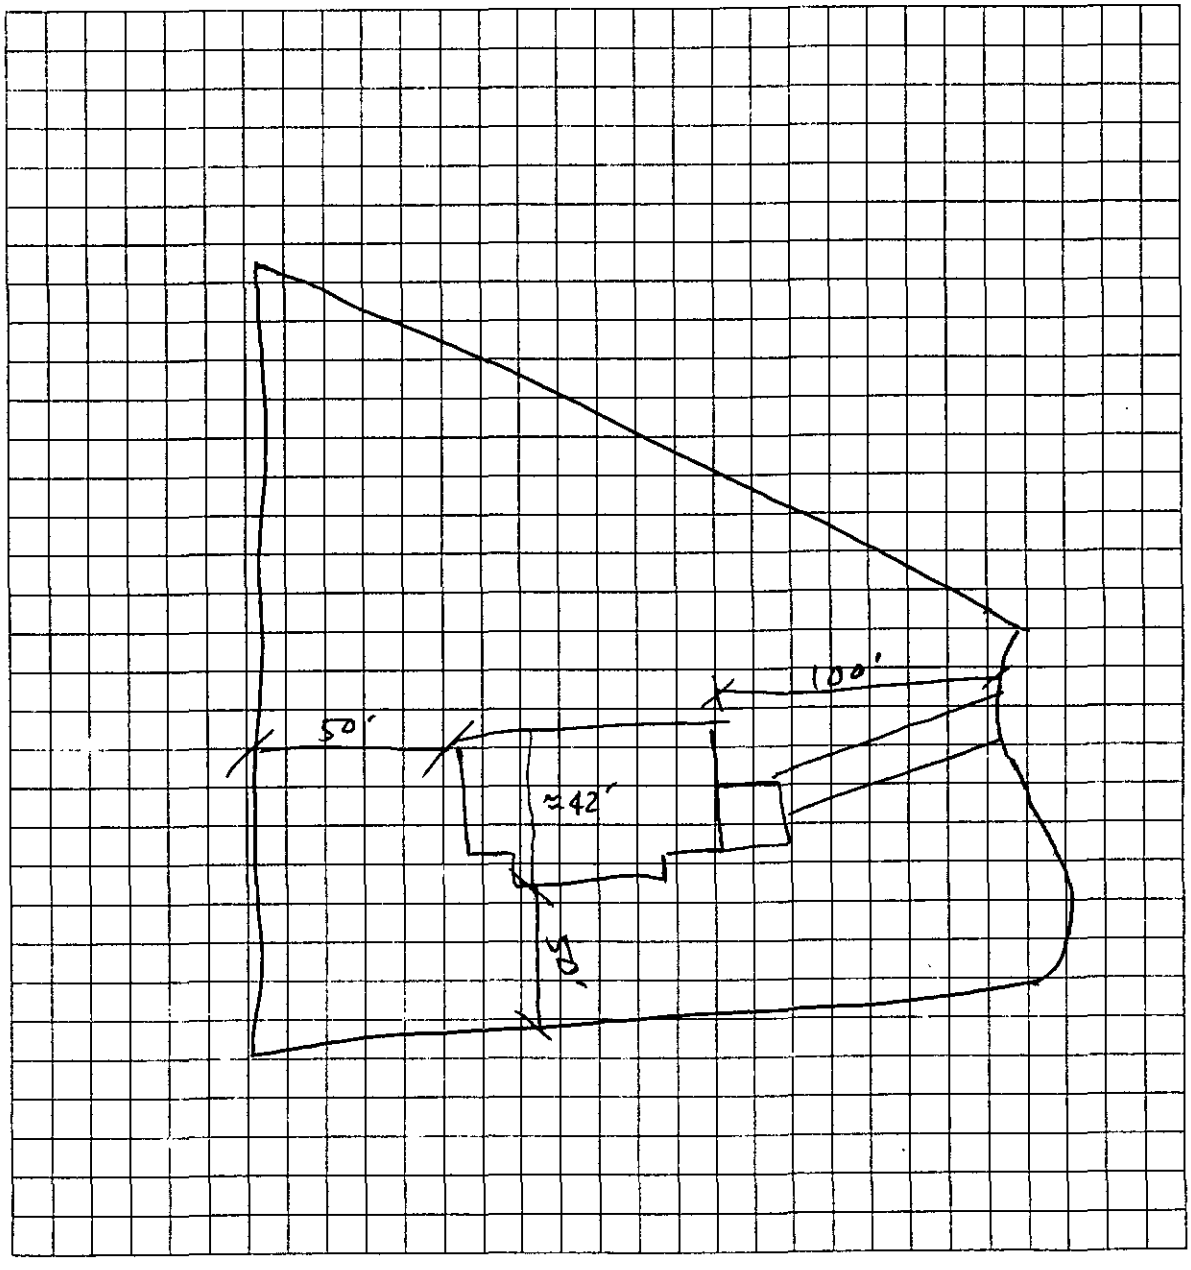

Owner/Agent Signature	Staff Signature
Date 7/21/05	Date