Date Received 2/26/80

SEE INSTRUCTIONS ON BACK

FEB 26 19..

(CAR(S) Application No. 16678

T. C. Ap.# 027-072-08


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) _____ Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

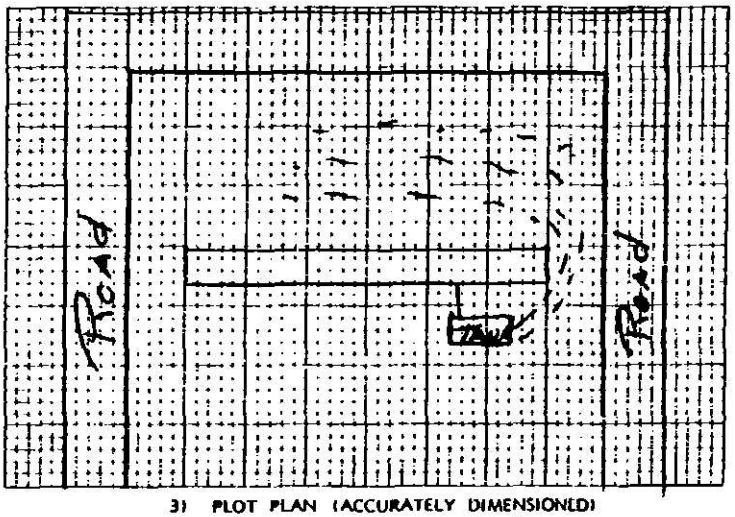

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ✓ Yes ___ No
Residence ✓ Yes ___ No
4) No. of Bedrooms 2
5) Business Use — Max No Employees _____
6) Washing Machine ___ Yes ✓ No
7) Garbage Disposal ___ Yes ✓ No
8) Dishwasher ___ Yes ✓ No
9) Water Supply:
A) Individual Well _____
B) Governmental System _____
C) Community System:
1 Well source X
2 Governmental source _____
10) Sewage System:
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11) FHA Case No. _____
12) VA Case No. _____

13) NAME OF OWNER Nisbet (LAST) E (FIRST) P (MIDDLE)

14) ADDRESS OF OWNER 1818 Baxter St.

15) PHONE NO. Home _____ Office _____

16) LOCATION OF SYSTEM Prosperity Church Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION Forest Park Lot No 28 Block No. _____

Map Book No. _____ Page No. _____

18) DEED REFERENCE — DEED BOOK _____ AT PAGE _____

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN _____

20) PTR NUMBER (See Instructions) _____

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

2-20-80
DATE OF APPLICATION

By Ralph Tinman
OWNER

EHD-5-/6

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Received 4/29/80

MECK COUNTY DEPARTMENT OF SEE INSTRUCTIONS ON BACK
RECEIVED
APR 29 1980

ICAR (S) Application No. 16678

T. C. No. PO 027-072-08


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) _____ Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

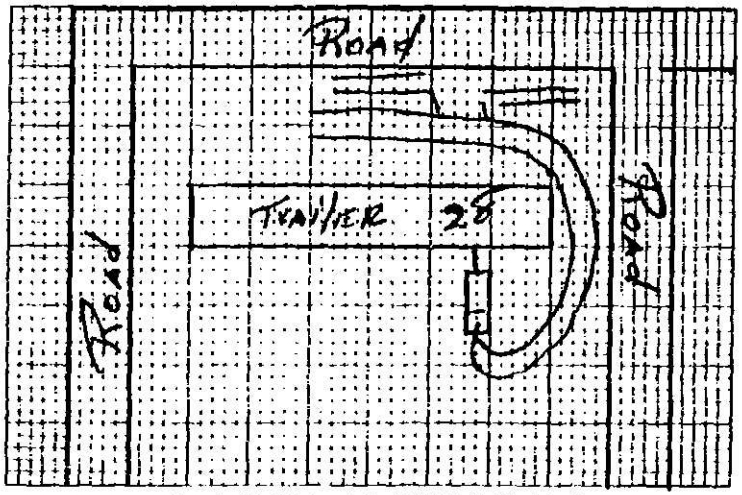

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ✓ Yes ___ No
Residence ✓ Yes ___ No

4) No. of Bedrooms 2
5) Business Use — Max No Employees _____
6) Washing Machine ___ Yes ✓ No
7) Garbage Disposal ___ Yes ✓ No
8) Dishwasher ___ Yes ✓ No
9) Water Supply:
   A) Individual Well _____
   B) Governmental System _____
   C) Community System:
      1. Well source ✓
      2. Governmental source _____
10) Sewage System:
   House located within 200 feet of public sewer ___ Yes ✓ No
   House located within 200 feet of community sewer ___ Yes ✓ No
11) FHA Case No _____
12) VA Case No. _____

13) NAME OF OWNER Nuckt (LAST) E. P. (FIRST) _____ (MIDDLE)
14) ADDRESS OF OWNER Prosperity Church Rd
15) PHONE NO. Home _____ Office 597-1427
16) LOCATION OF SYSTEM Prosperity Church Rd. (STREET OR COUNTY ROAD)
17) SUBDIVISION Forest Park Lot No. 28 Block No. _____

Map Book No. _____ Page No. _____

18) DEED REFERENCE — DEED BOOK _____ AT PAGE _____

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN _____

20) PTR NUMBER (See Instructions) _____

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

4-28-80
DATE OF APPLICATION

Ralph Garman
OWNER

EHD-S-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Issued 5-9-80

Serial 3896


ICAR(S) Permit No. 16678

p.O. T. C. No. 027-072-08

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 16678, dated 4-28-80 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 5-19-80, after which date this permit shall be null and void.

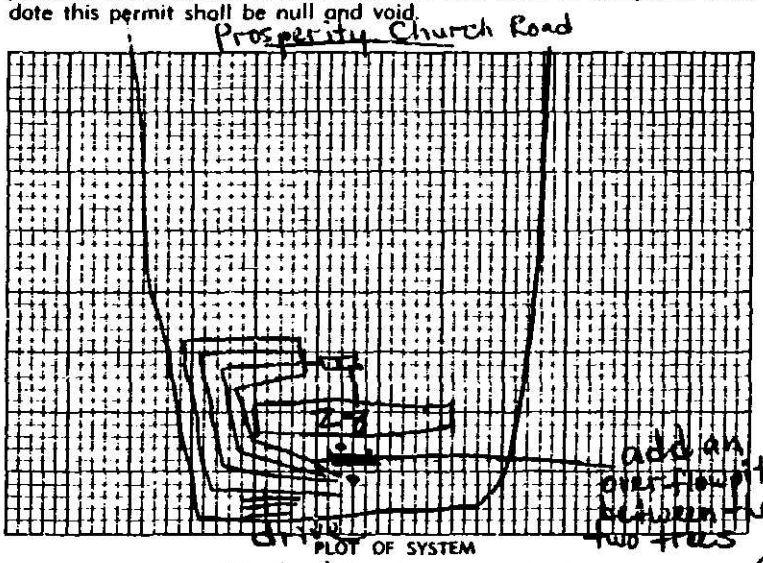

Permeability Rate ___

Liquid Capacity of Tank ___

Tank Construction ___

Absorption and/or Nitrification Lines:

Total Line Length 100'

Number of Lines 1

Distance from House 10'

Distance from Property Line 10'

Distance from Well >100'

NAME OF OWNER E. P. Nisbet Oil Co. (Ralph Farman)

LOCATION OF PROPERTY lot 28 Forest Park Mobile Home Park

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

3'wide × 15'long × 10'of stone overflow pit

call for a partial a 5'depth of stone

grade yard to drain all surface water Mike Sexton

Division or Section Head — Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Date Issued 5-15-80 Serial 3736 C of A (s) No. 16678 P.O. T. C. No. 027-072-08

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner E.P. Nisbet Oil Co. (LAST / FIRST / MIDDLE)

Location of Property lot 28 Forest Park MHP

Application Number 16678 Permit Number 16678

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 100' Number of Lines 2

Depth of Filter Material 8' Cover Depth 38"

Water Supply Source community well Distance from Water Source >100'+

Excavation Inspected — (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 5-15-80 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ✓ installed or constructed, ____ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments: Toilet plumbing appears to be leaking sewage under trailer.
Very little room left to repair.

Mike Sexton
Environmentalist

EHD-5-76

Environmental Health Department's Copy