Date Received 3/15/79

MECK COUNTY ENVIRONMENTAL HEALTH
RECEIVED
MAR 14 1979


ICAR(S) Application No 15251
T.C. No. 032-212-03
Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) Install or Construct 2) X Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

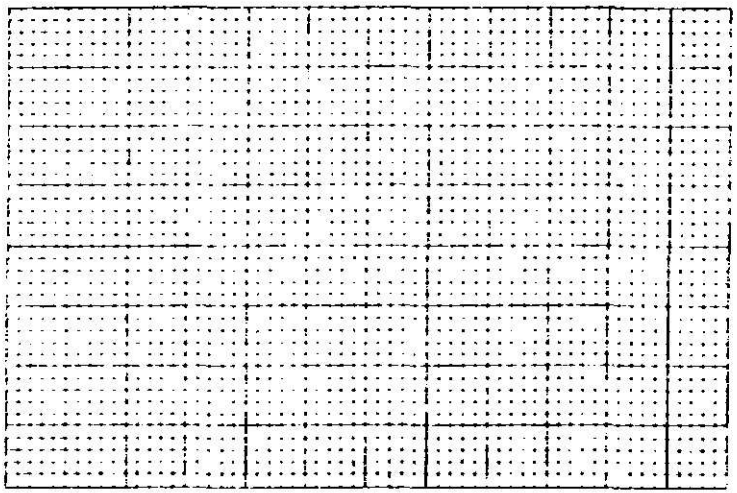

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home X Yes ___ No
Residence ___ Yes ___ No

4) No of Bedrooms ___
5) Business Use Max No Employees ___
6) Washing Machine ___ Yes X No
7) Garbage Disposal ___ Yes X No
8) Dishwasher ___ Yes X No
9) Water Supply
A) Individual Well ___
B) Governmental System ___
C) Community System
1 Well source Yes
2 Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___ Yes ___ No
House located within 200 feet of community sewer ___ Yes ___ No
11) FHA Case No ___
12) VA Case No ___

13) NAME OF OWNER DANCY HOMES, INC. (LAST / FIRST / MIDDLE)

14) ADDRESS OF OWNER 1543 South Boulevard, Charlotte, N.C., 28203

15) PHONE NO Home ___ Office 332-6310

16) LOCATION OF SYSTEM HEMLOCK CIRCLE NORTH - Off Highway 115 (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. 7, 16 & 19 - 8 Block No. ___

Map Book No ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? Yes YES ___ NO DATE RUN any years ago

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

3/12/79
DATE OF APPLICATION

DANCY HOMES, INC.
A. F. Dancy
OWNER

EHD-5-76

Environmental Health Department's Copy


Date Issued 4-10-79 Serial No. 2568 ICAR(S) Permit No. 15251

TCA No. 037-212-03

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to [redacted] Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 15251, dated 3-15-79 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 5-10-79, after which date this permit shall be null and void.

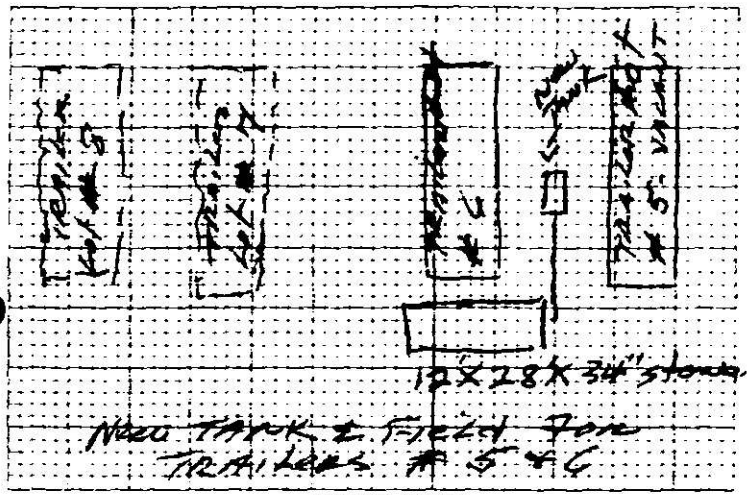

PLOT OF SYSTEM

Permeability Rate P/S

Liquid Capacity of Tank 1500

Tank Construction P/C

Absorption and or Nitrification Lines

Total Line Length 220

Number of Lines 4

Distance from House 10'+

Distance from Property Line 10'+

Distance from Well 50'+

NAME OF OWNER DANCY Homes, Inc.

LOCATION OF PROPERTY Henderson circle off Hwy. 115

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used.

Comments

THE ISSUANCE OF THIS PERMIT DOES NOT IN ANY WAY GUARANTEE THAT THE SYSTEM ANTICIPATED TO BE CONSTRUCTED WILL OPERATE PROPERLY OR RELIEVE ANY PERSON NOW OR HEREAFTER OWNING, CONTROLLING OR USING SUCH SYSTEM FROM ANY LIABILITY RESULTING FROM THE FAILURE OF THE SYSTEM TO OPERATE PROPERLY.

Division or Section Head

Marshall Edwards
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHO-5-76


Environmental Health Department's Copy

Date Issued 4-10-79 Serial No. 2567 ICAR(S) Permit No. 15251 FCH037-212-03

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 15251, dated 3-15-79 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 5-10-79 after which date this permit shall be null and void.

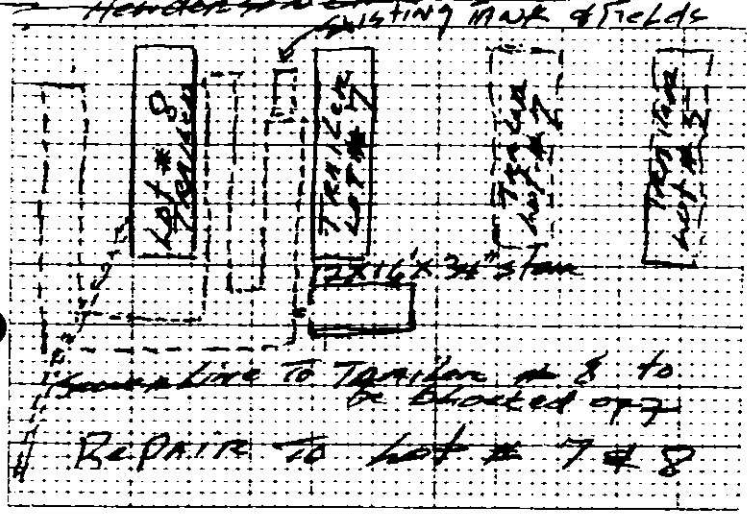

PLOT OF SYSTEM

Permeability Rate P/S

Liquid Capacity Tank Existing 1500

Tank Construction P/C

Absorption and or Nitrification Lines

Total Line Length 125' 4/5

Number of Lines 4

Distance from House 10'+

Distance from Property Line 10'+

Distance from Well 50'+

NAME OF OWNER Dancy Homes, Inc.

LOCATION OF PROPERTY Henderson Circle off Hwy 115

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used.

Comments

THE ISSUANCE OF THIS PERMIT DOES NOT IN ANY WAY GUARANTEE THAT THE SYSTEM ANTICIPATED OR CONSTRUCTED WILL OPERATE PROPERLY OR RELIEVE ANY PERSON NOW OR HEREAFTER OWNING, CONTROLLING OR USING SUCH SYSTEM FROM ANY LIABILITY RESULTING FROM THE FAILURE OF THE SYSTEM TO OPERATE PROPERLY.

Division or Section Head

Marshall Edwards
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Date Issued 4-11-79

Serial No. 2498

C of A (s) No. 15251 /

P.C. No. 037-212-03

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

ENVIRONMENTAL HEALTH DIVISION

~~CERTIFICATE OF COMPLETION~~

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner DANCY (LAST) Homes (FIRST), Inc (MIDDLE)

Location of Property Henderson Circle

Application Number 15251 Permit Number 15251

Inspection Data:

Liquid Capacity of Tank 1500 Tank Material P/C

Total Length of Drain Tile 220 Number of Lines 4

Depth of Filter Material 34" Cover Depth 20"

Water Supply Source Well Distance from Water Source 50'+


Excavation Inspected 4-11-79 (DATE) Tank Inspected 4-11-79 (DATE)

Nitrification Field Inspected 4-11-79 (DATE)

Washing Machine Line Inspected, If Applicable N.A (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ~~installed~~ or constructed, ~~altered~~ or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments Henderson Circle

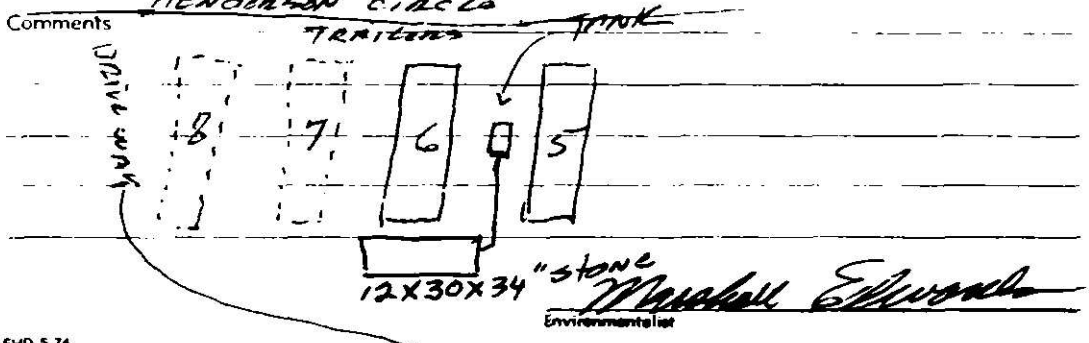

Marshall Ellwood
Environmentalist

EHD-5-76

Environmental Health Department's Copy

Date Issued 4-12-79 Serial No. 2499 C of A (s) No. 15251 ✓ P&C No. 037-212-03

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Nancy Homes, Inc (LAST, FIRST, MIDDLE)

Location of Property Henderson Circle

Application Number 15251 Permit Number 15251

Inspection Data:

Liquid Capacity of Tank Existing Tank Material P/C

Total Length of Drain Tile 125' Number of Lines 4

Depth of Filter Material 34" Cover Depth 20"

Water Supply Source Well Distance from Water Source 50'+


Excavation Inspected 4-12-79 (DATE) Tank Inspected Existing (DATE)

Nitrification Field Inspected 4-12-79 (DATE)

Washing Machine Line Inspected, If Applicable N.A. (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments Henderson Circle Existing Tank & Field

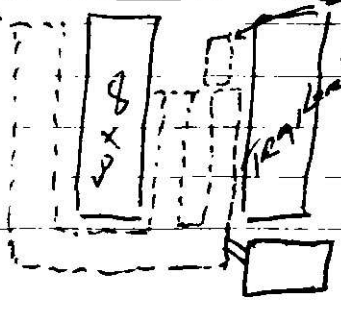

Marshall Edwards
Environmentalist

EHD-5-76

Environmental Health Department's Copy