W

Date Received 7-12-73

SEE INSTRUCTIONS ON BACK

MECK COUNTY HEALTH DEPT.
RECEIVED
JUL 12 1973
ENVIRONMENTAL HEALTH DIVISION

(CARES) Application No 6578

T C No

Map Date

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION


Application for an

Installation, Construction, Alteration, and/or Repair Permit

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to

1) Install or Construct 2) X Alter or Repair an individual septic tank wastewater treatment system with a subsurface soil absorption, effluent discharge

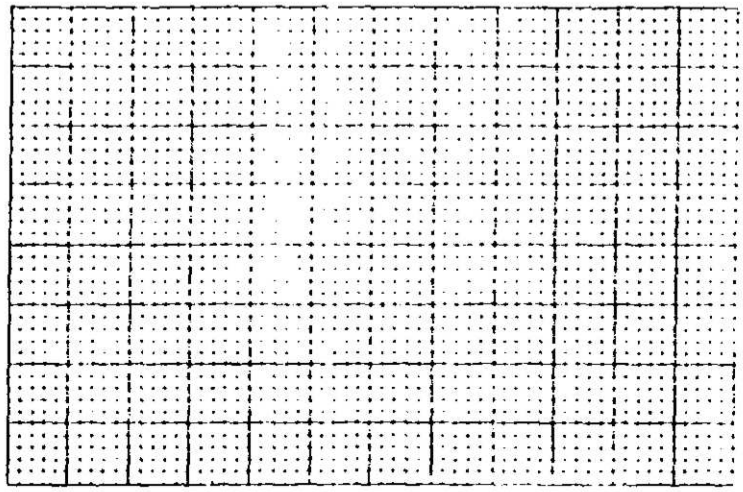

3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) No of Bedroom 3

5) Business Use Max No Employees

6) Washing Machine ✓ Yes No

7) Garbage Disposal Yes ✓ No

8) Dishwasher Yes ✓ No

9) Water Supply

A) Individual Well ✓

B) Government System

C) Community System

1 Well Source

2 Government System

10) Sewage System

House located within 200 feet of public sewer Yes No

House located within 200 feet of community sewer Yes No

11) FHA Case No

12) VA Case No

13) NAME OF OWNER GAMBRELL, (LAST) DANNY (FIRST) RAY (MIDDLE)

14) ADDRESS OF OWNER 2301 LAURA DRIVE

15) PHONE NO Home 537-1262 Office 536-8000

16) LOCATION OF SYSTEM LAURA DRIVE (STREET OR COUNTY ROAD)

17) SUBDIVISION SHARON FOREST Lot No 1 Block No. B

Map Book No 7 Page No. 417

18) DEED REFERENCE — DEED BOOK 2665 AT PAGE 164

19) HAS A PERCOLATION TEST BEEN RUN? YES X NO DATE RUN

20) PTR NUMBER (See Instructions)

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

7-9-73
DATE OF APPLICATION

Danny Ray Gambrell
OWNER

FORM NO E-4-9-1-72

HEALTH DEPARTMENT'S COPY

Serial No. 4080

Date Issued 7-25-73

ICAR(S) Permit No. 6528

T. C. No. 165 - 142-02

Map Date 9-29-71


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

INSTALLATION, CONSTRUCTION, ALTERATION, AND OR REPAIR PERMIT

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 6528, dated 7-12-73 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 8-25-73, after which date this permit shall be null and void.

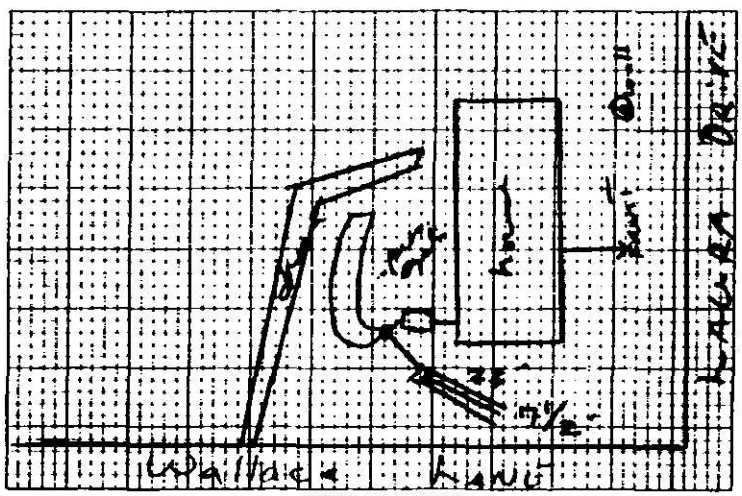

PLOT OF SYSTEM

Percolation Rate ___

Liquid Capacity of Tank ___

Tank Construction ___

Absorption and/or Nitrification Lines:

Total Line Lenght 100

Number of Lines 3

Distance from House 10'

Distance from Property Line 10'

Distance from Well 100'

NAME OF OWNER Danny Ray Gambrell

LOCATION OF PROPERTY 2301 Laura Drive

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Board of Health which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Health Director before any system can be covered up or otherwise rendered uninspectable or can be used.

Comments: 7½' x 33' x 1½" stone repair to be attached to sys system to receive overflow. Our Bus Const. Co, contractor

Thomas R. Ward

Division or Section Head — Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Environmental Health Division in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

FORM NO. E-5-4-1-71

HEALTH DEPARTMENT'S COPY

Date Issued 7-25-73 Serial No. 3624

C of A (s) No. 6578

T. C. No. 165-142-02

Map Date 9-29-71

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Gambrell (LAST) Danny (FIRST) Ray (MIDDLE)

Location of Property 2301 Laura Dr.

Application Number 6578 Permit Number 6578

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 100' Number of Lines 3

Depth of Filter Material 17" Cover Depth 18"

Water Supply Source well Distance from Water Source 100'

Excavation Inspected 7-25-73 (DATE) Tank Inspected 7-25-73 (DATE)

Nitrification Field Inspected 7-25-73 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ~~installed~~ or constructed, ~~altered~~ or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Board of Health in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments. Repair by Owner Gen. Cont. G.

Thomas R. Wall

Environmentalist

FORM NO. E-6-4-1-71

HEALTH DEPARTMENT'S COPY

Date Issued 18 September 1974 Serial No. 5754 ICAR(S) Permit No. 6578

T C No 165-142-02

Map Date 9-29-71


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 6578, dated 7-9-73 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 15 Oct 1974, after which date this permit shall be null and void

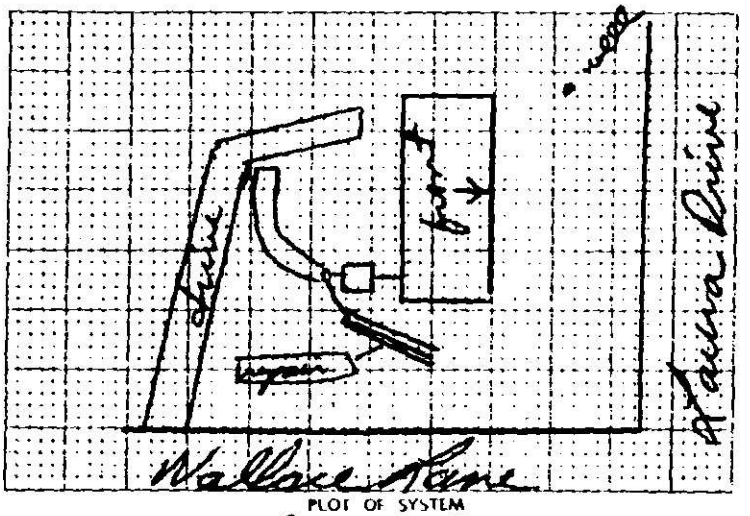

PLOT OF SYSTEM

Percolation Rate ___

Liquid Capacity of Tank ___

Tank Construction ___

Absorption and/or Nitrification Lines

Total Line Lenght 100 ± lft

Number of Lines 2 (5'x17½x4')

Distance from House 10' ±

Distance from Property Line 10'

Distance from Well 50' ±

NAME OF OWNER Danny Ray Gambrell

LOCATION OF PROPERTY 2301 Laura Drive

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Board of Health which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Health Director before any system can be covered up or otherwise rendered uninspectable or can be used

Comments 5'x17½x4' - tie into old repair

Division or Section Head

John R Atkisson
Environmentalist

If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Environmental Health Division in order to be valid. Only the signature of the Environmental Health Specialist is required where an existing system is being altered or repaired

E-5-9-1-72

536-8009

Date Issued 18 September 1974 Serial No. 5144 C of A (s) No. 6528

T C No 165-142-02

Map Date 9-29-71

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Gambrell (LAST), Danny (FIRST) Ray (MIDDLE)

Location of Property 2301 Laura Drive

Application Number 6528 Permit Number 6528

Began ~~Inspection~~ Date:

Liquid Capacity of Tank / Tank Material /

Total Length of Drain Tile 100 l/ft Number of Lines 2 (5x15x4')

Depth of Filter Material 4" Cover Depth 24"

Water Supply Source well Distance from Water Source 50'+

Excavation Inspected 9/18/74 (DATE) Tank Inspected / (DATE)

Nitrification Field Inspected / (DATE)

Washing Machine Line Inspected, If Applicable / (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ~~installed~~ or constructed, ~~altered~~ or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Board of Health in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments

/ / / / / /

John R Atkinson

Environmentalist

FORM NO E-6-8-1-72

HEALTH DEPARTMENT'S COPY