Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 9490 Permit #: 5368 Tax Parcel #: 021-211-06

Property Owner: Mike Pickard

Job Location Address: 14711 Autumncrest Road

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: _____ Contractor Name: Carey Tucker

Permitted Design Flow: 240 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: — gallons

Effluent Pump Model: —

Drainfield Installation ☐ N/A

Trench Depth: 24 inches

Trench Width: 3 feet

Line Spacing: 7 feet (O.C.)

Total line length: 200 feet

# of Lines: 2 @ 100 feet

Depth of Media: 12 inches (Type) IQ4W

Depth of Cover: 12 inches

Distribution Device: DROP CHAMBER

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ *inches (Type)* _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: >5' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >100' feet


Inspection Dates

Tank(s) Inspected: 3/8/12

Excavation Inspected: 3/8/12

Pump & Controls Inspected: —

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

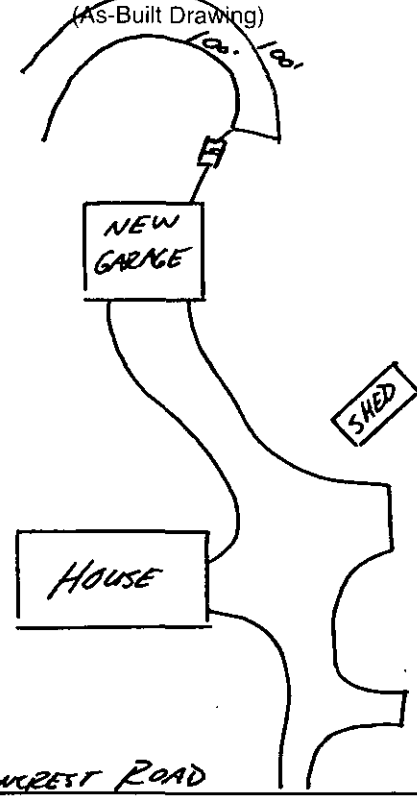

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: III g, Gravity, IQ4W, NA, NA

DENR Authorized Agent: Jeremy Nicholas REHS Signature: Jeremy Nicholas, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 9490 Permit #: 5368 Tax Parcel #: 021-211-06

Property Owner: Mike Pickard

Job Location Address: 14711 Autumncrest Road

City: Huntersville State: NC Zip Code: 28078

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: III-g

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Jeremy Michka, REHS Date: 3/8/12

Signature: Jeremy Michka, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 9490 Permit #: 5368 Tax Parcel #: 021-211-06

Property Owner: Mike Pickard

Job Location Address: 14711 Autumncrest Road

City: Huntersville State: NC Zip Code: 28078

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: III-g

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). *The system owner is responsible for all fees associated* with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Jeremy Mickler, REHS Date: 3/8/12

Signature: Jeremy Mickler, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 9490 Permit #: 5368 Tax Parcel #: 021-211-06

Property Owner: Mike Pickard

Job Location Address: 14711 Autumncrest Road

City: Huntersville State: NC Zip Code: 28078

Installation Approval Issuance Date: 3/7/12

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 9/7/12, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

NOTICE: This system shall not be installed while soils are in a wet condition.

Permitted Design Flow: 240 GPD

Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: —— gallons

Drainfield Design ☐ N/A

Trench Depth: 24 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 200 feet

# of Lines: 2 @ 100 feet

Depth of Media: 12 inches (Type) 25% RED.

Distribution Device: D-Box

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: >5' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: >100' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

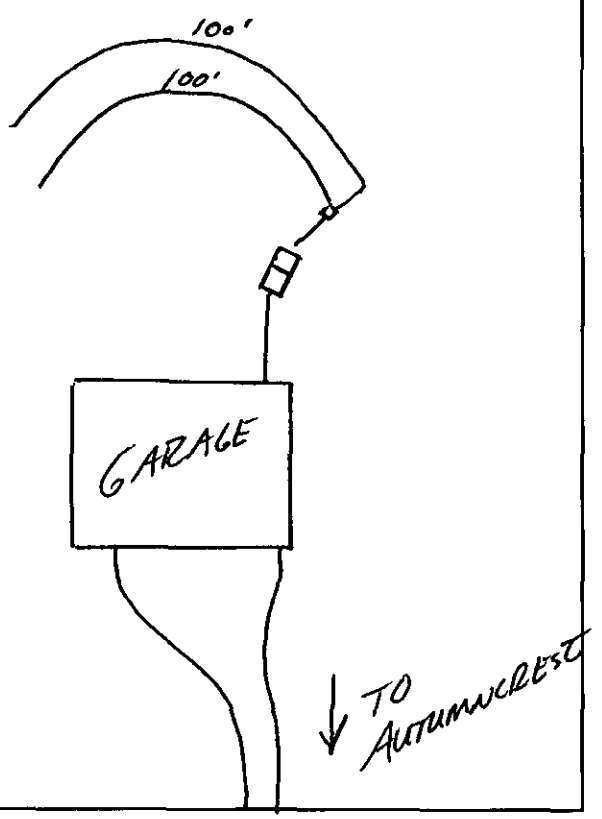

Comments: System Classification & Type: IIIg 25% RED. System

DENR Authorized Agent: Jeremy Michalec, R.S. Signature: Jeremy Michalec, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St. Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-8894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30005368 GWS File #: 9490 Tax Parcel #: 021-211-06

- *This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be* NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 12/14/2016

Type of Installation: Residential - New System **Lot Number:** 13

Structure Type: OTHER Size (ft^2): 2400 # Bedrooms: 1 # Occupants: 2

Building Foundation: Concrete Slab Water Supply: Municipal

II. Initial System Type: Approved **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd): 240 LTAR (gpd/ft^2): 0.3 Septic Tank Size (gal): 1500 Pump Tank Size (gal): N/A

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 600 Total Trench Length (ft): 200

Maximum Trench Depth (in): 24 Depth of Media (in): 12 Distribution Device: Distribution Box

III. Repair System Type: Approved **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd): 240 LTAR (gpd/ft^2): 0.3 Septic Tank Size (gal): 1500 Pump Tank Size (gal): N/A

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 600 Total Trench Length (ft): 200

Maximum Trench Depth (in): 24 Depth of Media (in): 12 Distribution Device: Distribution Box

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone Owner/Legal Agent: WARREN WEEKS
Print Name

Signature: Jeremy Michelone Signature: Warren Weeks

Date Issued: 12/14/2011 Southern Flair Bldg.

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30005368 GWS File #: 9490

IV. Permit Conditions/Comments:

- *All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.*
- The invert of the sewer pipe exiting the structrue should be kept as high as possible in order to achieve gravity flow to the drain field. A dosing tank will be required if gravity flow to the drain field can not be achieved.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone


Signature: Jeremy Michelone

Date Issued: 12/14/2011

Owner/Legal Agent: WARREN WEEKS
Print Name

Signature: Warren Weeks
Southern Flair Bldrs


IMPROVEMENT PERMIT FOR:
14711 AUTUMNCREST ROAD
FILE # 9490

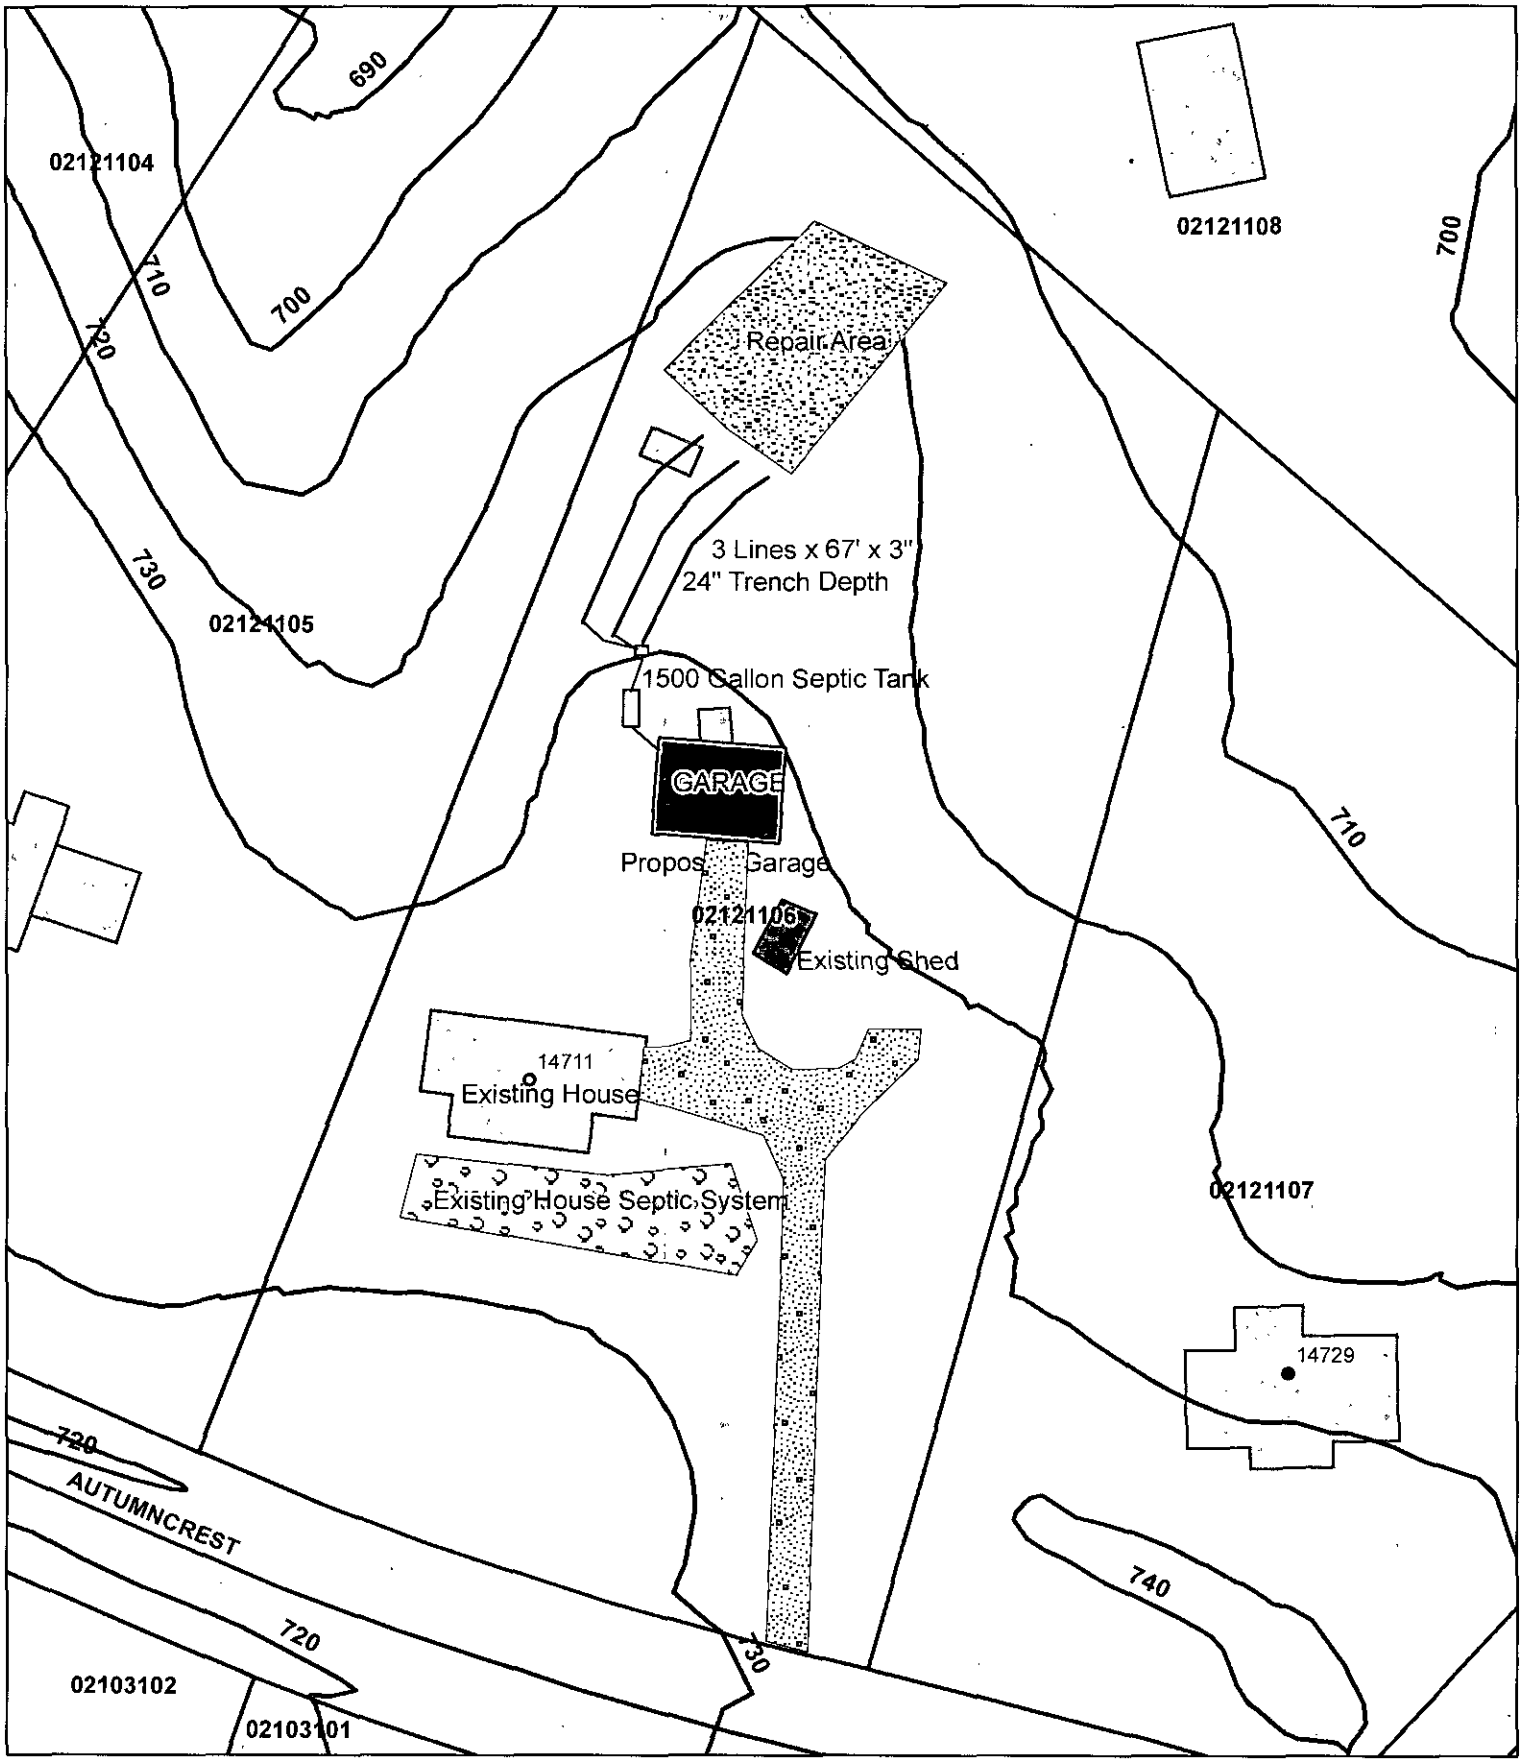

Map Created By: JEREMY MICHELONE
Map Created On: 12/14/11

0 30 60 120 Feet


SOIL EVALUATION FOR:
14711 aUTUMNCREST ROAD
FILE # 9490

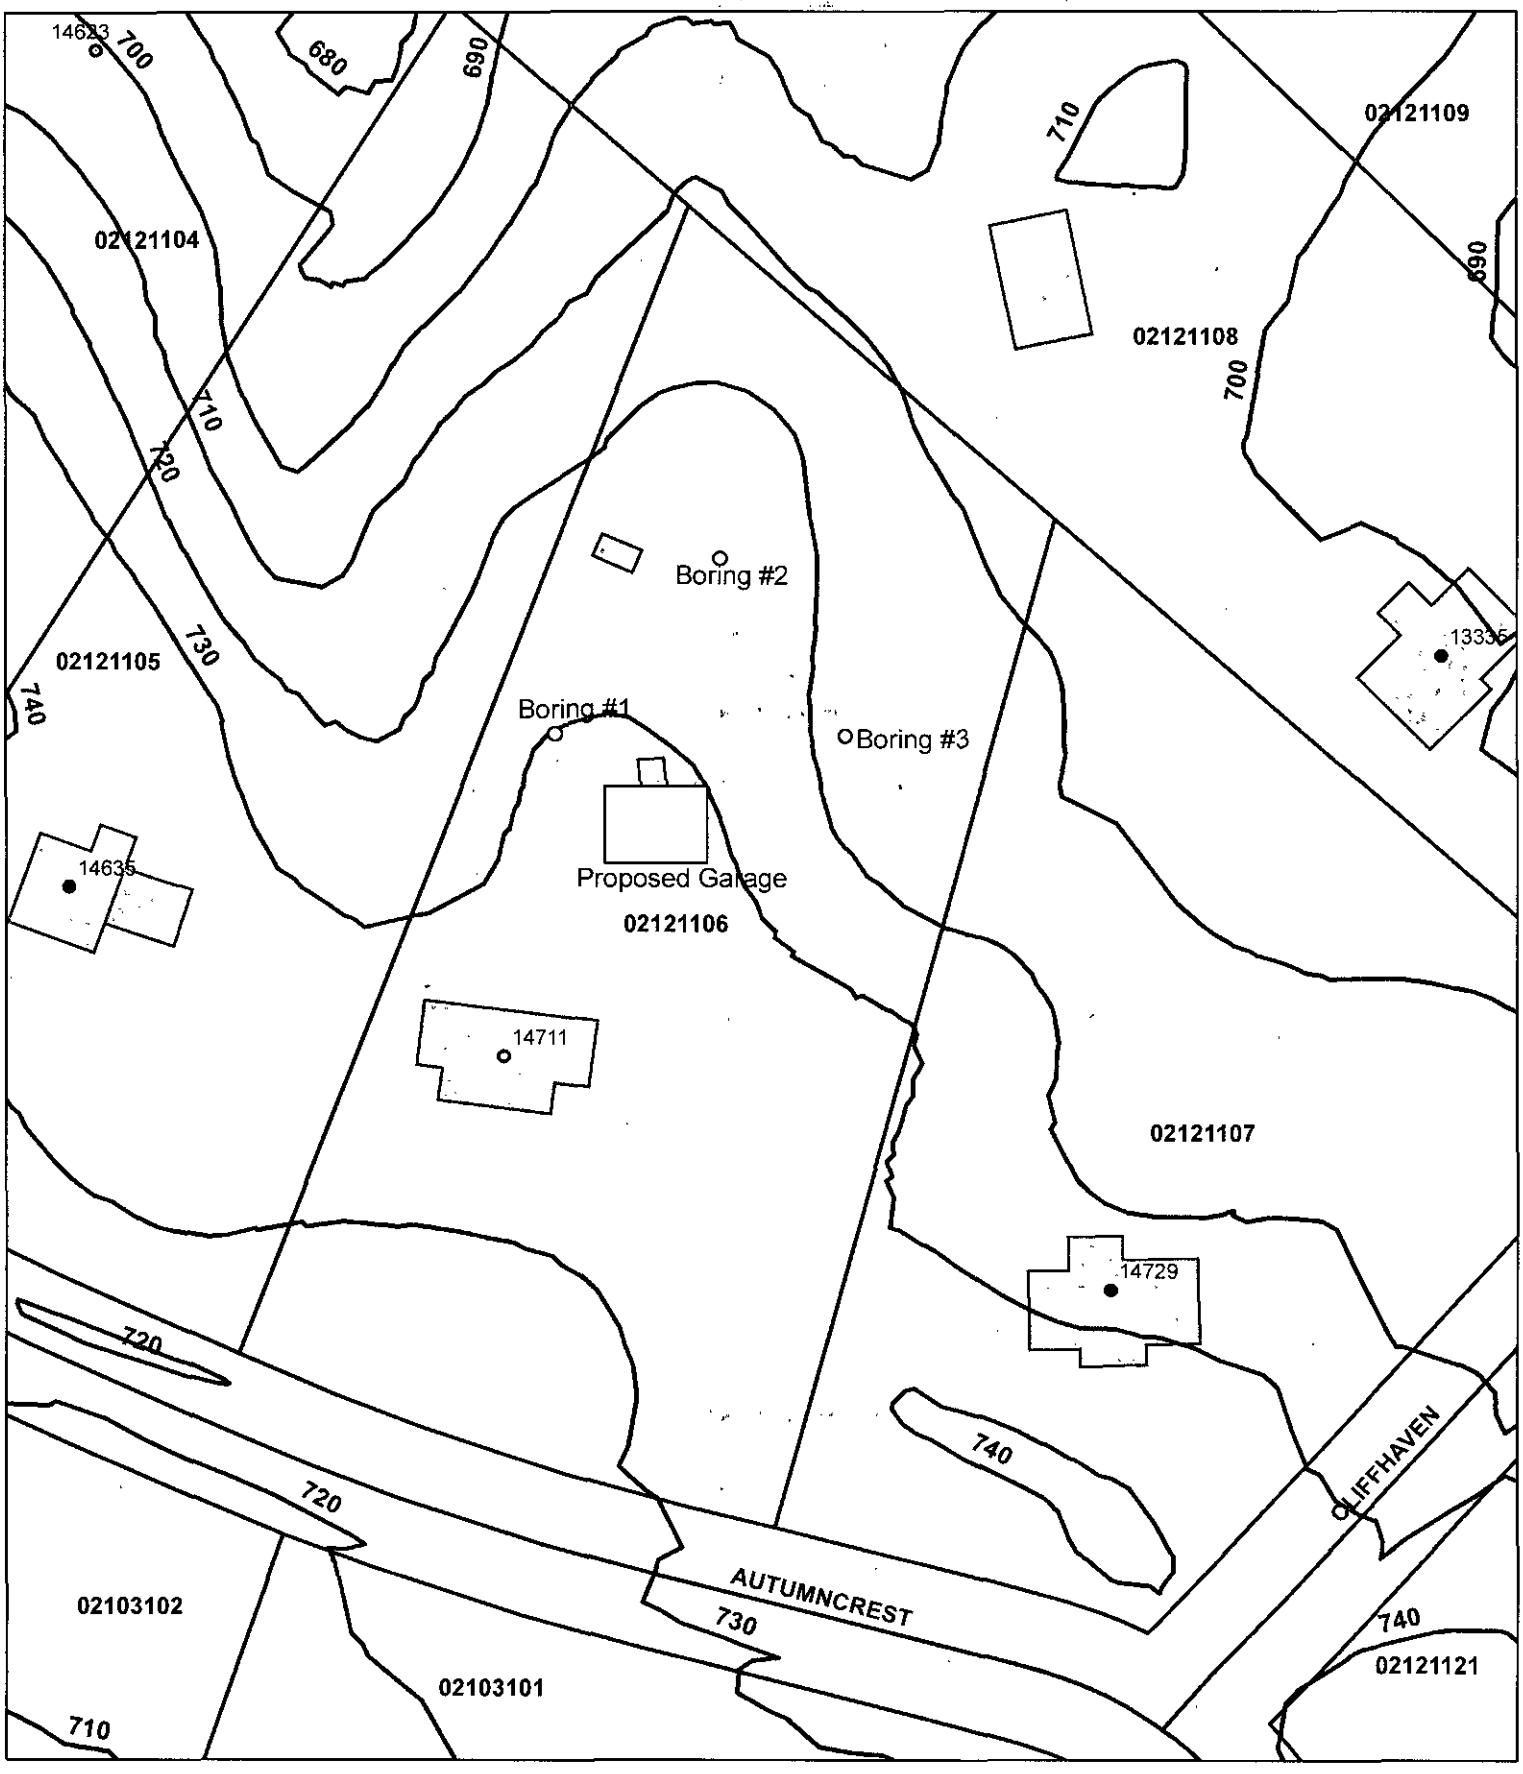

Map Created By: JEREMY MICHELONE
Map Created On: 12/14/11

0 37.5 75 150 Feet

IMPROVEMENT PERMIT FOR:
14711 AUTUMNCREST ROAD
FILE # 9490

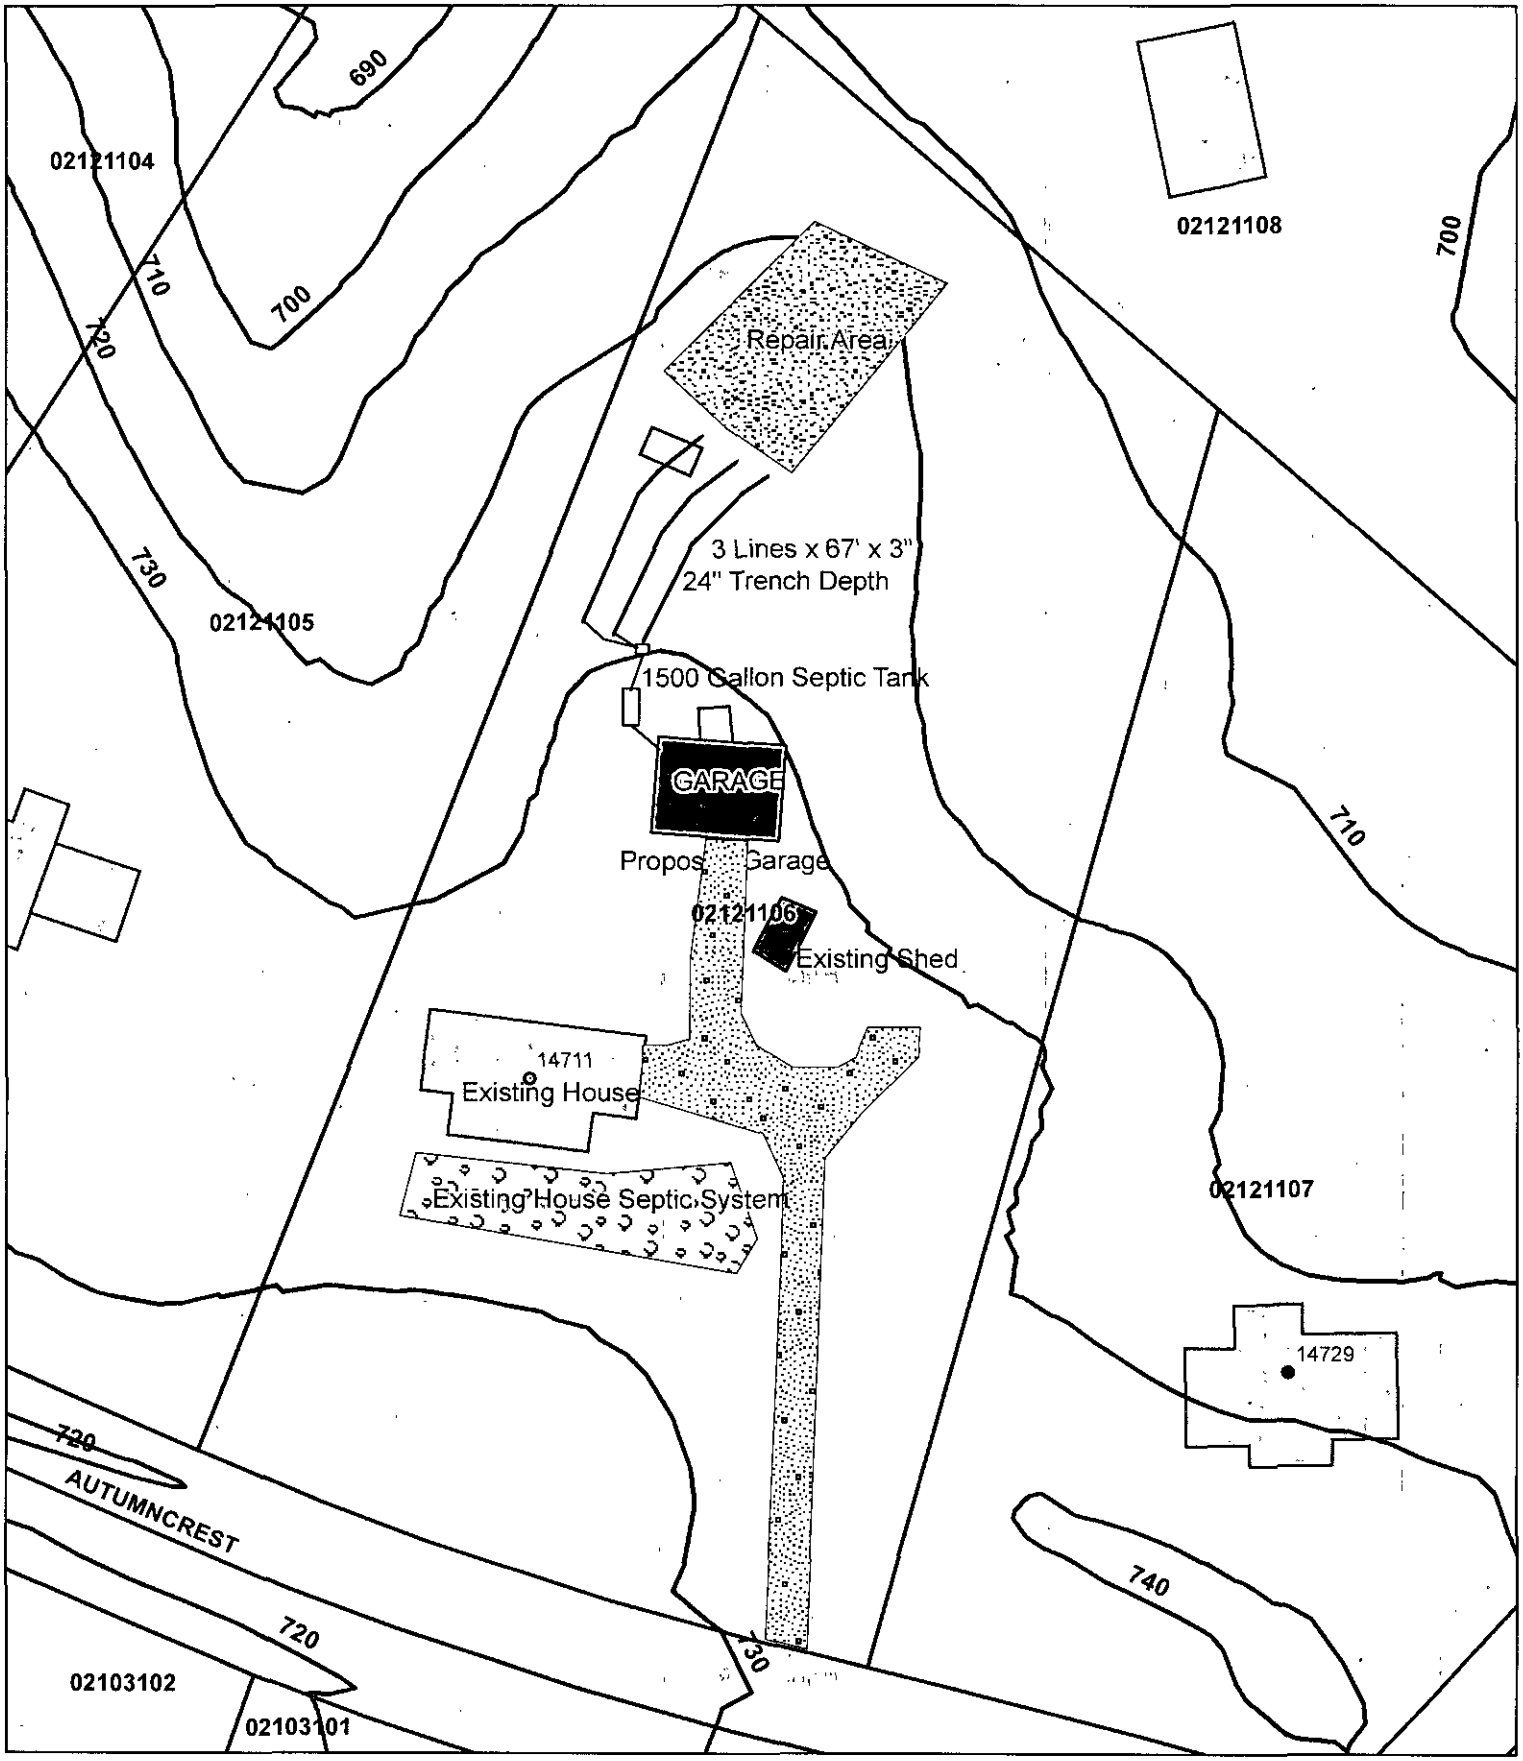

Map Created By: JEREMY MICHELONE
Map Created On: 12/14/11

0 30 60 120 Feet

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Property ID: 2121106
Lot #:
File #: 9490
AppID: 5368

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: MIKE & CATHERINE PICKARD
Applicant: SOUTHERN FLAIR BUILDERS
Address: 14711 AUTUMNCREST ROAD
Date Evaluated: 12/14/2011
Proposed Facility: GARAGE W/ LIVING Design Flow (.1949) 240 GPD
Property Size:
Location of Site: 14711 AUTUMNCREST ROAD
Property Recorded:
Water Supply: [X] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 1941 Structure/ Texture	1941 Consistence Mineralogy	b PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr. Horiz.	Profile Class & LTAR
1	LS	0-4	GR/LOAM	FR/NS/NP/NEXP	>47" TO SOIL WETNESS	47"	NA	NA	PS
	5%	4-35	GR/SL	FR/NS/NP/NEXP					0.3 G/D/FT2
		35-47	GR/SL	FR/NS/NP/NEXP					
2	LS	0-4	GR/LOAM	FR/NS/NP/NEXP	>42" TO SOIL WETNESS	42"	NA	NA	PS
	5%	4-30	GR/SL	FR/NS/NP/NEXP					0.3 G/D/FT2
		30-42	GR/SL	FR/NS/NP/NEXP					
3	LS	0-13	GR/SL	FR/NS/NP/NEXP	>46" TO SOIL WETNESS	46"	NA	NA	PS
	8%	13-34	WSBK/SCL	FR/SS/SP/SEXP					0.3 G/D/FT2
		34-46	WSBK/SCL	FI/SS/SP/SEXP					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	III g	III g
Site LTAR	0.3	0.3

Other Factors (.1946):
Soil Evaluation By: Jeremy Michelone, REHS
Others Present: Kennerly Johnstone
Site Classification (.1948): Provisionally Suitable
Site Evaluation By: Jeremy Michelone, REHS
Others Present: Kennerly Johnstone


Jeremy Michelone, REHS

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	


IMPROVEMENT PERMIT FOR:
14711 AUTUMNCREST ROAD
FILE # 9490

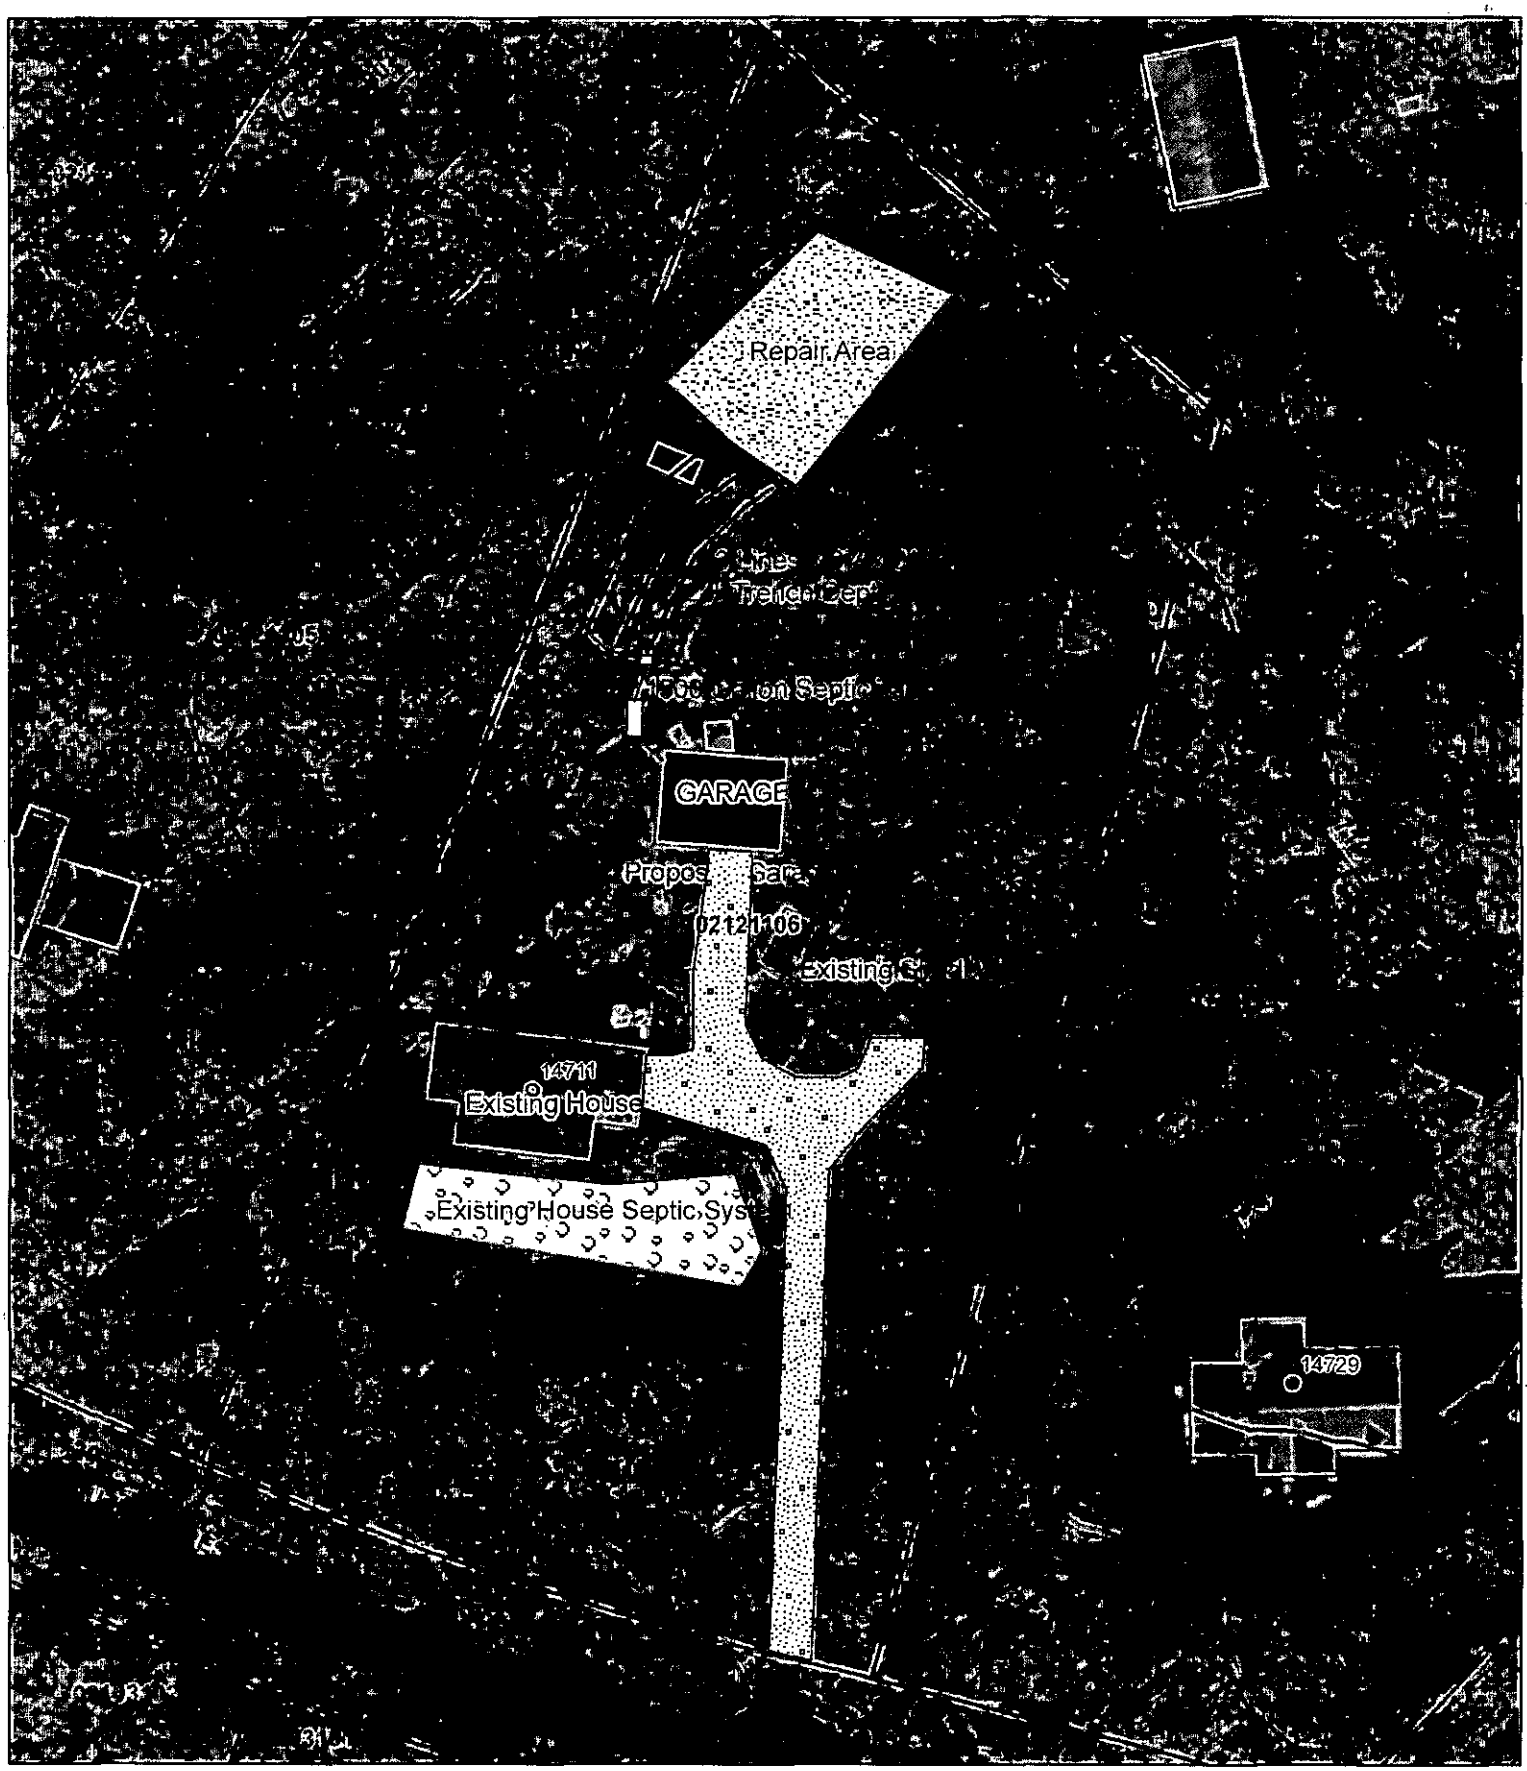

Map Created By: JEREMY MICHELONE
Map Created On: 12/14/11

0 30 60 120 Feet

IMPROVEMENT PERMIT FOR:
14711 AUTUMNCREST ROAD
FILE # 9490

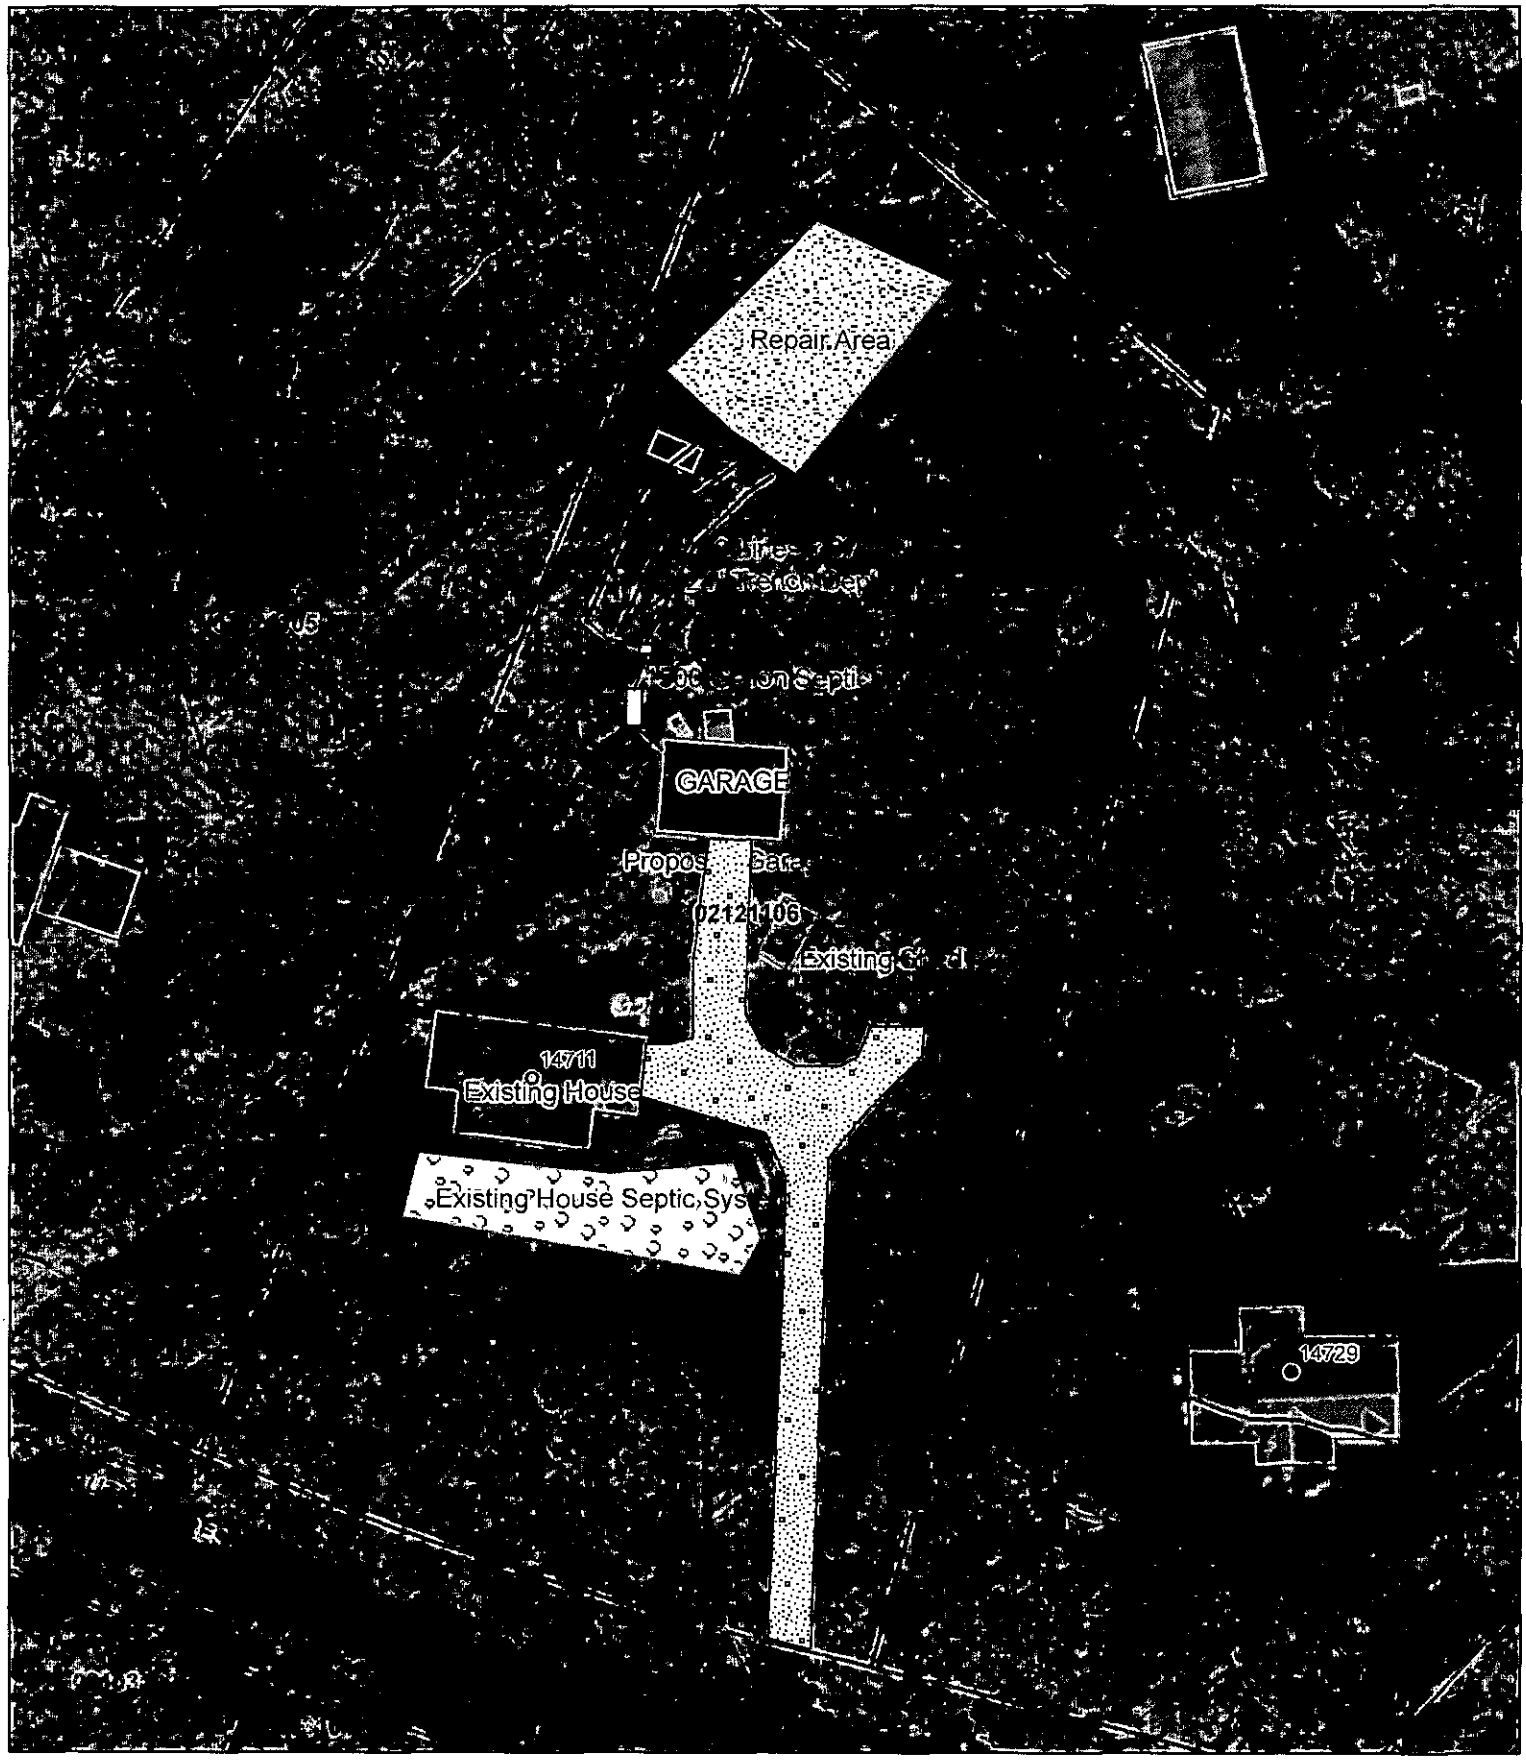

Map Created By: JEREMY MICHELONE
Map Created On: 12/14/11

0 30 60 120 Feet

#2 system

9490

MECKLENBURG COUNTY
HEALTH DEPARTMENT 5368

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ⊘ NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ⊘ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 02121106
STREET ADDRESS: 14711 AUTUMNCREST RD,
CITY: HUNTERSVILLE
STATE: NC ZIP: 28078
SUBDIVISION NAME: OAKWOOD FOREST
LOT #: 13 LOT SIZE (acres): 2.43
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ⊘ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
○ HOUSE ⊘ OTHER GARAGE w/ Apartment above
HEATED SQUARE FOOTAGE: 2400
NUMBER OF BEDROOMS: 1
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
⊘ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
○ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ⊘ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ⊘ N/A ○ IRRIGATION ○ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☐ ANY TYPE ☑ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: 1 ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ⊘ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ⊘ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	⊘ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ⊘ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ⊘ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ⊘ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ⊘ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ⊘ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ⊘ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ⊘ NO
WASTE STORAGE	○ YES ⊘ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ⊘ NO

REFER TO PLOT PLAN

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 2000 ☐ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☑ N/A

12. PROPERTY OWNER:
NAME: MIKE & CATHERINE PICKARD
ADDRESS: 14711 AUTUMNCREST RD
CITY: HUNTERSVILLE
STATE: NC ZIP: 28078
WORK PHONE: _____
MOBILE PHONE: (704) 564-1405
FAX: _____
E-MAIL: _____

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: SOUTHERN FLAIR BUILDERS
ADDRESS: P.O. BOX 481923
CITY: CHARLOTTE
STATE: NC ZIP: 28269
WORK PHONE: (704) 948-6100
MOBILE PHONE: (704) 309-1288
FAX: (704) 948-6106
E-MAIL: SOUTHFLAIR@AOL.COM

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

_____ _____

Property Owner's or Owner's Legal Representative Signature Date

---

OFFICE USE ONLY

O SURVEY PLAT TO SCALE SUBMITTED O SCALED SITE PLAN SUBMITTED O UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ 250.00 DATE FEE RECEIVED: 12/8/11

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: lws

GWS FILE NUMBER ASSIGNED: 9498 (second systems)

APPLICATION ID NUMBER ASSIGNED: 5368

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


Revised on: 12/15/10

File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 14711 AUTUMNCREST RD. Tax Parcel #: 02121106

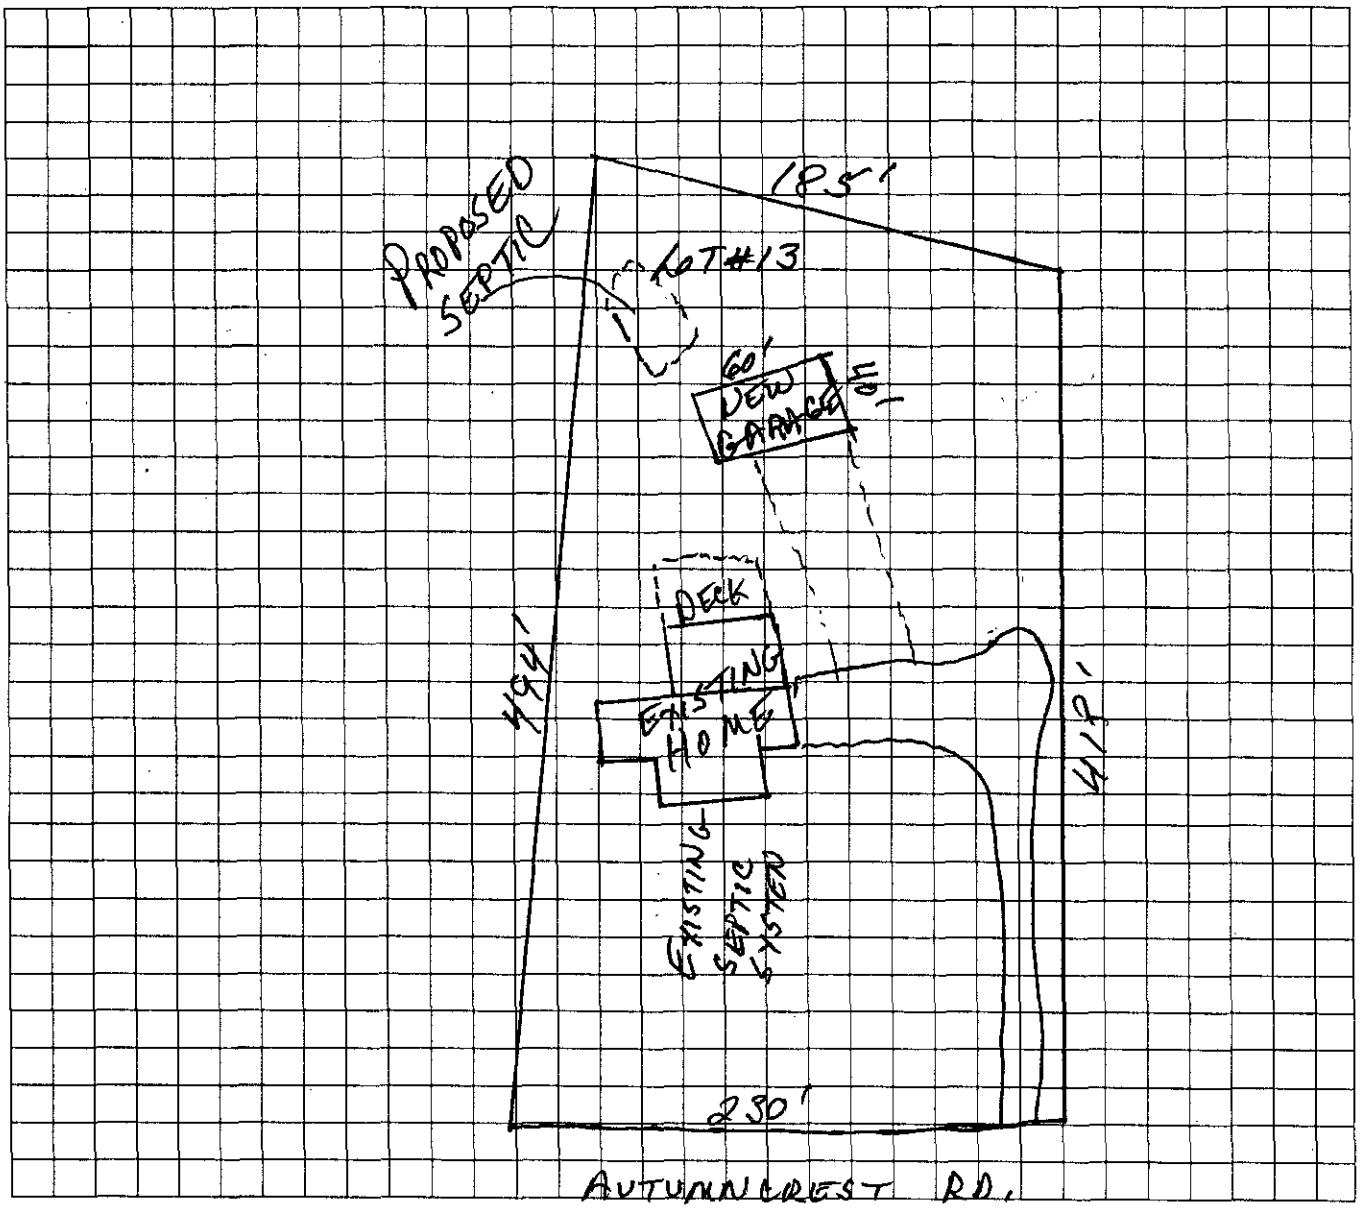

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- This permit is not transferable.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

_____

_____

_____ _____

REHS Signature Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11