WELL RECORD Permit No 6367

MAIL COMPLETED FORM TO: WELL WATER SUPPLIES

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION, 1200 BLYTHE BOULEVARD, CHARLOTTE, N. C 28203

Drilling Contractor

1. Location of property Peterson, Carolina, N.C.
2. Name of owner Michael Ling Mr. Ford
   Address Box 223, Pineville, N.C.
3. Does this well replace an existing well? No
4. Topography (circle one): draw, slope, hilltop, valley, flat
5. Use of well Home Date completed 7-12-78
6. Rig type or method Air Total depth 225 ft.
7. Casing:

	Depth		Inside Diam.	Wall thick. or Wt. ft.	Type
From	0	to 23 ft.	6 in.	Galv.	Steel

8. Grout:

	Depth		Material	Method
From	0	to 20 ft.	Neat	Slurried

9. Liner, if used: Depth _____ Diameter _____
   No. holes drilled and abandoned _____
10. Water zones (depth and gpm) 210-225 5 gpm
11. Static water level: 50 ft. above (below) top of casing
    which is 1 ft. above land surface. Elev. _____
    Date _____
12. Yield (gpm) 15 Method of testing Air
13. Pumping water level: _____ ft. after _____ hrs.
    at _____ gpm.
14. Water quality _____ Temperature (°F) _____
15. Well sterilization method Acid
16. Permanent pump: _____ Type _____ Make _____
    Installed – Date _____ By _____
    Capacity _____ gpm. Hp _____ TDH _____
    Intake depth _____ Airline depth _____
17. Remarks: _____

DRILLING LOG

Depth From	To	Formation
0	20	soil & rock & sand gravel
20	225	blue & black sparkle granite

MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH
JUL 26 19
REVIEWED BY

I do hereby certify that this well record is true and exact.

Signature of Contractor or Agent

FORM NO. E-22-5-1-73

Date Received 6-22-76 | Apt. RECEIVED JUN 22 1976 | Application No. (W) 6367
T. C. No. 001-081-04
Map Date 6-4-76

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION

APPLICATION FOR WELL WATER SUPPLY PERMIT

NAME OF OWNER MCLEOD (LAST), MICHAEL (FIRST) RAY (MIDDLE)

ADDRESS OF OWNER BOX 605, DAVIDSON N.C., ZIP 28036

PHONE NO. Home 892-5423 Office 332-8521

LOCATION OF PROPERTY JETTON ROAD, CORNELIUS N.C.
(STREET OR COUNTY ROAD)


SUBDIVISION Mountain View Beach LOT NO. 16 BLOCK NO.

MAP BOOK NO. 11 PAGE NO. 243 FHA LOAN

DEED REFERENCE: DEED BOOK 3237 PAGE NO. 609 VA LOAN

WELL CONTRACTOR _____ LICENSE NO. _____

Application is hereby made to the Mecklenburg County Health Department for a permit to drill a water well on the hereinabove described lot to be used as a source of ✓ individual, _____ semi public, or _____ public water supply.

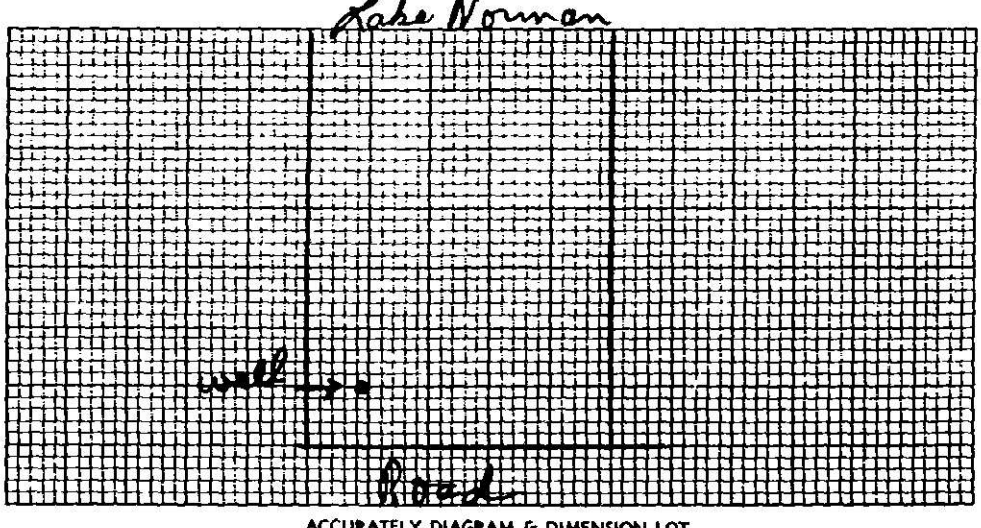

ACCURATELY DIAGRAM & DIMENSION LOT

17 June 1976
DATE OF APPLICATION

Michael Ray McLeod
OWNER

Application approved and permit hereby granted

Permit No: 6367

John A. Akerson
ENVIRONMENTALIST

FORM NO. E-20-5-1-73

HEALTH DEPARTMENT'S COPY

Date Received 5.24.73

APT No. 6367

T C. No.

Map Date

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

APPLICATION FOR PERCOLATION TEST

1) NAME OF OWNER Taylor, Jr. (LAST) Theodore (FIRST) W. (MIDDLE)

2) ADDRESS OF OWNER Route #7, Box 681-P, Charlotte, N. C. ZIP 28213

3) PHONE NO. Home 596-1450 Office 596-1441


4) LOCATION OF PROPERTY Jetton Road, Cornelius, N. C. (STREET OR COUNTY ROAD)

5) SUBDIVISION Mountain View Beach LOT NO. 16 BLOCK NO.

MAP BOOK NO. 11 PAGE NO. 243

6) DEED REFERENCE DEED BOOK 3237 PAGE NO. 609

Application is hereby made to the Mecklenburg County Health Department for the conduct of a percolation test and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge.

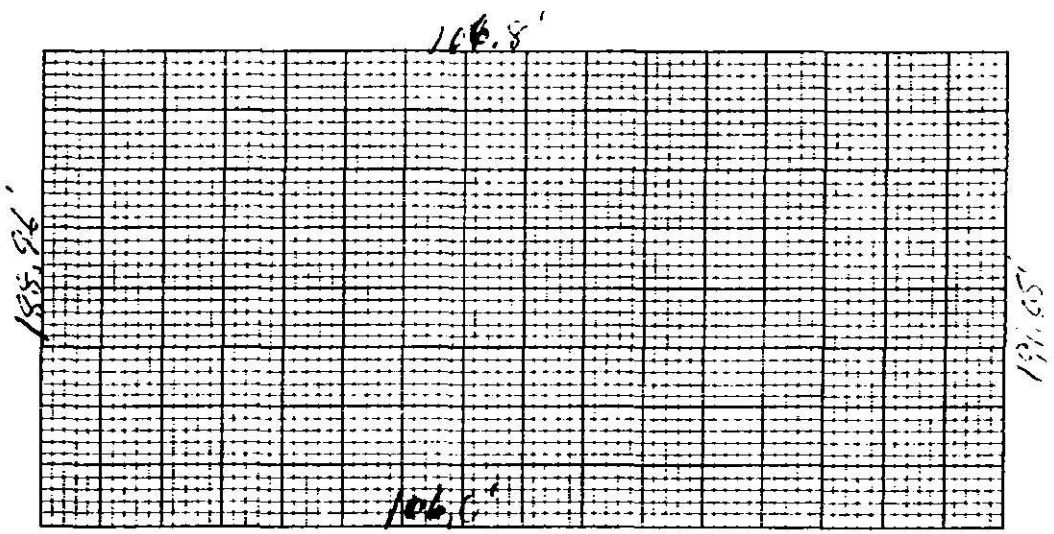

7) ACCURATELY DIAGRAM & DIMENSION LOT

Theodore W. Taylor Jr.
OWNER

FORM NO. E-1-11-1-70

HEALTH DEPARTMENT'S COPY

Serial No. [illegible]

PTR No. 6367

Date Issued September 12, 1973

T C No 001-081-04

Map Date 3-1-72

Do Not Issue A Building Permit Based On This Form

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION


PERCOLATION TEST REPORT

NAME OF OWNER Taylor, Jr. (LAST) Theodore (FIRST) W. (MIDDLE)

ADDRESS OF OWNER Route 7, Box 681-P ZIP 28213

LOCATION OF PROPERTY Jetton Road (STREET OR COUNTY ROAD)

SUBDIVISION Mountain View Beach LOT NO 16 BLOCK NO.

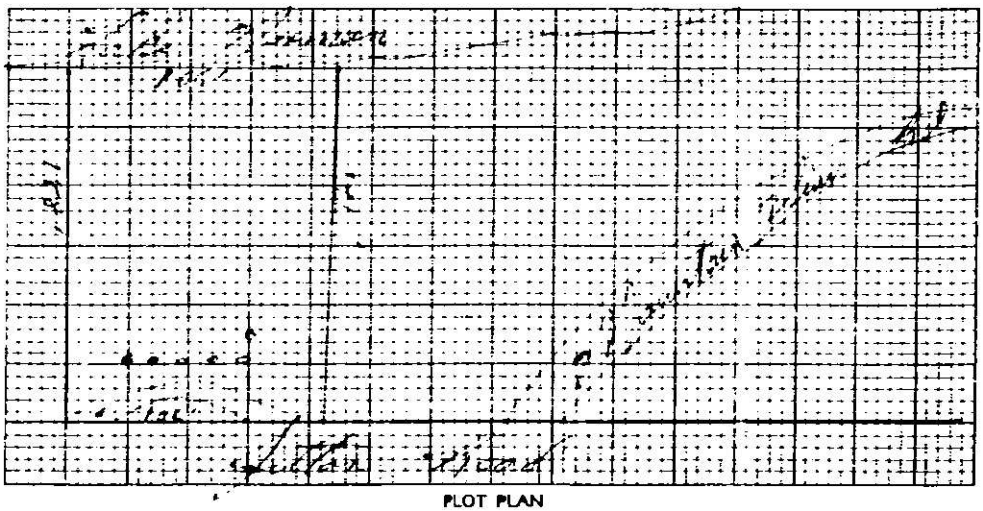

PLOT PLAN

This is to certify that a percolation test has been run and an on-site inspection made by the Mecklenburg County Health Department on the lot described above. The said test was conducted on that portion of the lot as indicated on above plot.

The percolation rate determined by the test was 60 min/in The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install, construct, alter, or repair the specific system shall be obtained from the Mecklenburg County Health Department prior to the beginning of any construction of buildings, or of the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater teratment system which must be installed will be determined by the Health Department prior to installation based on the percolation rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area where the percolation test was run.
4. This approval is void if any grading, filling, or construction (including the drilling of a well) is performed on the lot which, in the opinion of the Health Department, renders the area where the percolation test was run unsuitable for the installation, construction, alteration, and/or repair of such a system.

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina State Board of Health and the Mecklenburg County Board of Health which were in effect on the date of issuance and is void if at any time in the future, prior to the completion of the system, these laws, rules, and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

[signature]

Director, Environmental Health Division or Authorized Section Head

FORM NO. E-2-4-1-71

HEALTH DEPARTMENT'S COPY

SEE INSTRUCTIONS ON BACK

Date Received 6/14/76

ICAR(S) Application No 1,2,3,4

T C No 001-081-04

Map Date 3-1-76


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to

1) ✓ Install or Construct 2) ___ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge

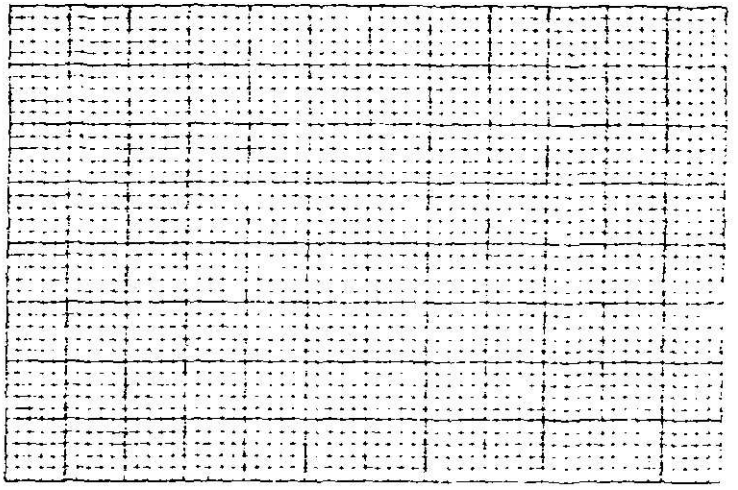

3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) No of Bedrooms 2

5) Business Use – Max No Employees ___

6) Washing Machine ✓ Yes ___ No

7) Garbage Disposal ___ Yes ✓ No

8) Dishwasher ✓ Yes ___ No

9) Water Supply
- A) Individual Well ✓
- B) Governmental System ___
- C) Community System
  - 1 Well source ___
  - 2 Governmental source ___

10) Sewage System
House located within 200 feet of public sewer ___ Yes ___ No
House located within 200 feet of community sewer ___ Yes ___ No

11) FHA Case No ___

12) VA Case No ___

13) NAME OF OWNER McLEOD (LAST) MICHAEL RAY (FIRST, MIDDLE)

14) ADDRESS OF OWNER BOX 505, TROUTMAN N.C. 28166

15) PHONE NO. Home 528 6463 Office 332 8529

16) LOCATION OF SYSTEM JETTON ROAD (STREET OR COUNTY ROAD), CORNELIUS, N.C.

17) SUBDIVISION MOUNTAIN VIEW BEACH Lot No. 16 Block No. ___

Map Book No. 11 Page No. 243

18) DEED REFERENCE — DEED BOOK 3237 AT PAGE 609

19) HAS A PERCOLATION TEST BEEN RUN? ✓ YES ___ NO DATE RUN 1973

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

6/17/76
DATE OF APPLICATION

Michael Ray McLeod
OWNER

FORM NO E-4-4-2M-6-76S

HEALTH DEPARTMENT'S COPY

Date Issued 6-17-76

Serial No. 6017

IMPROVEMENTS PERMIT

LA No. 6367

T. C. No. 001-081-04

Map Date 3-1-72

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER McLeod (LAST) Michael (FIRST) Ray (MIDDLE)

ADDRESS OF OWNER Box 505, Troutman, N. C. ZIP 28166

LOCATION OF LOT Jetton Road, Cornelius, N. C. (STREET OR COUNTY ROAD)

SUBDIVISION Mountain View Beach LOT NO 16 BLOCK NO. _____

MAP BOOK NO. _____ PAGE NO. _____

The above specified lot is approved by the Mecklenburg County Health Department for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the percolation test results which yielded a percolation rate of _____, on an on-site inspection of the said lot, and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 6367. This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered, and/or repaired in the same area where the percolation test was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altred, and/or repaired and that the system be installed in accordance with same.

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic-tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit

John R Adkisson
Environmentalist

Director, Environmental Health Division or Authorized Section Head

FORM NO. E-3-9-2M-6-75

HEALTH DEPARTMENT COPY

Date Issued 8 July 1976 **Serial** No. 7642 ICAR(S) Permit No. 6367

T C No. _____

Map Date _____


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, __ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 6367, dated 6/17/76, and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 6 Aug 1976 after which date this permit shall be null and void.

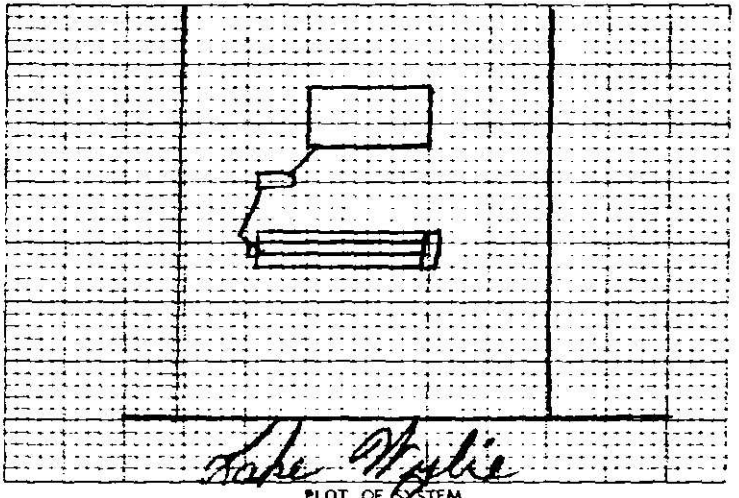

PLOT OF SYSTEM

Percolation Rate 60

Liquid Capacity of Tank 1500

Tank Construction precast

Absorption and/or Nitrification Lines

Total Line Lenght 450

Number of Lines 5

Distance from House 15'

Distance from Property Line 10'

Distance from Well 50'

NAME OF OWNER McLeod, Michael Ray

LOCATION OF PROPERTY Jetton Rd

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Board of Health which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Health Director before any system can be covered up or otherwise rendered uninspectable or can be used.

Comments: in bed 12½ x 45 x 36" plus aeration pit on end

John R. Atkisson

Division or Section Head

Environmentalist

If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Environmental Health Division in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

FORM NO E-5-4-2M-6-75

HEALTH DEPARTMENT COPY

Date Issued 21 July 1976 Serial No. 0003

C of A (s) No. 6367

T C. No 001-081-04

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

ENVIRONMENTAL HEALTH DIVISION

John R Atkisson

CERTIFICATE OF COMPLETION **CERTIFICATE OF APPROVAL**

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner McLeod, Michael Ray (LAST, FIRST, MIDDLE)

Location of Property Jetton Road, Cornelius, N.C

Application Number 630 Permit Number 6367

Inspection Data:

Liquid Capacity of Tank 1500 Tank Material precast

Total Length of Drain Tile 450 Number of Lines 5

Depth of Filter Material 36" Cover Depth 15"

Water Supply Source well Distance from Water Source 50'+

Excavation Inspected 21 July 1976 (DATE) Tank Inspected 21 July 1976 (DATE)

Nitrification Field Inspected 21 July 1976 (DATE)

Washing Machine Line Inspected, If Applicable _____ (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ___ installed or constructed, ___ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments installed as permitted - considerable amount of rock - larger ones set aside bottom of drain field leveled with soil

John R Atkisson

Environmentalist

EHD-S-76

Environmental Health Department's Copy