

7612 HOLLYWOOD ST

03722308

12/26/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Mecklenburg County
Health Department

September 5, 1996

Mr. John D. Pressley
6133 Rumple Road
Charlotte, NC 28262

Re: 7612 Hollywood Street
File: 1551B
Parcel: 037-223-08PO

Dear Mr. Pressley:

Receipt of your Application for Improvement Permit for the above referenced property is acknowledged. A soil evaluation and a site visit have been conducted. The results of the evaluation indicated that the site is **UNSUITABLE** under Rules .1941 **SOIL CHARACTERISTICS (MORPHOLOGY)**, .1942 **SOIL WETNESS CONDITIONS**, .1943 **SOIL DEPTH** and .1945 **AVAILABLE SPACE**. For these reasons your Application for Improvement Permit is denied. A possible way to develop the site exists under Rule .1948(d) which reads as follows:

> A site classified as **UNSUITABLE** may be used for a ground absorption sewage treatment and disposal system specifically identified in Rules .1955, .1956, or .1957 of this Section or a system approved under Rule .1969 if written documentation, including engineering, hydrogeologic, geologic or soil studies, indicates to the local health department that the proposed system can be expected to function satisfactorily. Such sites shall be reclassified as **PROVISIONALLY SUITABLE** if the local health department determines that the substantiating data indicate that:
> (1) a ground absorption system can be installed so that the effluent will be non-pathogenic, non-infectious, non-toxic, and non-hazardous;
> (2) the effluent will not contaminate ground or surface water; and
> (3) the effluent will not be exposed on the ground surface or be discharged to surface waters where it could come in contact with people, animals, or vectors.

The State shall review the substantiating data if requested by the local health department.

Please be advised that you have the right to an informal review by this department. You also have the right to appeal under G.S. 130A-24, and to have the appeal held in Mecklenburg County.

If you have any questions regarding this matter, please call me at 336-5575.

Sincerely,

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems

Mecklenburg County
Health Department

John D Pressley
6133 Rumple Rd
Charlotte NC 28262

Re: 7612 Hollywood st.
File: 1551 B
Parcel: 037-273-08 PO

Receipt of your Application for Improvement Permit for the above referenced property is acknowledged. A soil evaluation and a site visit have been conducted. The results of the evaluation indicated that the site is **UNSUITABLE** under Rules

For these reasons your Application for Improvement Permit is denied. A possible way to develop the site exists under Rule .1948(d) which reads as follows: over

> A site classified as **UNSUITABLE** may be used for a ground absorption sewage treatment and disposal system specifically identified in Rules .1955, .1956, or .1957 of this Section or a system approved under Rule .1969 if written documentation, including engineering, hydrogeologic, geologic or soil studies, indicates to the local health department that the proposed system can be expected to function satisfactorily. Such sites shall be reclassified as **PROVISIONALLY SUITABLE** if the local health department determines that the substantiating data indicate that:
> (1) a ground absorption system can be installed so that the effluent will be non-pathogenic, non-infectious, non-toxic, and non-hazardous;
> (2) the effluent will not contaminate groundwater or surface water; and
> (3) the effluent will not be exposed on the ground surface or be discharged to surface waters where it could come in contact with people, animals, or vectors.
>
> The State shall review the substantiating data if requested by the local health department.

Please be advised that you have the right to an informal review by this department. You also have the right to appeal under G.S. 130A-24, and to have the appeal held in Mecklenburg County.

If you have any questions regarding this matter, please call me at 336-5575.

Sincerely,

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems

.1941 SOIL CHARACTERISTICS (MORPHOLOGY),

.1942 SOIL WETNESS CONDITIONS, .1943

SOIL DEPTH AND .1945 AVAILABLE SPACE

FEE: $150 + check # 1443 DATE: 8-21-96 (OK)

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

1445 RD 1 CRT

TYPE APPLICATION: ✓ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM __ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 1551 B

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 037-223-08 P.O.

STREET ADDRESS: 7612 Hollywood St.

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

TYPE OF BUILDING (CHECK ONE):

✓ SINGLE MOBILE HOME(S)
✓ DOUBLE WIDE (D)
__ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

HEATED SQUARE FOOTAGE: 1200

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 3

FOUNDATION FOR RESIDENCE:

✓ WITHOUT BASEMENT
__ ON SLAB
✓ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

CLOSING DATE _____

CHH Mck
Home has been purchased from Public School system program (Garinger house) House must be moved in order for the new program for 96/97 school year. Home must be moved ASAP. Please help.

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

(Biel - They are looking to split this lot

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):
__ COMMUNITY (C)
__ MUNICIPAL (M)
✓ PRIVATE WELL (P)
__ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES __ YES ✓ NO
EXISTING WASTEWATER SYSTEMS __ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES ✓ NO
WELL, SPRINGS OR WATERLINES __ YES ✓ NO
DESIGNATED WETLANDS __ YES ✓ NO

PROPERTY OWNER: 346240

NAME: Pressley (LAST) John (FIRST) D (MI)

ADDRESS: 6133 Rumple Rd

CITY: CLT STATE: NC ZIP: 28262

DAYTIME PHONE: (704) 598-2742

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) —

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: John David Pressley DATE: 8-21-96

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

PROPOSED PLOT PLAN


1/09
132
109

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 1551 B

TC: 037-223-08

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

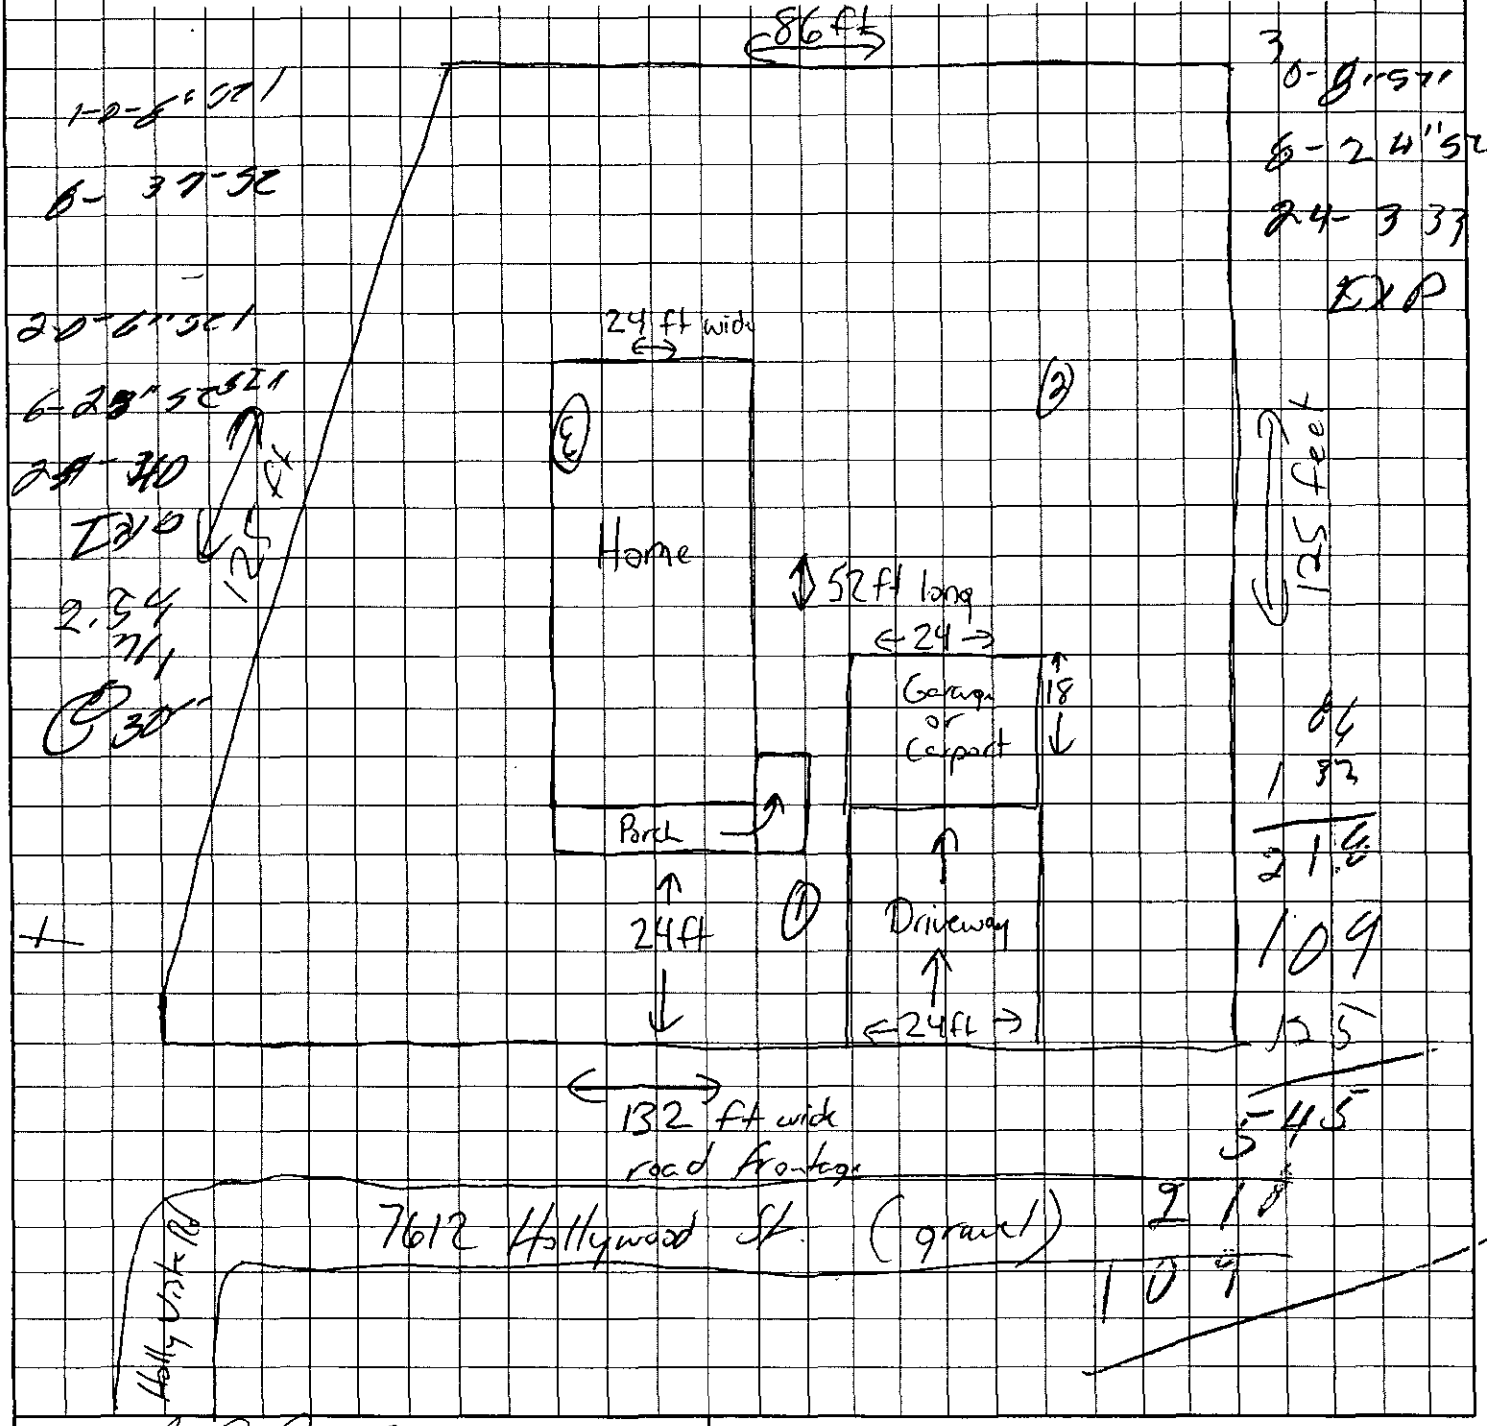

OWNER/AGENT SIGNATURE

DATE 8-21-96

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet #
PROPERTY ID #:
COUNTY:

#3

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

1551 B
PO 037-223-06
Lots 19-23

OWNER: John D. Priessley
ADDRESS: 6133 Pemble Road, Char
PROPOSED FACILITY: residence
LOCATION OF SITE: 7612 Hollywood Dr.
APPLICANT:
APPLICATION DATE:
PROPOSED DESIGN FLOW (.1949): 360 gpd
DATE EVALUATED:
PROPERTY SIZE: .33
PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☑ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	3-6% slopes .1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTA
1	LS	0-8"	gr/sc/	Fr/SEXP/SS/SP	2.5Y 7/1 @ 30-37"	37"	N/A	None	US
		8-37	sBK/C	Fr-Fi/SEXP/SS/SP					
2	LS	0-6"	gr/sc/	Fr/SEXP/SS/SP	2.5Y 7/1 @ 30"	40"	N/A	None	US
		6-28"	sBK/C	Fr-Fi/SEXP/SS/SP					
		28-40"	sBK/C	Fi/EXP/SS/P					
3	LS	0-8"	gr/sc/	Fr/SEXP/SS/SP	>33" TO Chroma 2 Colors	33"	N/A	None	US
		8-24"	sBK/SC	Fr-Fi/SEXP/SS/SP					
		24-33"	sBK/SC	Fi/EXP/SS/P					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): recommended
EVALUATED BY: William A. Martin E-23

OMMENTS: Probably mound soil

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	LPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope) V (Convex Slope) (Drainage Way) S (Debris Slump) P (Flood Plain) S (Foot Slope) (Head Slope) (Linear Slope) (Nose Slope) (Ridge) (Shoulder Slope) (Terrace)	I	S (Sand) LS (Loamy Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive) SEXP (Slightly Expansive) EXP (Expansive)	G (Single Grain) M (Massive) CR (Crumb) GR (Granular) SBK (Subangular Blocky) ABK (Angular Blocky) PL (Platy) PR (Prismatic)
	II	SL (Sandy Loam) L (Loam)	0.8 - 0.6	0.4 - 0.3		
	III	SI (Silt) SICL (Silty Clay Loam) CL (Clay Loam) SCL (Sandy Clay Loam) SLC (Silt Loam Clay)	0.6 - 0.3	0.3 - 0.15		
					MOIST	WET
	IV	SC (Sandy Clay) SIC (Silty Clay)	0.4 - 0.1	0.2 - 0.05	VFR (Very Friable) FR (Friable) FI (Firm) VFI (Very Firm v. Very Sticky) EFI (Extremely Firm)	NS (Non-sticky) SS (Slightly Sticky) S (Sticky) VS (Very Sticky) NP (Non-plastic) SP (Slightly Plastic) P (Plastic) VP (Very Plastic)
		O (Organic)	None			

OILS


ORIZON DEPTH	In inches below natural soil surface
EPTH OF FILL	In inches from land surface
FFECTIVE HORIZON	Thickness and depth from land surface
APROLITE	S(suitable) or U(unsuitable)
IGH WATER TABLE	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designati
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

1551 B

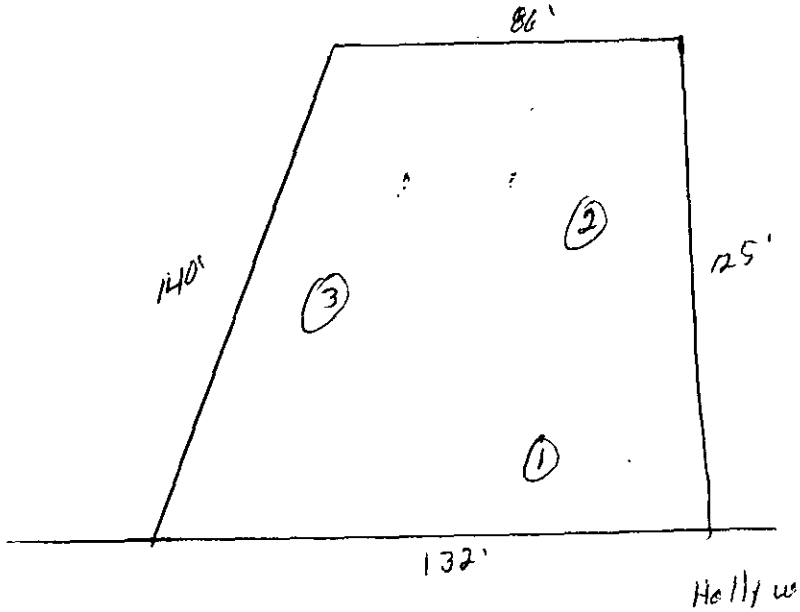

Hollywood St.

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

DW400 #3

Sheet
PROPERTY ID #:
COUNTY:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

1551 B
PO 037-223-06
Lots 19-23

OWNER: John D. Priestley APPLICANT:
ADDRESS: 6133 Rumple Road, Char. APPLICATION DATE: DATE EVALUATED:
PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949): 360gpd PROPERTY SIZE: .33
LOCATION OF SITE: 7612 Hollywood Dr. PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	3-6% 5 10-15 .1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS	0-8"	gr/sc/	Fv/SEXP/SS/SP	2.5Y 7/1 @ 30-37"	37"	N/A	None	US
		8-37	sBK/ C	Fr-Fi/SEXP/SP					
2	LS	0-6"	gr/sc/	Fr/SEXP/SS/SP	2.5Y 7/1 @ 30"	40"	N/A	None	US
		6-28"	sBK/ c	Fr-Fi/SEXP/SP					
		28-40"	sBK/ c	Fi/EXP/SP					
3	LS	0-8"	gr/sc/	Fv/SEXP/SS/SP	7 33" to chroma 2 colors	33"	N/A	None	US
		8-24"	sBK/sc	Fr-Fi/SEXP/SP					
		24-33"	sBK/sc	Fi/EXP/SP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Versuleler
EVALUATED BY: William A. Mueller 8-23-96
OTHER(S) PRESENT:

OMMENTS: Probably would not be 100% Repair

LEGEND

use the following standard abbreviations

LANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	EPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)				
(Ridge)		SCL (Sandy Clay Loam)			MOIST	WET
(Shoulder Slope)		SUC (Silt Loam Clay)				
(Terrace)					VFR (Very Friable)	NS (Non-sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FR (Friable)	SS (Slightly Sticky)
		SIC (Silty Clay)			FI (Firm)	S (Sticky)
					VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
		O (Organic)	None		EFI (Extremely Firm)	NP (Non-plastic)
						SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


OTES	
ORIZON DEPTH	In inches below natural soil surface
PTH OF FILL	In inches from land surface
USTRUCTIVE HORIZON	Thickness and depth from land surface
APROLITE	S(suitable) or U(unsuitable)
OIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

1551B

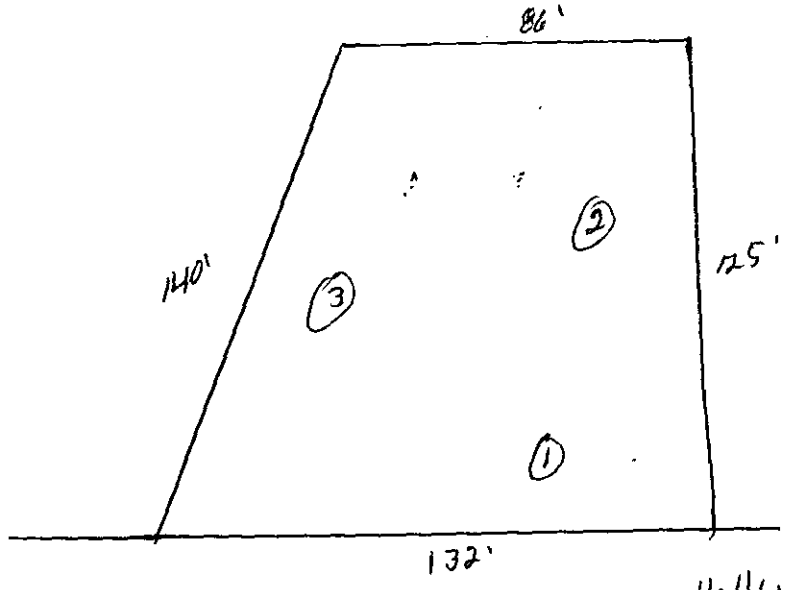

Hollywood St.

Aug-21, 1996

I, Cheryl M. Summerville, now the current deed holder to lots [redacted] located on Hollywood St. Block #24, and do give my permission to have A soil test done. The lots are in the process on being deeded into John D. Presley and Shannon E. Summerville's name.

Cheryl M. Summerville
John D. Presley

File #.155B

FEE: $ 100.00 check # 1143 DATE: 8-21-96 (SW)

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

1 1 CRT

TYPE APPLICATION: ✓ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 15518

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 037-223-08 P.O.

STREET ADDRESS: 7612 Hollywood St.

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
✓ DOUBLE WIDE (D)
___ HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

HEATED SQUARE FOOTAGE: 1200

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 3

FOUNDATION FOR RESIDENCE:

✓ WITHOUT BASEMENT
___ ON SLAB
✓ CRAWL SPACE
✓ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

CLOSING DATE _____ CH# Mck

Home has been purchased from Public School system program (Gaines house) House must be moved in order for the new program for 96/97 school year. Home must be moved ASAP. Please help.

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE): ___ COMMUNITY (C) ___ MUNICIPAL (M) ✓ PRIVATE WELL (P) ___ SHARED WELL (S) ___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	___ YES ✓ NO	WELL, SPRINGS OR WATERLINES	___ YES ✓ NO
EXISTING WASTEWATER SYSTEMS	___ YES ✓ NO	DESIGNATED WETLANDS	___ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS	___ YES ✓ NO		

PROPERTY OWNER:

NAME: Pressley (LAST) John (FIRST) D (MI)

ADDRESS: 6133 Rumple Rd

CITY: CLT STATE: NC ZIP: 28262

DAYTIME PHONE: (704) 598-2742

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) —

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: John David Pressley DATE: 8-21-96

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 1551B

TC: 037-223-08

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

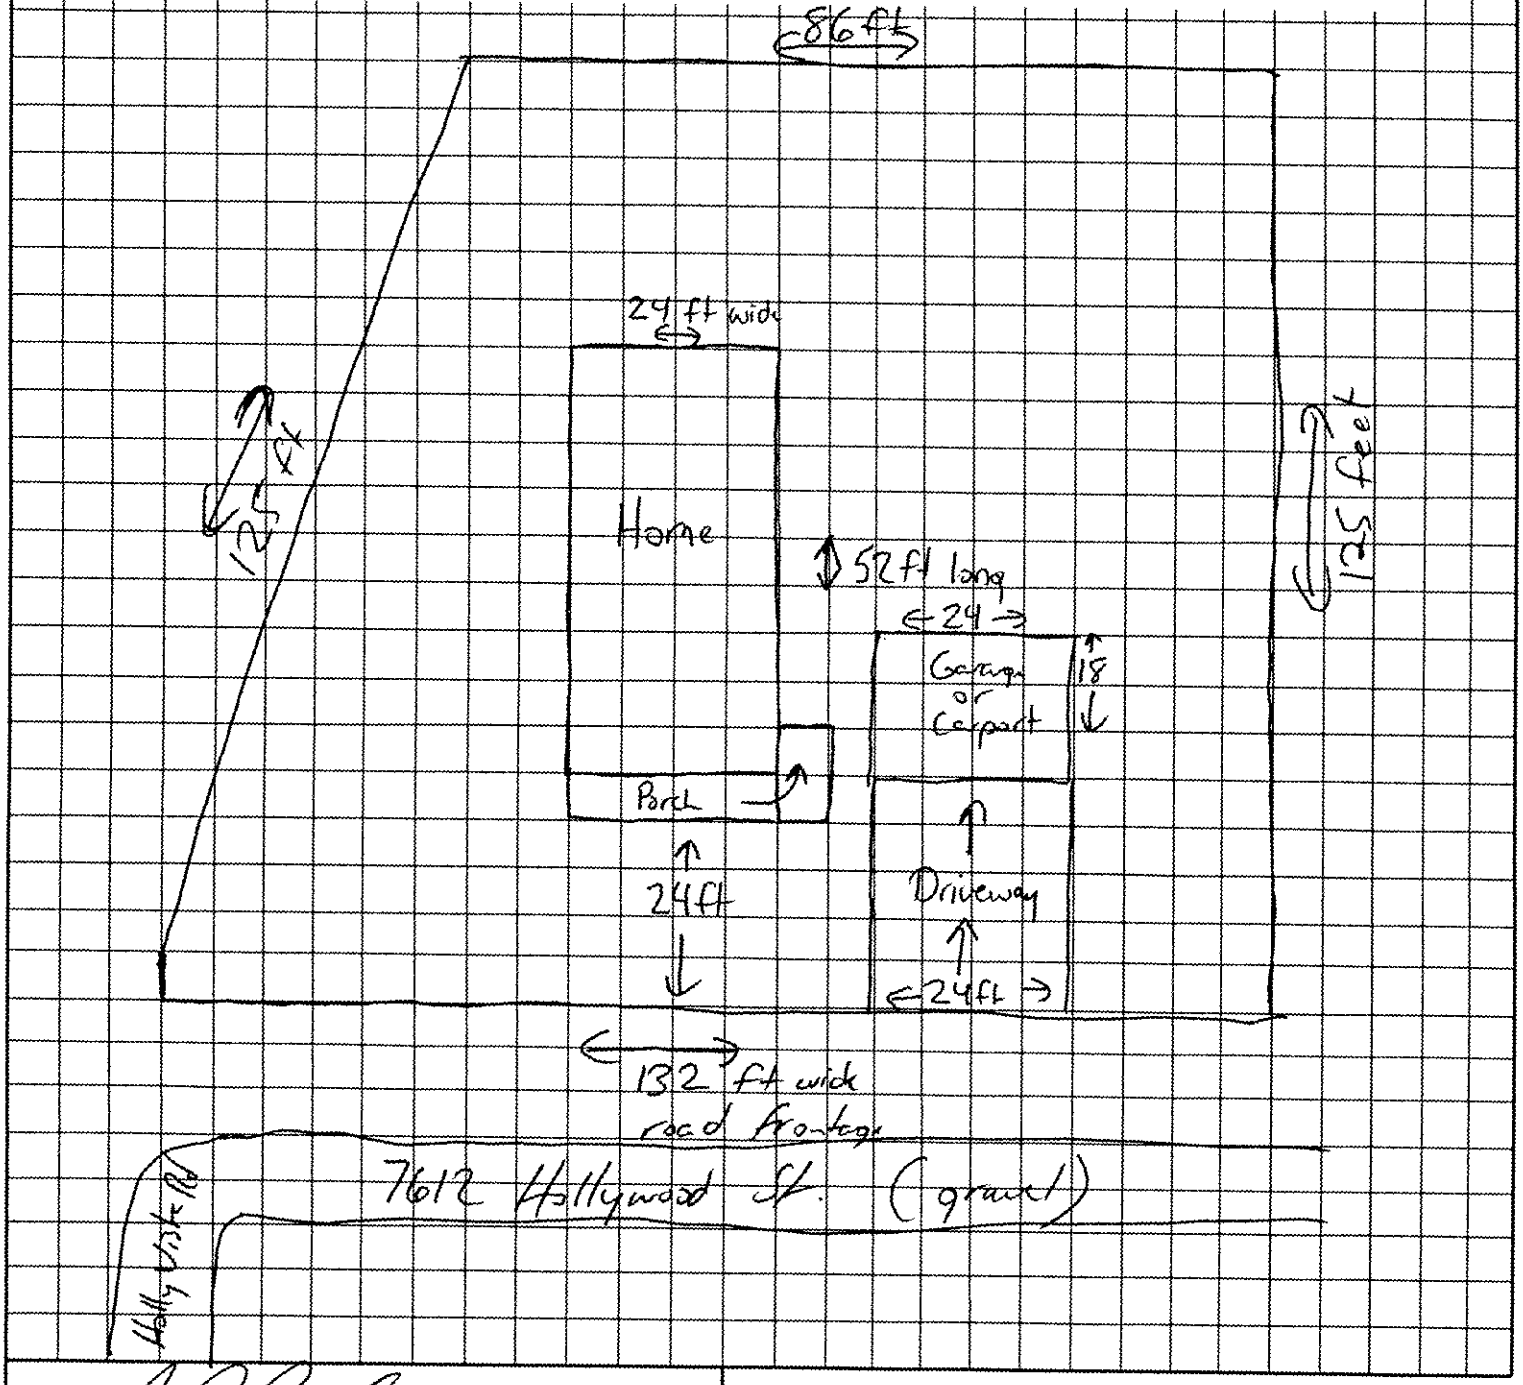

OWNER/AGENT SIGNATURE J D Presley

DATE 8-21-96

APPROVAL DATE _____

White - Health Department's Copy

Canary - E.H.S. Copy

Pink - Owner's Copy

DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet
PROPERTY ID #:
COUNTY:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

1551 B
PO 037-223-06
Lots 19-23

OWNER: John D. Buessley APPLICANT:
ADDRESS: 6133 Rumple Road, Char. APPLICATION DATE: DATE EVALUATED:
PROPOSED FACILITY: residence PROPOSED DESIGN FLOW (.1949): 360gpd PROPERTY SIZE: .33
LOCATION OF SITE: 7612 Hollywood Dr. PROPERTY RECORDED:
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☑ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☑ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	LS	0-8"	gr/sc/	Fr/SEXP/SS/SP	2.5Y 7/1 @ 30-37"	37"	N/A	None	US
		8-37	sBK/ C	Fr-Fi/SEXP/SIP					
2	LS	0-6"	gr/sc/	Fr/SEXP/SS/SP	2.5Y 7/1 @ 30"	40"	N/A	None	US
		6-28"	sBK/ c	Fr-Fi/SEXP/SIP					
		28-40"	sBK/ c	Fi/EXP/SIP					
3	LS	0-8"	gr/sc/	Fr/SEXP/SS/SP	>33" TO chroma 2 colors	33"	N/A	None	US
		8-24"	sBK/sc	Fr-Fi/SEXP/SIP					
		24-33"	sBK/sc	Fi/EXP/SIP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	US	US
System Type(s)		

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): Versuleler
EVALUATED BY: William A. Meuli 8-23-96
OTHER(S) PRESENT:

OMMENTS: Probably would not be 100% Repair

LEGEND

use the following standard abbreviations

ANDSCAPE POSITION	GROUP	SOIL TEXTURE	CONVENTIONAL 1955 LTAR	LPP 1957 LTAR	MINERALOGY/ CONSISTENCE	STRUCTURE
C (Concave Slope)	I	S (Sand)	1.2 - 0.8	0.6 - 0.4	NEXP (Non-expansive)	G (Single Grain)
V (Convex Slope)		LS (Loamy Sand)			SEXP (Slightly Expansive)	M (Massive)
(Drainage Way)					EXP (Expansive)	CR (Crumb)
S (Debris Slump)	II	SL (Sandy Loam)	0.8 - 0.6	0.4 - 0.3		GR (Granular)
P (Flood Plain)		L (Loam)				SBK (Subangular Blocky)
S (Foot Slope)						ABK (Angular Blocky)
(Head Slope)	III	SI (Silt)	0.6 - 0.3	0.3 - 0.15		PL (Platy)
(Linear Slope)		SICL (Silty Clay Loam)				PR (Prismatic)
(Nose Slope)		CL (Clay Loam)			MOIST	WET
(Ridge)		SCL (Sandy Clay Loam)				
(Shoulder Slope)		SLC (Silt Loam Clay)			VFR (Very Friable)	NS (Non-sticky)
(Terrace)					FR (Friable)	SS (Slightly Sticky)
	IV	SC (Sandy Clay)	0.4 - 0.1	0.2 - 0.05	FI (Firm)	S (Sticky)
		SIC (Silty Clay)			VFI (Very Firm v. Very Sticky)	VS (Very Sticky)
					EFI (Extremely Firm)	NP (Non-plastic)
		O (Organic)	None			SP (Slightly Plastic)
						P (Plastic)
						VP (Very Plastic)


OTES	
ORIZON DEPTH	In inches below natural soil surface
EPTH OF FILL	In inches from land surface
ESTRICTIVE HORIZON	Thickness and depth from land surface
APROLITE	S(suitable) or U(unsuitable)
OIL WETNESS	Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation
LASSIFICATION	S (Suitable), PS (Provisionally Suitable), or U (Unsuitable)

valuation of saprolite shall be by pits.

ong-term Acceptance Rate (LTAR): gal/day/ft²

Show profile locations and other site features (dimensions, reference or benchmark, and North).

1551B

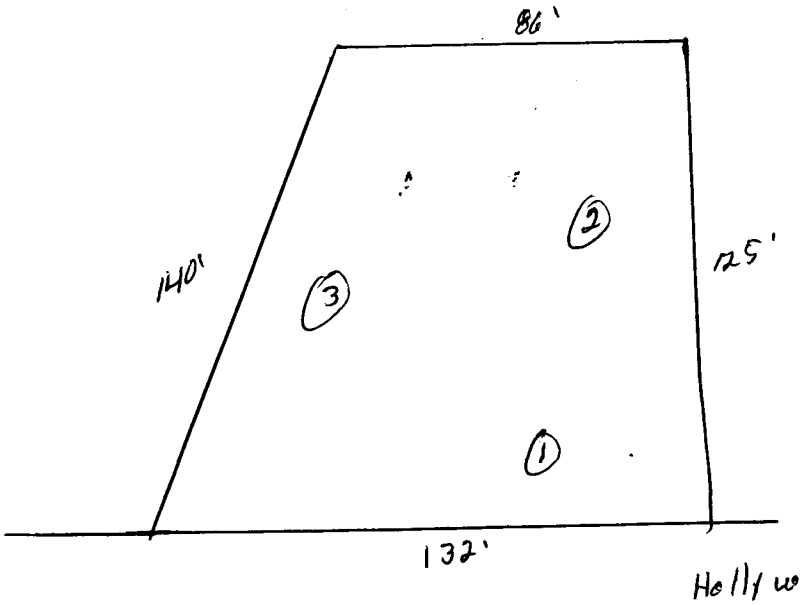

Hollywood St.

5151B

Supervisor/Administrative Professional Checklist

New Septic ☐ **New Well** ☐ **Use Existing** ☑ **Alteration** ☐ **Modified Plot Plan** ☐

New Septic Fees Paid:

IP ($250.00) _____ Initials/Date

CA ($200.00) _____ Initials/Date

OP ($200.00) _____ Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 lw 11/3/14 Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid)_____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☐ Reviewed ☐ ____

This site is served by septic and well. Verify each is complete before final hold is released. ☐

Septic file completed. ☐ _____ Well file completed. ☐ _____

Send permit for signature. ☐ Signature received. ☐ _____

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

5151B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

App# 7146

APPLICATION FOR APPROVAL TO USE AN EXISTING
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL

APPLICATION TYPE: ◉ SEPTIC ONLY ○ WELL ONLY ○ SEPTIC & WELL
○ ADDITION OR RENOVATION WITH OCCUPANCY INCREASE
◉ ADDITION OR RENOVATION WITH NO OCCUPANCY INCREASE
○ EXCHANGE MOBILE HOME (SAME # BEDROOMS)
○ COMMERCIAL OR INDUSTRIAL

PERSON FILING APPLICATION:
NAME: SONYA HARB
ADDRESS: 6608 HEATH GLEN DR
CITY: MINT HILL
STATE: NC ZIP: 28227
PHONE: 704 534 0086
ALTERNATE PHONE:
E-MAIL: sonyaharb@yahoo.com

PROPERTY OWNER: ☒ SAME AS PERSON FILING APPLICATION
NAME:
ADDRESS:
CITY:
STATE: ZIP:
PHONE:
ALTERNATE PHONE:
E-MAIL:

JOB LOCATION INFORMATION
TAX PARCEL #: 19507256
STREET ADDRESS: 6608 Heath Glen Dr
CITY: mint Hill
STATE: NC **ZIP:** 28227

SUBDIVISION OR MOBILE HOME PARK NAME: Heathfield
LOT #:

WATER SUPPLY:
◉ MUNICIPAL ○ PRIVATE WELL ○ PUBLIC WELL ◉ SHARED WELL ○ OTHER

RESIDENTIAL PROPERTY TYPE: ○ N/A
◉ HOUSE ○ MODULAR HOME ○ MULTIPLE FAMILY
○ SINGLE MOBILE HOME ○ DOUBLE WIDE
○ OTHER

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 2

COMMERCIAL / INDUSTRIAL PROPERTY TYPE: ☐ N/A
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ○ YES ○ NO
UNDERGROUND STORAGE TANKS? ○ YES ○ NO

ADDITION/RENOVATION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☒ PORCH ☐ DECK ☐ OTHER

ADDITION/RENOVATION TYPE DETACHED FROM EXISTING STRUCTURE:
☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☒ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Sonya Harb
Owner's/Agent's Signature

11/3/14
Date

A PROPOSED PLOT PLAN (see page 2) is required to be submitted with each application.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


Revised on: 01/03/11

File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

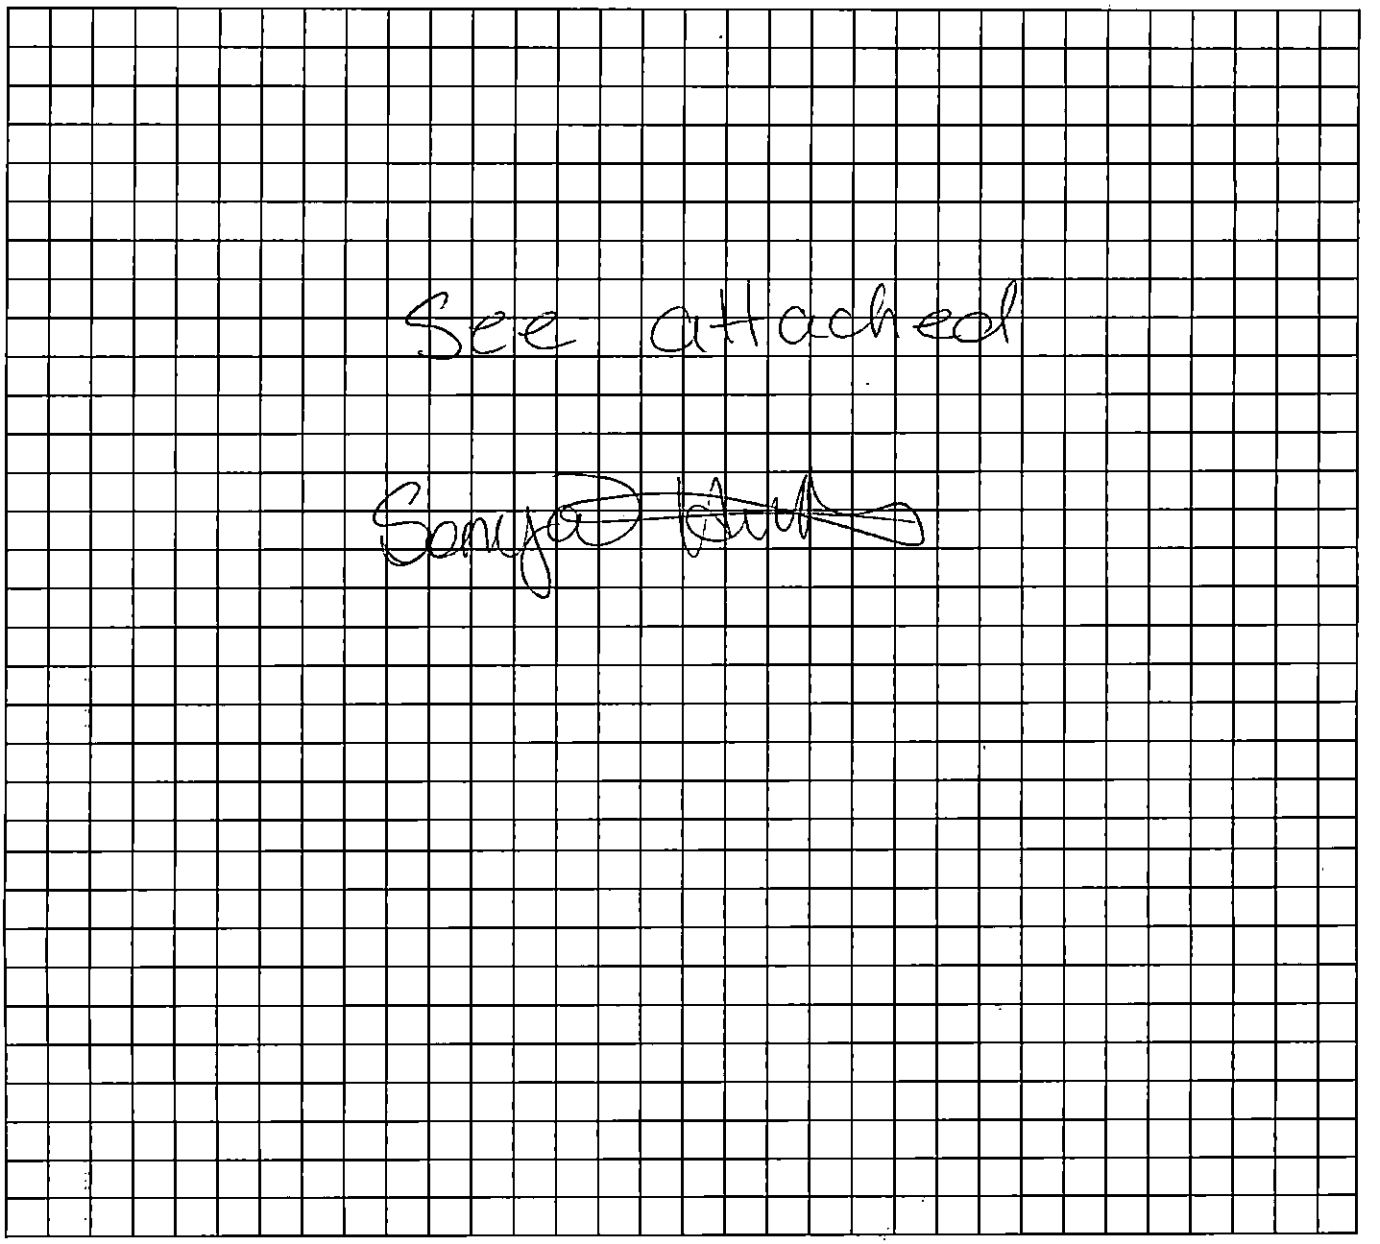

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:


- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- This permit is not transferable.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

use existing approved
Scr porch & storage building

REHS Signature 11/7/13 Date


MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11

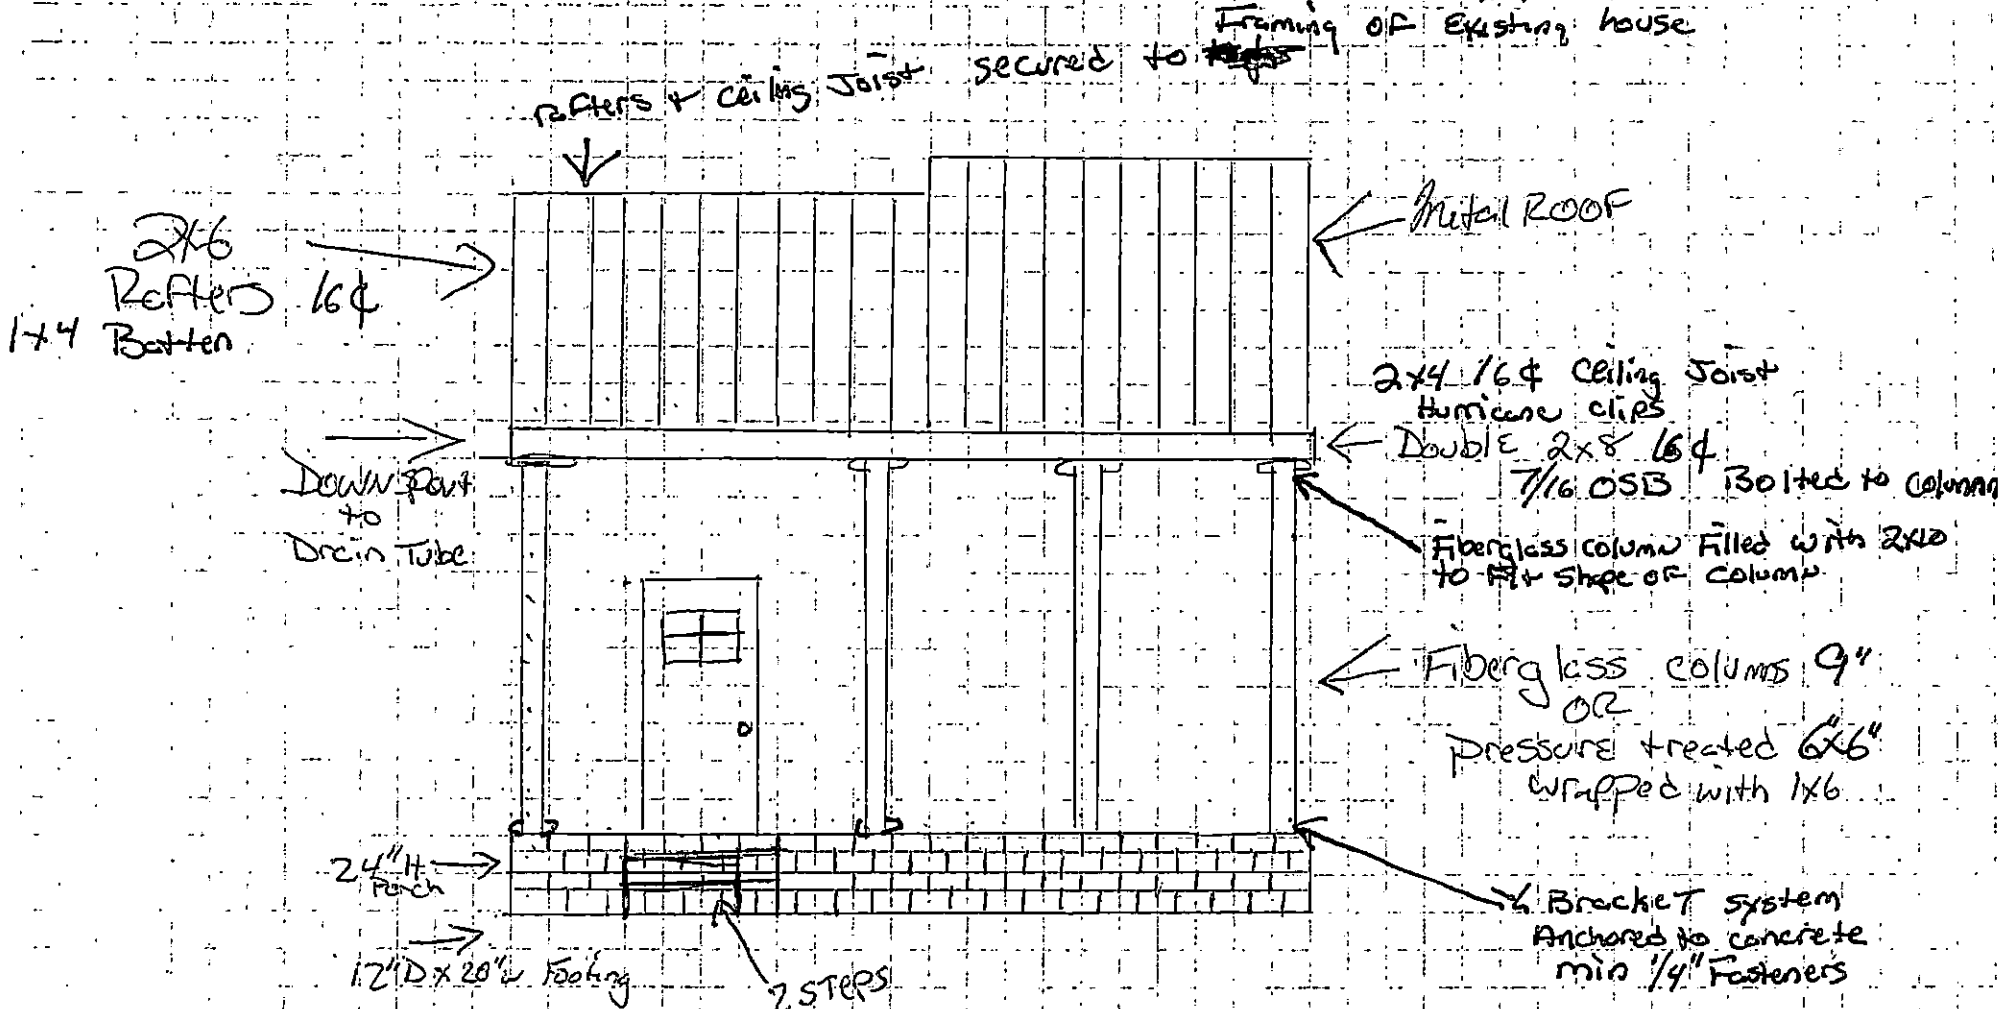

7x21' porch

6608 Heath Glen DR
Mint Hill, NC 28227

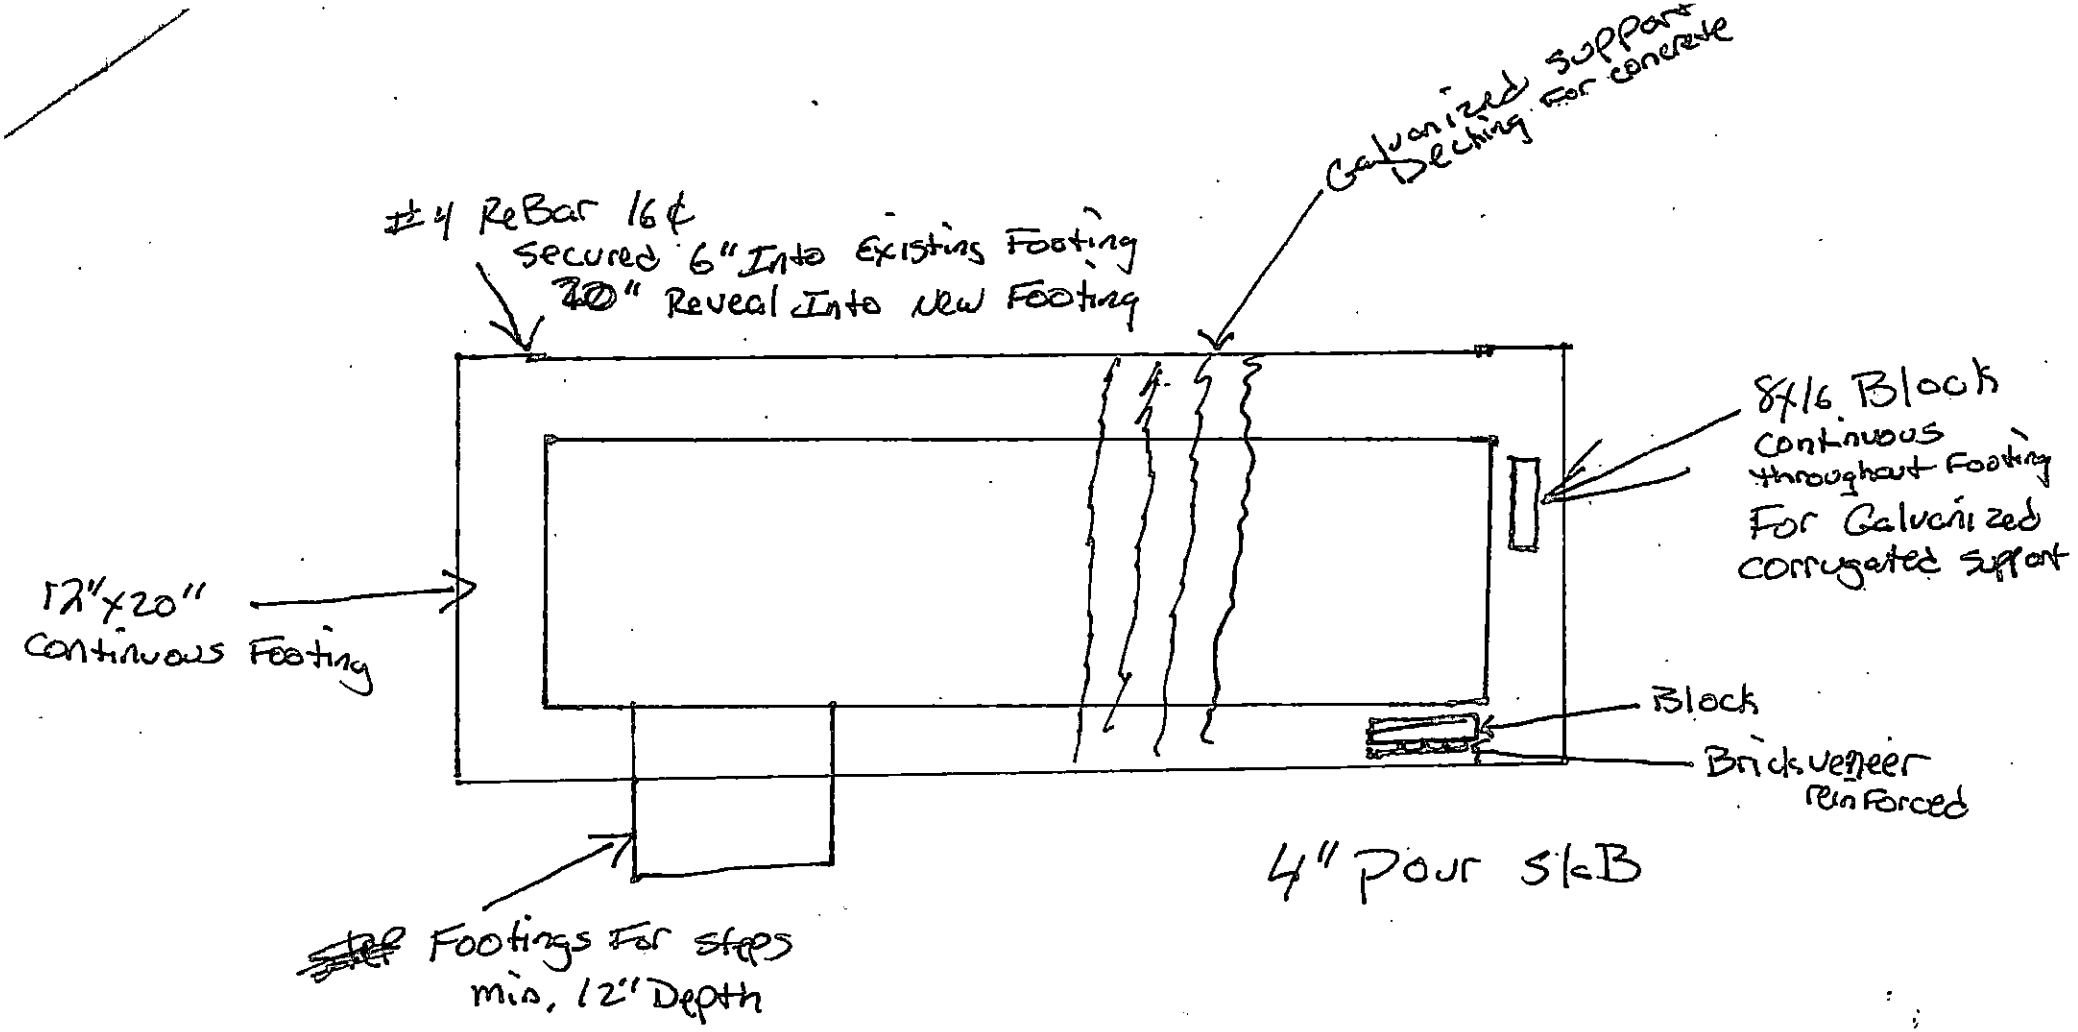

6608 Heath Glen DR
Mint Hill, NC 28227

Polaris 3G Map – Mecklenburg County, North Carolina

Date Printed: 11/3/2014 12:41:30 PM



This map or report is prepared for the inventory of real property within Mecklenburg County and is compiled from recorded deeds, plats, tax maps, surveys, planimetric maps, and other public records and data. Users of this map or report are hereby notified that the aforementioned public primary information sources should be consulted for verification. Mecklenburg County and its mapping contractors assume no legal responsibility for the information contained herein.

storage bldg

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 11/03/14
Receipt #: 91393
Check / Auth #: MC 80942Z
Received By: SADERLW

Amount: 100.00
Tendered: 100.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: HARB SONYA
Attn:
Address: 6608 HEATH GLEN DR
Address:
City/State/Zip: MINT HILL, NC 28227

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	Use Existing System		1	100.00	100.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
	2,717.05				