

14220 ASBURY DR

01918128

5/15/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Mecklenburg County
Health Department

MEMORANDUM

TO: File #4115A

FROM: Larry Thompson, R.S.

Date: April 14, 1997

Re: 14220 Asbury Drive (septic system repair)

An on-site visit was made to this property on April 7, 1997 by Lisa Mialik, R.S. and myself. The purpose of this visit was to determine the status of the on-site wastewater disposal system serving this residence (William J. Turonis, owner) before a court date of April 8, 1997.

Mr. Turonis had been previously found guilty of violating General Statute 130 A-335 (a), .1961 (a)1 of the N.C. Sewage Rules and received a suspended 10 day jail sentence and two years probation pending proper repairs being made to this system before his next scheduled court appearance of April 8, 1997.

At the time of this inspection it was found that repairs had been made to this system, however, they did not meet the specifications of the repair approval that was issued by Kelly Randall, R.S. on April 1, 1997. Mrs. Turnois was present at the time of our inspections and verified that the repair work had been performed by Mr. Turonis.

Problems observed during our review were as follows:

- Approximately 95% of the construction was covered before our visit.
- It could not be determined at which end of the septic tank the supply line originated.
- The schedule of the P.V.C. supply line could not be determined.
- A distribution box was not located.
- The drainfield was located farther downslope than permitted. It could not be determined if the drainfield was on the Turonis's property, nor could it be determined if the bed was outside the Asbury Drive Road right of way.
- The trench width was irregular. Two sections were partially uncovered which revealed widths of 5' and 6'6".
- The drainfield pipe was not the correct type. It was slotted pipe that is commonly used for french drains.
- The stone used had an abnormally high volume of fines and appeared to be unwashed.
- The trench bottom rises 1' in the 50' length (beginning to end).

An operation permit for this system was not issued due to these deficiencies.

The results of the April 8, 1997 court date, Judge Lanning presiding, was a Prayer for Judgement with a continuation at the request of this department.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4115-A DATE: 4-1-97

TC: 019-181-28 ☐ L

SERIAL Nº 17043

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 4-1-97. All work shall be completed on or before 4-8-97, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

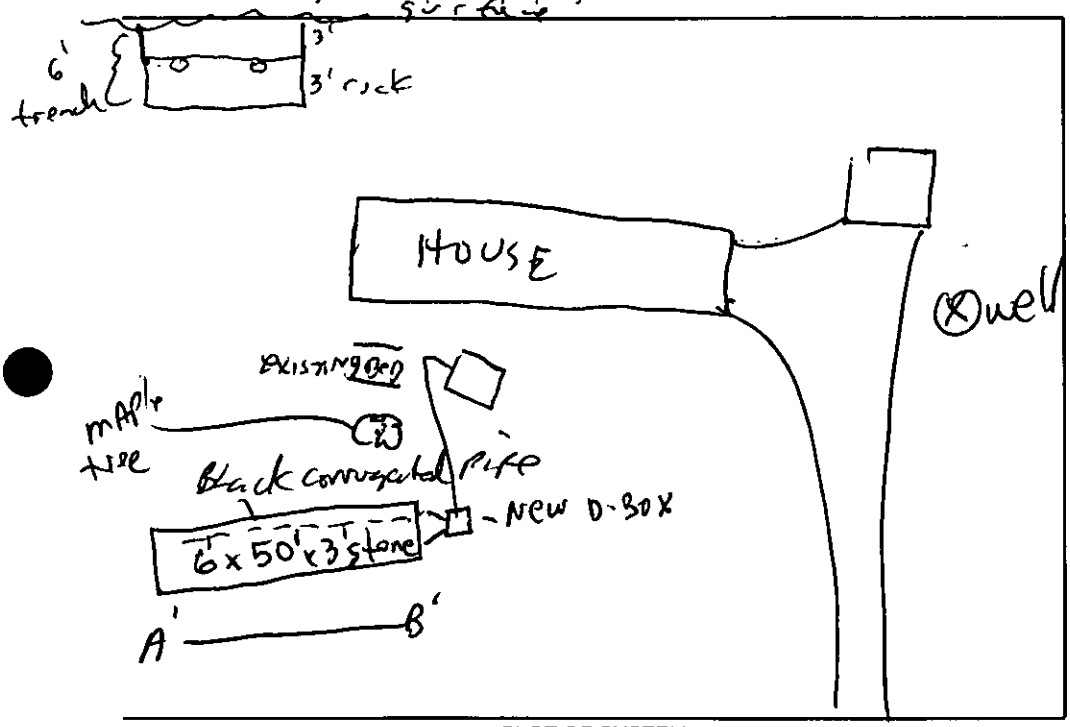

PLOT OF SYSTEM

Liquid Capacity of Septic Tank existing gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction PCC

Trench Depth 6 feet

Absorption and/or Nitrification Lines:

Trench Width 6 feet feet

Trench Walls Scored and Porous yes

Total Line Length 1 Bed 6'x6'x50' lons feet

Number of Lines 2

Depth of Stone 3 feet inches

Distance from House 5'+ feet

Distance from Property Line 10'+ feet

Distance from Well 100'+ feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER WILLIAM J TURONIS

LOCATION OF PROPERTY 14220 ASBURY DR

Comments: New 6' x 50 x 6' deep trench bottom with 3' stone (#5 stone) - trench bottom 6' deep to PS saprolite - keep trench bottom on contour - trench bottom from A' to B' NO more 1 inch fall - SCH40 PVC pipe from tank to new D-Box - Black corrugated pipe holes @ 45° towards trench bottom.

replace T in tank if necessary

Kelly Randall
Environmental Health Specialist

336-5575

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

FEE: NA
DATE: 4/1/97

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: __ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM ✓ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 415A

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 019-181-28

STREET ADDRESS: 14220 Asbury Dr

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TYPE OF BUILDING (CHECK ONE):

- ✓ SINGLE MOBILE HOME(S)
- __ DOUBLE WIDE (D)
- __ HOUSE (H)
- __ MODULAR HOME (M)
- __ MULTIPLE FAMILY (U)
- __ OTHER (O)

TOWNSHIP (CHECK ONE):

- __ 0 MECKLENBURG
- __ 1 CHARLOTTE
- __ 2 DAVIDSON
- __ 3 CORNELIUS
- __ 4 PINEVILLE
- __ 5 MATTHEWS
- ✓ 6 HUNTERSVILLE
- __ 7 MINT HILL

HEATED SQUARE FOOTAGE: 1170

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 4

CLOSING DATE 11-14-95

FOUNDATION FOR RESIDENCE:

- __ WITHOUT BASEMENT ON SLAB
- ✓ CRAWL SPACE
- __ WITH BASEMENT /PLUMBING
- __ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

- __ COMMUNITY (C)
- __ MUNICIPAL (M)
- ✓ PRIVATE WELL (P)
- __ SHARED WELL (S)
- __ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	✓ YES __ NO	WELL, SPRINGS OR WATERLINES	✓ YES __ NO
EXISTING WASTEWATER SYSTEMS	✓ YES __ NO	DESIGNATED WETLANDS	__ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS	__ YES __ NO		

PROPERTY OWNER:

NAME: Turonis William J
(LAST) (FIRST) (MI)

ADDRESS: 14220 Asbury Dr

CITY: Huntersville STATE: NC ZIP: 28078

DAYTIME PHONE: (704) 948-3790 or 823-9903 Page

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) —

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Marcella Turonis DATE: 4-1-97

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

Case # 97 CR 102466 William J. Turonis File 4115A

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

LOG NO: [ ][ ][ ]

REQUEST FOR APPROVAL AND RECORD OF LEGAL ACTION

DATE: [1][2] / [1][2] / [9][6] (MONTH / DAY / YEAR)

SECTION: [I][W][W][S] (AQ, WQ, FOOD, DC, MILK, POOL, S&HW, OPWD, VC)

TO: **DIRECTOR**

Request approval for initiation of (circle one): CS, CW, AI, CV, OTHER: _____

Against: WILLIAM J TURONIS

Violation: NC SEWAGE RULES .1961(a)1

Circumstances: (Outline Briefly) Outstanding septic system violation. Effluent on surface of ground at 14220 Asbury Drive, Huntersville. Violation notices sent and phone calls made to owner and his wife in reference to violation. On-Site consultations made with owner and/or his wife present in reference to violation. No action taken by Mr. Turonis. On-going septic violation needs to be resolved.

Lisa B. Mialik, R.S.
ENVIRONMENTALIST

Violation Notices (Date & Results):
NOV mailed 6/24/96, compliance date 7/24/96. NOV mailed 7/31/96, compliance date 8/12/96. NOV mailed 9/12/96, compliance date 10/02/96. NOV mailed 10/23/96, compliance date 10/31/96. Homeowner made tentative plans following NOVs; however, no action resulted.

Other Contacts: Phone conversations with Mr. & Mrs. William Turonis on 10/3/96.
Site visits:

6/18/96, 8/14/96, 10/10/96 & 12/6/96

Approved for proceeding with action:

Supervisor: _____ DATE: 12-13-96

Division Manager: _____ DATE: 12-16-96

Director: _____ DATE: _____

THE ENTIRE FILE MUST ACCOMPANY THIS FORM.

SERVICE REQUEST/WORK ORDER

Log No.: File 4115A Section: INWS Hazard? [ ] Yes [ ] No

Date: 6/18/96 Parcel: 019-181-28 <60 Days? [ ] Yes [ ] No

REQUESTING PERSON: Lisa Mialik Phone

Address City Zip

PROPERTY CONCERNED: Facility Name William + Marcella Turonis 948-3790

Address 14220 Asbury Dr City Hunt Zip 28078

SERVICE REQUESTED: Malfunction

ASSIGNED TO: TAKEN BY:

DATE	ACTIVITY REPORT
6/18/96	OBV @ 14204 for an appt. Observed from 14204 malfunction @ 14220 Asbury Dr (property to ©) of (#204)
	OBV @ 14220. Owner, Marcella Turonis present - Sewage surface above tank + drainfield saturated near S.T. Requested that Mrs. Turonis have her husband contact me - repair necessary + repair approved through our office
6/24/96	Tax Records indicate:
	019-181-28
	Prop. Loc. 14220 Asbury Chapel Rd?
	Owner: William J. Turonis, Jr.
	14220 Asbury Dr
	Huntersville, NC 28078
6/24/96	First NOV; Due 7/24/96
7/31/96	2nd NOV; Due 8/12/96
8/14/96	OBV. Marcella Turonis present - stated S.T. pumped by Bobby Mayhew today. They moved in 11/95 - effluent surfacing by Feb., toilets backing up. Per Mrs. Turonis, washer + shower plumbed to separate (pit) installation

NOTIFICATION TO REQUESTING PERSON: ( ) Written ( ) Verbal (✓ Not Applicable

COMPLETED BY: Lisa B. Mialik, RS, 4/8/97

REVIEWED BY:

SERVICE REQUEST/WORK ORDER

Date: 6/18/96 Log No.: File 4115A

Parcel 019-181-28

DATE	ACTIVITY REPORT
	① Inquired with various people about cost to dig up existing system & replace → $4,000 - of which they cannot afford. Washer effluent surfacing in yard; sewage/effluent not surfacing above S.T. Advised: ① repair approval required - which would not involve removal of old drainfield ② O.K. if her husband does work (due to financial problems) & after onsite discussion this review of regulations - he feels he can install to code. ③ Will check back ~ 8/28 to see if sewage/effluent surfacing above S.T. or backing up into home. Believe repair necessary even though S.T. needed sludge removed. Will decide plan of action @ that time.
8/22/96	CSV. No one @ home. No effluent surfacing above S.T. lid.
9/6/96	CSV. No answer @ door. Effluent surfacing above septic tank. Washer installation failing. Left bus. card & note to contact me. Repair necessary - must have repair approval, pt. JBR
9/12/96	Final NOV Due 10/2/96 JBR
10/3/96	PC w/Marcella Turonis - Per Mo. Turonis - thought 10/12 compliance date - will mail repair application in today, has contacted Charles Merryman ~1½ weeks ago & Has not heard back. Advised to consult her husband - that repair necessary. JBR
10/3/96	PC w/Mr. Turonis. Per Mr. Turonis - Will be consulting Charles Merryman 10/4 (closing attorney for both sides) & possibly a private attorney regarding issue. Advised repair needs to be done asap regardless of legalities.

SERVICE REQUEST/WORK ORDER

Date: 6/18/96 Log No.: File 4115A

Tax Parcel No. 019-181-28

DATE	ACTIVITY REPORT
10/3/96	Advised Mr Turonis to contact me next
cont.	week to arrange OSV for next week. jpn
10/10/96	OSV, Mr + Mrs. Turonis present. Effluent
	surfacing @ S.T.; via probing - drainfield deep,
	saturated. Advised Mr + Mrs Turonis to have
	S.T. contractor contact me within 1 week:
	to stop living room addition construction (footings poured)
	until septic problem resolved + building
	permit obtained. Observed 2 plumb. pipes
	exiting beneath mh. into 1 pipe to washer
	pit (?)
10/17/96	Conf ~~E~~ Mizelle -
	Attempted PC to Turonis 10:40, 10:45 11:00 AM
	NO ANSWER - SD
10/21/96	4:25 TC to Turonis, NO answer, no message machine
	Send 5 day notice, proceed ~~E~~ CS if no
	response by 10/31
10/23/96	Final NOV; Due 10/31 - then file C.S. if no response
10/30/96	PC to Turonis' - No contact w/Marcella or William
11/1/96 8:45	PC to Turonis. ~~NC~~. NC. Elderly gentleman answered phone
11/7/96	PC to Turonis. ~~NC~~. Elderly gentleman answered phone.
11/18/96	Paperwork prepared for C.S. - to S. Daniel.
12/6/96	OSV w/ L. Thompson. Marcella Turonis present.
	Effluent surfacing @ S.T. + @ washer/sink bed.
	Advised - legal action to be taken. jpn
12/16/96	C.S. filed @ Magistrates Office — proposed court date
	1/30/97 Room 2205 9:00 am Environ. Court. jpn
1/27/97	PC w/ Sherry's Dept. - Summons served 1/18/97
1/27/97	Mr + Mrs. from Bill Turonis - Stated he will be in court
10:46	Turo. has contact Don Lane Plumb - Septic - to do work
	in March. Preferred me to Mr Lane @ 834-0293 pager +
	629-0697 phone to confirm.

Date: 6/18/96 Log No.: File 411CA

Tax Parcel No. 019-181-28

DATE	ACTIVITY REPORT
1/29/97	PC from Mr Turonis - wants to postpone court date. Advised to contact court @ Bob Lane is not on our registered S.T. contractor list - mar repair not acceptable.
1/29/97	PC from Mr Turonis - stated unable to get response from any S.T. contractors that are local. Gave names + phone #'s for 7 S.T. contractors who work in the Lake Norman area - Claudius Morrison, Steve Autry, Willie Chrisharbury, Dennis Joye, A. Cornelius, Bobby Mayhew, Bobby McCarver.
1/29/97	PC w/ Clerk of Court - Administrative (Hearing) scheduled for 1/30/97. - witnesses will be subpornaed ~~to~~ to court when court date set.
2/12/97	PC w/ Sandy Clerk of Court 347-7809. - Court date 3/11/97 9:00 a.m. Room 207.
3/7/97	OBV. Photographs taken.
3/10/97	Per review of bldg stds screen - no building permit obtained for current addition
3/11/97	Ose Court Room 207 w/ Larry Thompson. Judge Lanning presiding. Mr Turonis + his wife present. Mr Turonis pleaded NOT GUILTY. Trial. Ruling - Mr Turonis guilty - 10 day jail sentence suspended until April 8 - in which Septic system is to be repaired according to code. (by owner or S.T. contractor). Court Date 4/8/97
3/31/97	Memo from Mr Turonis - has uncovered D-Box + beginning of 3 lines PC w/ Mr Turonis - advised we need to meet onsite to discuss repair, will consult L. Thompson + K. Randall regarding appt.
4/1/97	~9:15 Page to Mr Turonis 628-9903. No response PC to Asst Turonis residence @ ~9:30. NC LM on answer machine requesting 4/1 2:00 appt

5-0-9

Date: 6/18/96 Log No.: Rule 4115A

TC: 019-181-28

DATE	ACTIVITY REPORT
4/1/97	PC to Turonis' residence. NC. LM on answer machine - 2:30 appt.
4/1/97 2:30	OSV w/ L. Thompson + K. Randall. Marcella Turonis present. Repair approval issue. K Randall requested that Mrs Turonis have Mr Turonis contact him 4/2 a.m. to discuss installation
4/2/97	PC - Mr Turonis w/ K. Randall
4/7/97	OSV w/ Larry Thompson. Mrs Turonis present. ~95% of job covered up. Comments: (1) S.T. covered - unable to check tee or from which end/compartment supply line stubbed out. (2) Only portion of PVC line from S.T. to bed uncovered - unable to determine if schedule 40 PVC. (3) Bed installed downslope from site specified on repair approval. (4) Bed Portion of bed appears to be within road R/w - bed adjacent to "underpowerline". (5) Bed irregular width 5 - 6'. (6) Bed has ~1' rise as best as could be determined utilizing Lazer transit w/probe @ bottom of bed + grade rod on top of stone. (7) Unable to see D-Boxes (if present) - covered w/ dirt (8) Stone with fine rocks - appears unwashed. (9) Irrigation piping used in bed. Advised Mrs. Turonis that we would advise Judge - unable to give final approval due to problems with installation. Will notify DOT of bed location. No operation permit issued.
4/7/97	PC w/ Daryll Poole @ NC DOT 596-6900. Advised of situation
4/8/97	OS @ Court Room 207, Environ. Ct w/ L. Thompson. Sara Pressley present. Judge Lanning presiding. Defendant, William Turonis present. Ruling - Mr Turonis is not to have a failing septic system. PSC should system fail - this office is to contact Sara Pressley + have case brought back in front of Judge!

c:/original/serreqp2.frm

Case # 97 CR 102466

N. C. Department of Environment, Health, and Natural Resources/Division of Environmental Health

ON-SITE WASTEWATER VIOLATION NOTICE

OWNER William J. Turonis, Jr. MAILING ADDRESS 14220 Asbury Drive, Huntersville, NC

OCCUPANT same LOCATION same

[X] RESIDENCE [ ] BUSINESS [ ] OTHER Tax Parcel No. 019-181-28

You are hereby notified that you are violating the Rules adopted by the North Carolina Commission for Health Services or Article 11 of Chapter 130A of the General Statutes of North Carolina by owning or controlling a residence, place of business, or place of public assembly which is not provided with an approved wastewater system. Your wastewater system is not in compliance; the following corrections must be made. Consult your Local Health Department for advice and required permits by calling telephone number (704) 336-5573.

[X] Install/Repair wastewater system. You must obtain an Improvement Permit from the local health department prior to repairing your system.

[ ] Other Repairs *(specify)* _____

[ ] Eliminate wastewater discharge and connect to an approved wastewater system.

[X] Perform Maintenance *(specify)* Pump septic tank as needed to keep sewage effluent off surface of ground.

[ ] Pit Privy must be repaired/constructed.

If the wastewater violation is not brought into compliance by July 24, 1996, appropriate legal action will be taken.

Notice Issued June 24, 1996 (Date) Signed Lisa B. Mialik, R.S. Lisa B. Mialik, RS (Agent) (Division of Environmental Health)

Compliance _____ (Date) Signed _____ (Agent) (Division of Environmental Health)

DEHNR 1108 (Revised 9/92)
On-Site Wastewater Section (Review 10/94)

File-HISA

6-99

N. C. Department of Environment, Health, and Natural Resources/Division of Environmental Health

FINAL NOTICE

ON-SITE WASTEWATER VIOLATION NOTICE

OWNER William J. Turonis, Jr. MAILING ADDRESS 14220 Asbury Drive, Huntersville, NC

OCCUPANT same LOCATION same

☐ RESIDENCE ☐ BUSINESS ☐ OTHER Tax Parcel No. 019-181-28

You are hereby notified that you are violating the Rules adopted by the North Carolina Commission for Health Services or Article 11 of Chapter 130A of the General Statutes of North Carolina by owning or controlling a residence, place of business, or place of public assembly which is not provided with an approved wastewater system. Your wastewater system is not in compliance; the following corrections must be made. Consult your Local Health Department for advice and required permits by calling telephone number (704) 336-5573.

☒ Install/Repair wastewater system. You must obtain an Improvement Permit from the local health department prior to repairing your system.

☐ Other Repairs (*specify*) _____

☐ Eliminate wastewater discharge and connect to an approved wastewater system.

☒ Perform Maintenance (*specify*) Pump septic tank as as needed to keep effluent off surface of ground.

☐ Pit Privy must be repaired/constructed.

If the wastewater violation is not brought into compliance by August 12, 1996, appropriate legal action will be taken.

Notice Issued July 31, 1996 (Date) Signed Lisa B. Mialik, R.S. Lisa B. Mialik, RS (Agent) Division of Environmental Health

Compliance _____ (Date) Signed _____ (Agent) Division of Environmental Health

DEHNR 1108 (Revised 9/92)
On-Site Wastewater Section (Review 10/94)

FILE #154

289

12601 Asbury Chapel Rd.
019-181-27 7345A

S/D lot 33 ⇒ 291

4115A

"FINAL NOTICE" N. C. Department of Environment, Health, and Natural Resources/Division of Environmental Health

ON-SITE WASTEWATER VIOLATION NOTICE

OWNER William J. Turonis MAILING ADDRESS 14220 Asbury Drive, Huntersville 28078

OCCUPANT same as above LOCATION same as above

[X] RESIDENCE [ ] BUSINESS [ ] OTHER tax parcel no. 019-181-28 File 4115A

You are hereby notified that you are violating the Rules adopted by the North Carolina Commission for Health Services or Article 11 of Chapter 130A of the General Statutes of North Carolina by owning or controlling a residence, place of business, or place of public assembly which is not provided with an approved wastewater system. Your wastewater system is not in compliance; the following corrections must be made. Consult your Local Health Department for advice and required permits by calling telephone number (704) 336-5573.

[X] Install/Repair wastewater system. You must obtain an Improvement Permit from the local health department prior to repairing your system.

[ ] Other Repairs *(specify)* _____

[ ] Eliminate wastewater discharge and connect to an approved wastewater system.

[ ] Perform Maintenance *(specify)* _____

[ ] Pit Privy must be repaired/constructed.

If the wastewater violation is not brought into compliance by October 2, 1996, appropriate legal action will be taken.

Notice Issued September 12, 1996 (Date) Signed Lisa B. Mialik, R.S. Lisa B. Mialik, RS (Division of Environmental Health) Agent

Compliance _____ (Date) Signed _____ (Division of Environmental Health) Agent

cc: Sara Pressly, County Attorney

DEHNR 1108 (Revised 9/92)
On-Site Wastewater Section (Review 10/94)

File 4115A

8-89

N. C. Department of Environment, Health, and Natural Resources/Division of Environmental Health

FINAL NOTICE

ON-SITE WASTEWATER VIOLATION NOTICE

OWNER WILLIAM J. TURONIS

MAILING ADDRESS 14220 ASBURY DRIVE, HUNTERSVILLE, NC

OCCUPANT SAME

LOCATION SAME

☒ RESIDENCE ☐ BUSINESS ☐ OTHER TAX PARCEL NO. 019-181-28 FILE 4115A

You are hereby notified that you are violating the Rules adopted by the North Carolina Commission for Health Services or Article 11 of Chapter 130A of the General Statutes of North Carolina by owning or controlling a residence, place of business, or place of public assembly which is not provided with an approved wastewater system. Your wastewater system is not in compliance; the following corrections must be made. Consult your Local Health Department for advice and required permits by calling telephone number (704) 336-5573.

☒ Install/Repair wastewater system. You must obtain an Improvement Permit from the local health department prior to repairing your system.

☐ Other Repairs *(specify)* _____

☐ Eliminate wastewater discharge and connect to an approved wastewater system.

☐ Perform Maintenance *(specify)* _____

☐ Pit Privy must be repaired/constructed.

If the wastewater violation is not brought into compliance by OCTOBER 31, 1996, appropriate legal action will be taken.

Notice Issued OCTOBER 23, 1996 (Date) Signed LISA B. MIALIK, R.S. Lisa B. Mialik, RS (Agent) (Division of Environmental Health)

Compliance _____ (Date) Signed _____ (Agent) (Division of Environmental Health)

DEHNR 1108 (Revised 9/92)
On-Site Wastewater Section (Review 10/94)

SARA PRESSLY, ASSOCIATE COUNTY ATTORNEY
SYLVIA DANIEL, R.S., PROGRAM CHIEF

File 4115A

2-89

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

LOG NO: [ ][ ][ ]

REQUEST FOR APPROVAL AND RECORD OF LEGAL ACTION

DATE: [1][2] / [1][2] / [9][6]
MONTH / DAY / YEAR

SECTION: [I][W][W][S]
(AQ, WQ, FOOD, DC, MILK, POOL, S&HW, OPWD, VC)

TO: **DIRECTOR**

Request approval for initiation of (circle one): CS, CW, AI, CV, OTHER: _____

Against: WILLIAM J TURONIS

Violation: NC SEWAGE RULES .1961(a)1

Circumstances: (Outline Briefly) Outstanding septic system violation. Effluent on surface of ground at 14220 Asbury Drive, Huntersville. Violation notices sent and phone calls made to owner and his wife in reference to violation. On-Site consultations made with owner and/or his wife present in reference to violation. No action taken by Mr. Turonis. On-going septic violation needs to be resolved.

Lisa B. Mialik, R.S.
ENVIRONMENTALIST

Violation Notices (Date & Results):
NOV mailed 6/24/96, compliance date 7/24/96. NOV mailed 7/31/96, compliance date 8/12/96. NOV mailed 9/12/96, compliance date 10/02/96.
NOV mailed 10/23/96, compliance date 10/31/96. Homeowner made tentative plans following NOVs; however, no action resulted.

Other Contacts: Phone conversations with Mr. & Mrs. William Turonis on 10/3/96.

Site visits:

6/18/96, 8/14/96, 10/10/96 & 12/6/96

Approved for proceeding with action:

Supervisor: _____ DATE: 12-13-96

Division Manager: _____ DATE: 12-16-96

Director: _____ DATE: _____

THE ENTIRE FILE MUST ACCOMPANY THIS FORM.

26th JUDICIAL DISTRICT - MECKLENBURG COUNTY
NORTH CAROLINA

ENVIRONMENTAL COURT

CR NUMBER:

CMPD INCIDENT:

RESPONSIBLE AGENCY

[ ] ANIMAL CONTROL [ ] BUILDING STANDARDS [ ] COMMUNITY DEVELOPMENT
[ ] COMMUNITY IMPROVEMENT [ ] ENVIRONMENTAL PROTECTION [ ] FIRE
[X] HEALTH DEPARTMENT [ ] ZONING [ ] OTHER: _____

OFFENSE LOCATION: **14220 Asbury Drive**	CITY: **Huntersville**	STATE: **NC**	ZIP: **28078**
TAX PARCEL NUMBER: **019-181-28**	DEED NUMBER:	DEED DATE:	
PROPERTY OWNER(S): **William J. Turonis**	R/S:	AGE/DOB:	
ADDRESS: **14220 Asbury Drive**	CITY: **Huntersville**	STATE: **NC**	ZIP: **28078**
ALT. ADDRESS:	CITY:	STATE:	ZIP:
HOME TELEPHONE: **(704)948-3790**	ALTERNATE TELEPHONE:		

COMPLAINANT:			
ADDRESS:	CITY:	STATE:	ZIP:
ALT. ADDRESS:	CITY:	STATE:	ZIP:
HOME TELEPHONE:	ALTERNATE TELEPHONE:		
RELATIONSHIP TO PROPERTY OWNER:			

SUMMARY OF COMPLAINT:

COMPLAINT DATE:

SUMMARY OF INVESTIGATION:

COMPLETION DATE:

VIOLATION(S) DETECTED: **Malfunctioning Sewage Disposal System**

STATUTE/ORDINANCE NUMBER(S): **130A-335 (a), .1961 (a)1**

-- PRIOR HISTORY/PRIOR VIOLATIONS --

-- ENFORCEMENT ACTIONS --

CITATION NUMBER(S) ISSUED:	DATE:	COMPLIED:
CRIMINAL SUMMONS PREPARED BY:	DATE:	SERVED:
CRIMINAL SUMMONS SERVED BY:	CODE #:	AGENCY:

WITNESS #1: Mr. Larry Thompson, R.S.

ADDRESS: Mecklenburg County Health Department 700 N. Tryon St., Suite 211	CITY: Charlotte	STATE: NC	ZIP: 28202
ALTERNATE ADDRESS:	CITY:	STATE:	ZIP:
TELEPHONE: (704)336-5568	ALTERNATE TELEPHONE: (704)336-5102		

FACTS TO WHICH WITNESS CAN TESTIFY: Observed sewage surfacing on top of ground

CAN WITNESS IDENTIFY DEFENDANT? [ ] YES [X] NO | SUBPOENA THIS WITNESS? [ ] YES [ ] NO

WITNESS #2:

ADDRESS:	CITY:	STATE:	ZIP:
ALTERNATE ADDRESS:	CITY:	STATE:	ZIP:
TELEPHONE:	ALTERNATE TELEPHONE:		

FACTS TO WHICH WITNESS CAN TESTIFY:

CAN WITNESS IDENTIFY DEFENDANT? [ ] YES [ ] NO | SUBPOENA THIS WITNESS? [ ] YES [ ] NO

-- PHYSICAL EVIDENCE --

PHOTOGRAPHS? [ ] YES [ ] NO | WHERE STORED:

SPECIMEN (IDENTIFY): | TEST DATE:

DAMAGE ESTIMATE/TIME FOR COMPLIANCE:

CERTIFIED COPY OF APPLICABLE ORDINANCE(S): [ ] IN FILE [ ] IN COURTROOM

RECORDS OF OWNERSHIP (IDENTIFY):

NOTICE(S) OF VIOLATION: Mailed NOV:6/24/96, 7/31/96, 9/12/96, 10/23/96

OTHER:

-- INVESTIGATOR/INSPECTOR --

NAME: Lisa B. Mialik, R.S.

POSITION: Environmental Health Specialist | AGENCY: Mecklenburg County Health Dept.

BUSINESS ADDRESS: 700 N. Tryon St., Suite 211 | CHARLOTTE, N. C. 28202

TELEPHONE: (704)336-5573 | ALTERNATE TELEPHONE: (704)336-5102

NOTES/REMARKS:

File No.

MISDEMEANOR
ENV CRIMINAL SUMMONS

Offense: SEWAGE DISPOSAL

THE STATE OF NORTH CAROLINA VS.

Name, Address & Telephone No. Of Defendant:
William J. Turonis
14220 Asbury Drive
Huntersville, NC 28078

Race	Sex	Date Of Birth	Age
W	Male	unknown	unknown

Social Security No.: unknown

Drivers License No. & State: unknown

Name Of Defendant's Employer: self-employed

Offense Code:

Offense In Violation Of G.S.: 130A-335(a), .1961(a)1

Date Of Offense: December 6, 1996

Complainant (Name, Address Or Department, Phone No.)
Lisa Mialik, R.S.
Mecklenburg County Health Department
Environmental Health Division
700 N. Tryon Street, Suite 211
Charlotte, NC 28202
(704)336-5573

Witnesses (Names, Addresses, Phone Numbers)
Lisa Mialik, R.S./Larry Thompson, R.S.
Mecklenburg County Health Department
Environmental Health Division
700 N. Tryon Street, Suite 211
Charlotte, NC 28202
(704)336-5102

STATE OF NORTH CAROLINA

MECKLENBURG County


In The General Court Of Justice
District Court Division

To the defendant:

I, the undersigned, find that there is probable cause to believe that on or about the date of offense shown and in the county named above you unlawfully ~~and willfully~~ did while owning residence located at 14220 Asbury Drive, Huntersville, NC, tax parcel no. 019-181-28, failed to maintain a sanitary system of sewage disposal as required under G.S. 130A-335 (a), .1961 (a)1.

This act was in violation of the law referred to in this Criminal Summons. This Summons is issued upon information furnished under oath by the complainant listed. You are ORDERED to appear before the Court at the location, date and time indicated below to answer to the charge. If you fail to appear, an order for your arrest may be issued and you may be held in CONTEMPT OF COURT and imprisoned for up to thirty (30) days or fined up to $500.00 or both. This penalty for failure to appear is in addition to any sentence which may be imposed for the crime charged.

Date Issued	Signature	Location Of Court
Date Of Service	☐ Magistrate ☐ Deputy CSC ☐ Assistant CSC ☐ Clerk Of Superior Court	Court Date / Court Time ☐ AM ☐ PM

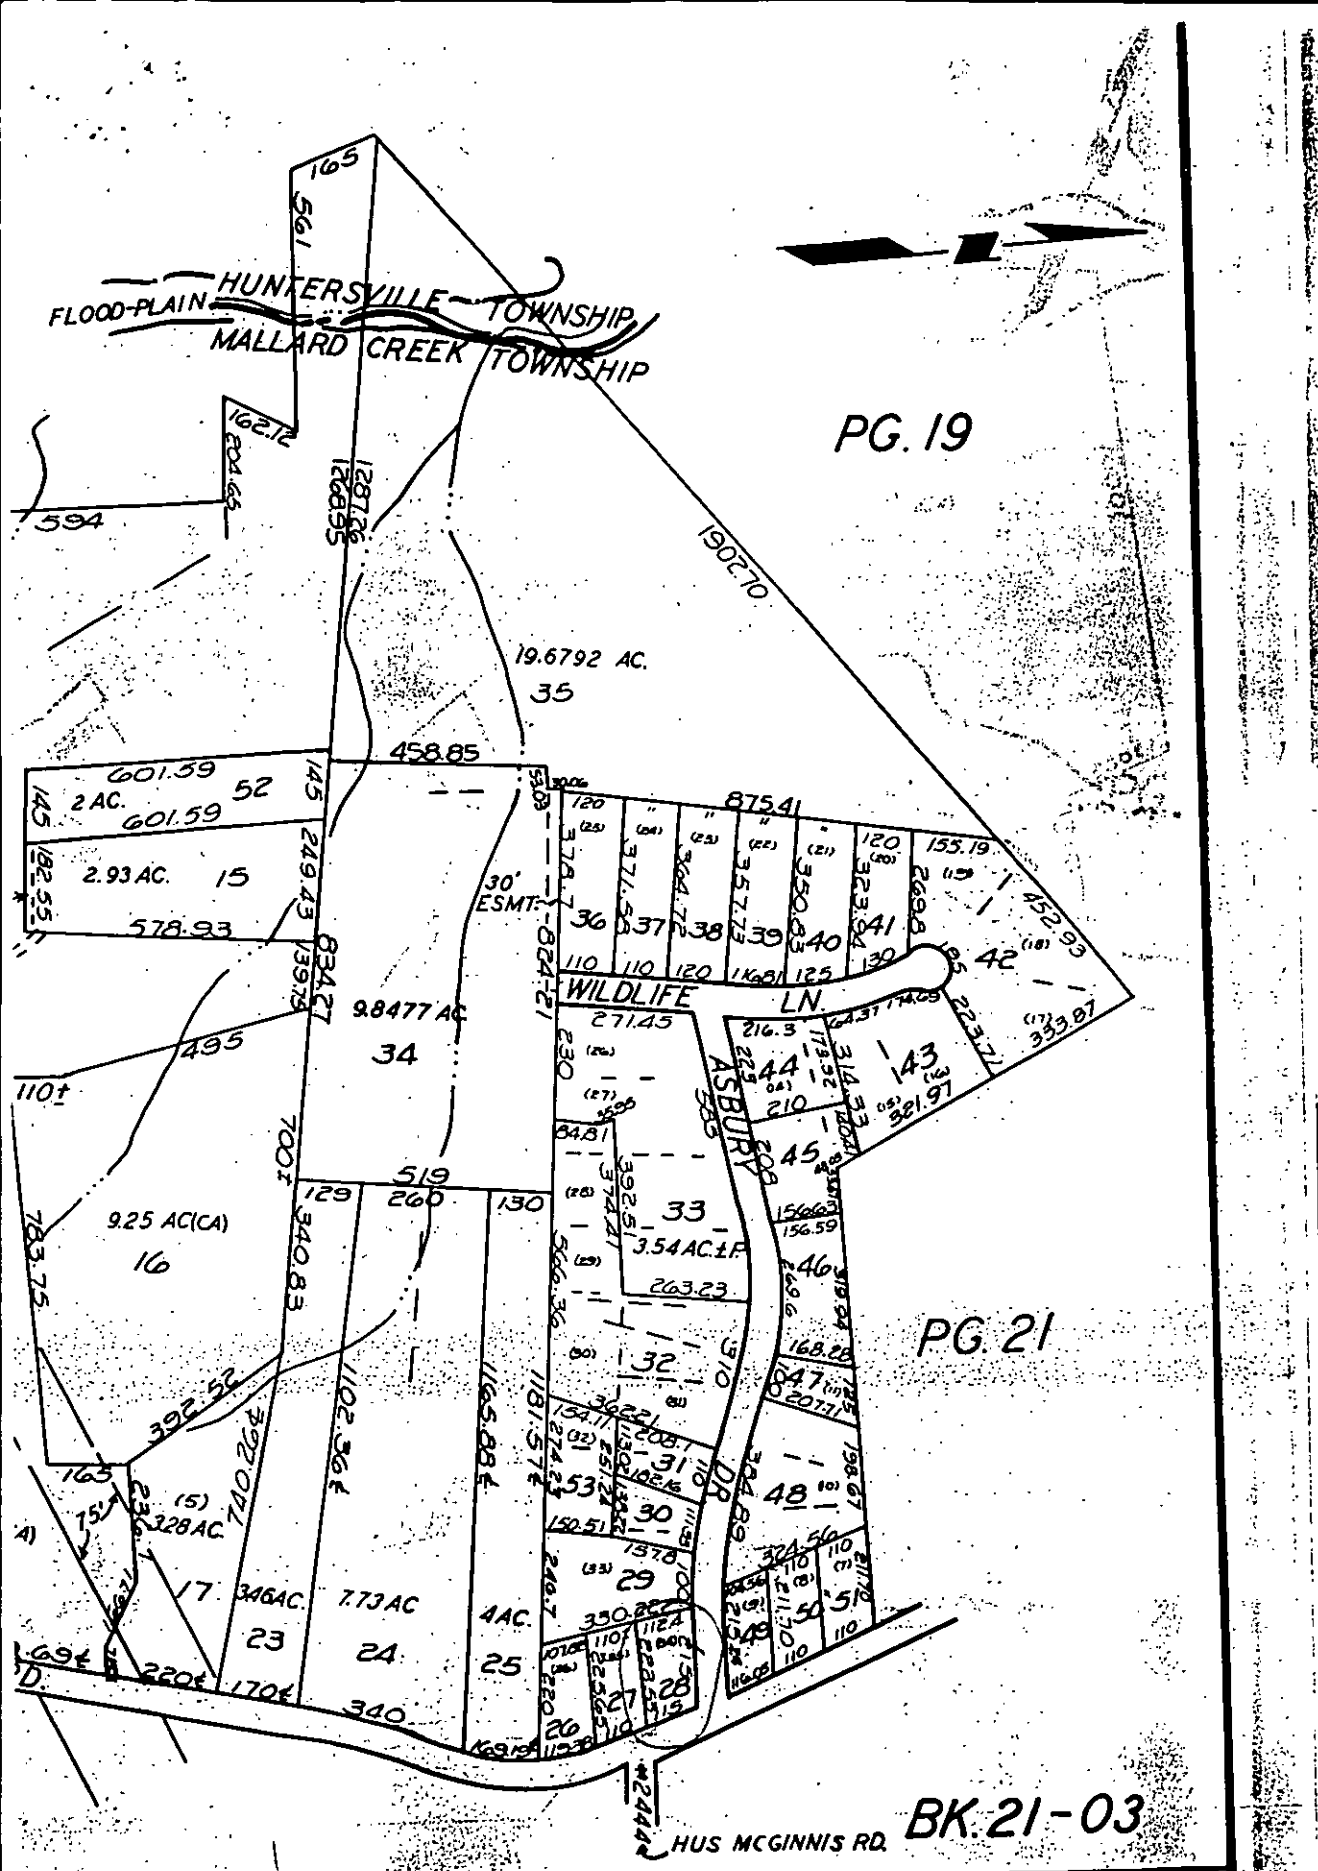
FLOOD-PLAIN
HUNTERSVILLE TOWNSHIP
MALLARD CREEK TOWNSHIP
PG. 19
PG. 21
19.6792 AC.
35
WILDLIFE LN.
ASBURY
HUS MCGINNIS RD.
BK. 21-03
TAX LINE MAP BOOK 19 PAGE 18
MECKLENBURG COUNTY, NORTH CAROLINA
REVISED 5-15-95 T.L.R.
SCALE 1" = 400'

JUDITH A GIBSON REG OF DEEDS MECK NC
**** NC EXCISE TAX: 112.00 ***
BK: 08366 PG: 0724/0726 #:0062 12.00
FILED FOR REGISTRATION 11/17/95 09:06

MECKLENBURG COUNTY

[redacted] 112.00

STATE OF NORTH CAROLINA

NOV17.95
Real Estate Excise Tax

Excise Tax Stamps $112.00

Tax Lot No. 019-181-28 Parcel Identifier No.

Verified by ..... County on the ..... day of ....., 19 .....

by .....

Mail after recording to GRANTEE

This instrument was prepared by Merryman and DeArmon (dhk)

Brief description for the Index

NORTH CAROLINA GENERAL WARRANTY DEED

THIS DEED made this 14 day of November, 19 95, by and between

GRANTOR	GRANTEE
HAVILAH LEON MCCOY and wife, PHYLLIS MCCOY	WILLIAM J. TURONIS, JR. Whose Address is: 14220 Asbury Drive Huntersville, NC 28078

Enter in appropriate block for each party: name, address, and, if appropriate, character of entity, e.g. corporation or partnership.

The designation Grantor and Grantee as used herein shall include said parties, their heirs, successors, and assigns, and shall include singular, plural, masculine, feminine or neuter as required by context.

WITNESSETH, that the Grantor, for a valuable consideration paid by the Grantee, the receipt of which is hereby acknowledged, has and by these presents does grant, bargain, sell and convey unto the Grantee in fee simple, all that certain lot or parcel of land situated in the City of , Township, Mecklenburg County, North Carolina and more particularly described as follows:

SEE ATTACHED EXHIBIT "A"

A map showing the above described property is recorded in Plat Book page .

TO HAVE AND TO HOLD the aforesaid lot or parcel of land and all privileges and appurtenances thereto belonging to the Grantee in fee simple.

And the Grantor covenants with the Grantee, that Grantor is seized of the premises in fee simple, has the right to convey the same in fee simple, that title is marketable and free and clear of all encumbrances, and that Grantor will warrant and defend the title against the lawful claims of all persons whomsoever except for the exceptions hereinafter stated. Title to the property hereinabove described is subject to the following exceptions:

All valid and enforceable easements, restrictions, covenants, encumbrances and rights of way of record.

IN WITNESS WHEREOF, the Grantor has hereunto set his hand and seal, or if corporate, has caused this instrument to be signed in its corporate name by its duly authorized officers and its seal to be hereunto affixed by authority of its Board of Directors, the day and year first above written.

(Corporate Name)

By: .....

.....President

ATTEST:

.....

.....Secretary (Corporate Seal)

USE BLACK INK ONLY

HAVILAH LEON MCCOY (SEAL)

Havilah Leon McCoy (SEAL)

PHYLLIS MCCOY

Phyllis McCoy (SEAL)

(SEAL)

DONNA McKENZIE NOTARY PUBLIC MECKLENBURG COUNTY, N.C.

Use Black Ink

NORTH CAROLINA, MECKLENBURG County.

I, a Notary Public of the County and State aforesaid, certify that HAVILAH LEON MCCOY and wife, PHYLLIS MCCOY Grantor,

personally appeared before me this day and acknowledged the execution of the foregoing instrument. Witness my hand and official stamp or seal, this 14 day of November, 19 95

My commission expires: 7/28/97 Donna McKenzie Notary Public

SEAL-STAMP

Use Black Ink

NORTH CAROLINA, ...County.

I, a Notary Public of the County and State aforesaid, certify that .....,

personally came before me this day and acknowledged that .... he is ..... Secretary of

..... a North Carolina corporation, and that by authority duly given and as the act of the corporation, the foregoing instrument was signed in its name by its ..... President, sealed with its corporate seal and attested by ..... as its ..... Secretary.

Witness my hand and official stamp or seal, this .....day of ..... 19.....

My commission expires: ..... Notary Public

The foregoing Certificate(s) of .....

.....

.....

is/are certified to be correct. This instrument and this certificate are duly registered at the date and time and in the Book and Page shown on the first page hereof.

.....REGISTER OF DEEDS FOR ..... COUNTY

By ..... Deputy Assistant - Register of Deeds

N C Bar Assoc Form No. 3 - 1976, Revised - 1977 .....

EXHIBIT "A"

Lying and being in the State of North Carolina, County of Mecklenburg and being more particularly described as follows:

BEGINNING at a point of intersection of the westerly edge of Asbury Chapel Road (if extended) and the Southerly edge of Asbury Drive (if extended) and running thence with the said westerly edge of Asbury Chapel Road South 15 deg. 34 min. East 115 feet to a point; running thence North 83 degrees 33 minutes 25 seconds West 222.53 feet to a point in the property line of William F. Lee (now or formerly); running thence with the Lee property line, North 12 deg. 00 minutes 20 seconds West 112.40 feet to a point in the Southerly edge of Asbury Drive; running thence with the Southerly edge of Asbury Drive (if extended) South 83 degrees 33 minutes 25 seconds East 215 feet to the point and place of BEGINNING, all as shown on that certain unrecorded map of revised portion of Asbury Hills made by R.B. Pharr & Associates on the 5th day of March, 1973, and according to a survey by H. Wayne Kester, Registered Land Surveyor dated November 8, 1995.

Included herewith is a 1988 Flintstone Mobile Home, Serial Number F315BSO498GA, (76' x 14').

Being the same property conveyed to Havilah Leon McCoy and wife by Deed recorded in Book 5989 at Page 697, Mecklenburg County Public Registry.

State of North Carolina, County of Mecklenburg

The foregoing certificate(s) of Donna H. Kern

Notary(ies) Public is/are certified to be correct. This 17th day of November 1995.

JUDITH A. GIBSON, REGISTER OF DEEDS By: Joe Marie McRae Deputy Register of Deeds



STATE OF NORTH CAROLINA
COUNTY OF MECKLENBURG

I, DO HEREBY CERTIFY THIS TO BE A TRUE COPY OF DOCUMENT FILED AND RECORDED IN BOOK 8366 PAGE(S) 724-726 THIS 10 DAY OF March 19 97

JUDITH A. GIBSON, REGISTER OF DEEDS

BY: Colleen J. Lewis
DEPUTY REGISTER OF DEEDS

REQUEST FOR SERVICE

LOCATION

PERMIT #

STREET # (N,S,E,W) STREET NAME (AV,RD,ST, etc)
14220 Asbury Drive

SUITE/UNIT(S):

TAX JURISDICTION (Check One): ☐ 0-Mecklenburg ☐ 1-Charlotte ☐ 2-Davidson ☐ 3-Cornelius ☐ 4-Pineville ☐ 5-Matthews ☑ 6-Huntersville ? ☐ 7-Mint Hill

OWNER William J. Turonis Jr. ADDRESS 14220 Asbury Drive
CITY Huntersville STATE NC ZIP 28078 PHONE 948-3790

ZONING MAP # JOB # USDC# 040

TAX PARCEL #019-181-28

REQUEST

REFERRED TO:

		OTHER DEPTS.	
BU	☑ BLDG.		
EL	☐ ELECT.	CC	☐ CD (CITY)
ME	☐ MECH.	CT	☐ CDOT
PL	☐ PLBG.	CE	☐ CITY ENG.
ZO	☐ ZONING	CF	☐ CITY FIRE
HO	☐ HOUSING	PC	☐ CMPC
FI	☐ FIRE	CU	☐ CMUD
AC	☐ ACCOUNT.	EN	☐ ENG. (CO.)
AD	☐ ADMIN.	EH	☐ ENV. HLTH.
CD	☐ CD (COUNTY)	EP	☐ ENV. PROT.
PR	☐ PLAN REV.	PO	☐ PARK OPER.
PW	☐ PER. WRIT.	OT	☐ OTHER
RE	☐ RECORDS		

TYPE OF REQUEST

AV	☐ Abandoned Veh	GL	☐ Gas Leak	SR	☐ Screening
AL	☐ ABC License	HC	☐ Handicapped	SH	☐ Sect. 8 Hsng.
BR	☐ Bldg. Reconnect	HW	☐ Hazardous Wiring	SW	☐ Sewage/Septic
BL	☐ Bond/License	HD	☐ Historic Dist.	SN	☐ Sign
RH	☐ CD/Rehab	IN	☐ Insulation	SS	☐ Substandrd Hsng
CC	☐ Change of Contr.	JV	☐ Junked Veh	UB	☐ Unsafe Bldg.
CU	☐ Change of Use	LF	☐ Landfill	VT	☐ Venting/Drain
DC	☐ Day Care	MH	☐ Mobile Home	WD	☐ Water Damage
ES	☐ Exit/Safety Equip	NP	☑ No Permit	WH	☐ Water Heater
FD	☐ Fire Damage	PK	☐ Parking	ZB	☐ Zoning Bd. Adj.
FI	☐ Fire Safety	PR	☐ Pier	OT	☐ Other: Describe
FS	☐ Fire Suppression	PD	☐ Plan Deviation		
FP	☐ Flight Path Encro.	PV	☐ Plan Verify		
FW	☐ Floodway	PU	☐ Property Use		
FN	☐ Furnace	SC	☐ School		

RECEIVED BY: (#_____) _____ DATE: 3/12/97 TIME: _____ HOW REC'D. ☐ Phone ☐ Mail ☐ Person

RECEIVED FROM: Lisa Mialik ADD: Meck. Co. Health Dept. - DNWS PHONE 336.4573

OCCUPANT: Same ADD: PHONE

CONTRACTOR: ADD: PHONE

REMARKS

DESCRIBE REQUEST FOR SERVICE
Family room addition under construction at front of mobile home - No building permit.
Septic system failure. No approval will be given by DNWS until repair installed and finalled.
(Foundation may not meet 5' setback from septic tank)

ACTION REQUESTED: ☑ Investigate ☐ Respond in writing ☐ FYI

SPECIAL INSTRUCTIONS FOR INVESTIGATOR:
(1) Call before going out? ☐ Yes ☐ No Time:
(2) Is building open? ☐ Yes ☐ No
(3) Person to contact Phone #

OTHER INSTRUCTIONS

Mort Robins - inspector

HOLDS	PROCESSED BY		APPROVED BY	VALIDATED BY

CHARLOTTE-MECKLENBURG BUILDING STANDARDS DEPARTMENT
P.O. BOX 31097 • CHARLOTTE, NC 28231-1097 • 704/336-2831

B-85 10M 3/89

APPLICANT

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4115-A DATE: 4-1-97

TC: 019-181-28 ☐ L

SERIAL Nº 17043

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 4-1-97. All work shall be completed on or before 4-8-97, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

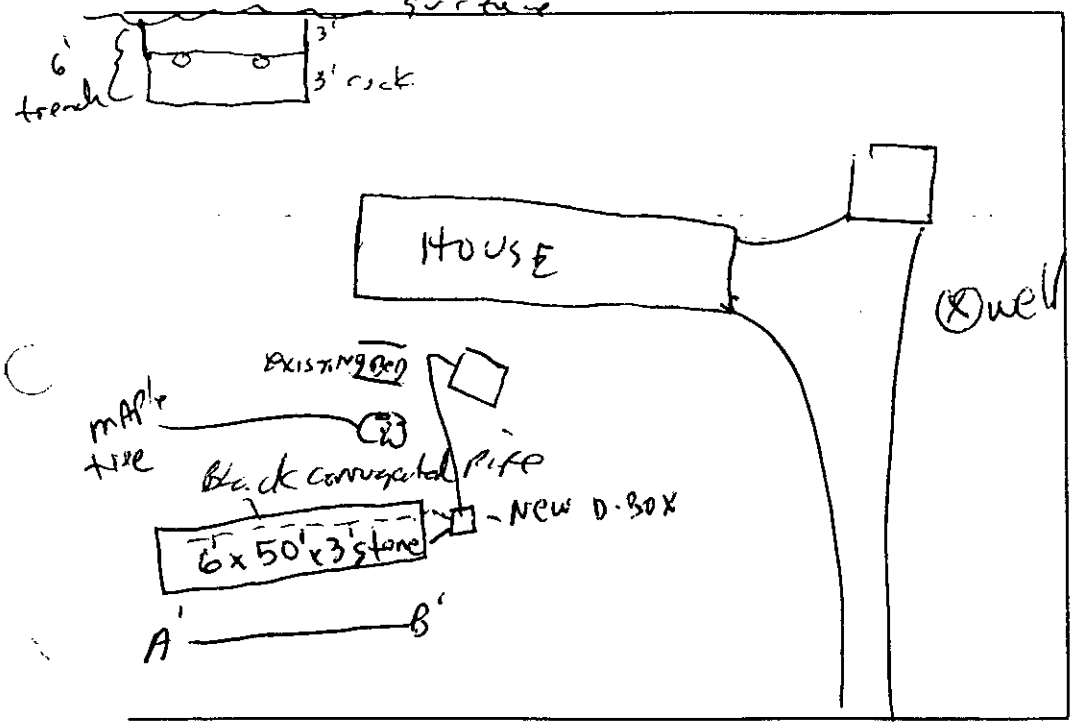

PLOT OF SYSTEM

Liquid Capacity of Septic Tank EXISTING gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction PCC

Trench Depth 6 feet

Absorption and/or Nitrification Lines:

Trench Width 6 feet feet

Trench Walls Scored and Porous YES

Total Line Length 1 Bed 6'x6'x50' lons feet

Number of Lines 2

Depth of Stone 3 feet inches

Distance from House 5'+ feet

Distance from Property Line 10'+ feet

Distance from Well 100'+ feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER WILLIAM J TURONIS

LOCATION OF PROPERTY 14220 ASBURY DR

Comments: NEW 6' x 50 x 6' deep trench bottom with 3' stone (#5 stone) - trench bottom 6' deep to PS saprolite - keep trench bottom on contour - trench bottom from A' to B' NO more 1 inch fall - SCH40 PVC pipe from tank to new D-Box - Black corrugated pipe holes @ 45° towards trench bottom.

replace T in tank if necessary

Kelly Randall
Environmental Health Specialist

336-5575

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

(8) irregular width
(9) obstacles?
~50'
5'
6'
8
(1) irregular Piping used
(2) access to R/W
(3) stone w/ fine rocks washed
(4) use CST covered
(5) unable to verify Piping from ST. Set. 40 PVC?
(6) downstream from intended Site
(7) 95% bed covered

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 4115-A DATE: 4-1-97

TC: 019-181-28 ☐ L

SERIAL Nº 17043

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 4-1-97. All work shall be completed on or before 4-8-97, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

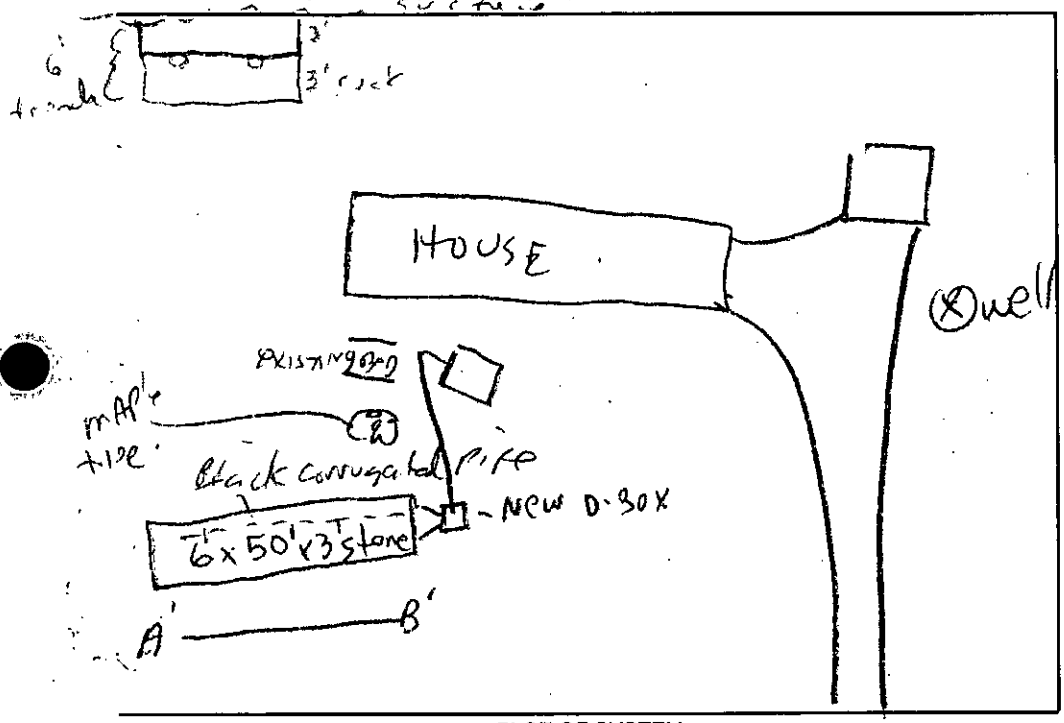

PLOT OF SYSTEM

Liquid Capacity of Septic Tank EXISTING gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction PCC

Trench Depth 6 feet

Absorption and/or Nitrification Lines:

Trench Width 6 feet feet

Trench Walls Scored and Porous YES

Total Line Length 1 Bed 6'x6'x50' lons feet

Number of Lines 2

Depth of Stone 3 feet inches

Distance from House 5'+ feet

Distance from Property Line 10'+ feet

Distance from Well 700'+ feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER WILLIAM J TURONIS

LOCATION OF PROPERTY 14220 ASBURY DR

Comments: New 6' x 50 x 6' deep trench bottom with 3' stone (#5 stone) - trench bottom 6' deep to PS saprolite - keep trench bottom on contour - trench bottom from A' to B' NO more 1 inch fall - SCH40 PVC pipe from tank to new D-Box - Black corrugated pipe holes @ 45° towards trench bottom. replace T in tank if necessary

Wally Randall
Environmental Health Specialist

336-5575

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

Mecklenburg County
Health Department
700 North Tryon Street
Suite 211
Charlotte, North Carolina 28202-2236


File 4115A

14220 Asbury Dr



picture 1 of 6

3/7/97 ~2:30 p.m.
William J. Turonis Jr.
14220 Asbury Drive

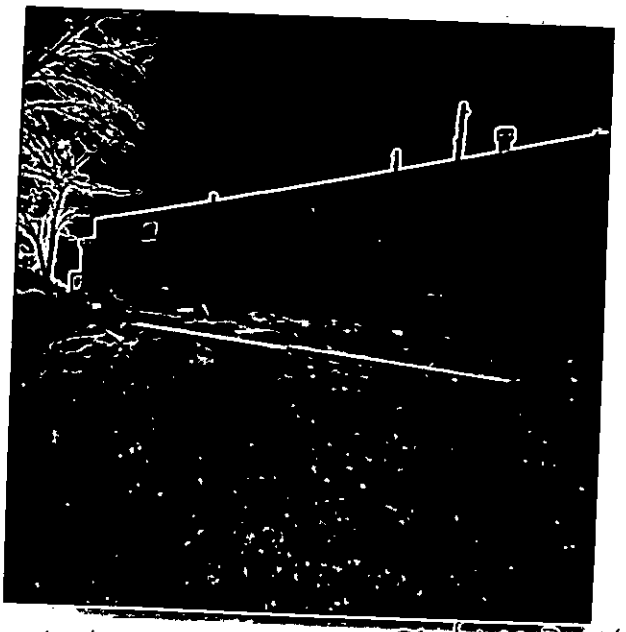

3/7/97 ~2:30pm. picture 2 of 6
William J. Turonis Jr.
14220 Asbury Drive




3 of 6.

3/7/97 ~ 2:30 pm
William J. Tulonis Jr.
14220 Asbury Drive



4 of 6

3/7/97 ~ 2:30 pm
William J. Tulonis Jr.
14220 Asbury Dr.

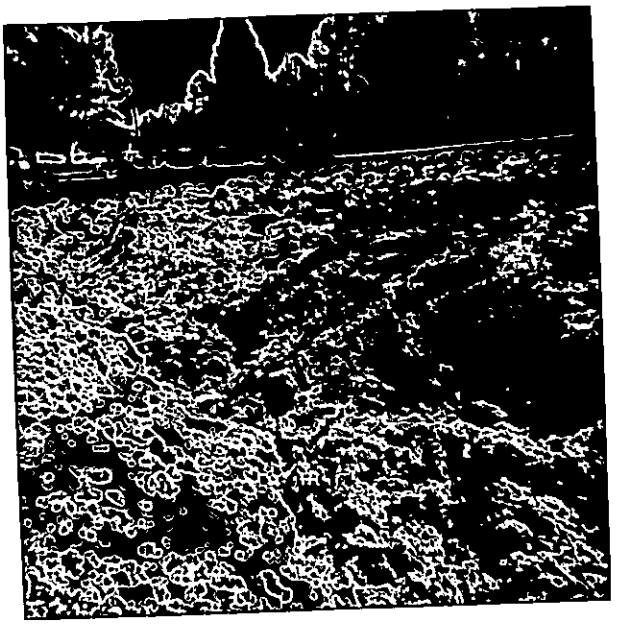

4/7/97 1:30 pm - View from
Beginning of Bed
14220 Asbury Drive
6 of 6



4/7/97 1:30 pm - View from
end of Bed
14220 Asbury Drive
5 of 6

4/22/91 Effluent bleeding out from tank area

4/29/91 Met Bill Martin on site.
Surface water problem observed.
Advised homeowner to put about 4" cover over top of drainfield and tank area.

6/10/91 Homeowner had put appx. 4" soil cover over tank and drainfield area.
No effluent was visible on ground surface during visit.

P. Walker
6/11/91

APPLICATION FOR AN IMPROVEMENT PERMIT

Paid

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

(OFFICE USE ONLY)
FILE: 4115A
TC: _____
SERIAL: № 19070

L ☐ CRT

JOB LOCATION

① ADDRESS: 14220 (STREET NO.) Asbury Drive (STREET) ② FILE: _____
③ JURISDICTION: Huntersville ④ TAX PARCEL NO.: 019-181-28
⑤ SUBDIVISION: _____ ⑥ LOT: _____ ⑦ BLOCK: _____

OWNER

⑧ NAME: Havilah (FIRST) L. (MIDDLE) McCoy (LAST)
⑨ MAILING ADDRESS: 14220 - Asbury Drive
⑩ CITY: Huntersville ⑪ STATE: NC. ⑫ ZIP: 28078
⑬ PHONE: (WORK) _____ ⑭ (HOME) 875-0918

REQUEST

This request is for a(n):

⑮ ☐ New permit
⑯ ☐ Repair or alteration permit
⑰ ☐ Authorization for mobile home exchange
⑱ ☒ Other (specify) Detached Garage

DESIGN CRITERIA

System will serve:

⑲ ☒ Residence ⑳ ☐ Mobile home ㉑ ☐ Business or place of public assembly
㉒ Number of bedrooms? _____ ㉕ Type? _____
㉓ Maximum occupancy? _____ ㉖ Maximum number of employees? _____
㉔ Basement? ☐ yes ☒ no ㉗ Maximum number of seats? _____

WATER SUPPLY

㉘ Water supply from (present or proposed):

A ☒ Individual well
B ☐ Municipal system
C ☐ Community well
D ☐ Community system

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

... No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

... This permit is not transferable, and shall become null and void 36 months from the date of issuance.

Use existing system.

Philo A. Walker, 6/10/91
Environmentalist Date

_____, 6-11-91
Director or Authorized Section Head Date

*This permit must be signed by the Director of Mecklenburg County Health Department or an authorized section head in order to be valid.

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Mon Technician
Date: 4/17/91


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 4115 A

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

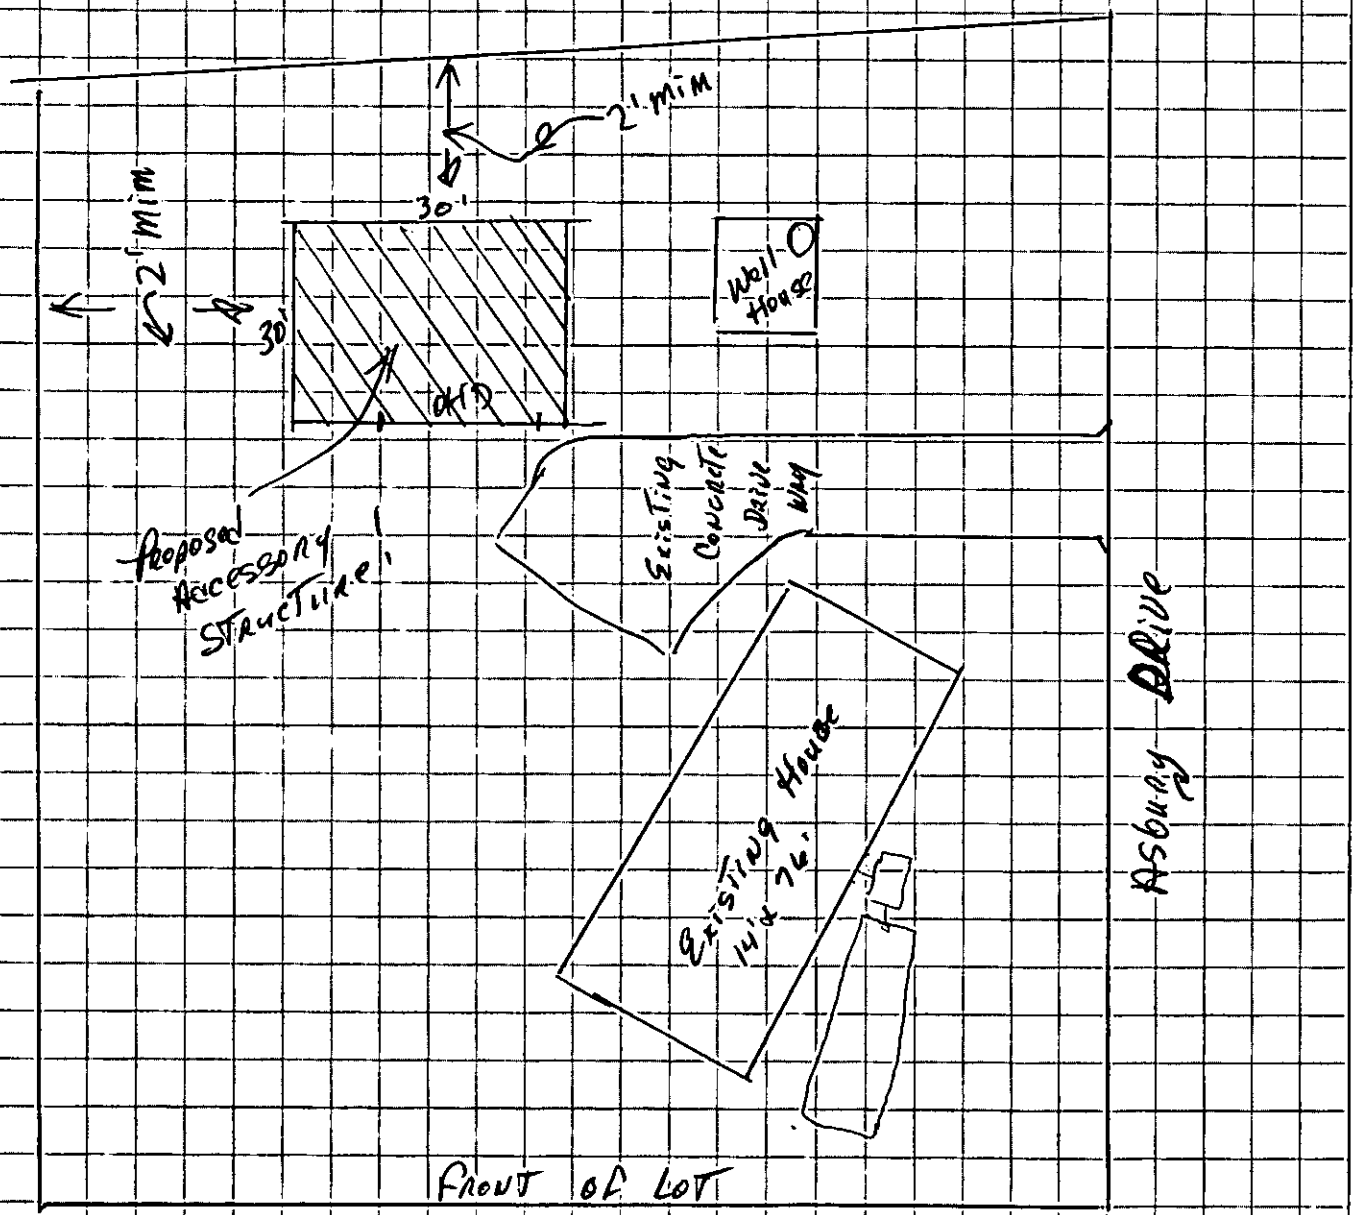

Signed: Don P. Schneider

Date: 4/17/91

$50.00 Improvement Permit Fee Paid 11-18-87 #50.00

APPLICATION FOR AN IMPROVEMENT PERMIT

MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH ·

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

(OFFICE USE ONLY)
FILE: 4115A
TC: 019-181-28
SERIAL: № 14997
☒ L ☑ CRT

JOB LOCATION

① ADDRESS: 14220 (STREET NO.) Asbury Drive (STREET) Huntersville NC ② FILE:
③ JURISDICTION: ④ TAX PARCEL NO.:
⑤ SUBDIVISION: ⑥ LOT: ⑦ BLOCK:

OWNER

⑧ NAME: Havilah (FIRST) Leon (MIDDLE) McCoy (LAST)
⑨ MAILING ADDRESS: 12804 Asbury Chapel Rd.
⑩ CITY: Huntersville ⑪ STATE: N.C. ⑫ ZIP: 28078
⑬ PHONE: (WORK) 597-1831 ⑭ (HOME)

REQUEST

This request is for a(n):

⑮ ☐ New permit
⑯ ☐ Repair or alteration permit
⑰ ☒ Authorization for mobile home exchange
⑱ ☐ Other (specify)

DESIGN CRITERIA

System will serve:

⑲ ☑ Residence ⑳ ☐ Mobile home
㉑ ☐ Business or place of public assembly
㉒ Number of bedrooms? 2
㉕ Type?
㉓ Maximum occupancy? 3
㉖ Maximum number of employees?
㉔ Basement? ☐ yes ☒ no
㉗ Maximum number of seats?

WATER SUPPLY

㉘ Water supply from (present or proposed):

A ☑ Individual well
B ☐ Municipal system
C ☐ Community well
D ☐ Community system

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH to enter onto the property for the purpose of processing this request.

Signed: Havilah L. McCoy
Date: 11-17-87

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

. . . No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

. . . This permit is not transferable, and shall become null and void 36 months from the date of issuance.

Kelly Ratliff, Environmentalist — 11-20-87 (Date)

Director or Authorized Section Head — 11-20-87 (Date)

*This permit must be signed by the Director of Environmental Health or an authorized section head in order to be valid.