Date Received 7/20/78

APT No. 7169 7/68

T. C. No.

Map Date

please mail report to: L.H. DAVIS 1000 REVERDY LN MATTHEWS, NC 28105 847-4501

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER PARNELL MARTIN COMPANY (LAST / FIRST / MIDDLE)

2) ADDRESS OF OWNER Box 1479, CHARLOTTE NC ZIP 28232

3) PHONE NO. Home _____ Office 375-8651


4) LOCATION OF PROPERTY LOT 28A - BLOCK C (TARAWOODS) PINE NEEDLE TRAIL (STREET OR COUNTY ROAD)

5) SUBDIVISION TARAWOODS LOT NO. 28-A BLOCK NO. C

MAP BOOK NO _____ PAGE NO. _____

6) DEED REFERENCE: DEED BOOK _____ PAGE NO. _____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge

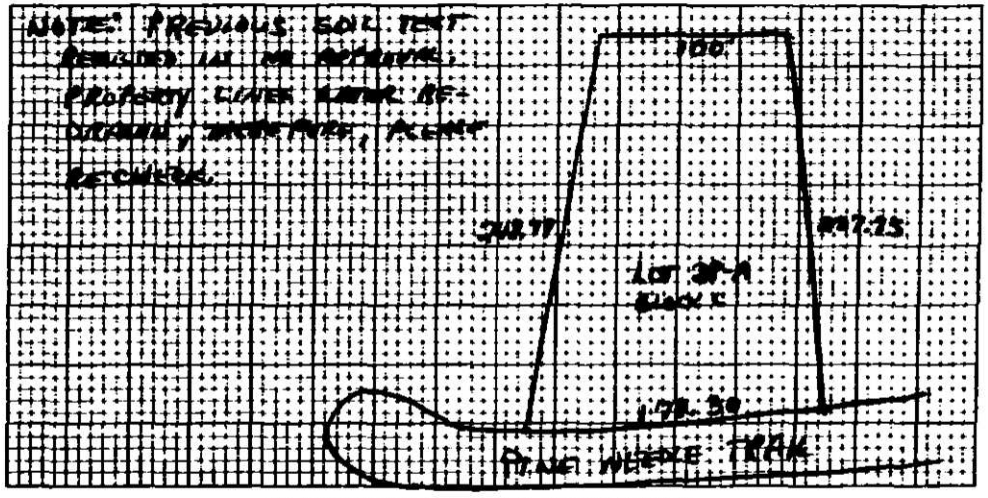

7) ACCURATELY DIAGRAM & DIMENSION LOT

PARNELL MARTIN CO.

John L. Slagle

OWNER

EHD-5-74

Environmental Health Department's Copy

Date Received 10-22-23

APT No. 7169

T. C. No. 135-183-10

Map Date 8-7-25-9-74

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

APPLICATION FOR PERCOLATION TEST

1) NAME OF OWNER Dellinger Madison & Assoc Inc
(LAST / FIRST / MIDDLE)

2) ADDRESS OF OWNER 411 S Sharon Amity Rd Charlotte NC ZIP 28211

3) PHONE NO. Home — Office 364-7155

4) LOCATION OF PROPERTY Pine Needle Trail
(STREET OR COUNTY ROAD)

5) SUBDIVISION Tanglewood LOT NO. 29 BLOCK NO. C

MAP BOOK NO. — PAGE NO. —

6) DEED REFERENCE: DEED BOOK — PAGE NO. —

Application is hereby made to the Mecklenburg County Health Department for the conduct of a percolation test and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge.



7) ACCURATELY DIAGRAM & DIMENSION LOT

Michael L Dellinger, Vice President
OWNER

FORM NO. E-1-9-1-72

HEALTH DEPARTMENT'S COPY

MECKLENBURG COUNTY
Department of Public Health

1200 Blythe Boulevard
Charlotte, North Carolina 28203

Telephone 374-2113

Date Issued
1. December 28, 1973
2. _____
3. _____

SITE DISAPPROVAL REPORT
INDIVIDUAL SEPTIC TANK SYSTEM WITH SUBSURFACE,
SOIL ABSORPTION, EFFLUENT DISCHARGE

SDR No. 7169 283-10
T.C. No. ~~P.O. 135-281-09~~
~~8-9-72~~
5-9-74

NAME OF OWNER Dellinger, Madison & Associates, Inc.

ADDRESS OF OWNER 411 S. Sharon Amity Rd. ZIP 28211

LOCATION OF LOT Pine Needle Trail, Lot 29-C

The lot described above has been disapproved for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge due to the following:

FAILURE TO PASS PERCOLATION TEST (60 minutes per inch or less)

	Test No.	Date of Test	Percolation Rate
_____	1.	_____	_____ min/in
_____	2.	_____	_____ min/in
_____	3.	_____	_____ min/in

X ON SITE INSPECTION REVEALED LOT TO BE UNSUITABLE FOR THE FOLLOWING REASON(S) Soils were found to be composed of fill material over the majority of the lot. These soils are composed of highly compacted clayey fill which has very little porosity. This factor results in inadequately slow percolation rate and permeability.

W. Everette Lyons, Jr.
Soil Scientist

John R. Adkisson
Environmentalist

(Stencil No.)
HHD 398
8/70

FORM NO.
H-19-8-14-70

MECKLENBURG COUNTY HEALTH DEPARTMENT

INTER-OFFICE COMMUNICATION

DATE: November 1, 1974

TO: John R. Adkisson

FROM: W. Everette Lynn, Jr. WEL
Soil Scientist

SUBJECT: APT. #7170 (R. M. Barbee)
Lot No. 5, 6 & 7, Block H, Durham La.
Date: 11-1-74

The proposed building site consists of soils of the Cecil series. These soils have good drainage, good aeration and moderate permeability (true mean perc. rate of 60 Min./in.).

The area available for installation of a septic tank system is highly restricted due to proximity of a well and existing septic tank system to the proposed installation site.

Assuming a system can be designed for the site, sizing of the system should be based on a 60 Min./in. perc. rate.

WEL/jjk