

PROPERTY NOW PART OF IREDELL COUNTY

5/6/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

North Carolina Department of Environment,
Health, and Natural Resources
919 North Main Street
Mooresville, N. C. 28115

MOORESVILLE N.C. OCT 13'95 P.B.METER 1506578 U.S. POSTAGE ≡ 0.32

MS SUE BATEMAN
MECKLENBURG CO HEALTH DEPT
700 NORTH TRYON STREET
SUITE 211
CHARLOTTE NC 28202-2236

28202-2236 11

State of North Carolina
Department of Environment,
Health and Natural Resources
Division of Environmental Management

James B. Hunt, Jr., Governor
Jonathan B. Howes, Secretary
A. Preston Howard, Jr., P.E., Director

DIVISION OF ENVIRONMENTAL MANAGEMENT

October 10, 1995

Chris Holcombe
16219 Weatherly Way
Huntersville, North Carolina 28078

RE: Well Violation Review
North Carolina Well Construction Standards
Charles Rader Well
Mecklenburg County, N.C.

Dear Mr Holcombe:

Staff of the Mooresville Regional Office Groundwater Section reviewed the well abandonment record which you delivered on October 5, 1995 for a well at the residence of Charles Rader located at 16634 Yacht Road (formerly Wally Road), Mooresville 28115-6639 in Mecklenburg County, North Carolina.

You received notification on October 2, 1995 that the well was in violation of the following North Carolina Well Construction Standard:

The well not been abandoned in accordance with Commission Rule 15A NCAC 2C .0113(2).

Review of the well abandonment record indicated that the well construction violation had been corrected. Due to your timely response to the Notice, no enforcement action will be recommended at this time.

Sincerely,

B. Keith Overcash, P.E.
Regional Supervisor

MAF
cc: Groundwater Section, Raleigh
Sue Bateman - Mecklenburg County Health Department
Charles Rader

CERTIFICATE OF COMPLETION/OPERATION PERMIT

0400

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 2409 A DATE: 11-23-94

TC: 001-342-04 ☐ L ☒ CRT

SERIAL № 14335

Name of Owner Charles Radar Juris.:

Address of Property 16634 Yacht Bailey Rd.

Inspection Data:

Tank Material PCC

Total Length of Drainfield 400'

Number of Lines 4 @ 100' each

Cover Depth 12"-24"

Water Supply Source well

Distance to Water Source 80'

Excavation Inspected 11-23-94

Tank(s) Inspected 11-23-94

Wash Line Inspected —

High Water Alarm Inspected —

PLOT

Design: 1994, conv, 1500 gal, 1200 sq ft drainfield, 12" stone, cecil-like CTR# Division 84

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: See attached copy of well abandonment form dated 10-5-95.

Type II

Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

NORTH CAROLINA DEPARTMENT OF ENVIRONMENT, HEALTH, & NATURAL RESOURCES

MOORESVILLE REGIONAL OFFICE

FROM: **Name:** Steven Bogaid

Division: EM

Section: GW

919 North Main Street
Mooresville, NC 28115

Phone 704/663-1699 **FAX** 704/663-6040

FAX

DATE: 10/6/95

TO: Sue Bateman

FAX NUMBER: 336-6894

SUBJECT: Well abandonment @ Rader residence

NUMBER OF PAGES (Including Cover): 2

Chris Holcombe
875 0173

N.C. DEPT. OF
ENVIRONMENT, HEALTH,
& NATURAL RESOURCES
OCT 5 1995
DIVISION OF ENVIRONMENTAL MANAGEMENT
MOORESVILLE REGIONAL OFFICE

Department of Environment, Health, & Natural Resources
Division of Environmental Management
Groundwater Section
P.O. Box 28687 - Raleigh, N.C. 27611

WELL ABANDONMENT RECORD

CONTRACTOR C.H. HOLCOMBE REG. NO.

1. WELL LOCATION: (Show a sketch of the location on back of form.)

Nearest Town: MOORESVILLE N.C. County MECKLENBURG

1 1/2 MI. WALLY RD. / LAKE NORMAN
(Road, Community, Subdivision, Lot. No.)

Quadrangle No.

2. OWNER: CHARLES RADER

3. ADDRESS: EVANSTON LANE, CORNELIUS

4. TOPOGRAPHY: draw, slope, hilltop, valley, flat

5. USE OF WELL: _____ DATE: _____

6. TOTAL DEPTH: 61'-4" DIAMETER: 2"


7. CASING REMOVED:
feet diameter
DEPTH OF HOLE 53' 2"
CASING IN HOLE PULLED -39'

8. SEALING MATERIAL:
Neat cement: bags of cement 3 1/2; gals. of water 12
Sand cement: bags of cement _____; yds. of sand _____; gals. of water _____

Other
Type material 2 tablespoons granular
Amount chlorine

9. EXPLAIN METHOD EMPLACEMENT OF MATERIAL
POLLED EXIST. CASING, ADDED CHLORINE, POURED WET CEMENT TILL WATER DISPLACED & HOLE WAS FULL, WAITED 6 HRS. & CAPPED SETTLEMENT OF CONC. IN HOLE.

WELL DIAGRAM: Draw a detailed sketch of the well showing total depth, depth and diameter of screens remaining in the well, gravel interval, intervals of casing perforations, and depths and types of fill materials used.

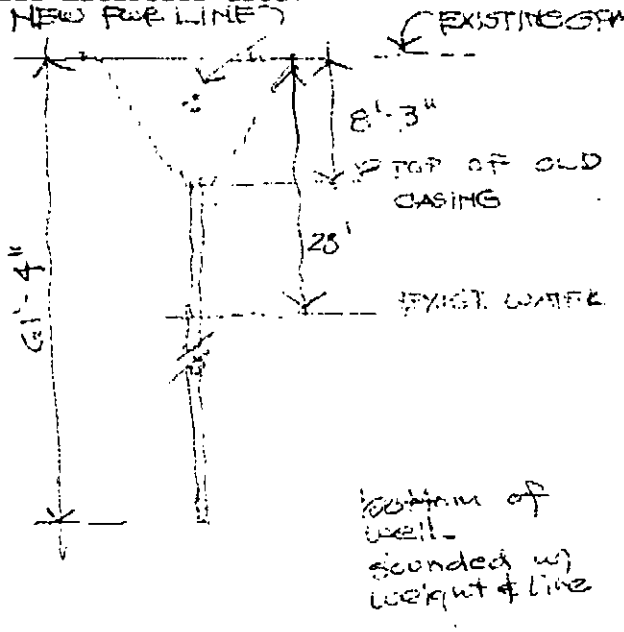

I do hereby certify that this well abandonment record is true and exact.

Signature of Contractor or Agent Christopher Holcombe Date 10/5/95

WELL LOCATION: Draw a location sketch on the reverse of this sheet, showing the direction and distance of the well to at least two (2) nearby reference points such as roads, intersections and streams. Identify roads with State Highway road identification numbers.

Submit original to the Division of Environmental Management, one copy to the Driller, and one copy to the owner.
GW-30

State of North Carolina
Department of Environment,
Health and Natural Resources
Mooresville Regional Office

James B. Hunt, Jr., Governor
Jonathan B. Howes, Secretary
Linda Diane Long, Regional Manager

DEHNR

DIVISION OF ENVIRONMENTAL MANAGEMENT

September 26, 1995

CERTIFIED MAIL
RETURN RECEIPT REQUESTED

Chris Holcombe
16219 Weatherly Way
Huntersville, North Carolina 28078

Re: NOTICE OF VIOLATION
NORTH CAROLINA WELL CONSTRUCTION STANDARDS
Charles Rader Well
Mecklenburg County, N.C.

Dear Mr. Holcombe:

Pursuant to North Carolina General Statute 87-91(a) you are hereby notified that Chris Holcombe is in violation of the Well Construction Standards, 15A NCAC 2C, as adopted by the Environmental Management Commission under authority granted by the North Carolina Well Construction Act. This notice is given in accordance with North Carolina General Statutes 87-83, et seq.

Specifically, staff of the Mooresville Regional Office reviewed the Well Abandonment Record (GW-30) submitted for a well at the residence owned by Charles Rader located at 16634 Yacht Road (formerly Wally Road), Mooresville 28115-6639 in Mecklenburg County, North Carolina. Said well was abandoned or caused to be abandoned by Chris Holcombe. Review of the record revealed that:

The well was not abandoned in accordance with Commission Rule 15A NCAC 2C. 0113(2).

In accordance with G.S. 87-94, Chris Holcombe may correct the above cited violations and thereby avoid enforcement action if the violation is corrected by performing the following within 30 days of receipt of this notice:

1. Properly abandon the well in accordance with Commission Rule 15A NCAC 2C. 0113(2).

2. Submit a well abandonment record to the MRO in accordance with Commission Rule 15A NCAC 2C. 0114(b).

You must notify the Regional Supervisor of the Mooresville Regional Office, 919 North Main Street, Mooresville, North Carolina 28115 in writing as to the date you corrected the violation. You should not assume the well is in compliance with the Well Construction Standards until you have been notified by the Division in writing.

This Notice of Violation of the North Carolina Well Construction Standards is given pursuant to the authority granted to the Department of Environment, Health, and Natural Resources in G.S. 87-91 and as delegated by the Secretary thereof pursuant to G.S. 143B-10.

Should you have any questions, please contact Peggy Finley in the Mooresville Regional Office.

Sincerely,

B. Keith Overcash, P.E.
Regional Supervisor

Enclosures

cc: Groundwater Section - Raleigh
Central Files - Raleigh
Mecklenburg County Health Department
Charles Rader

MAF/js

DATE 6/13/94

TO: CHARLOTTE-MECKLENBURG BUILDING STANDARDS
PERMIT ISSUING SECTION

FROM: MECKLENBURG COUNTY ENGINEERING

JURISDICTION Meck

001-342-04
PARCEL NUMBER

16634 Wally Yacht Rd
ASSIGNED STREET ADDRESS (ADDRESS OF RECORD)

EXISTING STREET ADDRESS (IF DIFFERENT FROM ASSIGNED)

NA
PROJECT NAME (IF APPLICABLE)

THE ABOVE DESCRIBED LOCATION HAS BEEN CHECKED CONCERNING:

1. SUBDIVISION REGULATIONS	✓ APPROVED	____ NOT APPROVED
2. FLOODWAY REGULATIONS	✓ APPROVED 6/13/94 Pmer	____ NOT APPROVED
3. WATERSHED PROTECTION	✓ APPROVED	____ NOT APPROVED
4. COMMERCIAL DRAINAGE PLAN	✓ APPROVED	____ NOT APPROVED
5. PUBLIC UTILITY EASEMENT	____ PRESENT	✓ NOT PRESENT
6. PROPERTY FRONTS ON THOROUGHFARE	____ YES	✓ NO
7. DRIVEWAY PERMIT REQUIRED	____ YES	✓ NO
8. DOES PROJECT CONFLICT WITH ROAD PROJECT?	____ YES	✓ NO

REMARKS: Home & Deck / Pmer FLOODWAY 6/13/94 Pmer
ELEVATION CERTIFICATE REQUIR

NOTE: THIS FORM MUST BE TURNED IN AT THE CASHIERS OFFICE WHEN PAYING PERMIT FEE. CERTIFICATE OF OCCUPANCY WILL NOT BE GRANTED UNTIL TRANSPORTATION DIVISION GRANTS FINAL APPROVAL ON DRIVEWAY(S).

ALL OTHER FORMS OBSOLETE

☐ NEW ADDRESS

SIGNED: Pmer

REVISED 1/91

(d) National Science Foundation (NSF) approved PVC pipe rated at 160 PSI may be used for liner casing. The annular space around the liner casing shall be at least five-eighths inches and shall be completely filled with neat-cement grout.

History Note: Statutory Authority G.S. 87-87; 87-88;
Eff. February 1, 1976;
Amended Eff. September 1, 1984.

.0113 ABANDONMENT OF WELLS

(a) Any well which has been abandoned, either temporarily or permanently, shall be abandoned in accordance with one of the following procedures:

(1) Procedures for temporary abandonment of wells:

(A) Upon temporary removal from service or prior to being put into service, the well shall be sealed with a water-tight cap or seal compatible with casing and installed so that it cannot be removed easily by hand.

(B) The well shall be maintained whereby it is not a source or channel or contamination during temporary abandonment.

(C) Every temporarily abandoned well shall be protected with a casing.

(2) Procedures for permanent abandonment of wells:

(A) All casing and screen materials may be removed prior to initiation of abandonment procedures if such removal will not cause or contribute to contamination of the groundwaters. Any casing not grouted in accordance with Rule .0107 Paragraph (d) of this Section shall be removed or properly grouted.

(B) The entire depth of the well shall be sounded before it is sealed to ensure freedom from obstructions that may interfere with sealing operations.

(C) The well shall be thoroughly disinfected prior to sealing.

(D) In the case of gravel-packed wells in which the casing and screens have not been removed, neat-cement shall be injected into the well completely filling it from the bottom of the casing to the top.

(E) "Bored" wells shall be completely filled with cement grout, dry clay or material excavated during drilling of the well and then compacted in place.

(F) Wells constructed in unconsolidated formations other than "bored" wells shall be completely dilled with cement grout by introducing it through a pipe extending to the bottom of the well which can be raised as the well is filled.

(G) Wells constructed in consolidated rock formations or that penetrate zones of consolidated rock may be filled with cement, sand, gravel or drill cuttings opposite the zones of consolidated rock. The top of the sand, gravel or cutting fill shall be at least five feet below the top of the consolidated rock. The remainder of the well shall be filled with cement grout only.

(H) Test wells less than 20 feet in depth which do not penetrate the water table shall be abandoned in such manner as to prevent the well from being a channel allowing the vertical movement of water or a source of contamination to the groundwater supply. Test wells or borings that penetrate the water table shall be abandoned by completely filling with cement grout.

(b) Any well which acts as a source or channel of contamination shall be repaired or permanently abandoned within 30 days or receipt of notice from the department.

(c) The drilling contractor shall permanently abandon any well in which the casing has not been installed or from which the casing has been removed, prior to removing his equipment from the site.

(d) The owner shall be responsible for permanent abandonment of a well except:

(1) As otherwise specified in these Regulations; or

(2) If well abandonment is required because the driller improperly locates, constructs, or completes the well.

History Note: Statutory Authority G.S. 87-87; 87-88;
Eff. February 1, 1976;
Amended Eff. September 1, 1984; April 20, 1978.

.0114 DATA AND RECORDS REQUIRED

(a) Well Cuttings

(1) Samples of formation cuttings shall be collected and furnished to the department from all wells when such samples are requested by the department.
(2) Samples or representatives cuttings shall be obtained for depth intervals of 10 feet or less beginning at the land surface. Representative cuttings shall also be collected at depths of each significant change in formation.
(3) Samples of cuttings shall be placed in containers furnished by the department and such container.. shall be filled, sealed and properly labeled with indelible-type markers, showing the well owner, well number if applicable, and depth interval the sample represents.
(4) Each set of samples shall be placed in a suitable container(s) showing the location, owner, well number if applicable, driller, depth interval, and date.
(5) Samples shall be retained by the driller until delivery instructions are received from the department or for a period of at least 60 days after the well record form (GW-1), indicating said samples are available, has been received by the department.
(6) The furnishing of samples to any person or agency other than the department shall not constitute compliance with the department's request and shall not relieve the driller of his obligation to the department.

(b) Reports
(1) Any person completing or abandoning any well shall submit a record of the construction or abandonment on forms provided by the department. The record shall include certification that construction or abandonment was completed as required by these Regulations, the owner's name and address, well location, diameter, depth, yield, and any other information the department may reasonably require.
(2) The certified record of completion or abandonment shall be submitted to the department within a period of thirty days after completion or abandonment.

History Note: Statutory Authority G.S. 87-87; 87-88;
Eff. February 1, 1976;
Amended Eff. September 1, 1984; April 20, 1978.

.0115 DIAGRAMS AND FORMS

History Note: Statutory Authority G.S. 87-87;
Eff. February 1, 1976;
Amended Eff. April 20, 1978;
Repealed Eff. September 1, 1984.

.0116 DESIGNATED AREAS: WELLS CASED TO LESS THAN 20 FEET

(a) In some areas the best or only source of potable water supply exists between ten and twenty feet below the surface of the land. In consideration of this, the Director may designate areas of the state where wells may be case to a depth less than twenty feet. To make this determination, the director will find:
(1) that the only or best source of drinking water exists between a depth of ten and twenty feet below the surface of the land;
(2) that utilization of said source of water is in the best interest of the public.

(b) The following areas are so designated:
(1) in Currituck County on Terres Quarter Island and in an area between the sound and a line beginning at the end of SR 1130 near Currituck Sound, thence north to the end of SR 1133, thence north to the end of NC 3 at the intersection with the sound;
(2) on the Outer Banks from the northern corporate limit of Nags Head on Bodie Island, south to Ocracoke Inlet;
(3) all areas lying between the Intercoastal Waterway and the ocean from New River Inlet south to New Topsail Inlet;
(4) all areas lying between the Intercoastal Waterway and the ocean from the Cape Fear River south to the South Carolina line.

(c) In all other areas, the source of water shall be at least 20 feet below land surface, except when adequate quantities of potable water cannot be obtained below a depth of twenty feet, and at sites not

BUILDING PERMIT # B0293995

North Carolina
Department of Natural Resources and Community Development
Division of Environmental Management
P.O. Box 27687 - Raleigh, N.C. 27611

WELL ABANDONMENT RECORD

CONTRACTOR REG. NO.

1. WELL LOCATION: (Show a sketch of the location on back of form.)

Nearest Town: MOORESVILLE County MECKLENBORO

16634 WALLY RD. Quadrangle No.
(Road, Community, Subdivision, Lot No.)

2. OWNER: CHARLES RADER

3. ADDRESS: P.O. BOX 1076 CORNELIOS, N.C. 28031

4. TOPOGRAPHY: draw, slope, hilltop, valley, flat

5. USE OF WELL: UNKNOWN DATE:

6. TOTAL DEPTH: UNKNOWN DIAMETER: 2"

7. CASING REMOVED:

feet	diameter
5'	3"

8. SEALING MATERIAL:

Neat cement
bags of cement ____
gals. of water ____

Sand cement
bags of cement ____
yds. of sand ____
gals. of water ____

Other
Type of material 3000 PSI CONCRETE
Amount 1 YARD


9. EXPLAIN METHOD OF EMPLACEMENT OF MATERIAL

- SLOWLY POURED CONCRETE IN PIPE & POURED 3' DIAMETER SOLID CAP. & 12" THICK

I do hereby certify that this well abandonment record is true and exact.


Signature of Contractor or Agent Date

WELL DIAGRAM: Draw a detailed sketch of the well showing total depth, depth and diameter of screens remaining in the well, gravel interval, intervals of casing perforations, and depths and types of fill materials used.

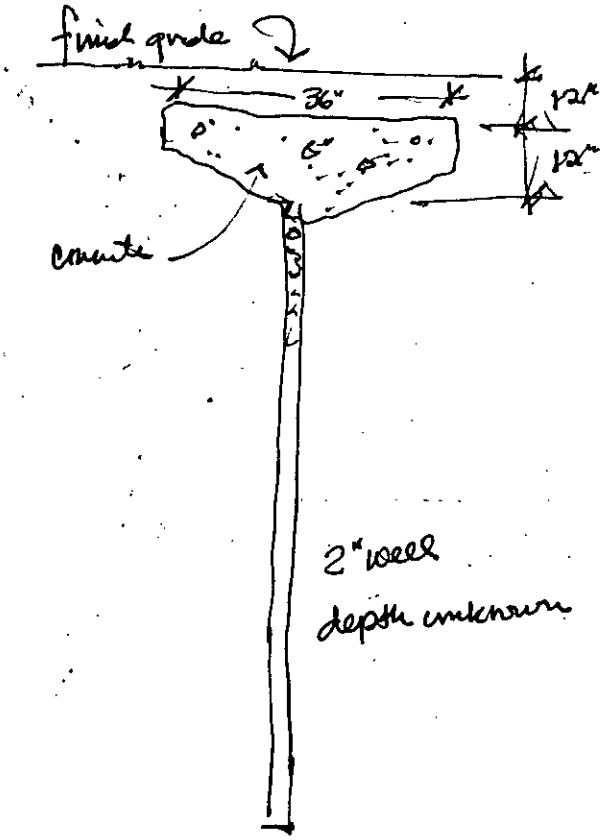

Submit original to the Division of Environmental Management, one copy to the Driller, and one copy to the Owner.

WELL LOCATION: Draw a location sketch showing the direction and distance of the well to at least two (2) nearby reference points such as roads, intersections and streams. Identify roads with State Highway road identification numbers.

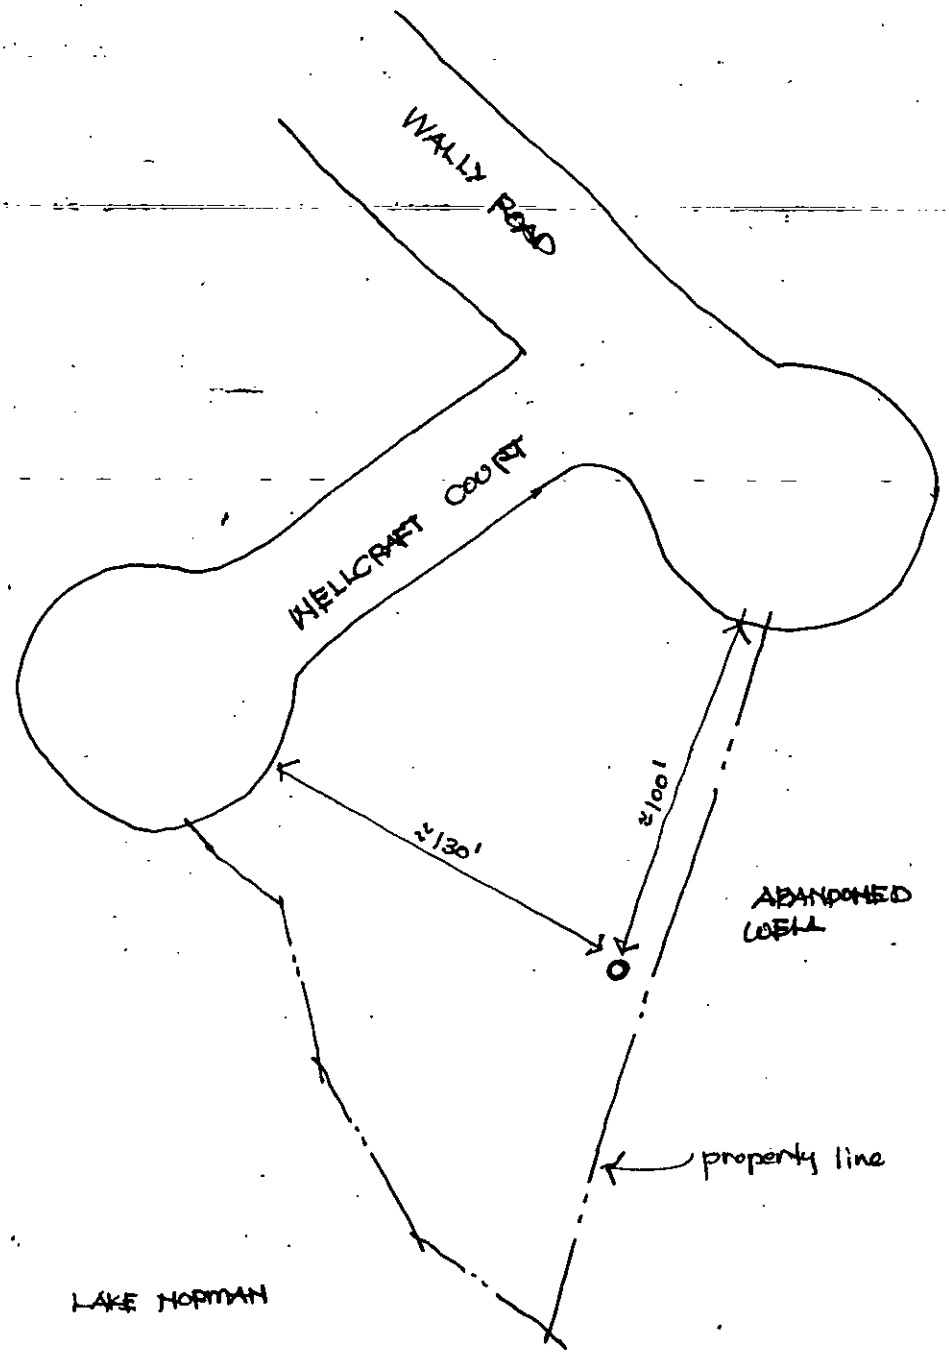


Friday Sept. 15

10 am Peggy Finley, investigate
DEM scheduled to (site visit)
this abandoned well.

9-11-95
Mr. Rader indicated That this form must have been incorrectly filled out by Chris, his builder. And That he is looking for a COC for Power.

Chris Holcombe
875 0173
Builder

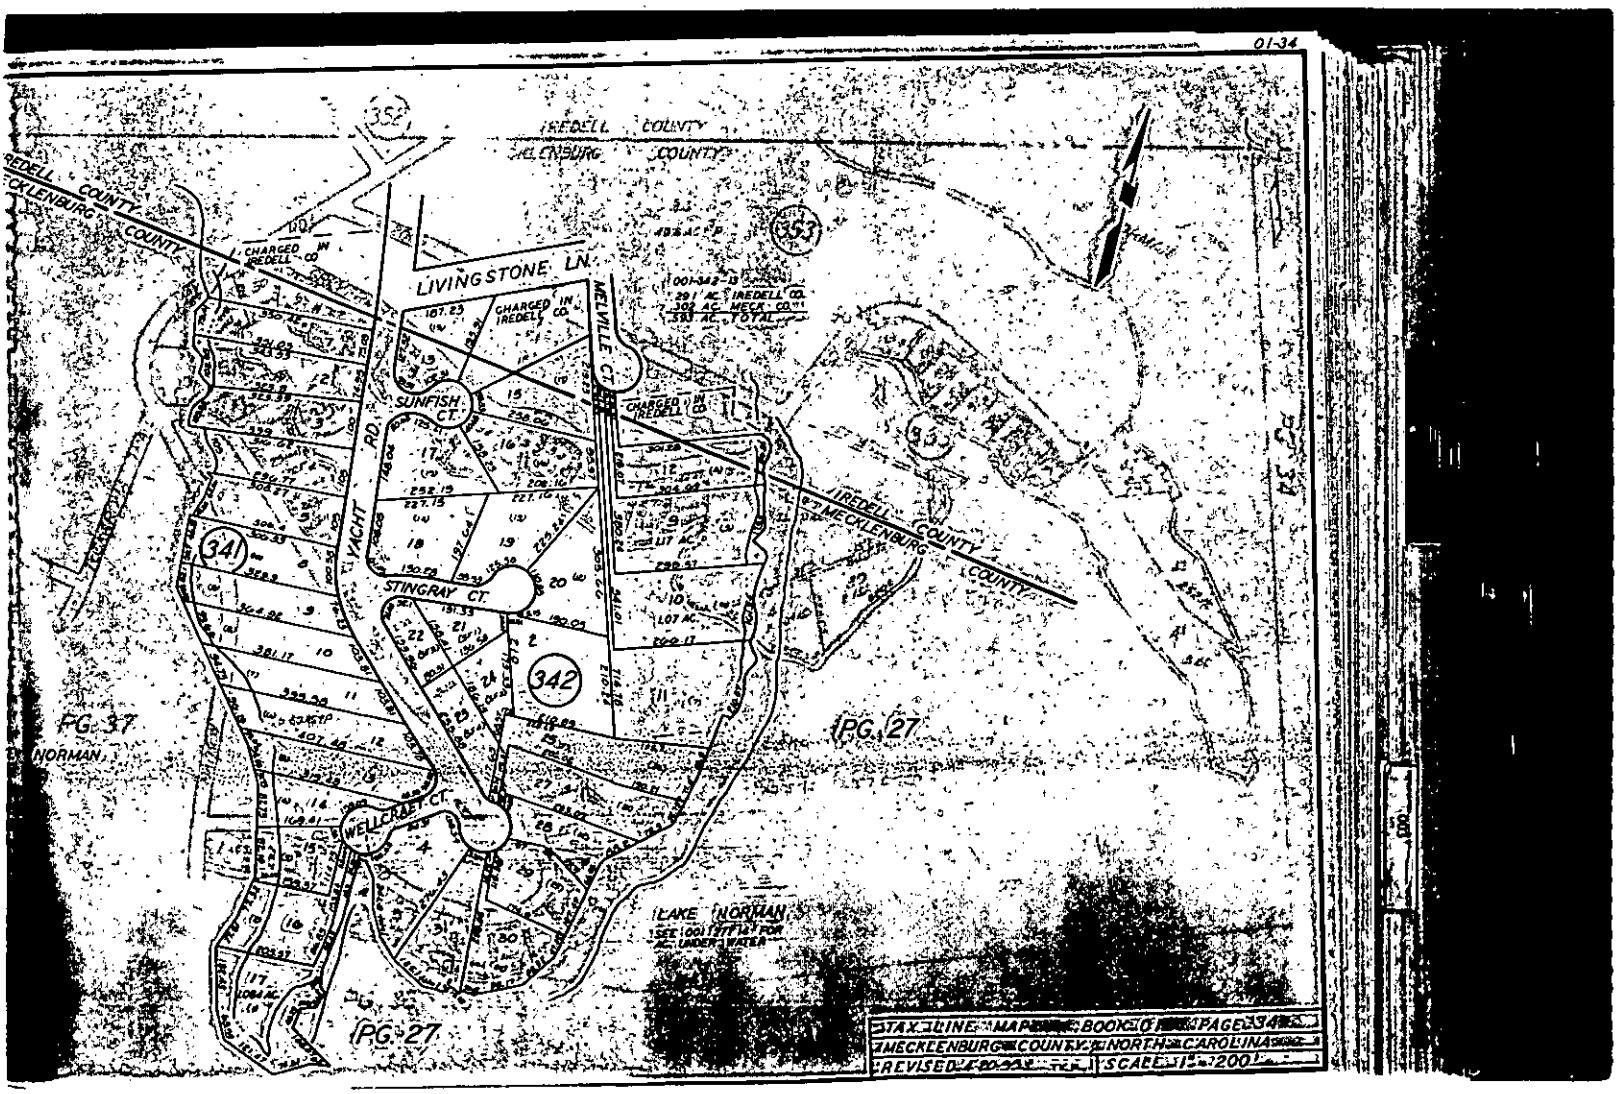


01 - INDEX
PG. 19
RIVER
LAKE
COUNTY
LINCOLN
CATAWBA
LAKE
NORMAN
IREDELL
MECKLENBURG
COUNTY
TWSP.
LEMLEY
CITY
LEMLEY TWP
DAVIDSON
CITY
1100
1182
1101

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 2409A DATE: 11-17-94

TC: 001-342-04 ☐ L

SERIAL Nº 13938

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 9-28-92. All work shall be completed on or before 12-17-94 after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15NCAC 18A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

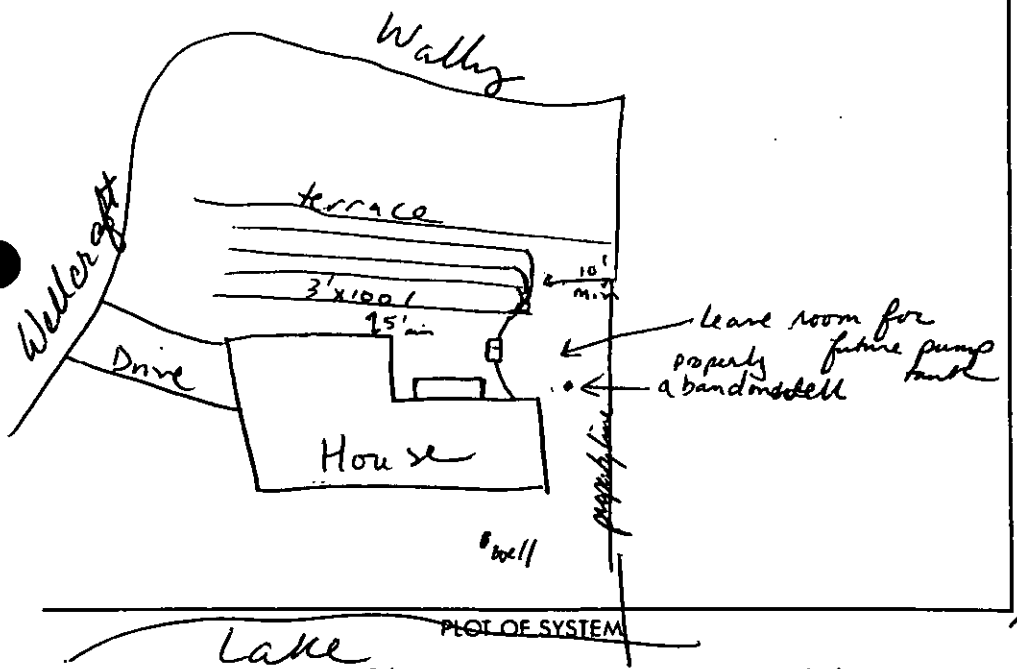

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank _____ gallons

Tank Construction Pcc

Absorption and/or Nitrification Lines:

Trench Width 3' feet

Total Line Length 400' feet

Number of Lines 4 at 100' each

Depth of Stone 12" inches

Distance from House 5' min feet

Distance from Property Line 10' min feet

Distance from Well 50' min feet

* 18"-36" to trench bottom

NAME OF OWNER Charles Rader yacht

LOCATION OF PROPERTY 16634 Wally Rd

Comments: level terrace. Keep tank very shallow. Submit copy of documents concerning proper abandonment of well. 3 bedroom design

R Newell for S Davis 11-17-94
Division or Section Head

Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

LX 40' PL 200' · 9/24/92

File # 2409A

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

LX ghk

57.

☐ CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: Young (last) Jay (first) A. (mi)

ADDRESS: P.O.Box 992 PHONE: (704) 875-8238

CITY: Huntersville STATE: N.C. ZIPCODE: 28078

Date: 9-28-92

PROPERTY OWNER:

NAME: Rader (last) Charles (first) (mi)

ADDRESS: P.O.B. 992 PHONE: (704) 875-8238

CITY: Hunt. STATE: N.C. ZIPCODE: 28078

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 001-342-04PC

STREET ADDRESS: ~~24910 Wetherall Ct.~~ 24910 Wetherall Ct

ZONING: 16634 Wally Rd

SUBDIVISION OR MOBILE HOME PARK NAME: Jacob

Township (check one):
☒ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

LOT NUMBER: A LOT SIZE (in acres): .768 Acres

TYPE APPLICATION (check one):

☐ SOIL TEST - INDIVIDUAL LOT (D)
☒ NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
☐ COMMERCIAL OR INDUSTRIAL (M)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☐ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
☐ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☒ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☐ Shared Well (S)
☐ Municipal (M) ☐ Other 'spring' (O)
☒ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☒ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: [signature] Date: 9-28-92

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

☐ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Phila S. Walker R.S. 11/6/92
Environmentalist Date

[signature]
Director or Authorized Section Head Date

WWATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 2409A

TC: 001-342-04

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

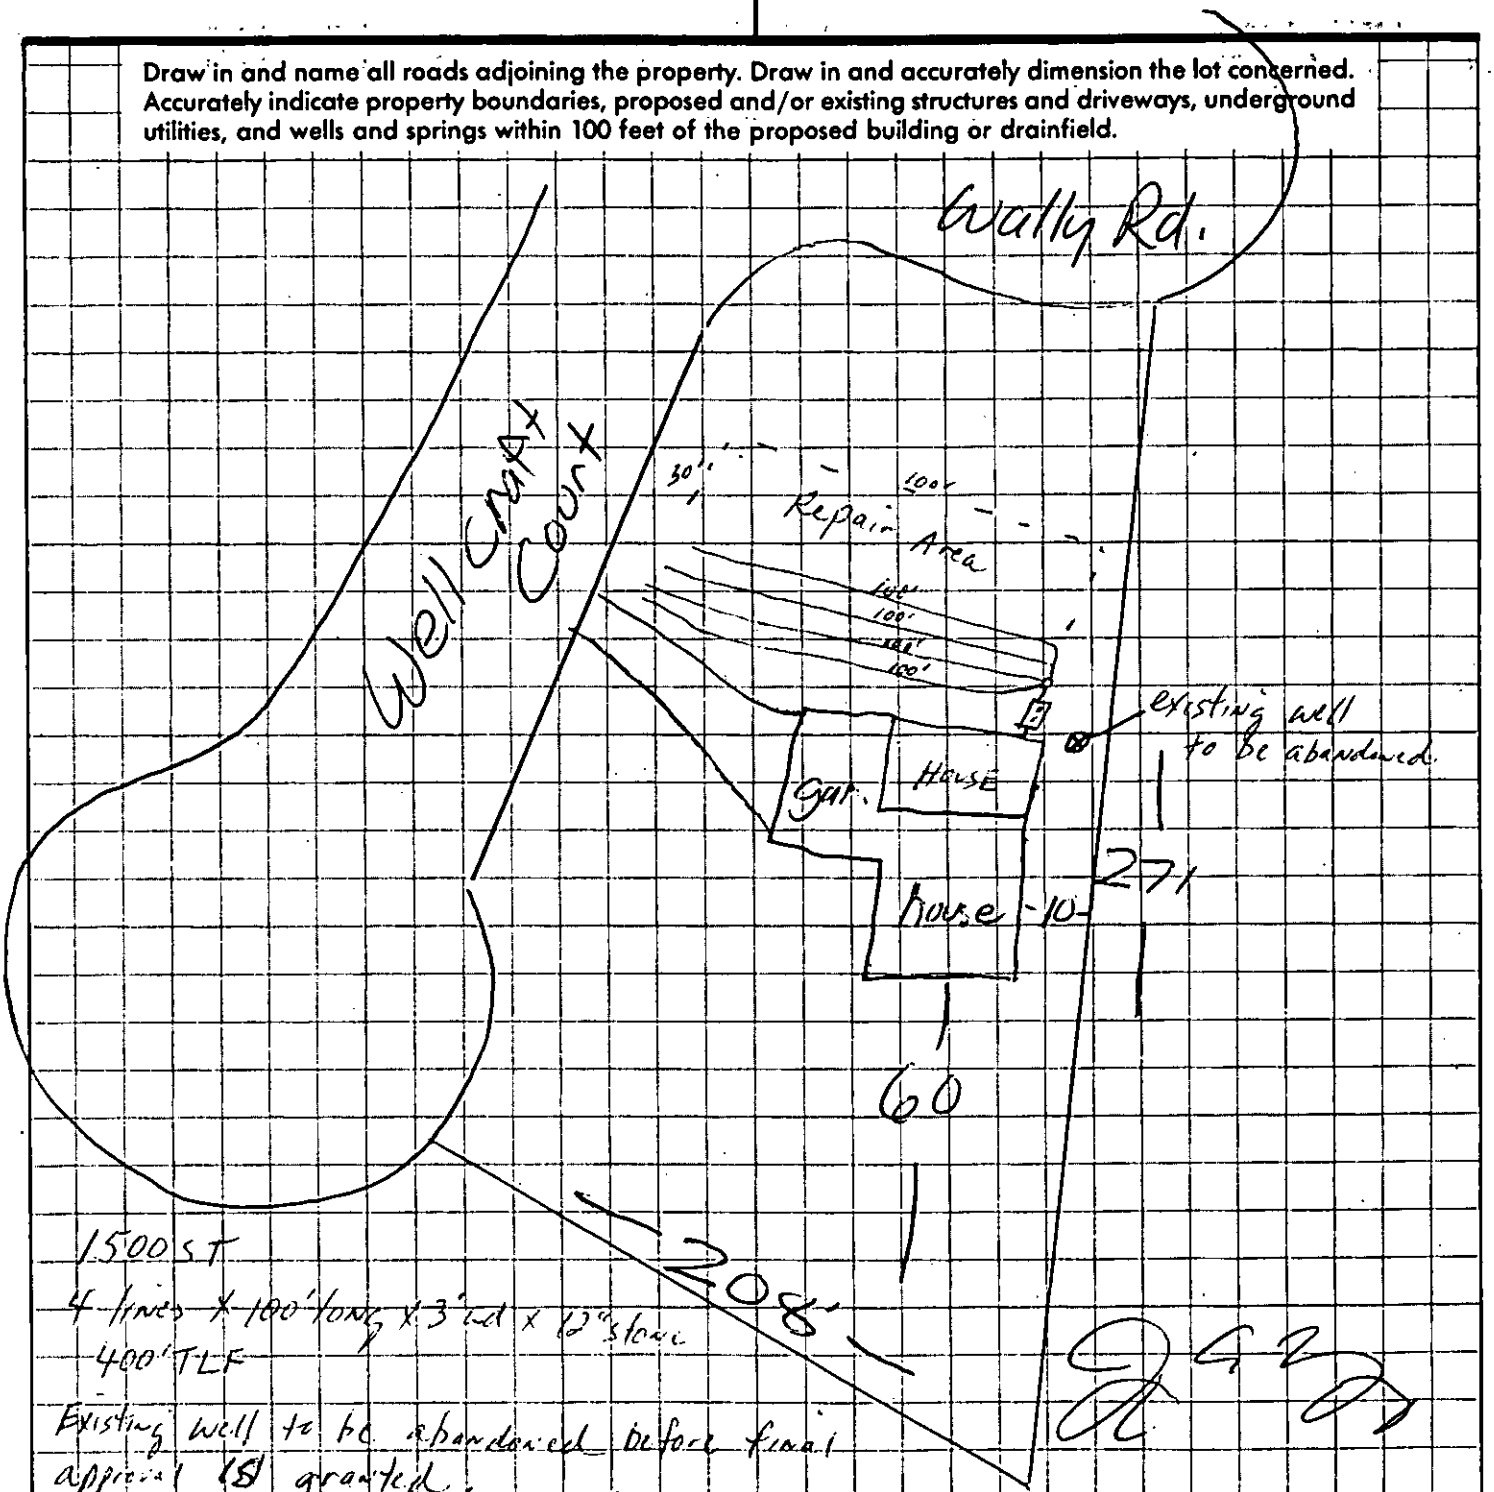

1500 ST
4 lines x 100' long x 3' wd x 12" stone
400' TLF

Existing well to be abandoned before final approval is granted.

Keep proposed well >50 from septic system

APPROVAL DATE PSW app 11/16/92

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH File: 2409A Action 4
SITE EVALUATION REPORT
SERIAL NUMBER 13109 Parcel: 001-342-04 PO ☐ PC

Location: Williams Road

Subdivision:


Lot: A Block: Acres: Approx. .42


Owner: Rebecca H. Huffman
Address: P. O. Box 1076
Cornelius, N. C. 28031

Comments: _____

Described by: William B. Mullin

Date: 10-8-86

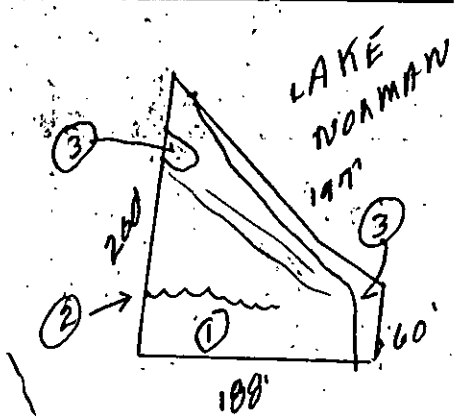

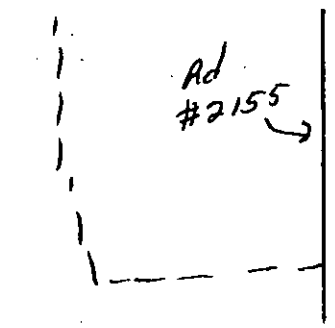

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	(S) PS U 2-8%	S PS (U) old Terrace	S PS U —	S PS U	S PS U	S PS U
Texture	S (PS) U clay	S PS U —	S PS U —	S PS U	S PS U	S PS U
Structure	S (PS) U Blocky	S PS U —	S PS U —	S PS U	S PS U	S PS U
Drainage	(S) PS U 48"+ to water	S PS (U) may channel run off	S PS (U) Depression	S PS U	S PS U	S PS U
Depth	(S) PS U 48"+	S PS U —	S PS U —	S PS U	S PS U	S PS U
Restrictive Horizons	(S) PS U 740"	S PS U —	S PS U —	S PS U	S PS U	S PS U
Available Space	S (PS) U very limited	S PS U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	IVA Cecil-like	old Terrace	Depression			
Area Classification	S (PS) U	S PS (U)	S PS (U)	S PS U	S PS U	S PS U