

13918 JONATHAN`S RIDGE RD

19519110

6/13/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 6240A DATE: 3/22/06

TC: 195/9110 ☐ L ☑ CRT

SERIAL 19955

Name of Owner Kati Homes INC Juris.: _____

Address of Property 13918 Jonathans Ridge Rd

Inspection Data:

Tank Material PCC

Total Length of Drainfield 370'

Number of Lines 4 @ See permit

Cover Depth 10"

Water Supply Source Well


Distance to Water Source >100'

Excavation Inspected 3/22/06

Tank(s) Inspected 3/22/06

Wash Line Inspected plumb to tank

High Water Alarm Inspected 3/22/06

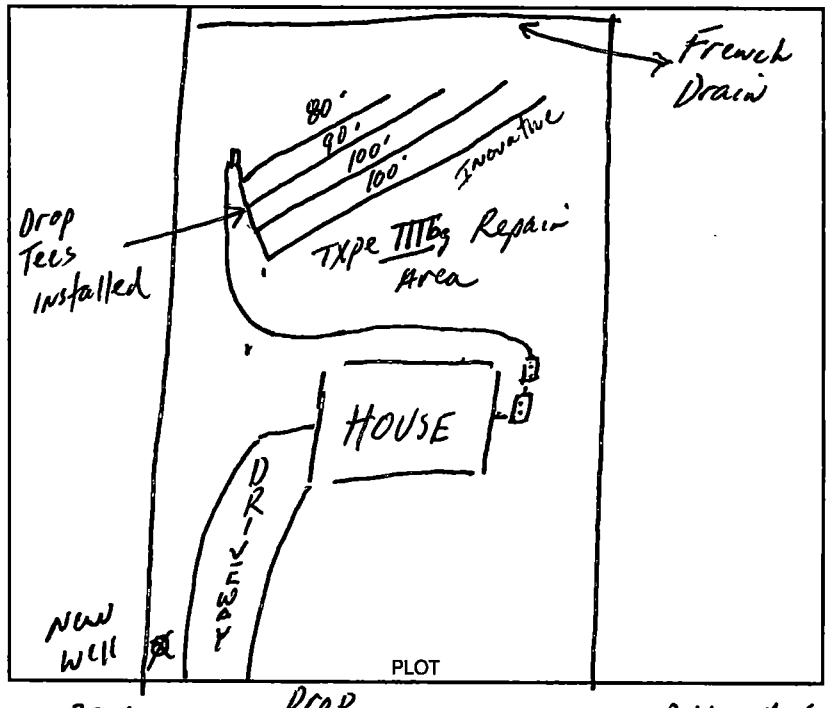

Design 2006, 1500ST, 1000DT, PI, INO, 370'EZ Flow, Drop Tees CTR# Bobby McCarver

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☐ in accordance with the permit issued ☒ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Septic System Designed for a 3 bedroom Residence Type IIIBg

Philip L Walker RS
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5103

FILE: 6240A DATE: 3/14/06

TC: 195 191 10 ☐ L

SERIAL Nº 20220

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 2/29/05. All work shall be completed on or before 4/14/06, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly. Install French Drain last up.

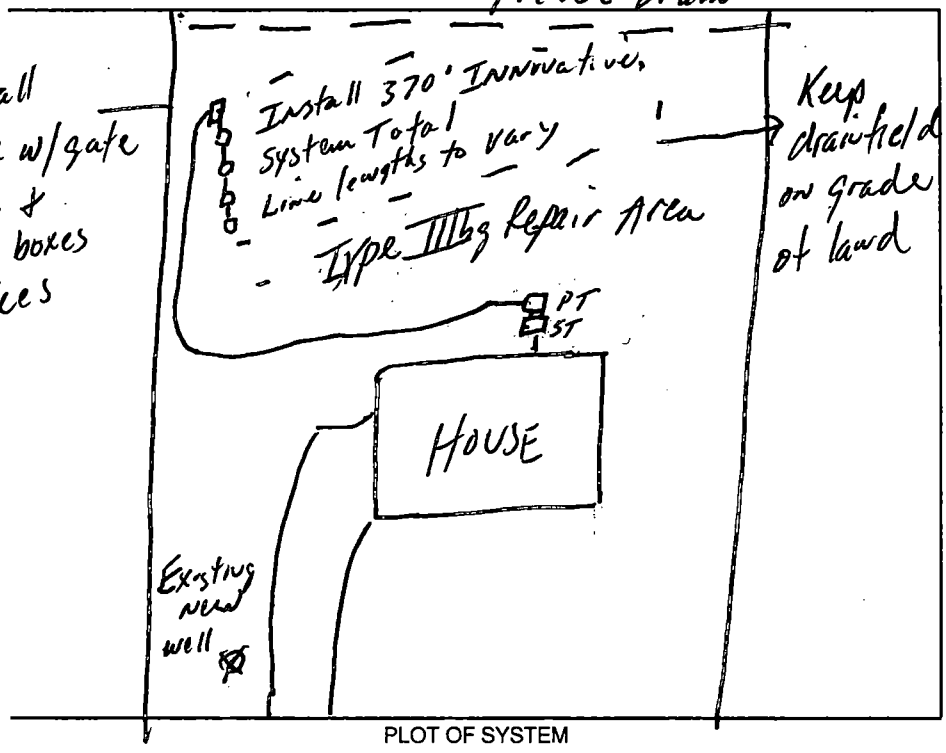

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank 1000 gallons

Tank Construction PCC

Trench Depth 24"

Absorption and/or Nitrification Lines:

Trench Width 3' feet

Trench Walls Scored and Porous yes

Total Line Length 370' feet

Number of Lines Line lengths vary

Depth of Stone NA inches

Distance from House 5' feet

Distance from Property Line 10' feet

Distance from Well >100' feet
50' min

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Kati Homes INC

LOCATION OF PROPERTY 13918 Jonathans Ridge Rd

Comments: Innovative septic System, 1500ST, 1000 PT, Drop box or tees distribution. Install 370' of Drainfield / Install french drain appr 6' deep above system

Thelo A. Walker RS
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

FEE: 300.00

DATE: 4/28/2006

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY

GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 6240A

PERMIT NUMBER: 30000708

PARCEL NUMBER: 19519110

JOB LOCATION INFORMATION

ADDRESS: 13918 JONATHAN`S RIDGE RD

CITY: CHARLOTTE **STATE: NC** **ZIP:** 28227

ISSUED TO: Kati Homes Inc.

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 4/28/2006

CONSTRUCTION AUTHORIZATION CONDITIONS

1. **WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30000708, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.**

2. **AN INSTALLATION APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.**

3. **ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.**

4. **THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, NOT TO EXCEED 60 MONTHS.**
   ***CONSTRUCTION AUTHORIZATION EXPIRATION DATE: 12/21/2010**

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30000708** GWS File #: **6240A** Tax Parcel #: **195-191-10**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 12/21/2010

Type of Installation: Residential - New System Lot Number: 10

Structure Type: HOUSE Size (ft^2): 2914 # Bedrooms: 3 # Occupants: 2

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Pump to Innovative or Experimental **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1080	Total Trench Length (ft):	360
Maximum Trench Depth (in):	28	Depth of Media (in):	12	Distribution Device:	Drop Tees		

III. Repair System Type: Pump to Innovative or Experimental **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1080	Total Trench Length (ft):	360
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Drop Tees		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Philo Walker

Signature: Philo J Walker

Date Issued: 12/21/2005

Owner/Legal Agent: _____
Print Name

Signature: _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30000708** GWS File #: **6240A**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 3 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- This type of septic systems requires a Certified Operator to maintain the system. A system maintenance contract with a Certified Operator must be on file prior to issuance of an Operation Permit.
- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Philo Walker

Signature: Phil Walker ES

Date Issued: 12/21/2005

Owner/Legal Agent: _____
Print Name

Signature: _____

CK# 1446 V.W.

FEE: $300.00

DATE: 9/29/05

AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION

VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE

ACS

LD ~~14718~~ 16353

PERMIT NUMBER: 6240A
PARCEL NUMBER: 195-191-10

JOB LOCATION ADDRESS: 13918 Jonathan's Ridge
PROPERTY OWNER: ____
BUILDING CONTRACTOR: Kati Homes
SUBDIVISION NAME: Jonathan's Landing, Lot 10
AUTHORIZATION ISSUED BY: J. Andrew Walker DATE: 09/02/05

DENR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 6240A, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH THE MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: Install French drain and surface diversion above the drainfield
Install 6 inches of soil cover over the drainfield after installation

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITSAND AUTHORIZATION TO CONSTRUCT.

SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE

DATE

CONDITIONS OF IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATON

Permit Number: 6240A Tax Number: 195-191-10

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☐ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

.25 Long-term acceptance rate (GPD/ft^2)	360 Max gallons/day wastewater flow	1440 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☒ Yes ☐ No	1500 Gallon septic tank	370 Total trench length (ft)	24 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
3 Bedrooms in residence	1000 Gallon pump tank	na Depth of stone (in)	

Any surface water present: Type: Minimum separation distance (ft):

Additional conditions: **(1) Utilize drop boxes for serial distribution**
(2) Install french drain and surface diversion above drainfield
(3) Install 6 inches of additional soil cover over drainfield.

Repair Area System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

1440 Absorption Area (ft^2) 370 Total trench length (ft)	na Depth of stone (in)	9 Trench spacing (min. on centers) (ft)	24 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.

*** This Improvement permit is transferable.

9/6/05
DENR Authorized Agent Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

9/27/05
Owner/Agent Signature Date

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

COPY

FILE COPY

FILED FOR REGISTRATION	DOC. # 184326
DATE 9-20-05	TIME 11:21
BOOK 19761	PAGE 756
STAMPS	REC FEE 20.00

JUDITH A. GIBSON, REGISTER OF DEEDS
MECKLENBURG COUNTY, NC

STATE OF NORTH CAROLINA

COUNTY OF MECKLENBURG

WASTEWATER TREATMENT AND DISPOSAL SYSTEM DESIGN AGREEMENT: 15A NCAC 18A .1948 AND ANY OF THE FOLLOWING RULES: .1956; .1957(a); .1957(b); or .1957(c); OR .1969

FILE # 6240-A
PARCEL # 195-191-10

The undersigned, Kuhl Homes, Inc, owner of property located at 13911 Jonathans Ridge Rd Mint Hill NC (the "site") and described in an instrument recorded in Book 25 at Page 332, Mecklenburg Public Registry, hereby acknowledges that the undersigned applied to the Mecklenburg County Health Department (the "Department") for a permit to install a septic tank sewage disposal system on the site; that the Department evaluated the site for suitability for such a system in accordance with the regulations promulgated by the North Carolina Commission for Health Services as 15A NCAC 18A .1900 et seq.; that the Department originally classified the site as "unsuitable" pursuant to the standards set forth in the regulations; that the undersigned requested that the Department reclassify the site as "provisionally suitable" in light of the particular septic tank system proposed by the undersigned; that the Department considered various studies, data, and other information which indicate to the Department that the septic tank system proposed by the undersigned is allowed by the rules; and that the Department therefore reclassified the site as "provisionally suitable" and issued an appropriate permit for such proposed septic tank system.

The undersigned further acknowledges that the proper design, construction, operation and maintenance of such septic tank system is the responsibility of the designer, owner, developer, installer, or user of the system, as applicable, and that neither the Department nor its officials, employees, or agents warrant or guarantee that the said system installed pursuant to the permit issued by the Department will function in a satisfactory manner for any given period of time or that the Department, its officials, employees or agents assume any liability for any damages of any kind which are caused, or which may be caused, by a malfunction of such system.

The undersigned further acknowledges that the following conditions will apply to the site:

This instrument was prepared by: Francis M Townsend
Mail after recording to: _____

-- Any changes on the property may make the Improvement Permit null and void and may make the Improvement Permit subject to revocation.

-- Do not grade, cut, fill, pave, construct a building or deck, dig a well, install a swimming pool or otherwise cover or disturb the soil (except for planting and maintaining grass or other ground covers) in a manner which will adversely affect the repair area or area where the septic tank system is located.

-- When a private certified operator is required, no improvement permit for the designated repair shall be issued unless there is a private certified operator to carry out this management program in the service area where the proposed system is to be located. (Refer to Rule .1961, "Maintenance of Sewage Systems," for further information.)

-- Additional fees will be required according to the Mecklenburg County user fee schedule applicable at the time for the issuance of a repair permit for any subsequent repairs to the sewage treatment and disposal system or for installation of a replacement system.

-- At the time repairs to the sewage treatment and disposal system are to be made or a replacement system installed, the regulations in effect at that time will govern the repairs or installation of a replacement system.

The undersigned further agrees for himself, his heirs and assigns that he shall indemnify and hold harmless theDepartment, its employees, and officials, as well as Mecklenburg County and its employees and officials, for any damages or other claims of any person or persons whatsoever arising out of the installation, operation, or failure of said septic tank system.

Use of the singular masculine pronoun forms herein shall be deemed to also include the plural and feminine forms as the context may require.

This document shall be placed on the public records of the Register of Deeds of Mecklenburg County and indexed therein under the Grantor Index in the name or names of the undersigned, and the foregoing acknowledgements shall henceforth be binding on all persons claiming any right, title, or interest in the site.

IN WITNESS WHEREOF, the undersigned has hereunto set his hand and seal, or if corporate, has caused this instrument to be signed in its corporate name by its duly authorized officers and its seal to be hereunto affixed by authority of its Board of Directors, this ____ day of _____, 20____.

Kali Homes, Inc (SEAL)
(Corporate Name)

(SEAL)

By: [signature] (SEAL)

President (SEAL)

ATTEST:

_____

_____ Secretary

(Corporate Seal)

STATE OF NORTH CAROLINA
COUNTY OF _____

I, _____, a Notary Public for said County and State, do hereby certify that _____ personally appeared before me this date and acknowledged the due execution of the foregoing instrument.

WITNESS my hand and notarial seal, this _____ day of _____, 20____.

_____
Notary Public

My Commission Expires:

_____

STATE OF NORTH CAROLINA
COUNTY OF Mecklenburg

I, the undersigned, a Notary Public for said County and State, do hereby certify that Francis M. Tivnan, Jr. personally came before me this day and acknowledged that he is President ~~Secretary~~ of Kati Homes, Inc., a North Carolina corporation, and that by authority duly given and as the act and deed of said corporation, the foregoing instrument was signed in its name by its President, sealed with its corporate seal, and attested by Francis M. Tivnan, Jr. as its ~~Secretary~~.

WITNESS my hand and notarial seal, this 19th day of September, 2005.

_____
Notary Public

My Commission Expires:

_____

GARY L. LOFLIN
NOTARY
My Comm. Exp.
July 21, 2009
PUBLIC
MECKLENBURG CO., N.C.

REVISED 8-15-02

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 09/29/05
Receipt #: 37256
Check / Auth #: CHECK 1449
Received By: WALKEVA

Amount: 150.00
Tendered: 150.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: KT HOMES, INC.
Attn:
Address: 9307-O MONROE ROAD
Address:
City/State/Zip: CHARLOTTE, NC 28270

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Auth for Waste Wtr Sys Constr 13918 JONATHAN'S RIDGE ROAD		1	150.00	150.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 09/29/05
Receipt #: 37255
Check / Auth #: CHECK 1449
Received By: WALKEVA

Amount: 150.00
Tendered: 150.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: KT HOMES, INC.
Attn:
Address: 9307-O MONROE ROAD
Address:
City/State/Zip: CHARLOTTE, NC 28270

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Installation/Final Approval 13918 JOHNATHAN'S RIDGE ROAD		1	150.00	150.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

GWS – RES. APP 07/05

SEPTIC FEE: 200.00 CHK # 1249
DATE: 8/1/05
CRT [ ]

PERMIT APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATION FOR ON-SITE WASTEWATER SYSTEM NEW WELL INSTALLATION OR REPAIR OF EXISTING WELL MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES

WELL FEE: _____
DATE: _____
CRT [ ]

FILE # 6240A

SEPTIC / TYPE APPLICATION: ☐ NONE ☑ NEW SYSTEM ☐ ALTERATION ☐ REPAIR ☐ MODIFY PLOT PLAN

WELL / TYPE APPLICATION: ☐ NONE ☑ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

JOB LOCATION INFORMATION:

TAX/PARCEL #: 195-191-10
STREET ADDRESS: 13918 JONATHAN'S RIDGE RD
CITY:
STATE: NC ZIP:
SUBDIVISION OR MOBILE HOME PARK NAME: JONATHAN'S LANDING
LOT #: 10
TOWNSHIP:

☑ 0-MECKLENBURG ☐ 4-PINEVILLE
☐ 1-CHARLOTTE ☐ 5-MATTHEWS
☐ 2-DAVIDSON ☐ 6-HUNTERSVILLE
☐ 3-CORNELIUS ☑ 7-MINT HILL

BUILDING INFORMATION:

TYPE OF BUILDING:

☐ SINGLE MOBILE HOME (S) ☐ MODULAR HOME (M)
☐ DOUBLE WIDE (D) ☐ MULTIPLE FAMILY (U)
☑ HOUSE (H) ☐ OTHER

HEATED SQUARE FOOTAGE: 2914
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS:

FOUNDATION FOR RESIDENCE:

☐ CONCRETE SLAB ☐ BASEMENT WITH PLUMBING
☑ CRAWLSPACE ☐ BASEMENT WITH NO PLUMBING

IF PLANNING TO EXPAND/ALTER THE EXISTING SYSTEM INDICATE THE FOLLOWING CHANGES:

NUMBER OF BEDROOMS TO BE ADDED: NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE:
WILL THERE BE A HOME BUSINESS IN THE RESIDENCE? ☐ YES ☑ NO TYPE:

WATER SUPPLY:

☐ MUNICIPAL (M) ☐ PUBLIC (C) ☑ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☑ POTABLE ☐ GEOTHERMAL ☐ OTHER

ARE ANY OF THE FOLLOWING LOCATED ON THE PROPERTY? IF SO, PLEASE SHOW LOCATION ON SITE PLAN/PLAT.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES	☑ NO	WELLS, SPRINGS, OR WATER LINES	☐ YES	☑ NO
EXISTING WASTEWATER SYSTEMS	☐ YES	☑ NO	DESIGNATED WETLANDS	☐ YES	☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☐ YES	☑ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES	☑ NO

PROPERTY OWNER:

NAME: Kati Homes Inc
ADDRESS: 9307-0 MONROE RD
CITY: CHARLOTTE
STATE: NC ZIP: 28270
HOME PHONE: 704-847-9434 WORK PHONE: 704-847-9434
MOBILE PHONE: 704-361-7148 FAX: 704-847-9463

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 9-14-89
WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? 8-19-05

*An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Francis M. Vivian 7/29/05
Owner's/Agent's Signature Date

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENT & NATURAL RESOURCES DIVISION
OF ENVIRONMENTAL HEALTH ON-SITE
WASTEWATER SECTION

*A Well Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Francis M Vivian 7/29/05
Owner's/Agent's Signature Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202 704-336-5103 / FAX: 704-336-6894

PROPOSED FLOOR PLAN


COPY

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5100

FILE: 6240A

TC: 195-191-10

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

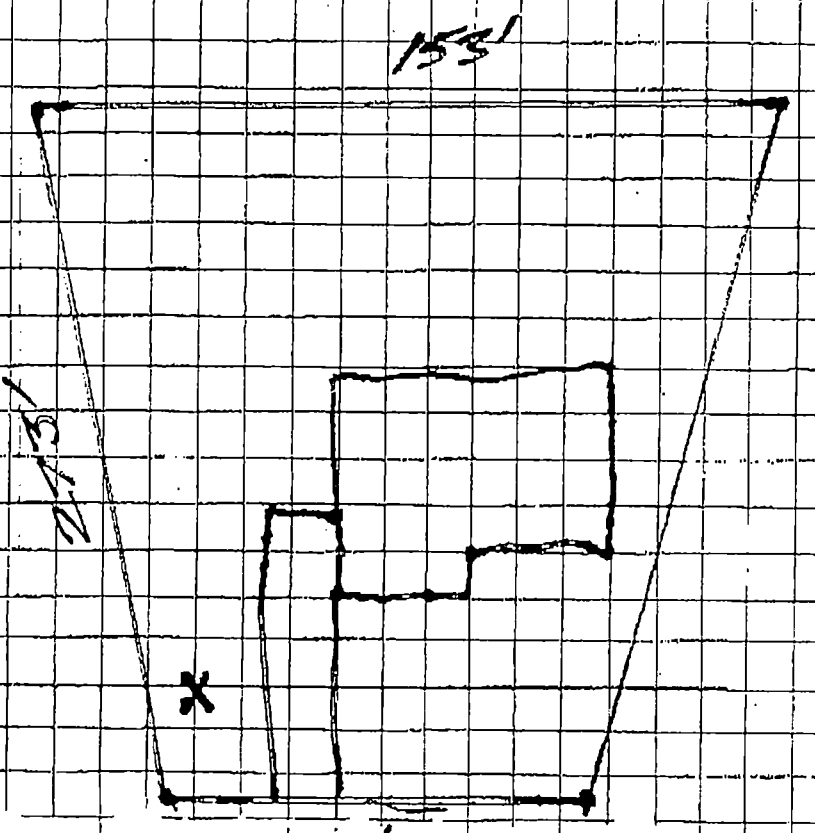

APPROVAL DATE _____

OWNER/AGENT SIGNATURE

DATE

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy
TOTAL P.03

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID # 195-191-10
Lot #: 10
File #: 6240A
Code: 1

ACS

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Kati Homes, Inc.
Applicant:
Address: 9307-O Monroe Road, Chjarlotte, N. C. 28270
Date Evaluated: 8/9/2005
Proposed Facility: Residence Design Flow (.1949): 360gpd
Property Size: .77a
Location of Site: 13918 Jonathan's Ridge Road
Property Recorded:
Water Supply: [ ] Public [x] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 10	0-10	GR/CL	FR/SEXP/SS/SP	>42" TO SOIL WETNESS	42	N/A	NONE	PS, IV .25GPD/FT^2
		10-42	SBK/C	FI/SEXP/S/P					
2	"	0-3	GR/CL	FR/SEXP/SS/SP	>37" TO SOIL WETNESS	37	"	"	"
		3-12	SBK/CL	"					
		12-37	SBK/C	FI/SEXP/S/P					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)		
Site LTAR	.25GPD/FT^2	.25GPD/FT^2


Other Factors (.1946):
Site Classification (.1948): PROVISIONALLY SUITABLE
Evaluated By: W. R. Marlin, LSS, 8/12/2005, W. R. Marlin
Others Present:

COMMENTS:
100% repair, will probably need pump


Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Food Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

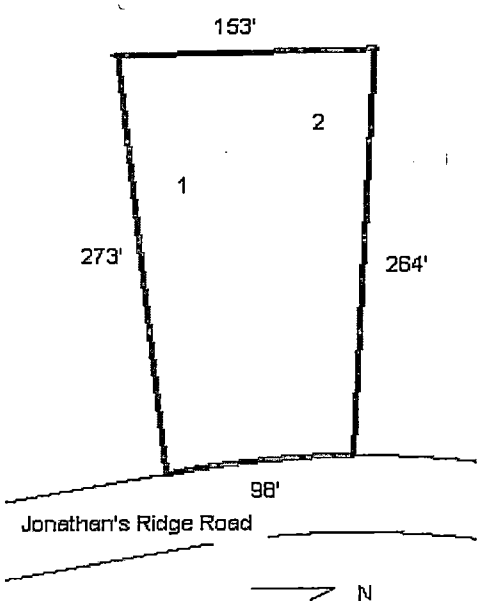

File # 6240A

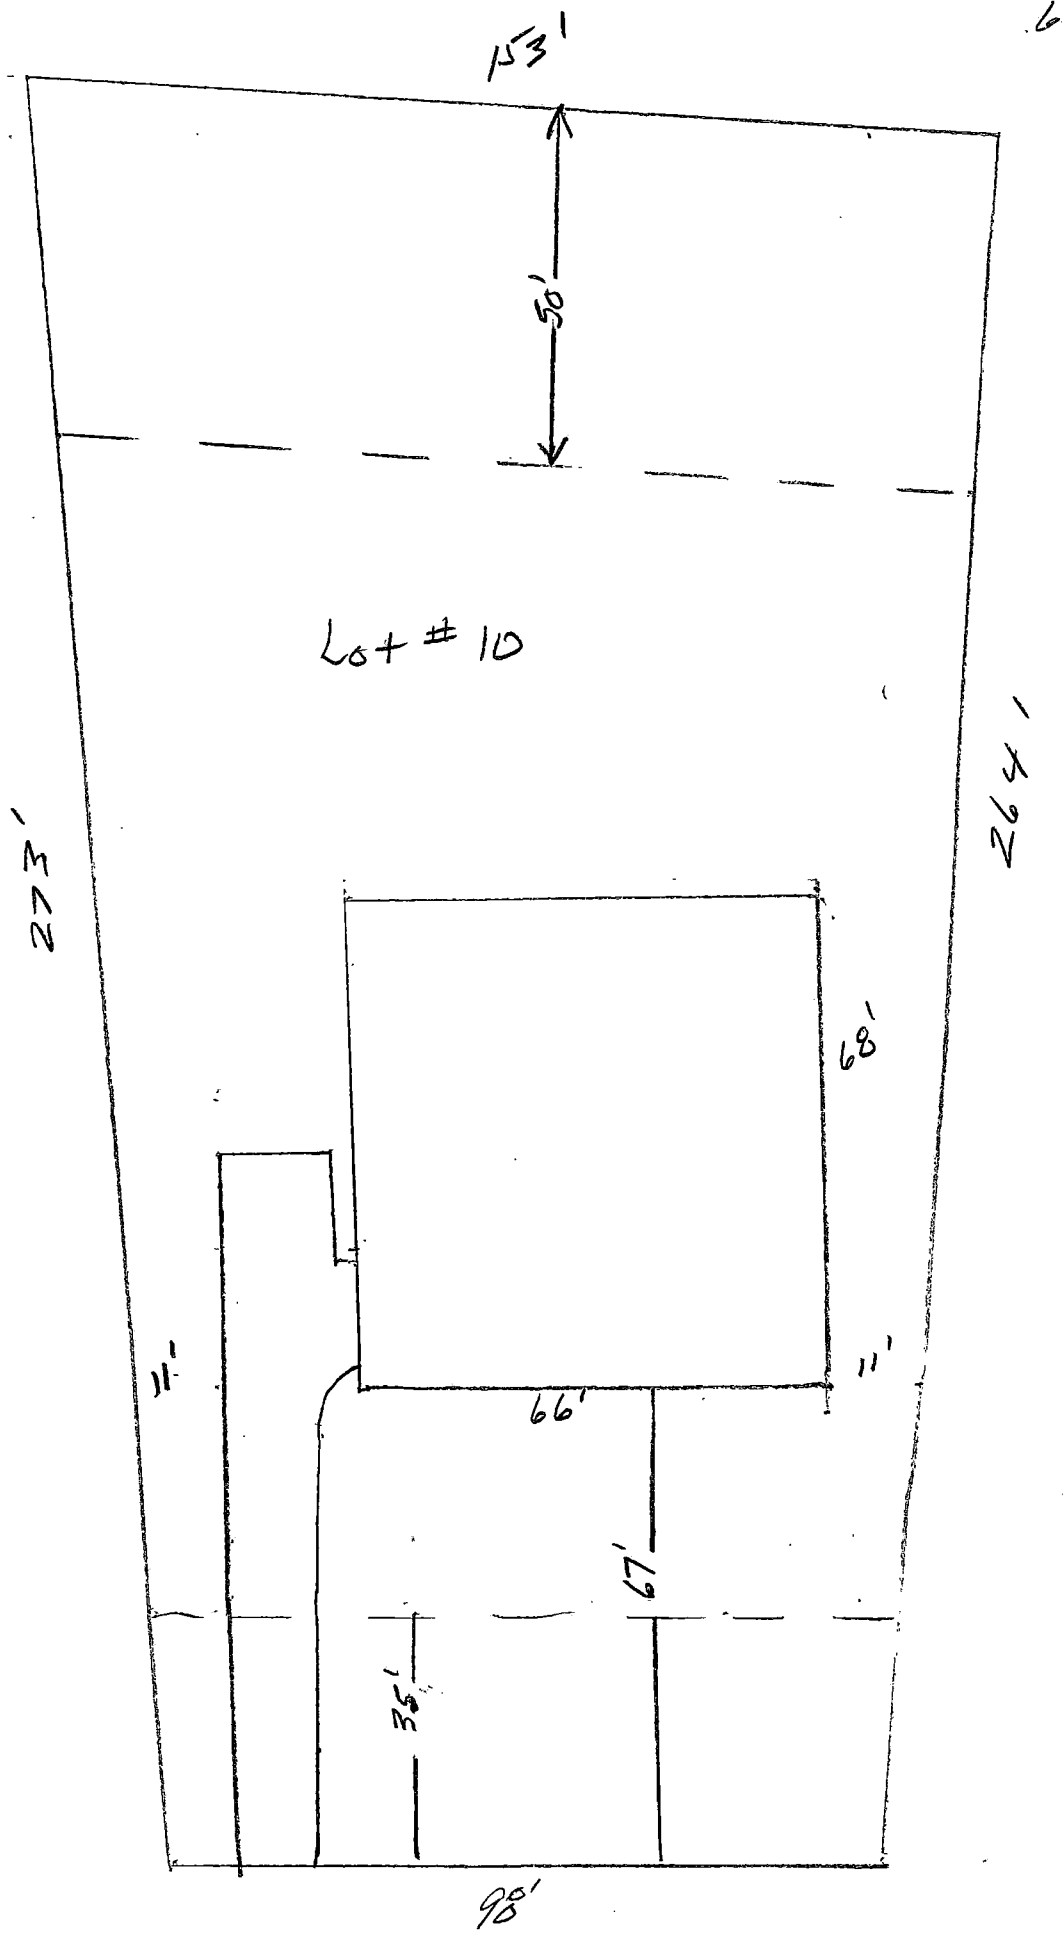

13918 JONATHANS RIDGE RD.

MECKLENBURG COUNTY HEALTH DEPARTMENT
SITE EVALUATION REPORT
SERIAL NUMBER 16546

File: 6240A Action 1

Parcel: ☐ PC

Location: Jonathan's Ridge Rd.

Subdivision:


Lot: 10 Block: Acres: .77

Owner: Jonathan's Landing Development
Address: 2300 Two First Union Center
Charlotte, NC 28282

Comments: 100% Repair
May need pump

Described by: William A. Mueller

Date: 7-25-90

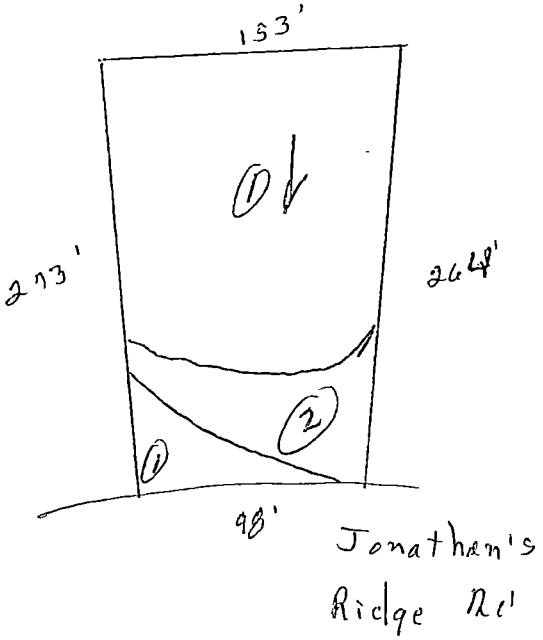

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	(S) PS U 6-12%	S PS (U) Drainageway Depression	S PS U	S PS U	S PS U	S PS U
Texture	S (PS) U Clay	S PS U —	S PS U	S PS U	S PS U	S PS U
Structure	S (PS) U Blocky	S PS U —	S PS U	S PS U	S PS U	S PS U
Drainage	S (PS) U 30 736" water	S PS U —	S PS U	S PS U	S PS U	S PS U
Depth	S (PS) U 36"+	S PS U —	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	S (PS) U 736"	S PS U —	S PS U	S PS U	S PS U	S PS U
Available Space	S (PS) U limited	S PS U —	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	III Cecil-Urban	Drainageway Depression				
Area Classification	S (PS) U	S PS (U)	S PS U	S PS U	S PS U	S PS U

Mecklenburg County
Health Department

July 26th, 1990

Jonathan's Landing Development
2300 Two First Union Center
Charlotte, NC 28282

RE: Property located at Jonathan's Ridge Rd.
FILE: 6240A
PARCEL: 19510103,04,05

Dear Sir:

At your request, a field investigation was conducted on the property designated above for the purpose of determining site suitability for the installation of a ground absorption sewage disposal system. The property was found to contain a limited area of soils which were classified as PROVISIONALLY SUITABLE for such an installation. A copy of the Site Evaluation Report (Serial Number) is enclosed for your information.

Should you desire to file for permission to install a ground absorption sewage disposal system, please submit an Application For An Improvement Permit with an ACCURATELY dimensioned plot plan detailing the location of current and/or proposed buildings, wells and sewage disposal systems to this office. The plan will be reviewed and if it is found that the area of provisionally suitable soils is adequate for the proposed construction, an Improvement Permit will be issued by this Department.

If I may be of assistance, please do not hesitate to contact me.

Very truly yours,

Gene Vaughan, R.S., Supervisor
On Premises Waste Disposal & Water Supply

Enclosure

Environmental Health Division
1200 Blythe Boulevard • Charlotte, North Carolina 28203 • (704) 376-4603

APPLICATION FOR SOIL INVESTIGATION

See #6231A 10

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

(OFFICE USE ONLY)

FILE: 6240A

TC: _____

☐ PC ☐ REPT

JOB LOCATION

① ADDRESS: 13918 Jonathan's Ridge Road

② SUBDIVISION: Jonathan's Landing ③ LOT: 10 ④ BLOCK: _____

⑤ PARCEL REFERENCE: BOOK NO.: PO 195 PAGE NO.: 101 PARCEL NO.: 03, 04 & 05

⑥ DEED REFERENCE: BOOK NO.: DB 6001 PAGE NO.: 348

OWNER


⑦ NAME: Jonathan's Landing Development, a North Carolina General Partnership
(FIRST) (MIDDLE) (LAST)

⑧ MAILING ADDRESS: 2300 Two First Union Center

⑨ CITY: Charlotte ⑩ STATE: N. C. ⑪ ZIP: 28282

⑫ PHONE: (WORK) 704-372-4884 (HOME) 704-366-9509

⑬ Accurately diagram and dimension lot.

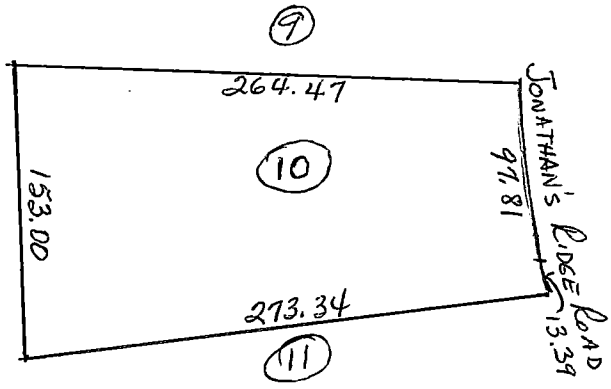

⑭ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: _____
H. PARKS HELMS, General Partner

Date: 10/16/89

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER'S COPY