

3918 VOYAGER RD

1/29/08

thomatc

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

SEE INSTRUCTIONS ON BACK

Date Received 2-17-84

MECK COUNTY DEPARTMENT OF RECEIVED FEB 17 '84 ENVIRONMENTAL HEALTH

ICAR(S) Application No. 20622

T. C. No. 113-172-0905


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) _____ Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

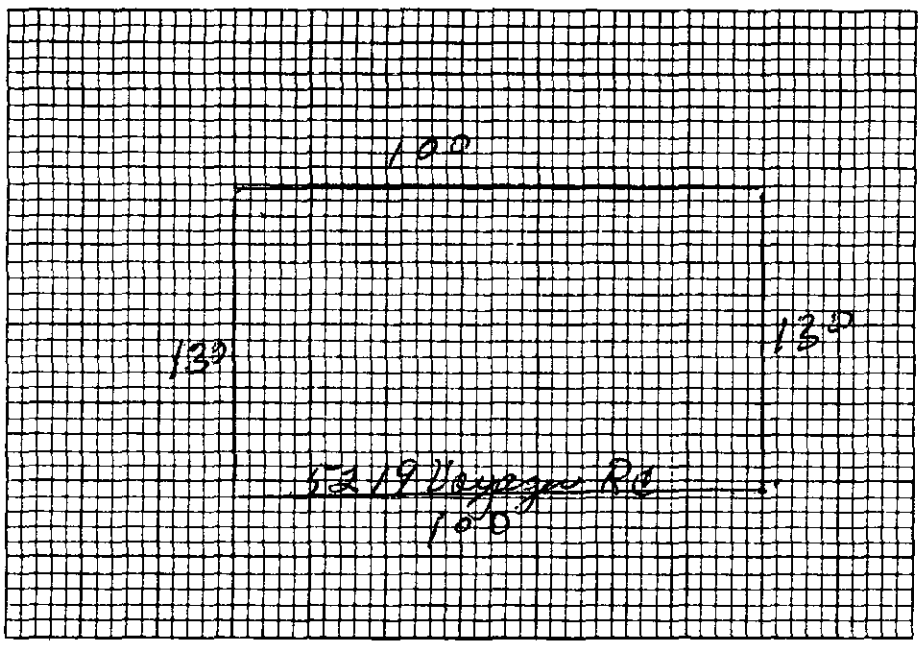

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ✓ Yes ___ No
Residence ✓ Yes ___ No

4) No. of Bedrooms 3

5) Business Use — Max No Employees ___

6) Washing Machine ✓ Yes ___ No

7) Garbage Disposal ___ Yes ✓ No

8) Dishwasher ___ Yes ___ No

9) Water Supply:
A) Individual Well ___
B) Governmental System ___
C) Community System: ✓
1. Well source ___
2. Governmental source ___

10) Sewage System:
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No

11) FHA Case No. ___

12) VA Case No. ___

13) NAME OF OWNER Mooney Jr. (LAST) W. (FIRST) K. (MIDDLE)

14) ADDRESS OF OWNER P.O. Box 1042 Kings Mtn, NC. 28086

15) PHONE NO. Home 399-3181 Office 399-3181

16) LOCATION OF SYSTEM Voyager Rd (5219) (STREET OR COUNTY ROAD)

17) SUBDIVISION Berryhill Mo. Ho. pk Lot No. # 11 Block No. ___

Map Book No. 349 Page No. 14

18) DEED REFERENCE — DEED BOOK 2852569 AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES ___ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

02/17/84
DATE OF APPLICATION

W.K. Mooney Jr.
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Serial No. 6960

Date Issued 22 Feb 84


ICAR (S) Permit No. 20622

T. C. No. 113-173-05

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ____Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 20622, dated 17 Feb 84 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 22 Mar 84, after which date this permit shall be null and void.

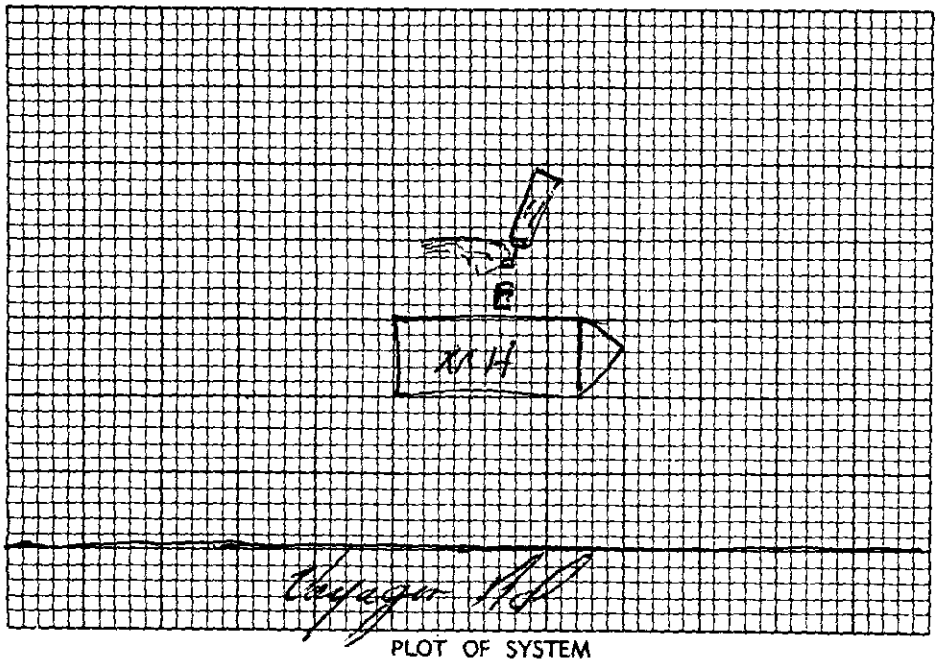

PLOT OF SYSTEM

Permeability Rate ✓

Liquid Capacity of Tank ✓

Tank Construction ✓

Absorption and/or Nitrification Lines:

Total Line Length 100'

Number of Lines 2

Distance from House ≥10'

Distance from Property Line >10'

Distance from Well ✓

NAME OF OWNER W. H. Mauney

LOCATION OF PROPERTY 5219 Voyager Rd. (Lot 11)

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

1 Lat 6' X 20' X 42"

Comments: _____

Division or Section Head

W. A. Kirby
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

C of A (s) No. 20622

Date Issued 3-26-84 Serial 6461 T. C. No. 113-173-05

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
CERTIFICATE OF COMPLETION

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Mauney (LAST) W. (FIRST) K. (MIDDLE)

Location of Property 5219 Voyager Dr. (Lot 11)

Application Number 20622 Permit Number 20622

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 100" Number of Lines 2

Depth of Filter Material 42" Cover Depth 24"

Water Supply Source Comm. Distance from Water Source —

Excavation Inspected 3-26-84 (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 3-26-84 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ____ installed or constructed, ✓ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments:

D. R. Ferguson
Environmentalist

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY