SEE INSTRUCTIONS ON BACK

Date Received 10/4/83

MECK. COUNTY DEPT. OF ENVIRONMENTAL HEALTH RECEIVED OCT 4 1983

ICAR (S) Application No. 20098

T. C. No. 139-072-03


Map Date _____

MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ___ Install or Construct 2) X Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

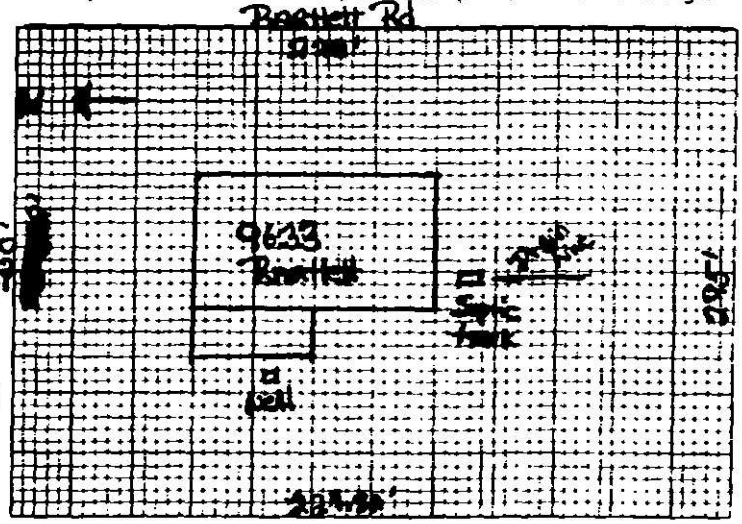

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ___ No
Residence X Yes ___ No

4) No of Bedrooms 3
5) Business Use — Max No Employees _____
6) Washing Machine X Yes ___ No
7) Garbage Disposal ___ Yes X No
8) Dishwasher X Yes ___ No
9) Water Supply
A) Individual Well X
B) Governmental System _____
C) Community System
1 Well source _____
2 Governmental source _____
10) Sewage System
House located within 200 feet of public sewer ___ Yes X No
House located within 200 feet of community sewer ___ Yes X No
11) FHA Case No _____
12) VA Case No. _____

13) NAME OF OWNER Hedrick (LAST) Lowell (FIRST) Wesley (MIDDLE)

14) ADDRESS OF OWNER 9633 Bartlett Rd, Charlotte NC 28212

15) PHONE NO. Home 545-6033 Office 333-9211

16) LOCATION OF SYSTEM Bartlett Rd - 9633 (STREET OR COUNTY ROAD)

17) SUBDIVISION Runnymede Estates Lot No. 3 Block No. _____

Map Book No. [redacted]12 Page No. [redacted]377

18) DEED REFERENCE — DEED BOOK 139 AT PAGE 072

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN Unknown

20) PTR NUMBER (See Instructions) _____

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

10-2-83
DATE OF APPLICATION

Lowell Hedrick
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Issued 5 Oct 83

Serial No. 6625


ICAR(S) Permit No. 20098

T. C. No 139-072-03

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 20098, dated 4 Oct 83 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 4 Nov 83, after which date this permit shall be null and void.

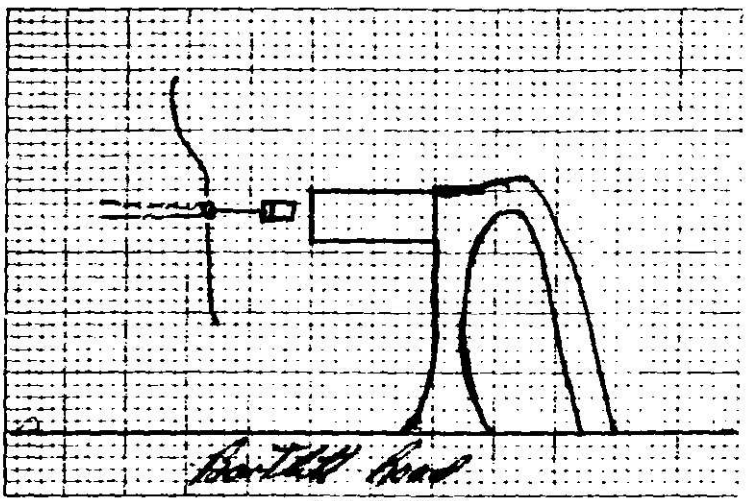

PLOT OF SYSTEM

Permeability Rate —

Liquid Capacity of Tank —

Tank Dimensions —

Absorption and/or Nitrification Lines

Total Line Length 100'

Number of Lines

Distance from House 210'

Distance from Property Line 210'

Distance from Well 200'

NAME OF OWNER Hedrick, Laurel Ellis

LOCATION OF PROPERTY Bartlett Road (9633)

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

1 trench 3'x50'x12" rock

Comments: _____

Division or Section Head _____

Environmentalist M. A. Kirby

* If this permit is for the installation or construction of a new system, it must be signed by the division or section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

C of A (s) No. 20098

Date Issued 11 Oct 83 Serial 6210 T C No. 139-07203

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF COMPLETION

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Welch (LAST), Terrell (FIRST), W. (MIDDLE)

Location of Property 9634 Bartlett Road

Application Number 20098 Permit Number 20098

Inspection Data:

Liquid Capacity of Tank — Tank Material —

Total Length of Drain Tile 100' Number of Lines 2

Depth of Filter Material 12" Cover Depth 18-24"

Water Supply Source Well Distance from Water Source 200'

Excavation Inspected 10 Oct 83 (DATE) Tank Inspected — (DATE)

Nitrification Field Inspected 11 Oct 83 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ___ installed or constructed, ✓ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments 2 Trenches; 3'X50'X12"

M. L. Hinkley
Environmentalist

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Received 7-24-84

RECEIVED
AUG 8 1984
ENVIRONMENTAL HEALTH

ICAR (S) Application No. 20098

T. C. No. 137-0720


Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to.

1) ___ Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption effluent discharge.

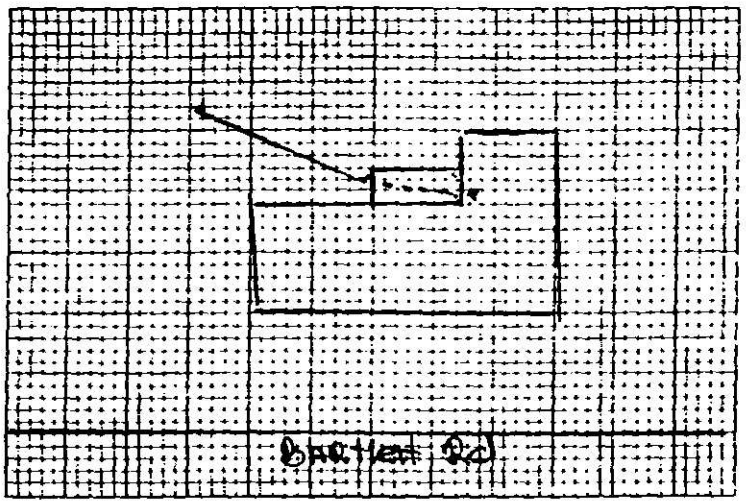

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ___ No
Residence ✓ Yes ___ No

4) No of Bedrooms 3
5) Business Use — Max No Employees ___
6 Washing Machine ✓ Yes ___ No
7 Garbage Disposal ___ Yes ✓ No
8 Dishwasher ✓ Yes ___ No
9) Water Supply
A) Individual Well ✓
B) Governmental System ___
C) Community System
1 Well source ___
2 Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11) FHA Case No ___
12) VA Case No ___

13) NAME OF OWNER Hedrick (LAST) Lowell (FIRST) Wesley (MIDDLE)

14) ADDRESS OF OWNER 9633 Barthett Rd 28212

15) PHONE NO. Home 5456033 Office 3339211

16) LOCATION OF SYSTEM 9633 Barthett Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION Runnymede Estates Lot No. 3,4,5 Block No. ___

Map Book No. 12 Page No. 377

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES ___ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

7-24-84
DATE OF APPLICATION

Lowell W. Hedrick 1984
OWNER

EHB-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Issued 8-21-84

Serial No. 07504


ICAR(S) Permit No. 20098

T C No. 139-072-03

Map Date 7

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 20098, dated 7-24-84 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 9-21-84, after which date this permit shall be null and void.

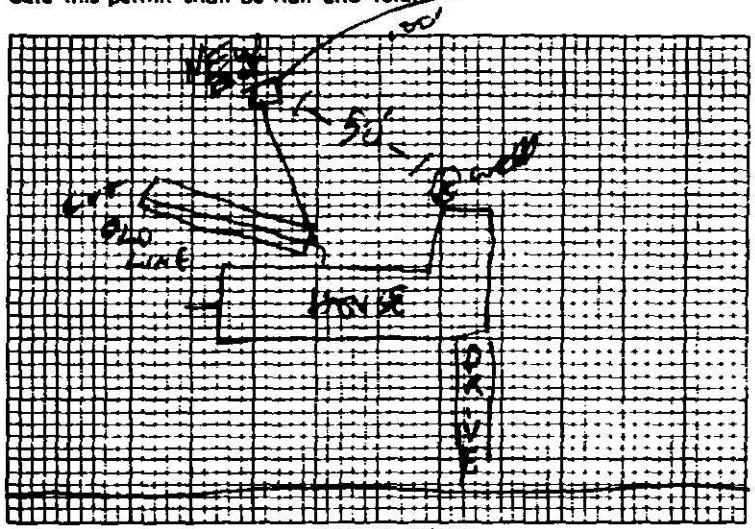

PLOT OF SYSTEM

Permeability Rate REPAIR

Liquid Capacity of Tank —

Tank Construction —

Absorption and/or Nitrification Lines:

Total Line Length 100'

Number of Lines 1 x 100

Distance from House 5'

Distance from Property Line 10'

Distance from Well 50'

NAME OF OWNER HEDRICK, LOWELL W.

LOCATION OF PROPERTY 9633 BARTLETT RD.

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

1 line x 100' long x 3' wide x 12" stone w/straw cover w/galberm

Comments:

B. Hamlett — Division or Section Head

Kelly Daniel — Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

BHD-5-76

Environmental Health Department's Copy