

10009 AMAZONA DR

01521420

5/16/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

MECKLENBURG COUNTY
Department of Environmental Health

December 16th, 1987

Americana Park, Inc.
1320 E. Morehead Street
Charlotte, NC 28204

RE: Property located at Amazona Drive
FILE: 4157A
PARCEL: 01521420

Dear Sir:

At your request a soils investigation was conducted on the property designated above. Results of this investigation showed the site to be classified as UNSUITABLE under criteria as set forth in Section .1900 of the North Carolina Administrative Code, Title 10, Department of Human Resources, Chapter 10, Division of Health Services; Sanitary Engineering Section, Subchapter 10A, Sanitation. A copy of the Site Evaluation Report (Serial Number 14822) is enclosed.

The soil on this property is not suitable for use with any conventional system, modified or alternative, with which I am aware.

If I can be of assistance, please do not hesitate to call.

Sincerely,

Sylvia D. Daniel, R.S.
Environmental Health Supervisor
Environmental Resources Division

Enclosure

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
SITE EVALUATION REPORT
SERIAL NUMBER 14822

File: 4157A Action 3

Parcel: 01521420 ☐ PC

Location: Amazona Drive

Subdivision:


Lot: Block: Acres: .46

Owner: Americana Park, Inc.
Address: 1320 E. Morehead Street
Charlotte, NC 28204

Comments: The Marked Lot + TAX Code Map Are Not The Same. Both Are Unsuitable

Described by: W. B. Ramsey

Date: 12-14-87

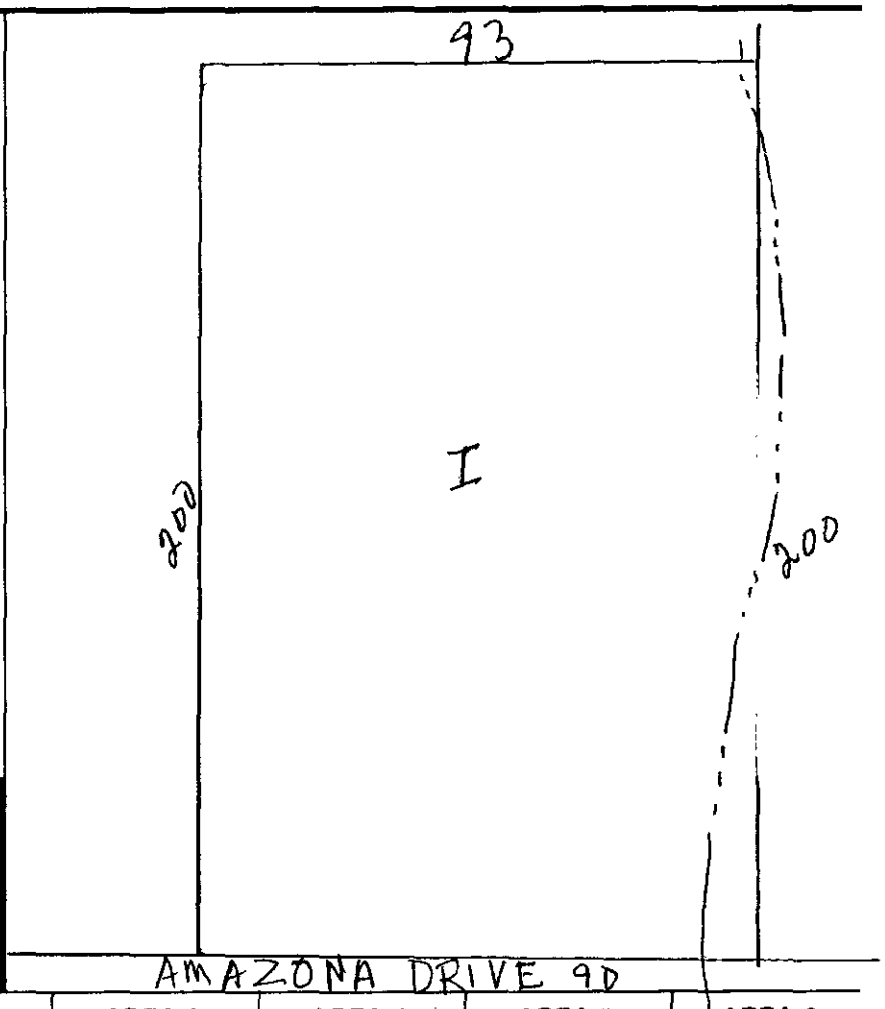

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	S (PS) U 2-4	S PS U	S PS U	S PS U	S PS U	S PS U
Texture	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U
Structure	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U
Drainage	S PS (U) Subject To Flooding	S PS U	S PS U	S PS U	S PS U	S PS U
Depth	S PS (U) 12-15	S PS U	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U
Available Space	S (PS) U	S PS U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	IVa Thin Alluvium Soil					
Area Classification	S PS (U)	S PS U	S PS U	S PS U	S PS U	S PS U

Date Received_____

APT No. 4157A

T. C. No._____

Map Date_____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER M AMERICANA PARK INC
(LAST / FIRST / MIDDLE)

2) ADDRESS OF OWNER 1320 East Morehead St. ZIP 28204

3) PHONE NO. Home_____ Office 377-6451


4) LOCATION OF PROPERTY Amazona Dr.
(STREET OR COUNTY ROAD)

5) SUBDIVISION Brasilia Park LOT NO. 20 BLOCK NO. D

MAP BOOK NO. 15 PAGE NO. 49

6) DEED REFERENCE: DEED BOOK 015-214-20 PAGE NO._____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge.

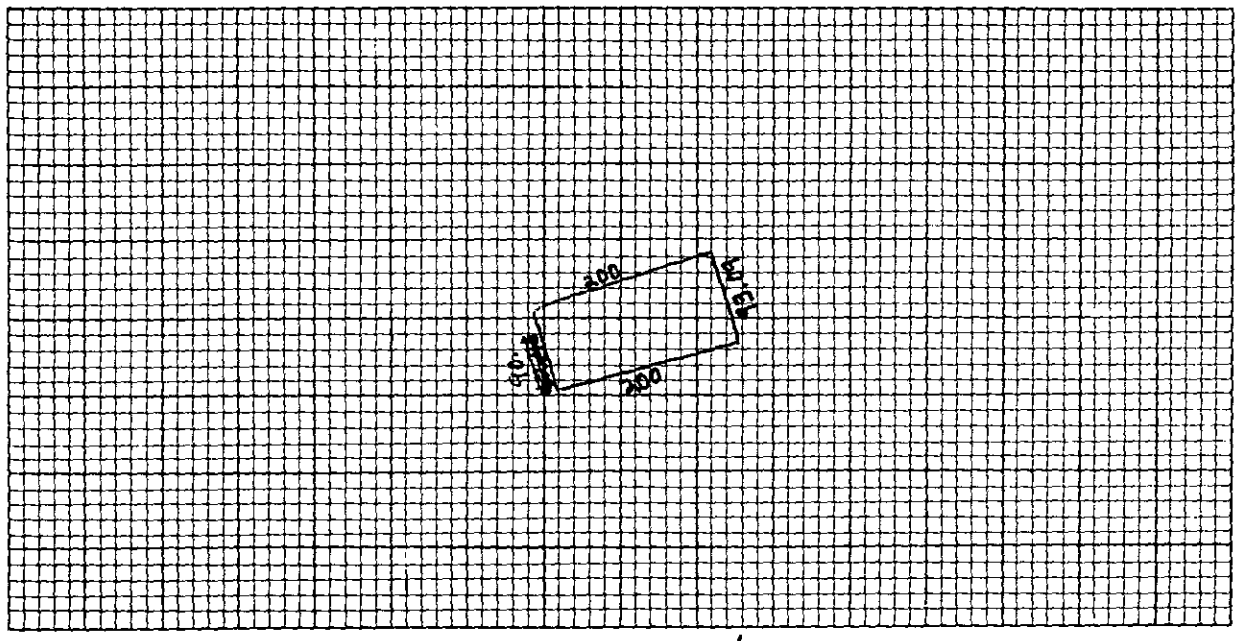

7) ACCURATELY DIAGRAM & DIMENSION LOT

Isaac Cumbo
OWNER

EHD-5-76

Environmental Health Department's Copy