

7605 HAPPY HOLLOW DR

13705101

12/19/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 1027 B DATE: 11/14/95

TC: 137 051 01 ☐ L ☐ CRT

SERIAL № 14291

Name of Owner Doris Duncan Juris.:

Address of Property 7605 Happy Hollow Dr

Inspection Data:

Tank Material Existing

Total Length of Bed Drainfield 150'

Number of Bed Lines 3 @ 50'

Cover Depth 8" - 20"

Water Supply Source well

Distance to Water Source > 50'

Excavation Inspected 11/14/95

Tank(s) Inspected -

Wash Line Inspected -

High Water Alarm Inspected -

PLOT

Design: 1995, Repair, CON, 450 SFB, 18" stone CTR# Potts Rd

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☒ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: Repair Instructed property owner to check plumbing for leaks (Septic system still running ~~during~~ during time of inspection)

Philip S. Walker R.S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

Repair

1027B

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

1027B

☐ CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: _____ (last) _____ (first) _____ (mi)

ADDRESS: _____ PHONE: (__) _____

CITY: _____ STATE: _____ ZIPCODE: _____

Date:

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 137 05 101

STREET ADDRESS: 7605 Happy Hollow Dr

ZONING:

X PROPERTY OWNER:

NAME: Duncan (last) Doris (first) _____ (mi)

ADDRESS: 7605 Happy Hollow Dr PHONE: (__) _____

CITY: Charlotte STATE: NC ZIPCODE: _____

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
☐ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

TYPE APPLICATION (check one):

LOT NUMBER: LOT SIZE (in acres):

☐ SOIL TEST - INDIVIDUAL LOT (O)
☐ NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or N)
☐ COMMERCIAL OR INDUSTRIAL (N)
☐ SOIL TEST DEVELOPMENT (P)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
☐ MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
☒ REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☒ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☐ Shared Well (S)
☐ Municipal (M) ☐ Other 'spring' (O)
☒ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☐ Deck/Patio ☐ Bedrooms ☐ Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: X Doris C Williams Duncan Date: 11/9/95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

... Repair

☐ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Philip S. Walker R.S. 11/9/95
Environmentalist Date

Director or Authorized Section Head Date

WATER 12/91

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 1027B DATE: 11/9/95

TC: 137 051 01 ☐ L

SERIAL Nº 16442

Permission is hereby given to _____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 11/9/95. All work shall be completed on or before 12/9/95, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

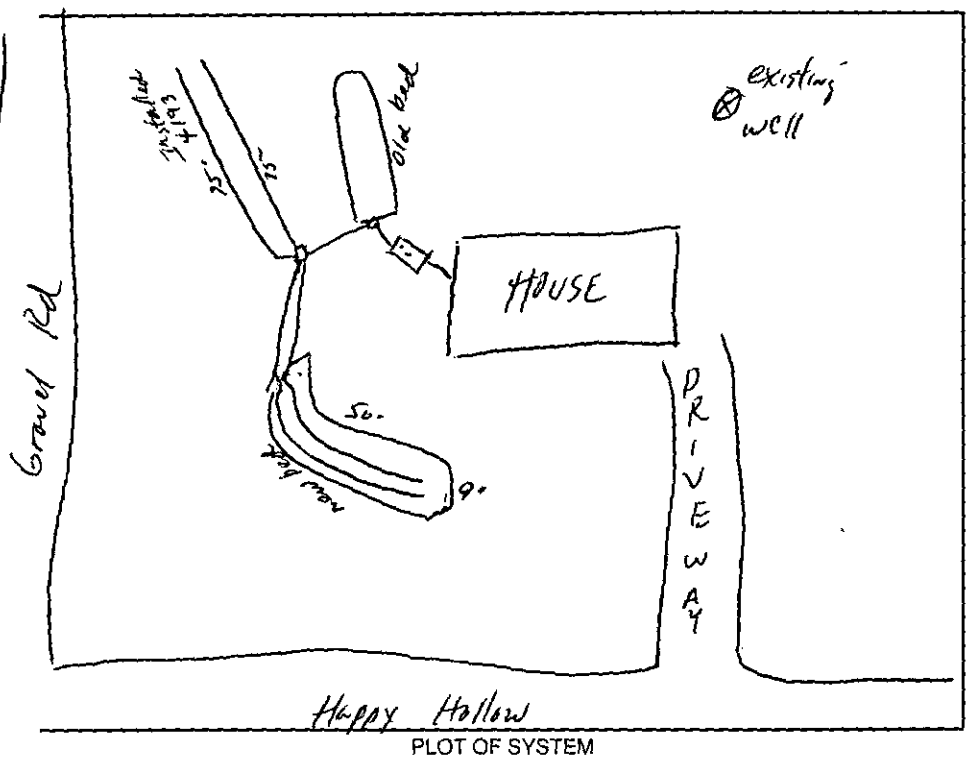

PLOT OF SYSTEM

Liquid Capacity of Septic Tank — gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction —

Trench Depth 36"

Absorption and/or Nitrification Lines:
Bed
Trench Width 9' feet

Trench Walls Scored and Porous —

Total Line Length 150' feet

Number of Lines 3 (50')

Depth of Stone 18 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well > 50' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Doris Duncan

LOCATION OF PROPERTY 7605 Happy Hollow Dr

Comments: Bed system 9' wd x 50' long x 18" stone
Keep septic system > 50' from well

Philo S. Walker R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

Permit Number: 1027B

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number: 13705101

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	____ Yes	✓ No	____ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	____ Conventional ____ Prefabricated, permeable block panel system ____ Shallow Placed Conventional	____ Low Pressure Pipe ____ Large Diameter Pipe ____ Fill ____ Other	____ Innovative or Experimental: ____ IWWS-93-1 ____ IWWS-93-2 ____ IWWS-94-1
____ Long-term acceptance rate	____ Max gallons/day wastewater flow	____ Absorption Area (sq ft)	____ Trench spacing (min. on centers)
YES Serviced by private well	____ Gallon septic tank	____ Total trench length (ft)	____ Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
3 Bedrooms in residence	____ Gallon pump tank	____ Depth of stone	
Any surface waters present: NO Type:		Minimum separation distance:	
Site modifications required:			
Additional Conditions: Repair to existing waste water system >20yrs old (1) 9" X 50' long x 18" stone			
Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ____ Prefabricated, permeable block panel system ____ Shallow Placed Conventional	____ Low Pressure Pipe ____ Large Diameter Pipe ____ Fill ____ Other	____ Innovative or Experimental: ____ IWWS-93-1 ____ IWWS-93-2 ____ IWWS-94-1
450' Absorption Area (Sq ft) 150' Total Trench Length (Ft)	18 Depth of Stone Trench	NA Trench spacing (min. on centers)	36" Maximum Trench Depth
For existing system, enter the year originally installed:			

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.
- This Improvement permit is transferable.

Philip S. Walker 11/9/95

DEHNR Authorized Agent Date

Owner/Agent Signature Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

4002

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 1627B DATE: 4-28-93

TC: 137-051-01

SERIAL Nº 15493

Permission is hereby given to ____ Install or Construct, X Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 4-28-93. All work shall be completed on or before 5-28-93, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

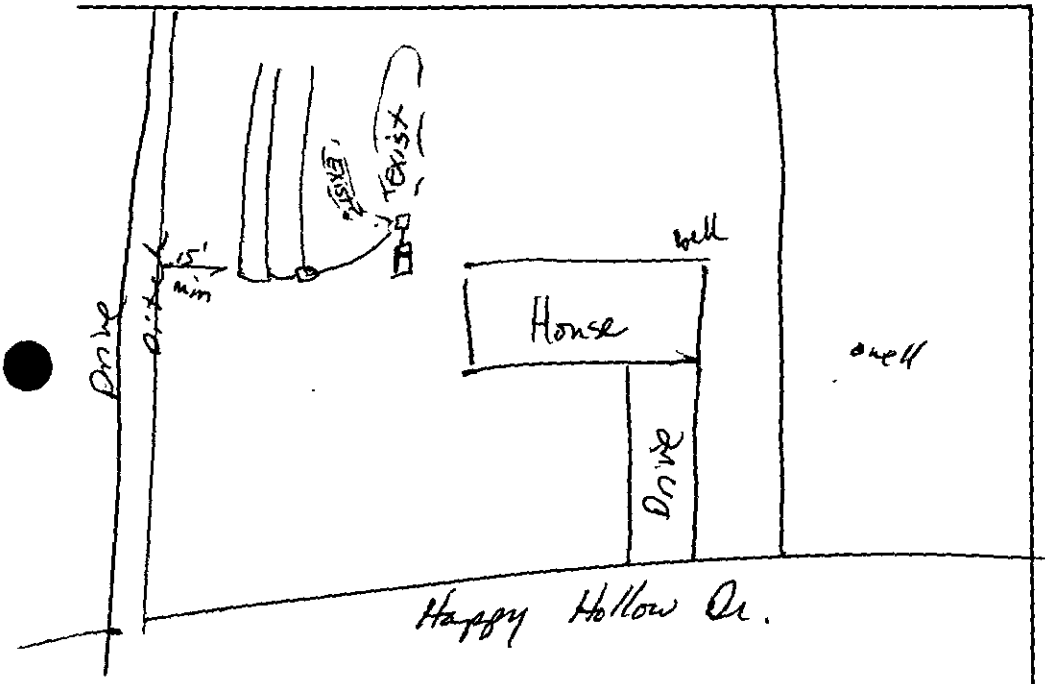

PLOT OF SYSTEM

Liquid Capacity of Septic Tank Exist gallons

Liquid Capacity of Dosing Tank ____ gallons

Tank Construction ____

Absorption and/or Nitrification Lines:

Trench Width 3' feet

Total Line Length ~~50'~~ feet

Number of Lines 3 at 50' each

Depth of Stone 12" inches

Distance from House 5'+ feet

Distance from Property Line 10' feet

Distance from Well 50' min feet

12" soil cover
Keep shallow

NAME OF OWNER Don's Dunkin

LOCATION OF PROPERTY 7605 Happy Hollow Dr.

Comments: Keep lines shallow. Feed existing system as well as new Washing machine to plumbing to septic tank.

Division or Section Head

Susan Salem
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Mecklenburg County Health Department in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - HEALTH DEPARTMENT'S COPY • CANARY - ENVIRONMENTALIST'S COPY • PINK - OWNER OR AGENT'S COPY

Mint Hill Grove Rd yellow + brown house

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

[] CRT

10276/8899A

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: _____ (last) (first) (mi)

ADDRESS: _____ PHONE: (___) _____

CITY: STATE: ZIPCODE:

Date: 04/22/93

PROPERTY OWNER:

NAME: Duncan Don (last) (first) (mi)

ADDRESS: 7605 HAPPY HOLLER PHONE: (___) 545-3153

CITY: Mint Hill STATE: NC ZIPCODE:

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 137-051-01

STREET ADDRESS: 7605 HAPPY HOLLER

ZONING:

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

LOT NUMBER: LOT SIZE (in acres):

TYPE APPLICATION (check one):

[] SOIL TEST - INDIVIDUAL LOT (D)
[] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[X] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [X] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: 3 NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[X] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [] Bedrooms [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Don Duncan Date: 4-28-93

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

... Repair to System

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Susan Peterson 4-28-93
Environmentalist Date

Director or Authorized Section Head Date

WWATER : 122791

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 1027B/8699A/9099A DATE: 5-4-93

TC: 137-05-01 ☐ CRT

SERIAL Nº 15135

Name of Owner Dons Dunkin Juris.:

Address of Property 7605 Happy Hollow Dr

Inspection Data:

Tank Material Exist

Total Length of Drainfield 150'

Number of Lines 2 @ 75'

Cover Depth 12-14"

Water Supply Source well

Distance to Water Source 50'+

Excavation Inspected 5-4-93

Tank(s) Inspected ——

Wash Line Inspected connected to plumbing to tank

High Water Alarm Inspected ——

PLOT

Design: 1993, 2 lines at 3'x75'x12" stone installed, Sanitary tee installed, Fed original system 1st then new lines CTR# 167

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☒ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS: Repair? ODF 1983, 1955

Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.