

3612 KELLY RD

03309115

1/7/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 5114B DATE: 11/21/02

TC: 033-091-15 ☒ L ☐ CRT

SERIAL 19075

Name of Owner Jeff Carder Juris.:

Address of Property 3612 Kelly Road

Inspection Data:

Tank Material existing

Total Length of Drainfield 100'

Number of Lines 2 @ 50'

Cover Depth 6-12"

Water Supply Source well


Distance to Water Source >50'

Excavation Inspected 11/21/02

Tank(s) Inspected N/A

Wash Line Inspected 11/21/02

High Water Alarm Inspected N/A

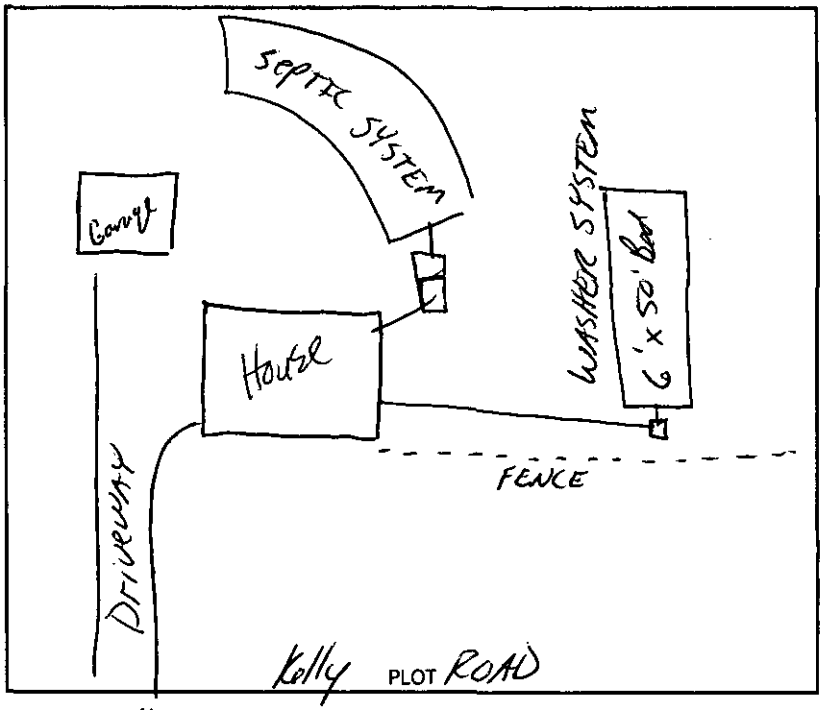

Design 2002 Repair, 300 SFB, 18" Stone Washer system CTR# D. Caney

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☒ altered or repaired

☐ in accordance with the permit issued ☒ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Repair to Washer System
6' x 50' x 18" Stone Bed
Type II Conventional System

Built 1969

Terry Mitchell L.S.
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

Gwen,

Please assign a file #, and please mail the yellow copy to the homeowner's address. They are supposed to mail a copy of the application.

Thank You,
Jeremy

M/d 11/22/02

2826

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 5114B DATE: 10/23/02

TC: 033-091-15 ☒ L

SERIAL 19185

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 10/23/02. All work shall be completed on or before 11/23/02, after which date this permit shall be null and void. The system shall meet all of the construction requirements of I5A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

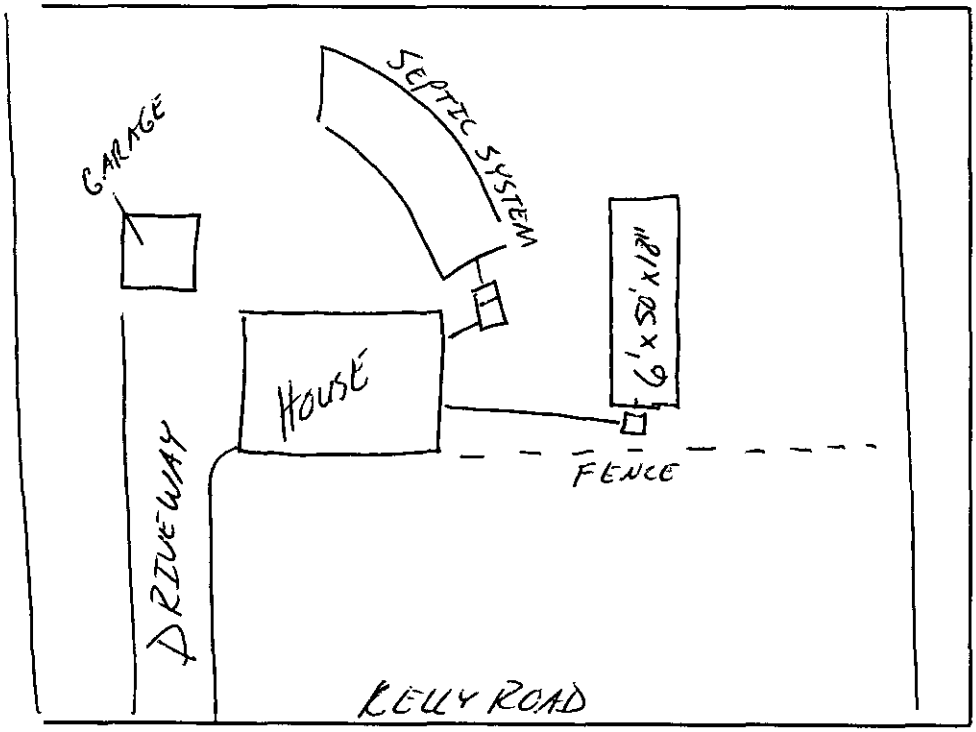

PLOT OF SYSTEM

Liquid Capacity of washer Septic Tank _____ gallons

Liquid Capacity of Dosing Tank N/A gallons

Tank Construction washer box

Trench Depth 30"

Absorption and/or Nitrification Lines:

Trench Width 6'x50' feet

Trench Walls Scored and Porous yes

Total Line Length 100' feet

Number of Lines 2x50'

Depth of Stone 18" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well >50' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Jeff Carder

LOCATION OF PROPERTY 3612 Kelly Road

Comments: Repair to washer system
Install new D-Box
Install 6'x50'x18" Stone

Tony Nicholas R.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY