

16413 CLEAR CREEK DR

13917303

1/3/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3640B DATE: 7/14/95

TC: 139 173 03 ☐ L

SERIAL Nº 16306

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 7/14/95. All work shall be completed on or before 8/14/95, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

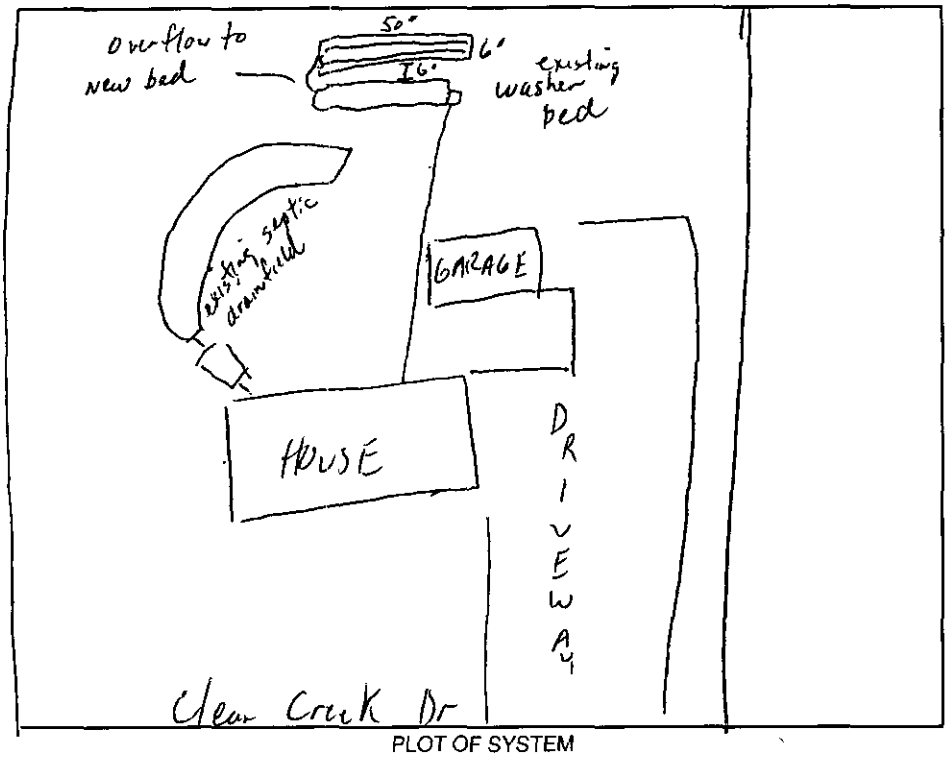

PLOT OF SYSTEM

Liquid Capacity of Septic Tank — gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction —

Bed Trench Depth 2.5'

Absorption and/or Nitrification Lines:

Bed Trench Width 6' feet

Trench Walls Scored and Porous —

Total Line Length 100' feet

Number of Lines 2 (50')

Depth of Stone 18" inches

Distance from House 5' feet

Distance from Property Line 10' feet

Distance from Well > 100' feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Walt Brown

LOCATION OF PROPERTY 16413 Clear Creek Dr

Comments: Bed system (Washer bed Repair) 6'wd x 50'long x 18"stone
Overflow from old washer bed to new bed
Keep septic system 750' from well

Phila S. Walker E.S.
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3640B DATE: 7/18/95

TC: 139 173 03 ☐ L ☐ CRT

SERIAL Nº 16305

Name of Owner Walt Brown Juris.: _____

Address of Property 16413 Clear Creek Dr

Inspection Data:

Tank Material –

Total Length of Drainfield 100'

Number of Lines 2 @ 50'

Cover Depth 14"

Water Supply Source well

Distance to Water Source 7100+

Excavation Inspected 7/18/95

Tank(s) Inspected –

Wash Line Inspected 7/18/95

High Water Alarm Inspected –

PLOT

Design 1995 Repair Washer line 300' SFB, 18" Stone CTR# R. Eudy 239

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☒ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Washer line repair

Philo A. Walker R.S.

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.