

3127 BUTTER CHURN LN

23122306

7/8/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

3934# J Michael

FEE: 100.00
DATE: 10-21-08
CRT I 1 Visa appR - 086701

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM
MECKLENBURG COUNTY - GROUNDWATER & WASTEWATER SERVICES
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

GWS – UES.APP 06/07

FILE #: 14023

TYPE APPLCATION:

☐ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A / M)
☐ ADDITION - RENOVATION OR GARAGE WITH NO MAJOR CHANGES (X)
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☐ COMMERCIAL OR INDUSTRIAL (N)

PERSON FILING APPLICATION: C O Green Construction
NAME: Craig Green
ADDRESS: PO Box 77351
CITY: Charlotte
STATE: NC ZIP: 28271
PHONE: 704-622-0998
ALTERNATE PHONE: 704-841-9050

PROPERTY OWNER:
NAME: Rob McClintock
ADDRESS: 3127 Butter Churn Ln
CITY: Matthews
STATE: NC ZIP: 28105
PHONE: 321-5207
ALTERNATE PHONE: 321-5207

JOB LOCATION INFORMATION
TAX/PARCEL #: 231-223-06
STREET ADDRESS: 3127 Butter Churn Ln.
CITY: Matthews
STATE: NC ZIP: 28105
SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #:

TOWNSHIP:
☐ 0-MECKLENBURG ☐ 4-PINEVILLE
☐ 1-CHARLOTTE ☒ 5-MATTHEWS
☐ 2-DAVIDSON ☐ 6-HUNTERSVILLE
☐ 3-CORNELIUS ☐ 7-MINT HILL

WATER SUPPLY:
☒ MUNICIPAL (M) ☐ COMMUNITY (C) ☐ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

RESIDENTIAL PROPERTY TYPE:
☒ HOUSE (H) ☐ MODULAR HOME (M) ☐ MULTIPLE FAMILY (U)
☐ SINGLE MOBILE HOME (S) ☐ DOUBLE WIDE (D)
☐ OTHER (O)

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 4
NUMBER OF OCCUPANTS: 4

COMMERCIAL / INDUSTRIAL PROPERTY TYPE:
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ☐ YES ☐ NO
UNDERGROUND STORAGE TANKS? ☐ YES ☐ NO

ADDITION TYPE ATTACHED TO EXISTING STRUCTURE:
☐ BEDROOM ☐ BATHROOM ☐ KITCHEN ☐ DINING ROOM ☐ LIVING ROOM ☐ DEN
☐ GARAGE ☐ SUNROOM ☐ PORCH ☐ DECK ☒ OTHER Play room

ADDITION TYPE DETACHED FROM EXISTING STRUCTURE:
☐ DETACHED GARAGE ☐ DETACHED GARAGE WITH PLUMBING ☐ POOL HOUSE ☐ SHOP ☐ BARN
☐ STORAGE SHED ☐ DETACHED PORCH / DECK ☐ OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Craig Green — Owner's/Agent's Signature
10/21/08 — Date

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted y this Department.
- This permit is not transferable.

☐ ADDITION / RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE

Meets all required setbacks off septic


Jeremy J Mulkey — EHS Signature
10-23-08 — Date

Mecklenburg County
Land Use & Environmental Service Agency
Groundwater & Wastewater Services
700 N. Tryon St., Suite 211
Charlotte, NC 28202
Phone: (704) 336-5103
Fax: (704) 336-6894

File #_____
Date_____

PROPOSED PLOT PLAN

A map showing existing and proposed property lines and easements with dimensions, the location of the single family residence, non-single family residence, or other facility, and appurtenances, the site for the proposed well, and the location of existing or proposed sewer lines and/or sewage disposal systems, surface water bodies, aboveground or underground storage tanks. Name all roads adjoining the property. If this a repair indicate the type of repair.

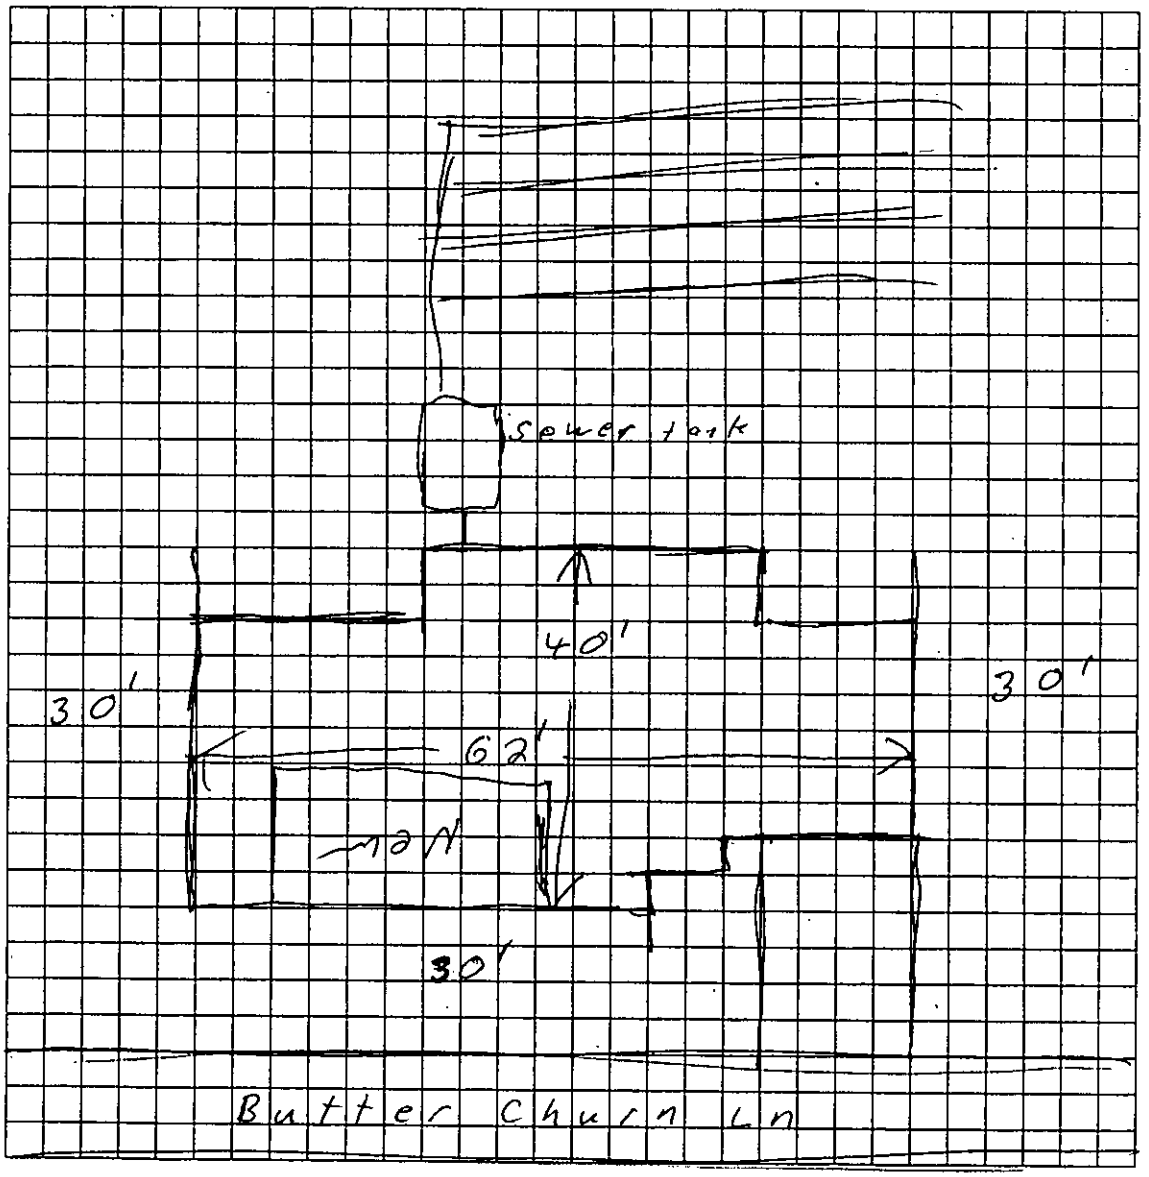

Owner/Agent Signature Craig Green
Date 10/21/08

LBC 12/15/04

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	10/21/08	**Amount:**	100.00
Receipt #:	59364	**Tendered:**	0.00
Check / Auth #:	VISA 086701	**Returned:**	0.00
Received By:	GLADNAG		

Account Information

Account #:	200000
Contractor:	GREEN CRAIG
Attn:	
Address:	P.O. BOX 77351
Address:	
City/State/Zip:	CHARLOTTE, NC 28270

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	MH Exc/Add/Repl w/o System Mod 3127 ~~BULTER~~ CHURN LN Butter		1	100.00	100.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

Ck #8039 $100.00
8/20/03 mvb

Alteration to System

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

$200.00 8/27/03 JKA

☐ CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102 14023

Date: 8 20 03

PERSON FILING APPLICATION:
NAME: McClintock (last) Robin (first) A (mi)
ADDRESS: 3127 Butterchurn Ln PHONE: 704 847-2691
CITY: MATTHEWS STATE: NC ZIPCODE: 28105

PROPERTY OWNER:
NAME: McClintock (last) Robin (first) A (mi)
ADDRESS: 3127 Butterchurn Ln PHONE: 704 847-2691
CITY: MATTHEWS STATE: NC ZIPCODE: 28105

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 231-223-06
STREET ADDRESS: 3127 Butterchurn Ln
ZONING:

Township (check one):
☒ 0 Mecklenburg County ☐ 2 Davidson ☐ 4 Pineville ☐ 6 Huntersville
☐ 1 Charlotte ☐ 3 Cornelius ☐ 5 Matthews ☐ 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME: HearthStone

LOT NUMBER: 12 LOT SIZE (in acres): .74

TYPE APPLICATION (check one):

[redacted]
☐ EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
☒ ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
☐ COMMERCIAL OR INDUSTRIAL (N)
☐ ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[redacted]

RESIDENTIAL PROPERTY (Type Building, check one):
☐ SINGLE MOBILE HOME (S) ☒ HOUSE (H) ☐ MULTIPLE FAMILY (U)
☐ DOUBLE WIDE (D) ☐ MODULAR HOME (M) ☐ OTHER _____ (O)

NUMBER BEDROOMS: 4 NUMBER OCCUPANTS: 4

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
☐ Community (C) ☐ Shared Well (S)
☒ Municipal (M) ☐ Other 'spring' (O)
☐ Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
☐ Swimming Pool ☐ Jacuzzi ☐ Stable/Barn ☐ Workshop ☐ None
☐ Garage ☐ Storage Building ☒ Deck/Patio ☐ Bedrooms ☒ Other Enclosing Screen Porch

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: [signature] Date: 8-20-03

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...OK to use altered System See alteration Permit Paperwork

☐ IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
☐ MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
☐ ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Joshua R. Sellers R.S./R.E.H.S.
Environmentalist

Date 09-02-03

WWATER : 122791

49341


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 14023

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

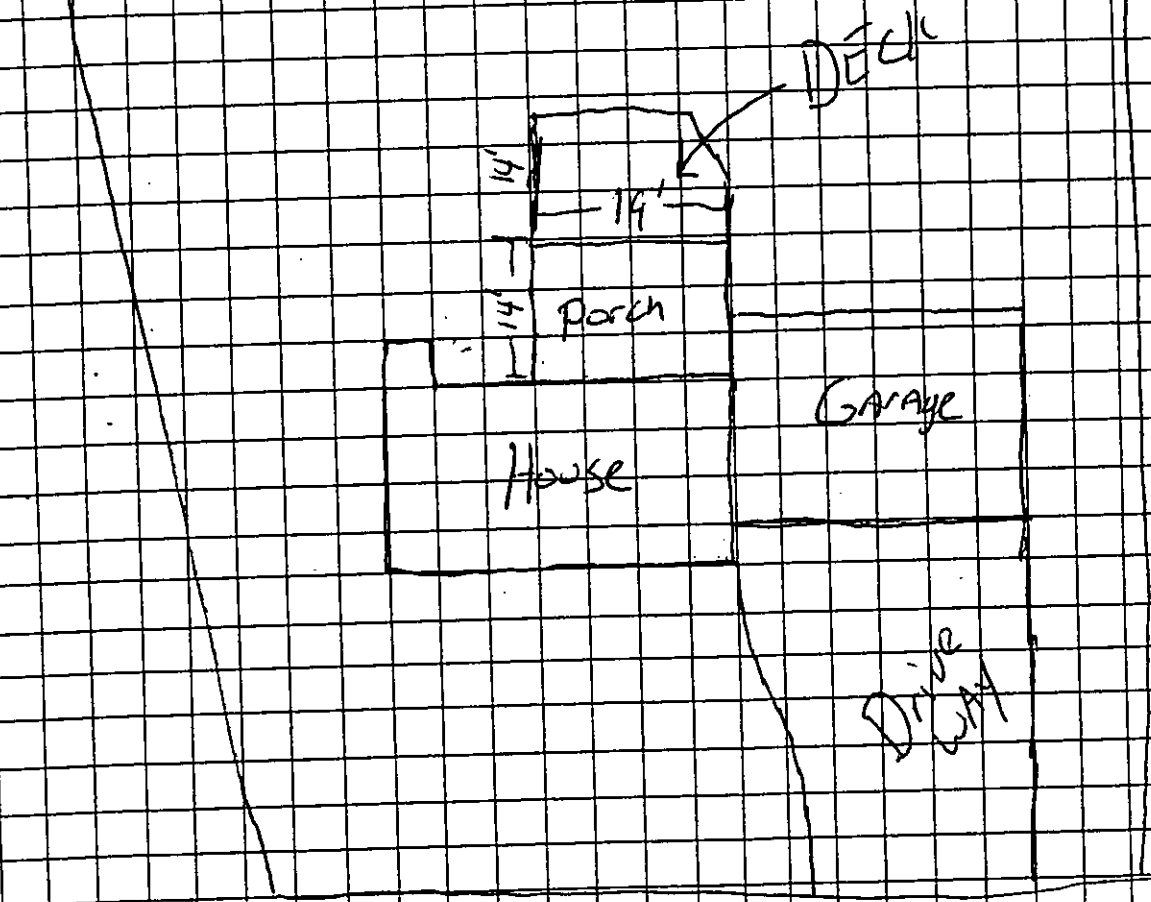

OWNER/AGENT SIGNATURE

DATE 8-20-05

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 14023 DATE: 09-02-03

TC: 231-223-04

SERIAL 19510

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 08-20-03. All work shall be completed on or before 09-20-03, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

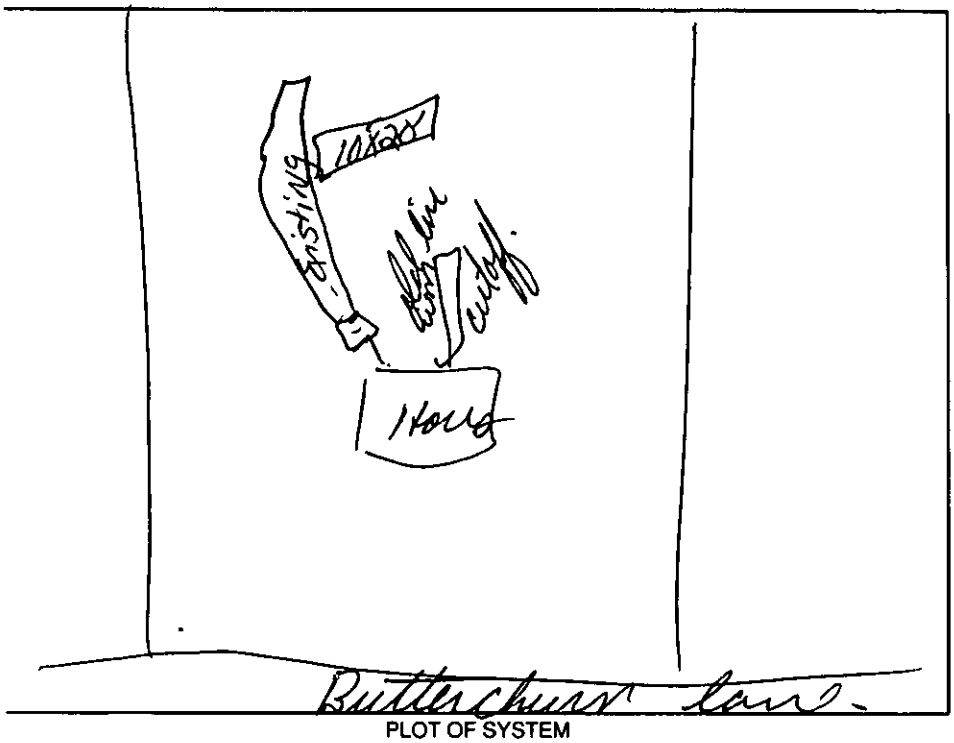

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 existing gallons

Liquid Capacity of Dosing Tank N/A. gallons

Tank Construction PCC

Trench Depth ≤ 36"

Absorption and/or Nitrification Lines:

Trench Width 10' feet

Trench Walls Scored and Porous yes

Total Line Length 200' feet

Number of Lines 3@10'x20'

Depth of Stone 12" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well ⊗ Mun. feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Robin McClintock

LOCATION OF PROPERTY 3127 Butterchurn Lane

Comments: Install new 10'x20' bed and Plumb washing machine into septic tank

Joshua R. Sellers R.S. IREHS
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 14023 DATE: 09-02-03

TC: 231-223-06

SERIAL 19510

Permission is hereby given to ___ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 08-20-03. All work shall be completed on or before 09-20-03, after which date this permit shall be null and void. The system shall meet all of the construction requirements of I5A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

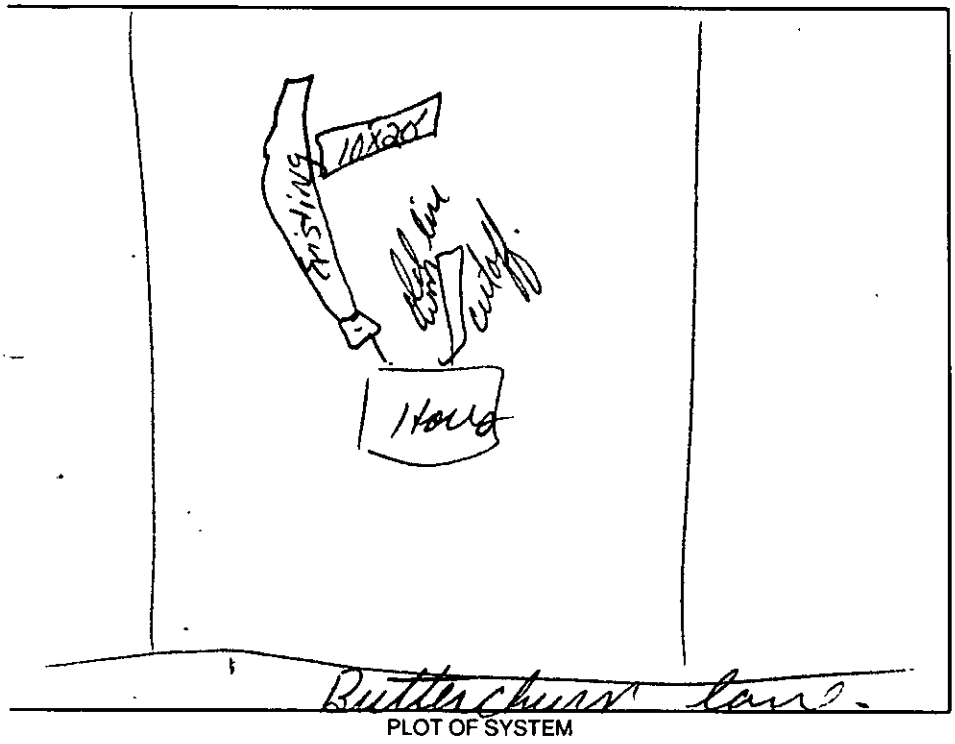

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 Existing gallons

Liquid Capacity of Dosing Tank N/A. gallons

Tank Construction PCC

Trench Depth ≤ 36"

Absorption and/or Nitrification Lines:

Trench Width 10' feet

Trench Walls Scored and Porous yes

Total Line Length 200' feet

Number of Lines 3@10'x20'

Depth of Stone 12" inches

Distance from House >5' feet

Distance from Property Line >10' feet

Distance from Well ⊗ Mun. feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Robin McClintock

LOCATION OF PROPERTY 3127 Butterchurn Lane

Comments: Install new 10'x20' bed and Plumb washing machine into septic tank

Joshua K. Sellers R.S. IREHS
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 14023 DATE: 09-02-03

TC: 231-223-06 ☒ L ☒ CRT

SERIAL 19318

Name of Owner Robin McClintock Juris.:

Address of Property 3127 Butterchurn Lane

Inspection Data:

Tank Material PCC Existing

Total Length of Drainfield 200'

Number of Lines 3 @10'x20'

Cover Depth 12"-24"

Water Supply Source Comm

Distance to Water Source ≥100'

Excavation Inspected 09-02-03

Tank(s) Inspected N/A

Wash Line Inspected N/A.

High Water Alarm Inspected

PLOT

See installation approval.

Design 2003 Repair 200 SFB PS- 12G. CTR# P. Haney

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ altered or repaired

☐ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Installed 10'x20' Bed to tie stub drain line from bedroom washing machine line into septic tank.

Joshua R. Sellers R.S. REHS.
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 14023 DATE: 09-02-03

TC: 231-223-06 ☒ L ☒ CRT

SERIAL 19318 LD County

Name of Owner Robin McClintock Juris.: _____

Address of Property 3127 Butterchurn Lane

Inspection Data:

Tank Material PVC Existing

Total Length of Drainfield 200'

Number of Lines 3 @ 10'x20'

Cover Depth 12-24"

Water Supply Source Comm

Distance to Water Source >100'

Excavation Inspected 09-02-03

Tank(s) Inspected N/A

Wash Line Inspected N/A.

High Water Alarm Inspected _____

PLOT

Sat Installation approval.

Design 2003 Repair 200 SFB PS- 126. CTR# P. Haney

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☑ altered or repaired

☐ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Installed 10'x20' Bed to use stub drain line plumbed washing machine line into septic tank.

Joshua R Sellers R.S. IIE H.S.

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

2008 UTJ OK

Groundwater & Wastewater Services
Septic Project File & Data Review Worksheet

GWS File #: 14023 WASPS App #: ~~14037~~ 3434

Primary ES assigned to project: OJ

Secondary ES assigned to project: _____

Project Type: New System ☐ Alteration ☐ Repair ☐ Modified Plot Plan ☐ UTJ OK

I. File Review:

Rule or Law	Permit Application			
.1937(d)	Is the Application complete	Yes ☑	No ☐	N/A ☐
.1937(d)	Is there a Site plan/Plat with application	Yes ☑	No ☐	N/A ☐
.1937(d)	Is the Facility shown?	Yes ☑	No ☐	N/A ☐
.1937(d)	Are appurtenances shown	Yes ☑	No ☐	N/A ☐
	Site Evaluation Information			
.1939 (a)(1)	Topography and Landscape Position Recorded?	Yes ☐	No ☐	N/A ☐
.1940 (a-g)	Slope % Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Texture Class Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Structure type Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Consistence Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(2)	Mineralogy Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(3)	Soil Wetness Condition Recorded?	Yes ☐	No ☐	N/A ☐
.1939 (a)(4)	Soil Depth to Rock or Parent Material Recorded When Encountered	Yes ☐	No ☐	N/A ☐
.1939 (a)(5)	Depth to Restrictive Horizons Recorded When Encountered?	Yes ☐	No ☐	N/A ☐
.1939 (a)(6)	Sufficient Available Space Recorded?	Yes ☐	No ☐	N/A ☐
.1937(m)	Are the Profile Locations Shown?			
.1939(a)	Are the S/PS Profiles in system & in repair area?	Yes ☐	No ☐	N/A ☐
& .1945(b)	Number of auger borings made: _____ Were sufficient auger borings made?	Yes ☐	No ☐	N/A ☐
.1939(d), .1955, .1956, .1957	LTAR	Yes ☐	No ☐	N/A ☐
	Improvement Permit/Construction Authorization			
.1937(g) 130A-336(a)	Proposed System Type stated-Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Proposed System Type stated-Repair	Yes ☐	No ☐	N/A ☐
130A-336 (a)(3)	System location identifiable by setbacks - Initial	Yes ☐	No ☐	N/A ☐
.1937(g) .1945(b)	System components shown – Initial	Yes ☐	No ☐	N/A ☐
.1945(b)	Repair area shown	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Does System design match facility, flow & WWcharacteristics?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is System design consistent with soil/site conditions?	Yes ☐	No ☐	N/A ☐
.1937 (f)(g)	Is the System located in the approved area?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Is the Design flow (gpd) indicated?	Yes ☐	No ☐	N/A ☐

130A-336(a)	Number of Bedrooms, employees, seats, etc. indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench depth indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench width indicated?	Yes ☐	No ☐	N/A ☐
.1937(g)	Trench length indicated?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Proposed/existing well shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)(1)	Property line lengths shown?	Yes ☐	No ☐	N/A ☐
130A-336(a)	Facility/appurtenance setbacks shown from fixed points?	Yes ☐	No ☐	N/A ☐
	Operation Permit			
.1937(i)	System type as described in table V(a) of rule .1961	Yes ☐	No ☐	N/A ☐
.1937(i)	Conditions for system performance, operation, maintenance, monitoring and reporting.	Yes ☐	No ☐	N/A ☐

II. WASPS Review:

Construction authorization issued	Yes ☐	No ☐	N/A ☐
Installation approval issued	Yes ☐	No ☐	N/A ☐
Operation permit issued	Yes ☐	No ☐	N/A ☐
Other related documentation	Yes ☐	No ☐	N/A ☐

Items requiring correction/modification: _____

Comments:

_____

_____

_____

_____

_____

IA issued date: _____

OP issued date: _____

Review performed by: JR Date performed: 10-25-07