12053
#14977

20 SEP '24 PM 4:41

MECKLENBURG COUNTY
HEALTH DEPARTMENT

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. **SEPTIC / TYPE APPLICATION:** ○ N/A ○ NEW SYSTEM ○ ALTERATION ☑ REPAIR ○ MODIFIED PLOT PLAN

2. **WELL / TYPE APPLICATION:** ☑ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. **JOB LOCATION INFORMATION:**
TAX PARCEL NUMBER: 02325115
STREET ADDRESS: 11430 Kennewick Rd
CITY: Charlotte
STATE: NC ZIP: 28216
SUBDIVISION NAME: Comanche
LOT #: _____ LOT SIZE (acres): 0.93
TOWNSHIP:
☑ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. **BUILDING INFORMATION:**
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
☑ HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 1,993
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
☑ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. **IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION:** ☑ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. **WATER SUPPLY:** ○ MUNICIPAL ☑ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. **PROPOSED USE OF WELL:** ○ N/A ○ IRRIGATION ☑ POTABLE (DRINKING WATER) ○ OTHER _____

8. **PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE** *(1-MOST DESIRED 5-LEAST DESIRED):*
☑ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. **RANK:** ____ ____ ____ ____ ____

9. **DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.**

BURIED CABLES, LANDFILLS, STUMPHOLES	☑ YES ○ NO	GRADING/SOIL REMOVAL PERFORMED	☑ YES ○ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	☑ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ☑ NO
WELLS, SPRINGS, OR WATER LINES	☑ YES ○ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ☑ NO
EASEMENTS OR RIGHT-OF-WAYS	☑ YES ○ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ☑ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ☑ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ☑ NO
WASTE STORAGE	○ YES ☑ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ☑ NO

10. **WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?** _____ ☐ UNKNOWN

11. **WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY?** _____ ☑ N/A

12. **PROPERTY OWNER:**
NAME: William & Claudia Morrow
ADDRESS: 11430 Kennewick Rd
CITY: Charlotte
STATE: NC ZIP: 28216
WORK PHONE: —
MOBILE PHONE: 704-491-8835
FAX: —
E-MAIL: wmorrow001@att.net
wmorrow001@att.net

13. **OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:**
**Owner's Authorization form is required if legal representative is submitting application*
NAME: —
ADDRESS: —
CITY: —
STATE: — ZIP: —
WORK PHONE: —
MOBILE PHONE: —
FAX: —
E-MAIL: —

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
3205 Freedom Drive, Suite 8000, Charlotte, NC 28208
OFFICE: 980-314-1680, FAX: 704-336-6894 Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

CM (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

William J Morrow
Claudia Morrow
Property Owner's or Owner's Legal Representative Signature

9/12/24
Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
3205 Freedom Drive, Suite 8000, Charlotte, NC 28208
OFFICE: 980-314-1680, FAX: 704-336-6894 Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

Subdivision Name: _____ Lot #: _____

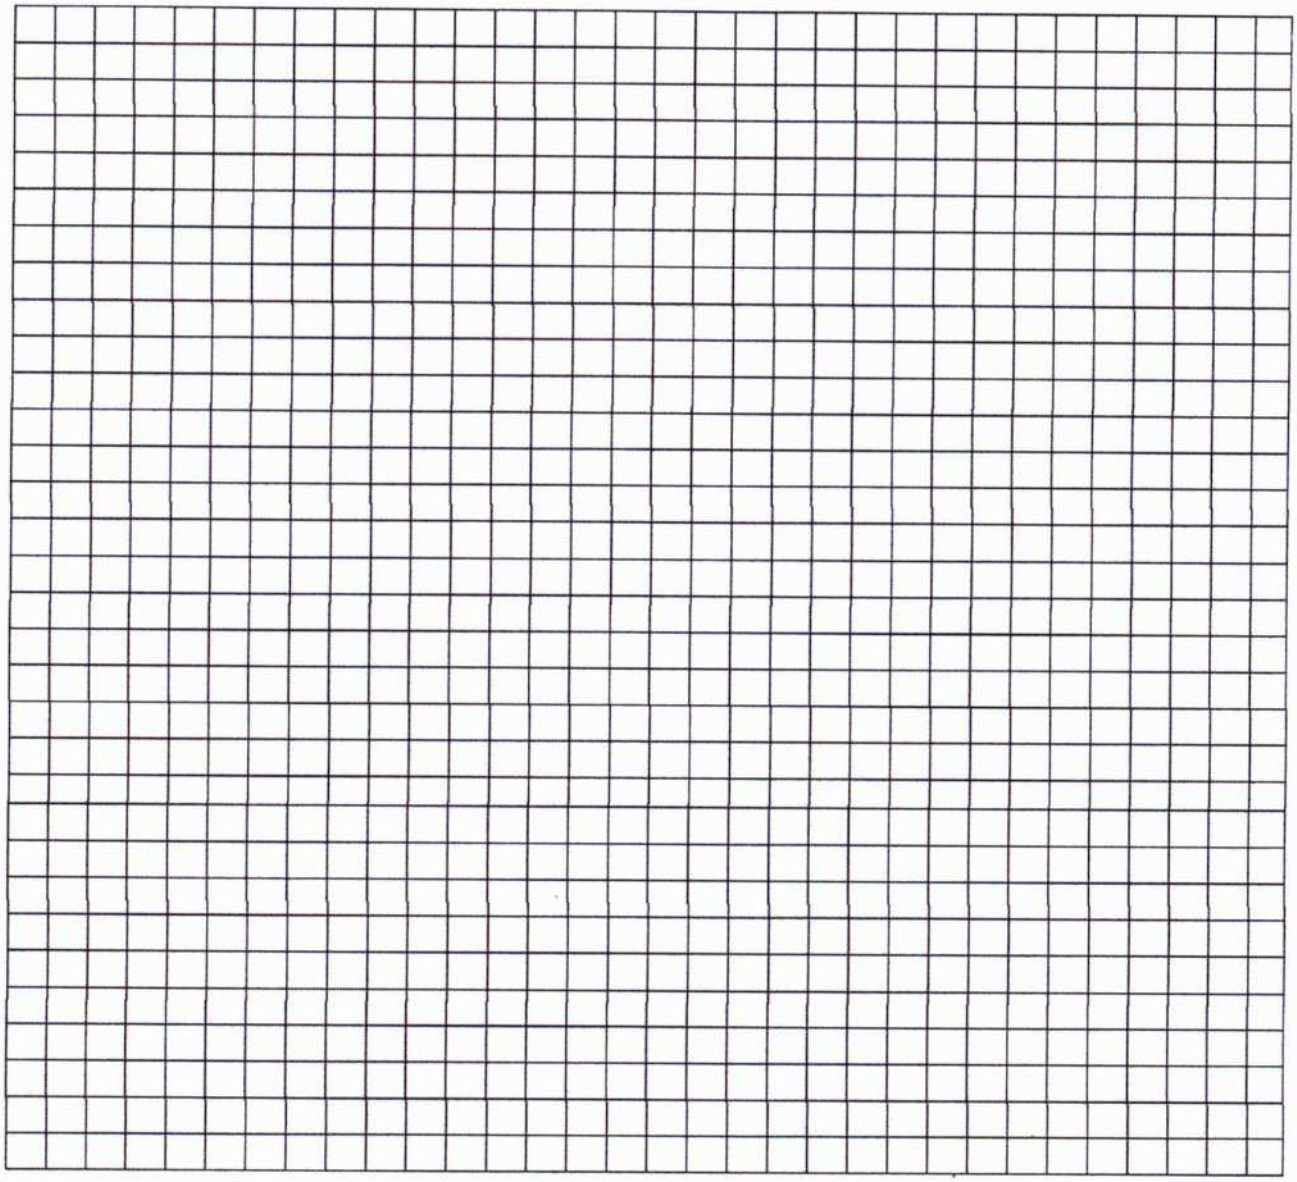

_____ _____

Property Owner's or Owner's Legal Representative Signature Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
3205 Freedom Drive, Suite 8000, Charlotte, NC 28208
OFFICE: 980-314-1680, FAX: 704-336-6894 Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

SEE INSTRUCTIONS ON BACK

Date Received 3/11/77

ICAR(S) Application No. 1253

T.C. No. 23095.51

Map Date ———


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

Application for an
Installation, Construction, Alteration, and/or Repair Permit
Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to

1) ✓ Install or Construct 2) ___ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge

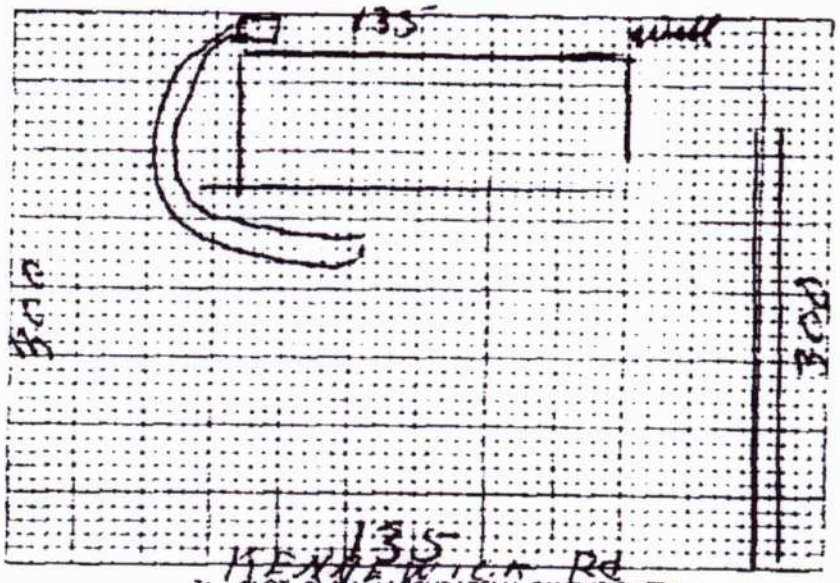

3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) No. of Bedrooms 3

5) Business Use — Max No Employees ___

6) Washing Machine ✓ Yes ___ No

7) Garbage Disposal ___ Yes ✓ No

8) Dishwasher ___ Yes ✓ No

9) Water Supply
- A) Individual Well ✓
- B) Governmental System ___
- C) Community System:
  - 1 Well source ___
  - 2 Governmental source ___

10) Sewage System:
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No

11) FHA Case No. ___

12) VA Case No. ___

13) NAME OF OWNER Lamm (LAST) Jack (FIRST) E. (MIDDLE)

14) ADDRESS OF OWNER 2101 Oakdale Rd

15) PHONE NO Home 392-4775 Office 394-7215

16) LOCATION OF SYSTEM Hickswood Road (STREET OR COUNTY ROAD)

17) SUBDIVISION Comanche Lot No ___ Block No. ___

Map Book No 15 Page No. 254

18) DEED REFERENCE — DEED BOOK 3333 AT PAGE 523

19) HAS A PERCOLATION TEST BEEN RUN? ___ YES ✓ NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

DATE OF APPLICATION ___

OWNER Jack E Lamm

FORM NO. E-4-4-...

HEALTH DEPARTMENT'S COPY

SUPERVISOR/ADMINISTRATIVE PROFESSIONAL CHECKLIST

☐ NEW SEPTIC ☑ REPAIR ☐ USE EXISTING ☐ MODIFIED PLOT PLAN ☐ ALTERATION

File Number: 12053

Assigned Inspector: Heather

☐ IP $250.00: _____Initial/Date

☐ IP Commercial $450.00: _____ Initial/Date

☐ CA & OP $400.00: _____ Initial/Date

☐ Alteration Fees $300: _____Initial/Date

☐ Modified Plot Plan Fees $100.00: _____Initial/Date

☐ Use Existing Fees $100.00: _____Initial/Date

☐ Use Existing Approved ☐ Use Existing Denied

☐ Send IP permit for signature: _____ ☐ Signature received: _____

☐ Floor plans reviewed

☐ Generate CA ☐ Approve as Noted in Winchester

☐ This site is served by septic and well. Verify each is complete before final hold is released

☐ This septic system requires a certified operation contract before final hold is released

☐ Certified operator contract is on file: _____

☐ Septic file complete: _____

☐ Release final hold in Winchester: _____

Comments:

Mecklenburg County Groundwater & Wastewater Services
3205 Freedom Dr. Suite 8000 Charlotte, NC 28208
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT/CONSTRUCTION AUTHORIZATION for REPAIRING an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 12053 Permit #: 14977 Tax Parcel #: 02325115

Property Owner: William & Claudia Morrow

Job Location Address: 11430 Kennewick Rd

City: Charlotte State: NC Zip Code: 28216

Improvement Permit Issuance Date: _____ **Construction Authorization Issuance Date:** 10/3/24

Permission is hereby given to **repair** an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 10/3/25. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

Permitted Design Flow: 360 GPD Site LTAR: .3 GPD/ft²

Liquid Capacity of Septic Tank: existing gallons Liquid Capacity of Dosing Tank: 1000 gallons if needed

Drainfield Design ☑ N/A

Trench Depth: _____ inches

Trench Width: _____ feet

Line Spacing: _____ feet (O.C.)

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Bed Design *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: 36 inches

Bed Width: 10 feet

Total line length: 50 feet

# of Lines: 3 @ 50 feet

Depth of Media: 24 inches (Type) stone

Distribution Device: dbox

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____

Minimum System Setbacks

Distance from Building Foundation: 10 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 50 feet



Comments: System Classification & Type: Investigate connection from tank to drainlines

CALL INSPECTOR PRIOR TO UNCOVERING CONNECTION. PRE CON IS REQUIRED PRIOR TO INSTALLING REPAIR BED

Authorized Agent: Heather Ray Signature: Heather Ray

Owner Signature: _____ Date: _____