

6000 PLEASANT GROVE RD

03316116

1/3/2008

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3920B DATE: 2/28/96

TC: 033-161-16 ☐ L ☐ CRT

SERIAL Nº 16516

Name of Owner Edward Marz Juris.:

Address of Property 6000 Pleasant Grove Road

Inspection Data:

Tank Material Existing

Total Length of Drainfield 130'

Number of Lines 2 @ 1@60', 1@70'

Cover Depth 9-24"

Water Supply Source Well


Distance to Water Source >50'

Excavation Inspected 2/27/96, 2/28/96

Tank(s) Inspected NA

Wash Line Inspected NA

High Water Alarm Inspected NA

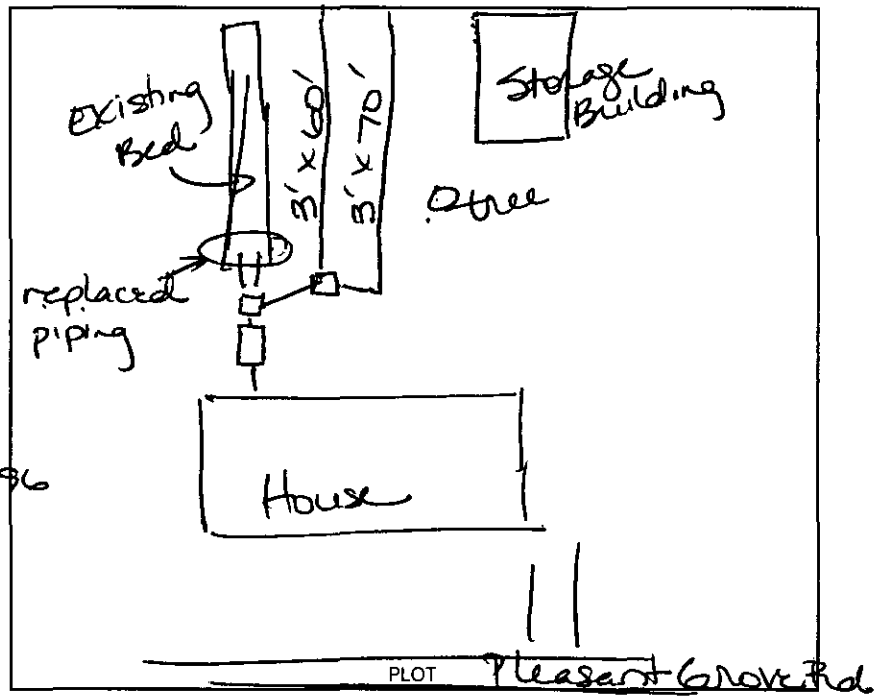

Design 1996 Repair, 390 ft2, 12"6, cecil-like CTR# 68

The undersigned has inspected the Septic Tank System described above, and certifies it has been Lefler-Stuart

☐ installed or constructed ☐ altered or repaired
☑ in accordance with the permit issued ☑ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

~~☐ Certificate of Completion~~ ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: Repair to existing system

Note: ~5' of clogged piping in existing bed replaced with corrugated. New installation being fed first, ~~over flowing back to~~ D Box into old bed

OD < 1985

Type II

Ilsa B. Mialik
Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 3820 B DATE: 1/11/96

TC: 033-161-16☐ L

SERIAL Nº 16524

Permission is hereby given to ✓ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 11/15/95. All work shall be completed on or before 2/11/96, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

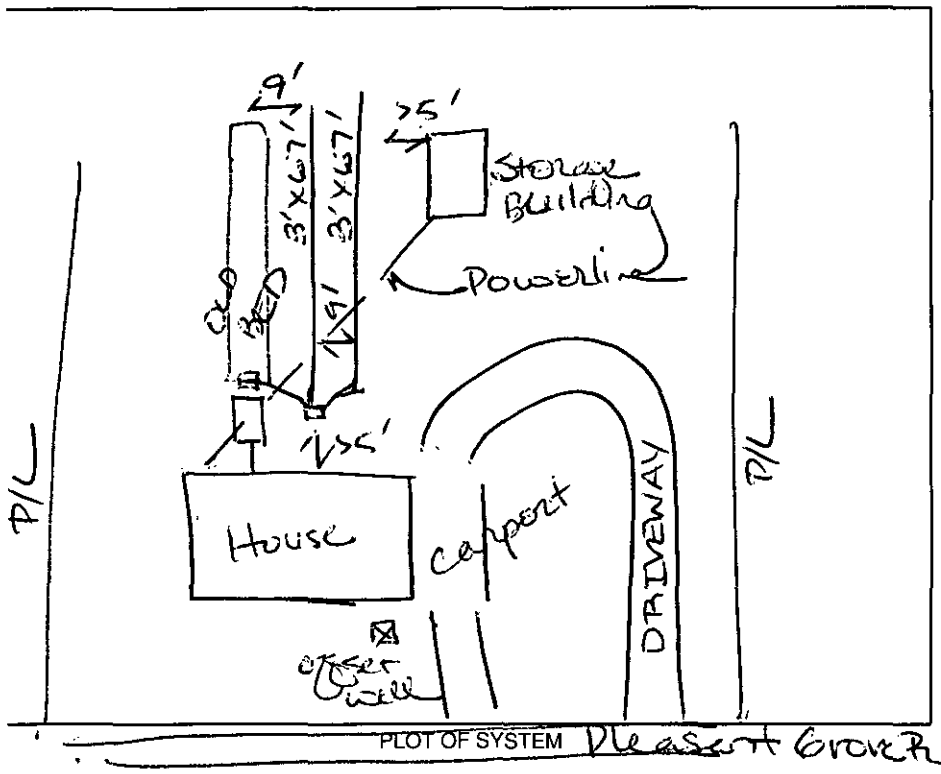

Liquid Capacity of Septic Tank Existing gallons

Liquid Capacity of Dosing Tank ____ gallons

Tank Construction ____

Trench Depth 36" max

Absorption and/or Nitrification Lines:

Trench Width 3' feet

Trench Walls Scored and Porous yes

Total Line Length 134 feet

Number of Lines 2@67' each

Depth of Stone 12" inches

Distance from House 5' feet

Distance from Property Line >10 feet

Distance from Well 750 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER Edward Marz

LOCATION OF PROPERTY 6000 Pleasant Grove Road

Comments:

Recommend 400 linear feet of drainline; however, less footage ~~installed at once~~ to be installed at owner's request

Ina B. Mialik, RS
Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

FEE: _____ **AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION**
DATE: _____ **VOID SIXTY (60) MONTHS FROM DATE OF ISSUANCE**

DATE: 1/11/96 PERMIT NO: 3820B

PARCEL NO: 033-161-16

JOB LOCATION ADDRESS: 6000 Pleasant Grove Rd

PROPERTY OWNER: Edward Marz

BUILDING CONTRACTOR: NA

SUBDIVISION NAME: NA

AUTHORIZATION ISSUED BY: Ida B. Mialik, RS DATE: 1/11/96

DEHNR AUTHORIZED AGENT

AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NO. 3820B, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. AN INSTALLATION, CONSTRUCTION, ALTERATION AND/OR REPAIR APPROVAL MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A REGISTERED SEPTIC TANK CONTRACTOR WITH MECKLENBURG COUNTY HEALTH DEPARTMENT.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. OTHER CONDITIONS: Repair ONLY; NO construction/building additions

OWNER CERTIFICATION

I CERTIFY THAT THERE HAVE BEEN NO ALTERATIONS IN SITE OR SOIL CONDITIONS OR MODIFICATIONS TO FACILITY, WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS FROM THOSE SPECIFIED IN THE ORIGINAL APPLICATION OR ASSOCIATED IMPROVEMENT PERMIT UNLESS AUTHORIZED IN WRITING BY THE MECKLENBURG COUNTY HEALTH DEPARTMENT. I ALSO UNDERSTAND THAT ANY SUCH ALTERATIONS, MODIFICATIONS, OR FALSE INFORMATION ARE GROUNDS FOR REVOCATION OF PERMITS AND AUTHORIZATION TO CONSTRUCT.

[signature] 1-15-96

SIGNATURE OF OWNER/OWNER'S REPRESENTATIVE DATE

Permit Number: 3820B

CONDITIONS OF IMPROVEMENT PERMIT

Tax Number 033-161-16

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement	___ Yes	✓ No	___ Partial Basement
Type Primary Wastewater System Type (circle one): I (II) III IV V VI	✓ *Conventional* ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ *Low Pressure Pipe* ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
3 Long-term acceptance rate	___ Max gallons/day wastewater flow	___ Absorption Area (sq ft)	___ Trench spacing (min. on centers)
___ Serviced by private well	___ Gallon septic tank	___ *Total trench length (ft)*	___ Maximum trench depth (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions)
___ Bedrooms in residence	___ Gallon pump tank	___ Depth of stone	
Any surface waters present: None Type:		Minimum separation distance:	
Site modifications required: None			
Additional Conditions: Repair to Septic Syptem. Keep repair installation 50' minimum from well, 5' minimum from any building foundation.			
Repair Area System Type Type (circle one): I (II) III IV V VI	✓ Conventional ___ Prefabricated, permeable block panel system ___ Shallow Placed Conventional	___ Low Pressure Pipe ___ Large Diameter Pipe ___ Fill ___ Other	___ Innovative or Experimental: ___ IWWS-93-1 ___ IWWS-93-2 ___ IWWS-94-1
402 Absorption Area (Sq ft) 134 Total Trench Length (Ft)	12" Depth of Stone Trench	9' Trench spacing (min. on centers)	36" Maximum Trench Depth
For existing system, enter the year originally installed: 1985			

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.
- This Improvement permit is transferable.

Lora B. Mialik, RS 1/11/96
DEHNR Authorized Agent Date

Owner/Agent Signature 1-11-96
Date

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, N.C. 28202.
(704) 336-5102

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH,
AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FEE: N/A

DATE: _____

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE

[ ] CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION OF EXISTING SYSTEM X REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 38203

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 033-161-16

STREET ADDRESS: 6000 Pleasant Grove Rd

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER:

TYPE OF BUILDING, (CHECK ONE)

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
✓ HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

TOWNSHIP (CHECK ONE):

___ 0 MECKLENBURG
✓ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS: 3 NUMBER OF OCCUPANTS: 2

FOUNDATION FOR RESIDENCE:

___ WITHOUT BASEMENT ON SLAB
X CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

IF EXPANSION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES X NO TYPE: _____

WATER SUPPLY (CHECK ONE):

___ COMMUNITY (C)
___ MUNICIPAL (M)
✓ PRIVATE WELL (P)
___ SHARED WELL (S)
___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES ___ YES ___ NO
EXISTING WASTE WATER SYSTEMS ___ YES ___ NO
EASEMENTS OR RIGHT-OF-WAYS ___ YES ___ NO
WELL SPRINGS OR WATERLINES ___ YES X NO
DESIGNATED WETLANDS ___ YES X NO

PROPERTY OWNER:

NAME: MARZ Edward
(LAST) (FIRST) (MI)

ADDRESS: 6000 Pleasant Grove Rd

CITY: Char STATE: ZIP:

DAYTIME PHONE: ( ) 3773429

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: SAME
(LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) —

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 1955

THE UNDERSIGNED, OWNER, OR LEGAL AGENT FOR THE OWNER, OF THE PROPERTY DESCRIBED ABOVE AS THE "JOB LOCATION" HAS READ THE FOREGOING APPLICATION, ACKNOWLEDGES THAT THE CONTENTS OF SAME ARE TRUE, AND AUTHORIZES AGENTS OF THE MECKLENBURG COUNTY HEALTH DEPARTMENT TO ENTER ONTO THE PROPERTY FOR THE PURPOSE OF PROCESSING THIS REQUEST.

SIGNED: X _____ DATE: 11-15-95

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102

**An IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change.