Date Received 12-6-83

ICAR (S) Application No. 20227

T. C. No. PO 137-022-01

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ✓ Install or Construct 2) _____ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

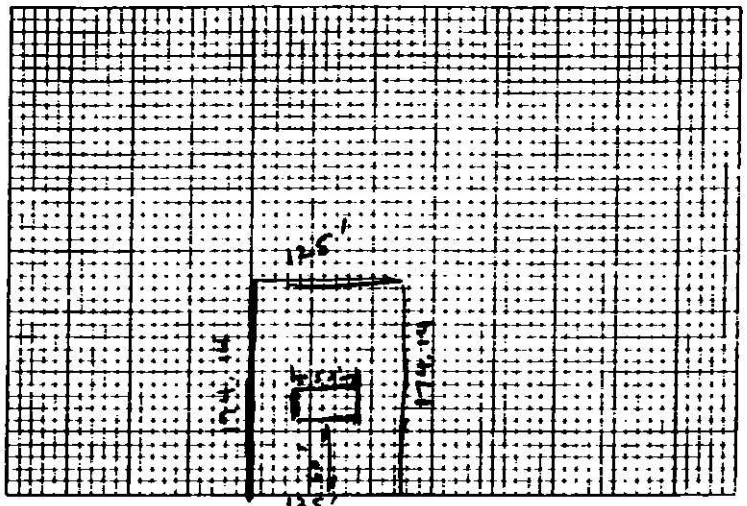

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ____ Yes ____ No
Residence ✓ Yes ____ No

4) No of Bedrooms 3
5) Business Use — Max No Employees _____
6) Washing Machine ✓ Yes ____ No
7) Garbage Disposal ____ Yes ✓ No
8) Dishwasher ✓ Yes ____ No
9) Water Supply
   A) Individual Well ✓
   B) Governmental System _____
   C) Community System
      1 Well source _____
      2 Governmental source _____
10) Sewage System
   House located within 200 feet of public sewer ____ Yes ✓ No
   House located within 200 feet of community sewer ____ Yes ✓ No
11) FHA Case No _____
12) VA Case No _____

13) NAME OF OWNER Seawell (LAST) Charles (FIRST) Coy (MIDDLE)

14) ADDRESS OF OWNER 4201 [illegible] Dr; [illegible] NC 28075

15) PHONE NO. Home 455-[illegible] Office Same

16) LOCATION OF SYSTEM ~~[illegible]~~ 6921 [illegible] Rd [illegible] NC [illegible]
STREET OR COUNTY ROAD

17) SUBDIVISION _____ Lot No. 3 Block No. 1

Map Book No. _____ Page No. _____

18) DEED REFERENCE — DEED BOOK _____ AT PAGE _____

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES ____ NO DATE RUN 11-8-83

20) PTR NUMBER (See Instructions) 20227

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

12-6-83
DATE OF APPLICATION

Charles C Seawell
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Received 10-28-83

MECK[illegible]Y DEPARTMENT OF

SIR No. 2022[illegible]7

TRC No. 137-022[illegible]

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER New Faith Baptist Church
LAST FIRST MIDDLE

2) ADDRESS OF OWNER 6840 Wilson Grove Rd. ZIP 28212

3) PHONE NO. Home 545-8310 Office SAme

4) LOCATION OF PROPERTY [illegible] Kuck Rd.
STREET OR COUNTY ROAD

5) SUBDIVISION New Faith LOT NO. 3 BLOCK NO. 1

MAP BOOK NO _____ PAGE NO. _____

6) DEED REFERENCE DEED BOOK _____ PAGE NO. _____

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge.

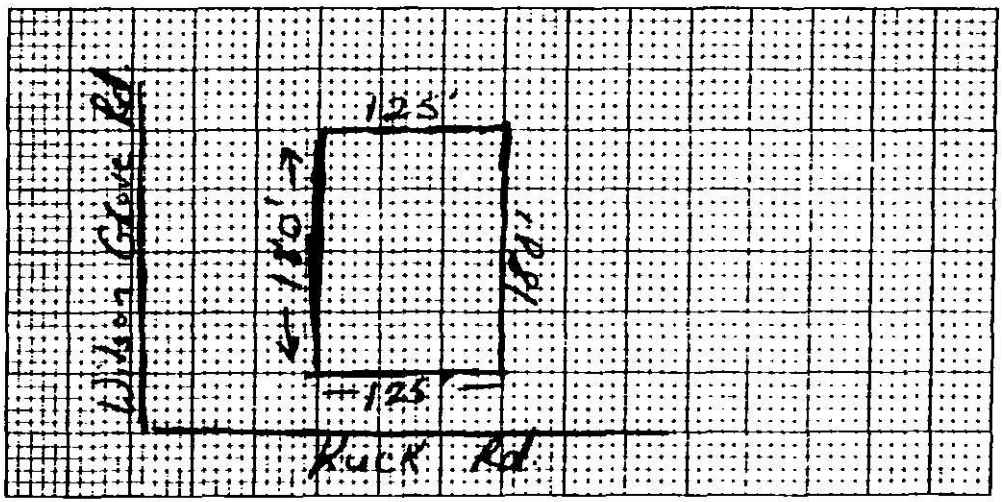

7) ACCURATELY DIAGRAM & DIMENSION LOT

Richard Gaster
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Serial No. 5322

SIR No. 20227

T. C. No. PO 137-022-01

Date Issued 11-8-83

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
SOIL INVESTIGATION REPORT

NAME OF OWNER New Faith Baptist Church
(LAST FIRST MIDDLE)

ADDRESS OF OWNER 6840 Wilson Grove Rd., Charlotte, NC ZIP 28212

LOCATION OF PROPERTY Kuck Road
(STREET OR COUNTY ROAD)

SUBDIVISION LOT NO 3 BLOCK NO. 1

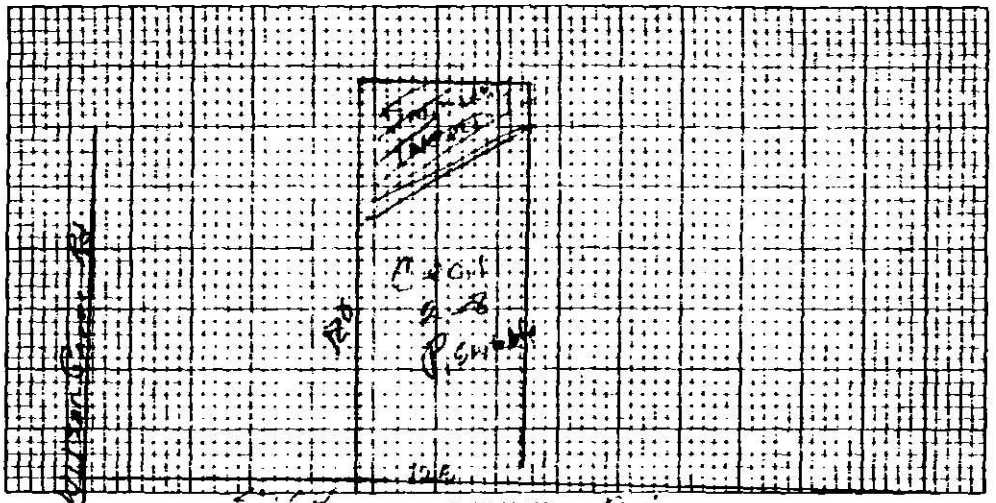

PLOT PLAN

This is to certify that a soil investigation and on-site investigation was made by the Mecklenburg County Department of Environmental Health on the lot described above. The said investigation was conducted on that portion of the lot as indicated on the above plot. **Provisionally Suitable**

The permeability rate determined by the investigation was . The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install, construct, alter or repair the specific system shall be obtained from the Mecklenburg County Department of Environmental Health prior to the beginning of any construction of buildings or of the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater treatment system which must be installed will be determined by the Mecklenburg County Department of Environmental Health prior to installation based on the permeability rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area indicated as acceptable for system installation on the above plot.
4. This approval is void of any grading, filling or construction, including the drilling of a well, is performed on the lot which in the opinion of the Mecklenburg County Department of Environmental Health renders the area indicated as acceptable for system installation unsuitable. Any installation, construction, alteration and/or repair of such a system.

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina Department of Human Resources, Division of Health Services and the Mecklenburg County Health Commission which were in effect on the date of issuance and is void if at any time in the future, prior to completion of the system, these laws, rules and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

W. B. Ramsey
Soil Scientist

Eric D. Henderson
Environmental Health Director or
Authorized Section Head

EHD-5-76

Environmental Health Department's Copy

DEPARTMENT OF ENVIRONMENTAL HEALTH
MECKLENBURG COUNTY,
NORTH CAROLINA

SITE EVALUATION

S.I.R. NO. 20227

T.C. NO. PO 137-022-01

(Ground Absorption Sewage Disposal)

OWNER: Richard Caster New Faith Baptist Church
ADDRESS: 6840 Wilson Grove Rd 28212
LOCATION OF SITE: Kuck Rd

PLAT NO:
LOT SIZE: 22,300 .51

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S (PS) U — 2-8	S (PS) U — 2-4	S PS U	S PS U
2. SOIL TEXTURE (12-36 inches) Sandy, Loamy, Clayey (Note 2-1 Clay)	S (PS) U — Clayey	S (PS) U — Clayey	S PS U	S PS U
3. SOIL STRUCTURE (12-36 inches)	S (PS) U — Blocky	S (PS) U — Blocky	S PS U	S PS U
4. SOIL DEPTH (inches)	S (PS) U — 45-48	S (PS) U — 45-48	S PS U	S PS U
5. RESTRICTIVE HORIZONS (Inches) (Impervious strata, Rock)	S (PS) U — None	S (PS) U — None	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (external and internal)	S (PS) U — Adequate	S PS (U) — Drainage way	S PS U	S PS U
7. OTHER (Specify)	S PS U	S PS U	S PS U	S PS U
8. SOIL GROUP	IVa	IVa		
9. SITE CLASSIFICATION	Pi Suitable	Un Suitable		
10. SOIL SERIES	Cecil	Drainage Way (Wet)		

S - Suitable PS - Provisionally Suitable U - Unsuitable

**See Diagram on Back (includes: soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slopes)

Recommendations/Comments:

Described by: W. B. Ramsey
Title: Soil Scientist

Date: 11-4-83

EHD 539 (Revised: 6/82)

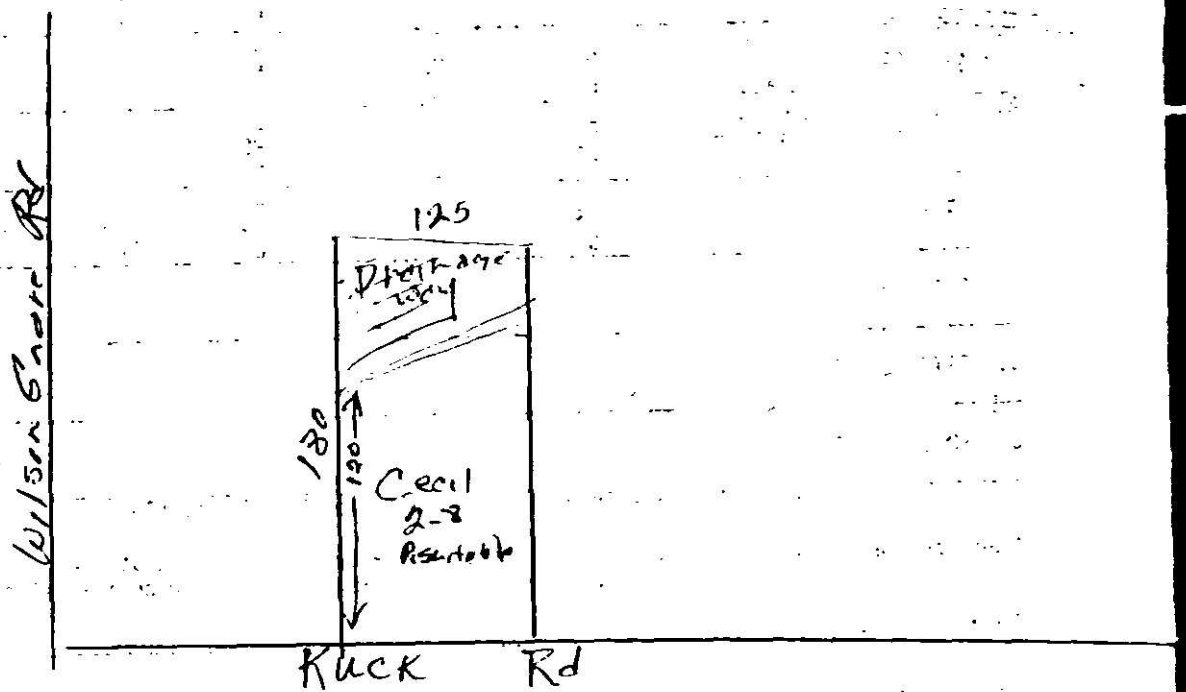
125
Drainage
Easy
180
120
Cecil
2-8
Resident
Wilson Church Rd
Kuck
Rd

Date Issued 12-7-83

Serial No. 7039

SIR No. 20227

T. C. No. PO 137-022-01

Map Date

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

TO THE BUILDING INSPECTION DEPARTMENT

APPROVAL OF LOT FOR INSTALLATION OF AN INDIVIDUAL SEPTIC TANK WITH SUBSURFACE, SOIL ABSORPTION, EFFLUENT DISCHARGE

NAME OF OWNER Seawell, (LAST) Charles (FIRST) Coy (MIDDLE)

ADDRESS OF OWNER 4201 Nonia Dr., Harrisburg, NC ZIP 28075

LOCATION OF LOT 6921 Kuck Road (STREET OR COUNTY ROAD)

SUBDIVISION _____ LOT NO. 3 BLOCK NO. 1

MAP BOOK NO. _____ PAGE NO. _____

The above specified lot is approved by the Mecklenburg County Department of Environmental Health for the installation of an individual septic tank system with subsurface, soil absorption, effluent discharge based on the soil investigation, on an on-site inspection of the said lot; and upon the information supplied in the "Application for an Installation, Construction, Alteration, and/or Repair Permit", number 20227. This approval is subject to the following terms and conditions:

1. That the nitrification field be installed, constructed, altered and/or repaired in the same area where the soil investigation was run.
2. That an "Installation, Construction, Alteration, and/or Repair Permit" be issued and in full force and effect when the system is installed, constructed, altered, and/or repaired and that the system be installed in accordance with same.

This approval may be revoked and the building inspection department requested to revoke any building permit(s) which have been issued to authorize construction on the said lot if at any time it is determined that any information contained in the "Application for an Installation, Construction, Alteration, and/or Repair Permit" is not correct or is untrue or that the septic-tank system is not being installed, constructed, altered and/or repaired in accordance with a valid Installation, Construction, Alteration, and/or Repair Permit.

Environmentalist

Environmental Health Director, or Authorized Section Head

EHD-S-76

Environmental Health Department's Copy

SIR No. 20227

Charles C. Seawell

6921 Kuck Rd

Charlotte, N.C.

MR KIRBY

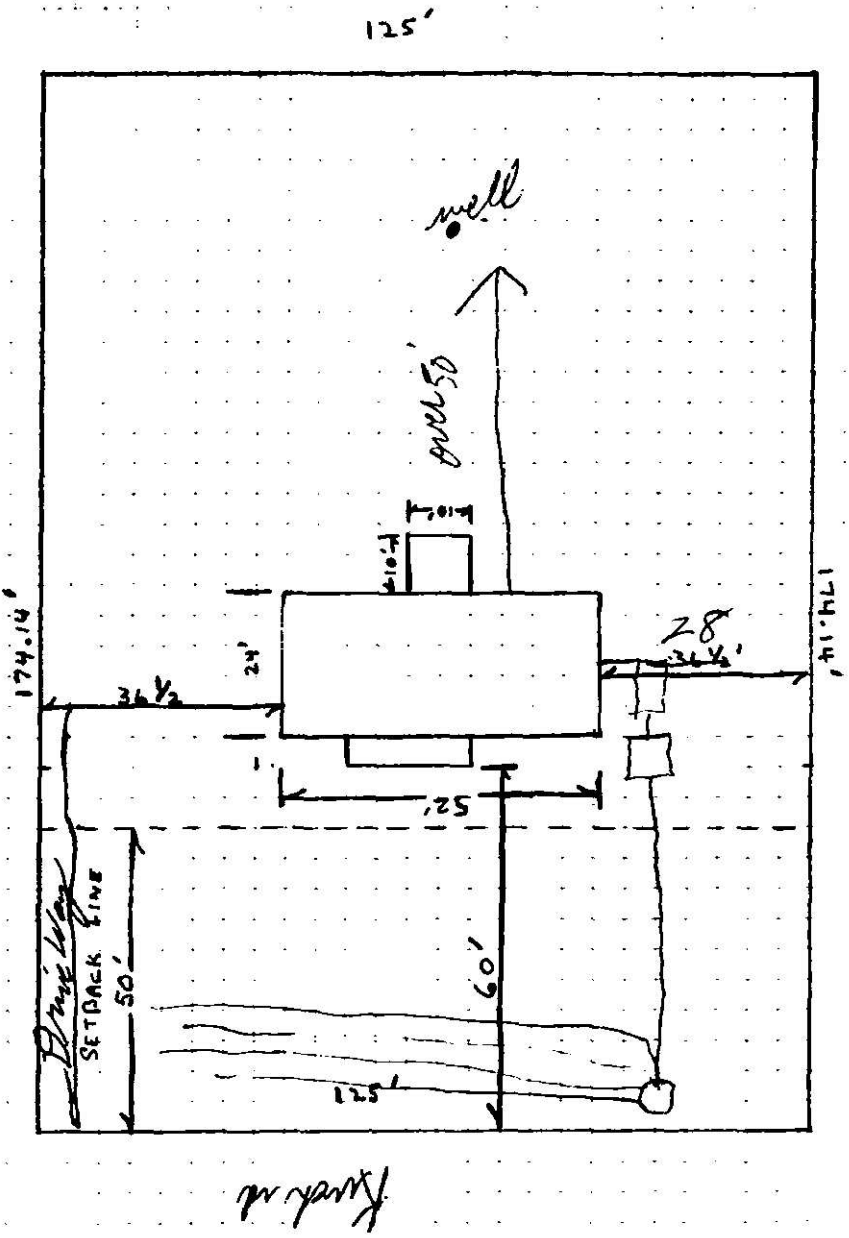

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 20227 DATE: 7-29-86

TC: 137-022-01 9L

SERIAL № 10239

Permission is hereby given to ✓ Install or Construct, ____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 12-6-85. All work shall be completed on or before 8-29-86, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Department of Environmental Health before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

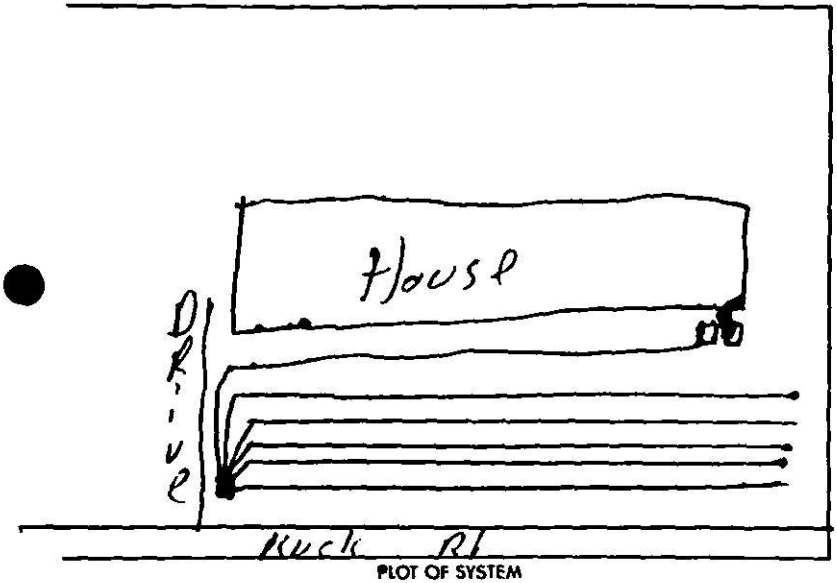

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank 1000 gallons

Tank Construction PCC

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 400 feet

Number of Lines Five

Depth of Stone 12 inches

Distance from House 5 feet

Distance from Property Line 10 feet

Distance from Well 50 feet

NAME OF OWNER Segwell, Charles

LOCATION OF PROPERTY 6921 Ruck Rd.

Comments: Five Trenches 60'x3'x12" stone
VS- 4" Sch 40 Pipe from D-Box to Trench

J R Adkisson
Division or Section Head

Jim Greene
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - ENVIRONMENTAL HEALTH DEPARTMENT'S COPY ● CANARY - ENVIRONMENTALIST'S COPY ● PINK - OWNER OR AGENTS COPY

C of A (s) No. 20227

Date Issued 8-4-86 **Serial** 8772 T. C. No. 137-022-01

L CKT

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Seawell, Charles
LAST FIRST MIDDLE

Location of Property 6921 Kuck Rd.

Application Number 20227 Permit Number 20227

Inspection Data:

Liquid Capacity of Tank 1500, 1000 gals. Tank Material PCC

Total Length of Drain Tile 400' Number of Lines Five

Depth of Filter Material 12" Cover Depth 18"

Water Supply Source Well Distance from Water Source 750'

Excavation Inspected — DATE Tank Inspected 8-4-86 DATE

Nitrification Field Inspected 8-4-86 DATE

Washing Machine Line Inspected, If Applicable — DATE

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been ✓ installed or constructed, ——— altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments 1986, 1500ST, 1000DT, PI, Con, 1200SFT, 126, Ceo!

Jim Evans
Environmentalist

EHD-5-76

Environmental Health Department Copy