Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 40048 Permit #: 5155 Tax Parcel #: 023-151-34

Property Owner: Shannon Jordan

Job Location Address: 3033 Nance Cove Road

City: Charlotte State: NC Zip Code: 28214

Operation Permit Issuance Date: 6/21/12 Contractor Name: Wally Christenbury

Permitted Design Flow: 360 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Effluent Pump Model: Zoeller 4/3

Drainfield Installation ☐ N/A

Trench Depth: 24 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 304 feet

# of Lines: 4 @ 76 feet

Depth of Media: 12 inches (Type) IQ4W

Depth of Cover: 12 inches

Distribution Device: P. Mumford

Inspection Dates

Tank(s) Inspected: 6/21/12

Excavation Inspected: 6/21/12

Pump & Controls Inspected: 6/21/12

Bed Installation *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet


# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

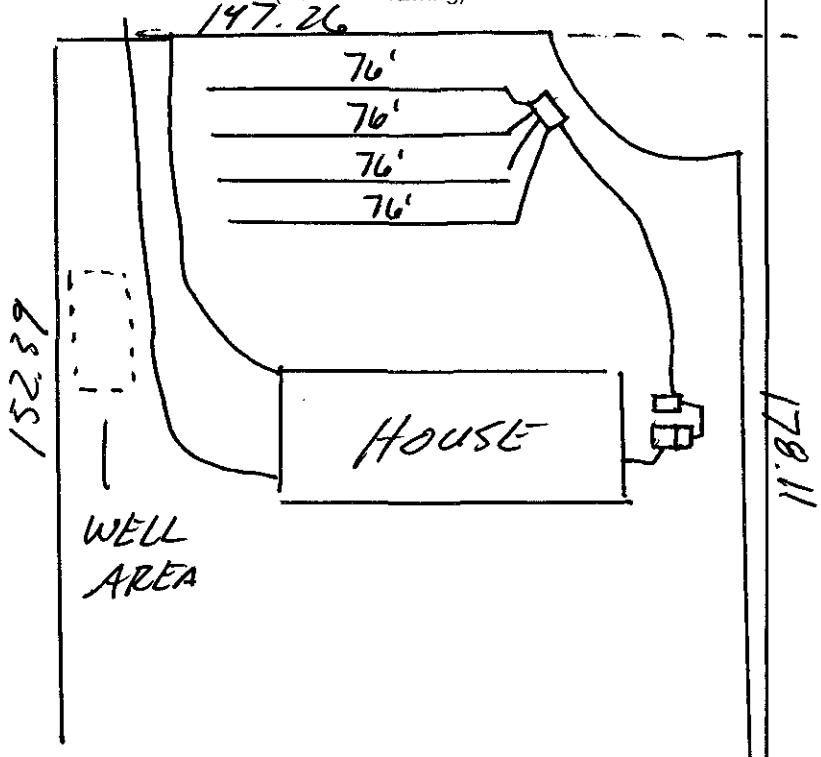

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: >5' feet

Distance from Property Line: >10' feet

Distance from Water Supply Source: NOT YET DRILLED (Well)

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: 1116, IQ4W, Pressure, NA, NA

DENR Authorized Agent: Jeremy Mulkey, REHS Signature: Jeremy Mulkey REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 4004B Permit #: 5155 Tax Parcel #: 023-151-34

Property Owner: Shannon Jordan

Job Location Address: 3033 Nance Cove Road

City: Charlotte State: NC Zip Code: 28214

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the *contents* of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIb

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☐ System does not require inspection by GWS on a routine frequency.

☒ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Jeremy Mechek, REHS Date: 6/21/12

Signature: Jeremy Mechek, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 40048 Permit #: 5155 Tax Parcel #: 023-151-34

Property Owner: SHANNON JORDAN

Job Location Address: 3033 Nance Cove Road

City: CHARLOTTE State: NC Zip Code: 28214

Installation Approval Issuance Date: 6/7/12

Permission is hereby given to ☒ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 7/7/12, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD

Site LTAR: 0.3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: 1000 gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 300 feet

# of Lines: 4 @ 75' feet

Depth of Media: 12 inches (Type) 25% REP.

Distribution Device: P. MANIFOLD

Bed Design *(For Repair Installations ONLY.)* ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 75' feet

Distance from Property Line: 710' feet

Distance from Water Supply Source: >50' feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

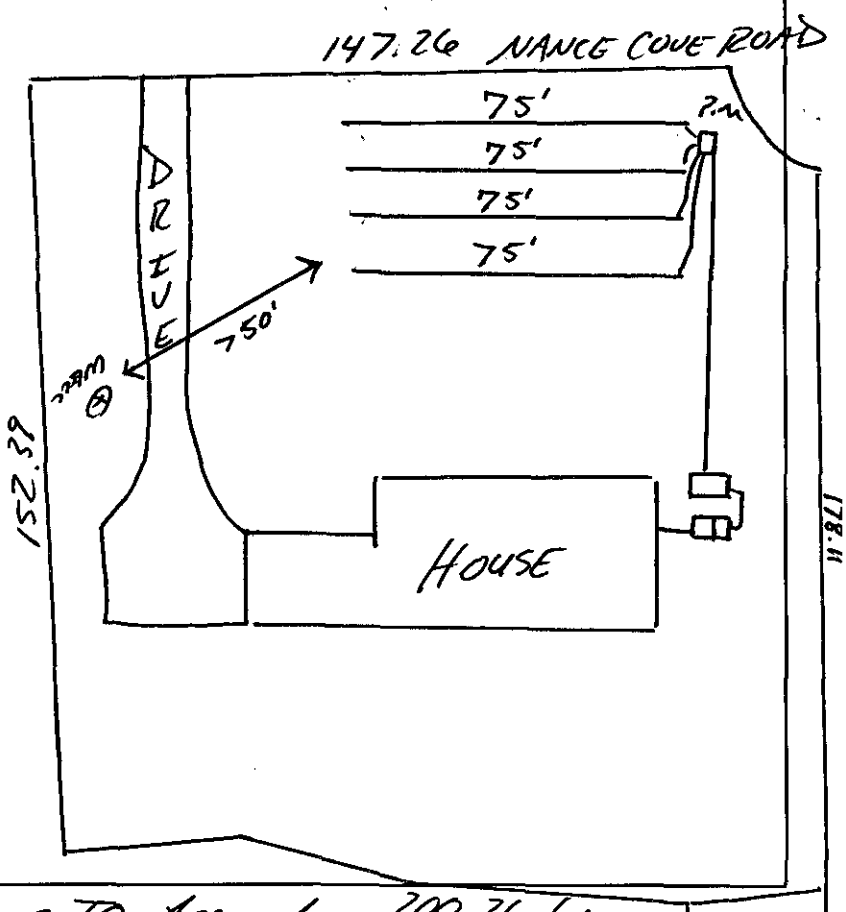

Comments: System Classification & Type: III Pump TO Approved

DENR Authorized Agent: Jeremy Michael Betts Signature: Jeremy Michael Betts

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Page 1
Property ID: 023-151-34
Lot #: 44
File #: 4004B
AppID: 5050

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: Shannon Jordan
Applicant: Shannon Jordan
Address: 3033 Nance Cove Road
Date Evaluated: 5/12/11
Proposed Facility: Residence
Design Flow (.1949): 360 GPD
Property Size: 0.80 acre
Location of Site: 3033 Nance Cove Road
Property Recorded:
Water Supply: [ ] Public [x] Individual [x] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941 Structure/ Texture	SOIL MORPHOLOGY 1941 Consistence Mineralogy	b PROFILE FACTORS 1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz	Profile Class & LTAR
1	LS	0-2	GR/SCL	FR/SS/SP/SEXP	>48' TO SOIL WETNESS	48	NA	NA	PS
	7%	2-48	SBK/C	FI/S/P/SEXP					IV
									0.3 G/D/FT2

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	III b	III b
Site LTAR	0.3	0.3

Other Factors (.1946):
Soil Evaluation By: Jeremy Michelone, R.S
Others Present: Shannon Jordan
Site Classification (.1948): PS
Site Evaluation By: Jeremy Michelone, R.S
Others Present: Shannon Jordan


Jeremy Mich. R.S.

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace				
FP-Flood Plain		CL-Clay Loam		
		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		


Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

SOIL EVALUATION
3033 NANCE COVE ROAD
FILE # 4004B

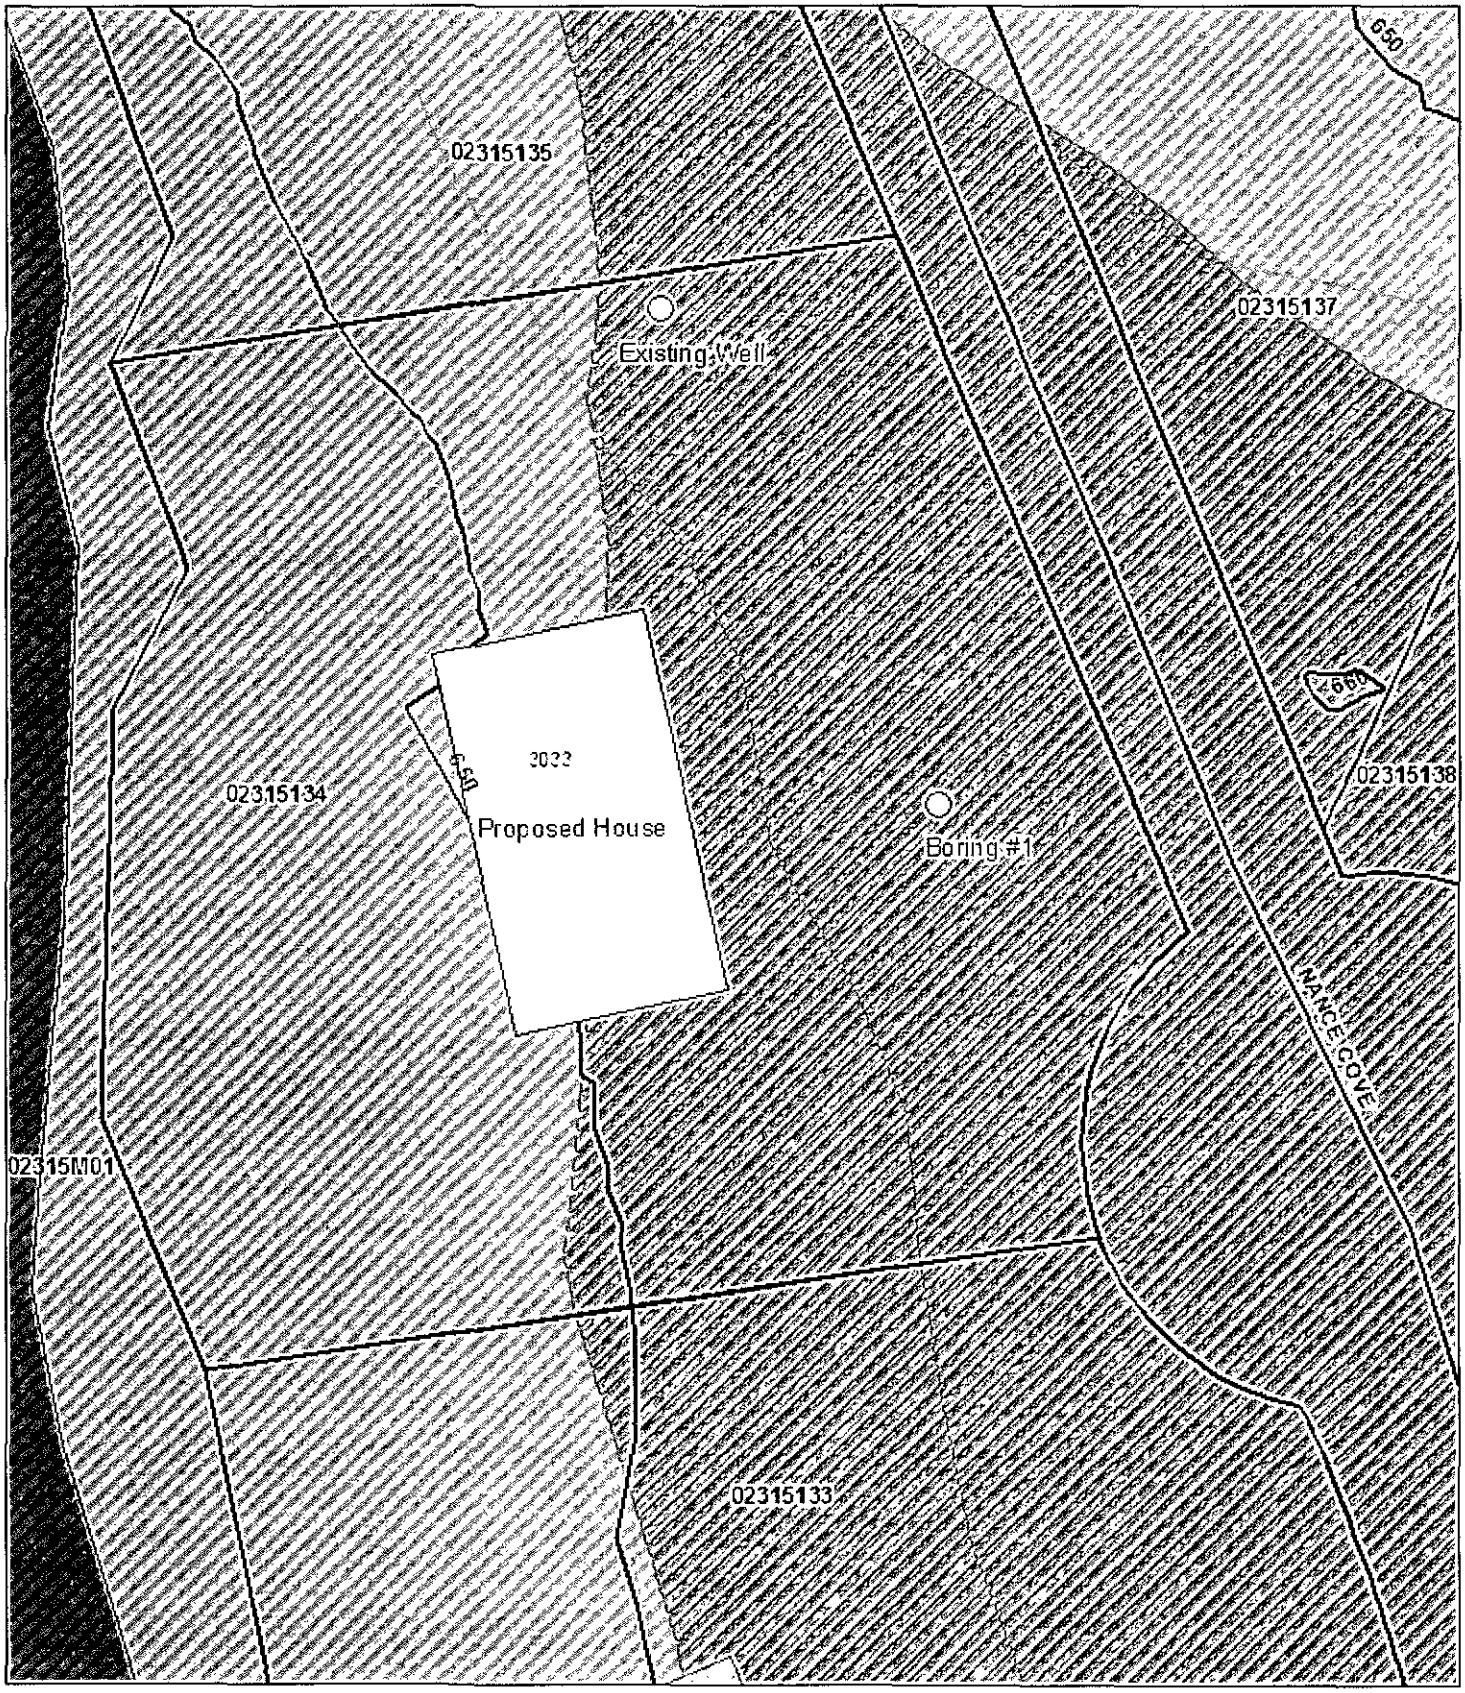

Jeremy Michelone, R.S.
May 12, 2011

0 20 40 80 Feet

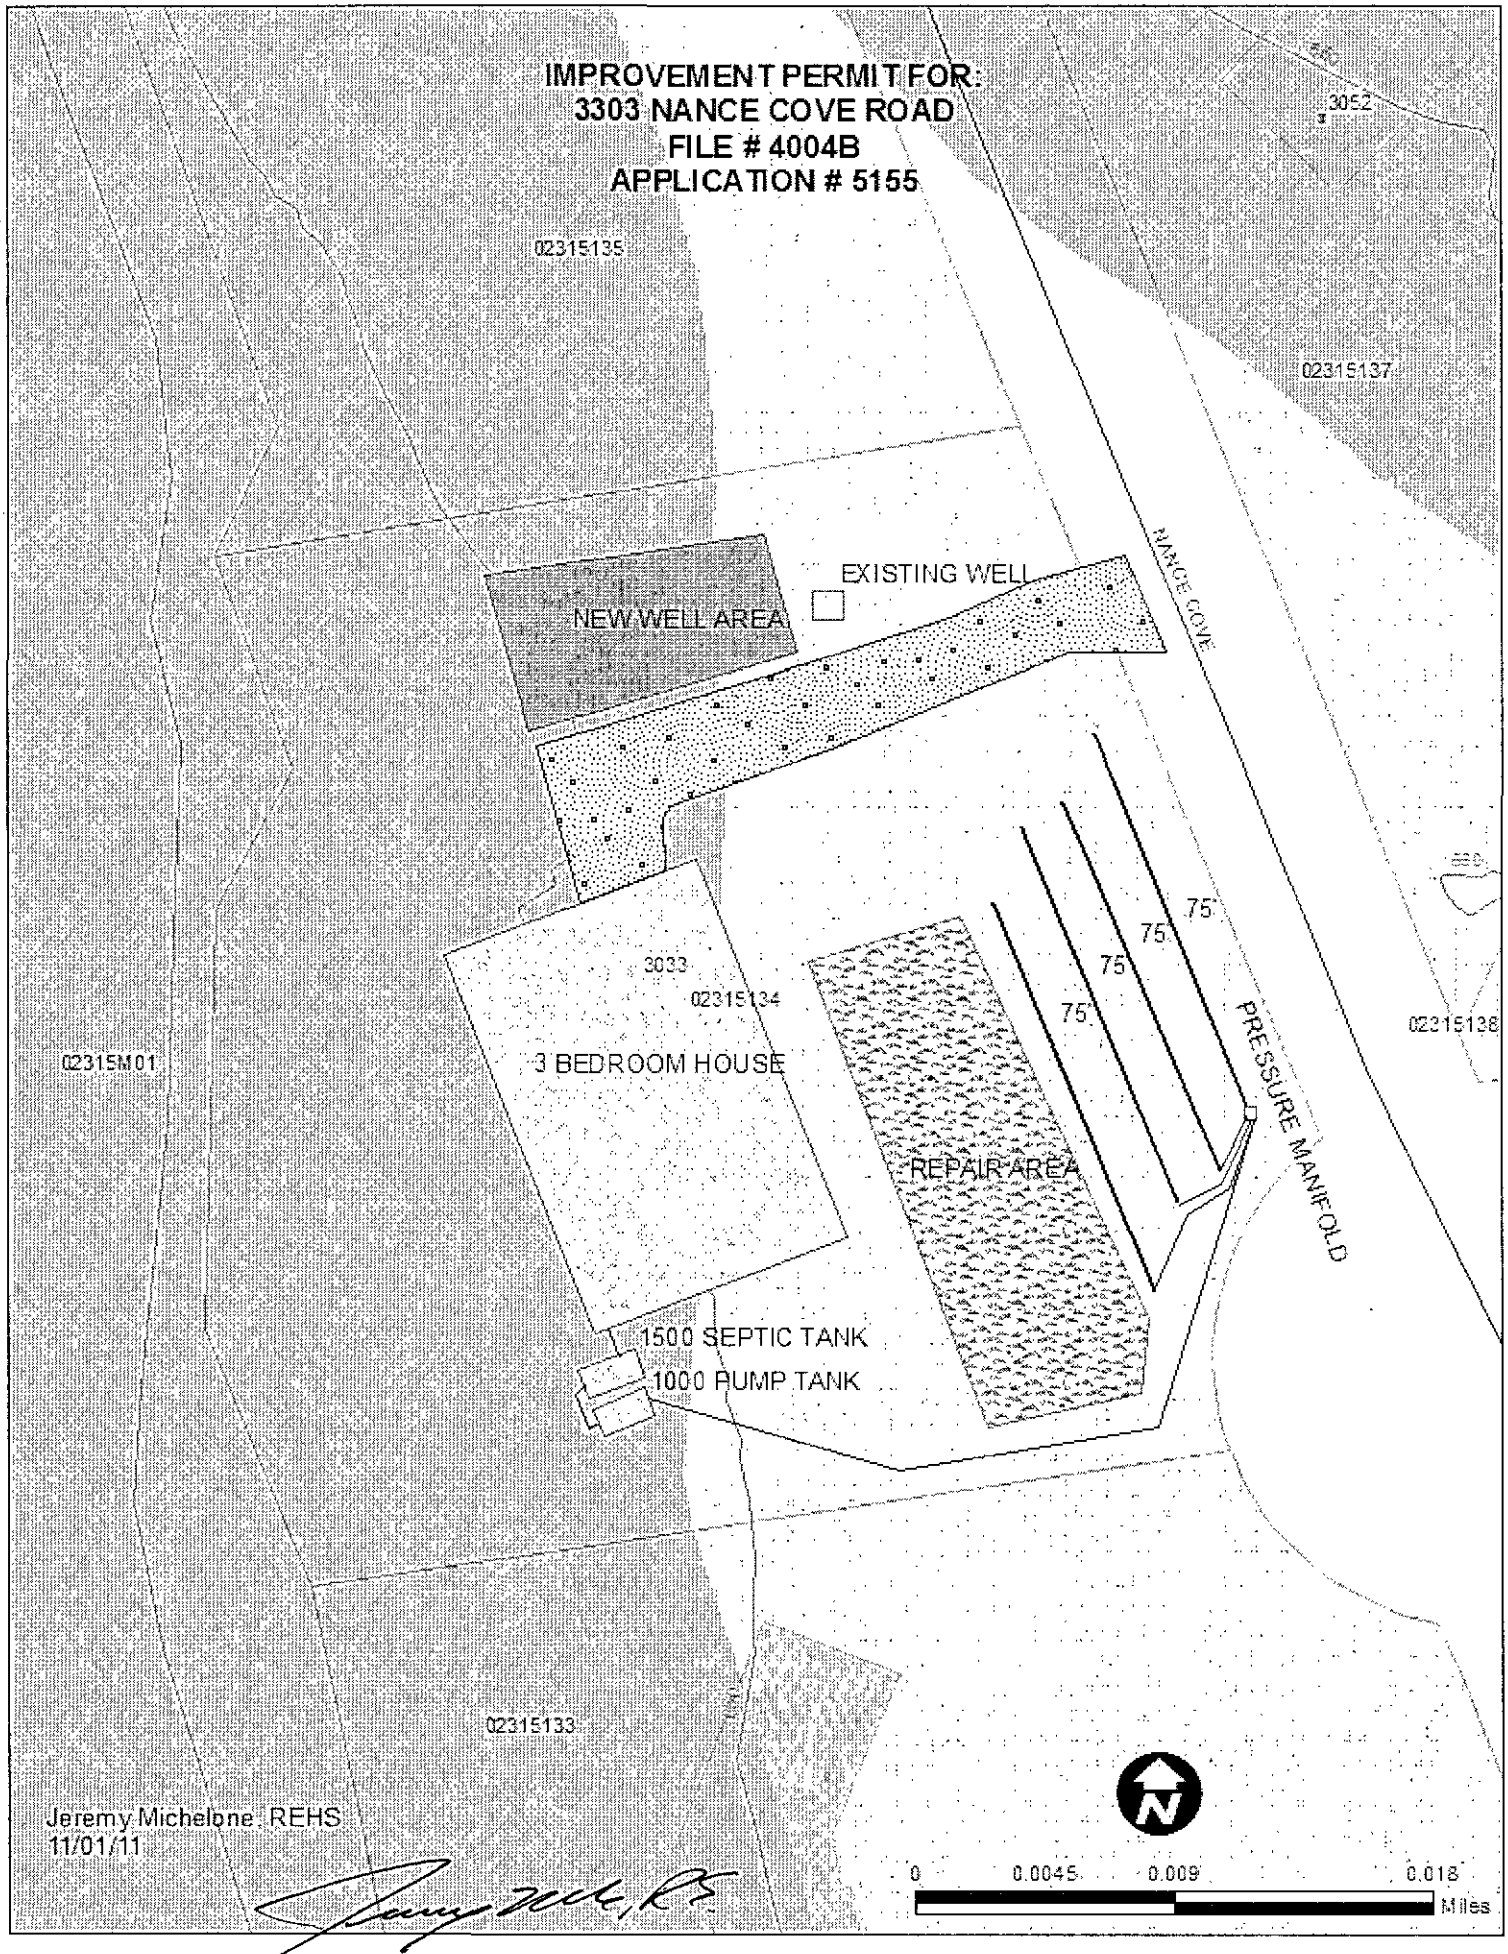
IMPROVEMENT PERMIT FOR:
3303 NANCE COVE ROAD
FILE # 4004B
APPLICATION # 5155
3052
02315135
02315137
NANCE COVE
EXISTING WELL
NEW WELL AREA
75'
75'
75'
75'
3033
02315134
02315138
02315M01
3 BEDROOM HOUSE
REPAIR AREA
PRESSURE MANIFOLD
1500 SEPTIC TANK
1000 PUMP TANK
02315133
Jeremy Michelone REHS
11/01/11
0
0.0045
0.009
0.018
Miles

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30005155** GWS File #: **4004B** Tax Parcel #: **023-151-34**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 8/2/2016

Type of Installation: Residential - New System Lot Number: 0

Structure Type: HOUSE Size (ft^2): 2907 # Bedrooms: 3 # Occupants: 2

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Pump to Approved **System Classification:** IIIb

Initial System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	900	Total Trench Length (ft):	300
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

III. Repair System Type: Pump to Approved **System Classification:** IIIb

Repair System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.3	Septic Tank Size (gal):	1500	Pump Tank Size (gal):	1000
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	900	Total Trench Length (ft):	300
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Pressure Manifold		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the Department.
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

DENR Authorized Agent: Jeremy Michelone Owner/Legal Agent: _____
Print Name

Signature: _____ Signature: _____

Date Issued: 8/2/2011

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30005155** GWS File #: **4004B**

IV. Permit Conditions/Comments:

- This type of septic system requires an inspection once every 5 years by our office. The system owner is responsible for any fees, as determined by the Mecklenburg County Board of Commissioners, associated with this inspection.
- All components of the septic system must be located a minimum distance from the normal pool elevation or mean high water mark for the nearby body of water. See plot plan for minimum setback requirements.

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until an INSTALLATION APPROVAL is granted by the *Department.*
- The septic system installer shall be a registered septic contractor with Mecklenburg County Health Department.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.


DENR Authorized Agent: Jeremy Michelone

Signature: _____

Date Issued: 8/2/2011

Owner/Legal Agent: _____
Print Name

Signature: _____

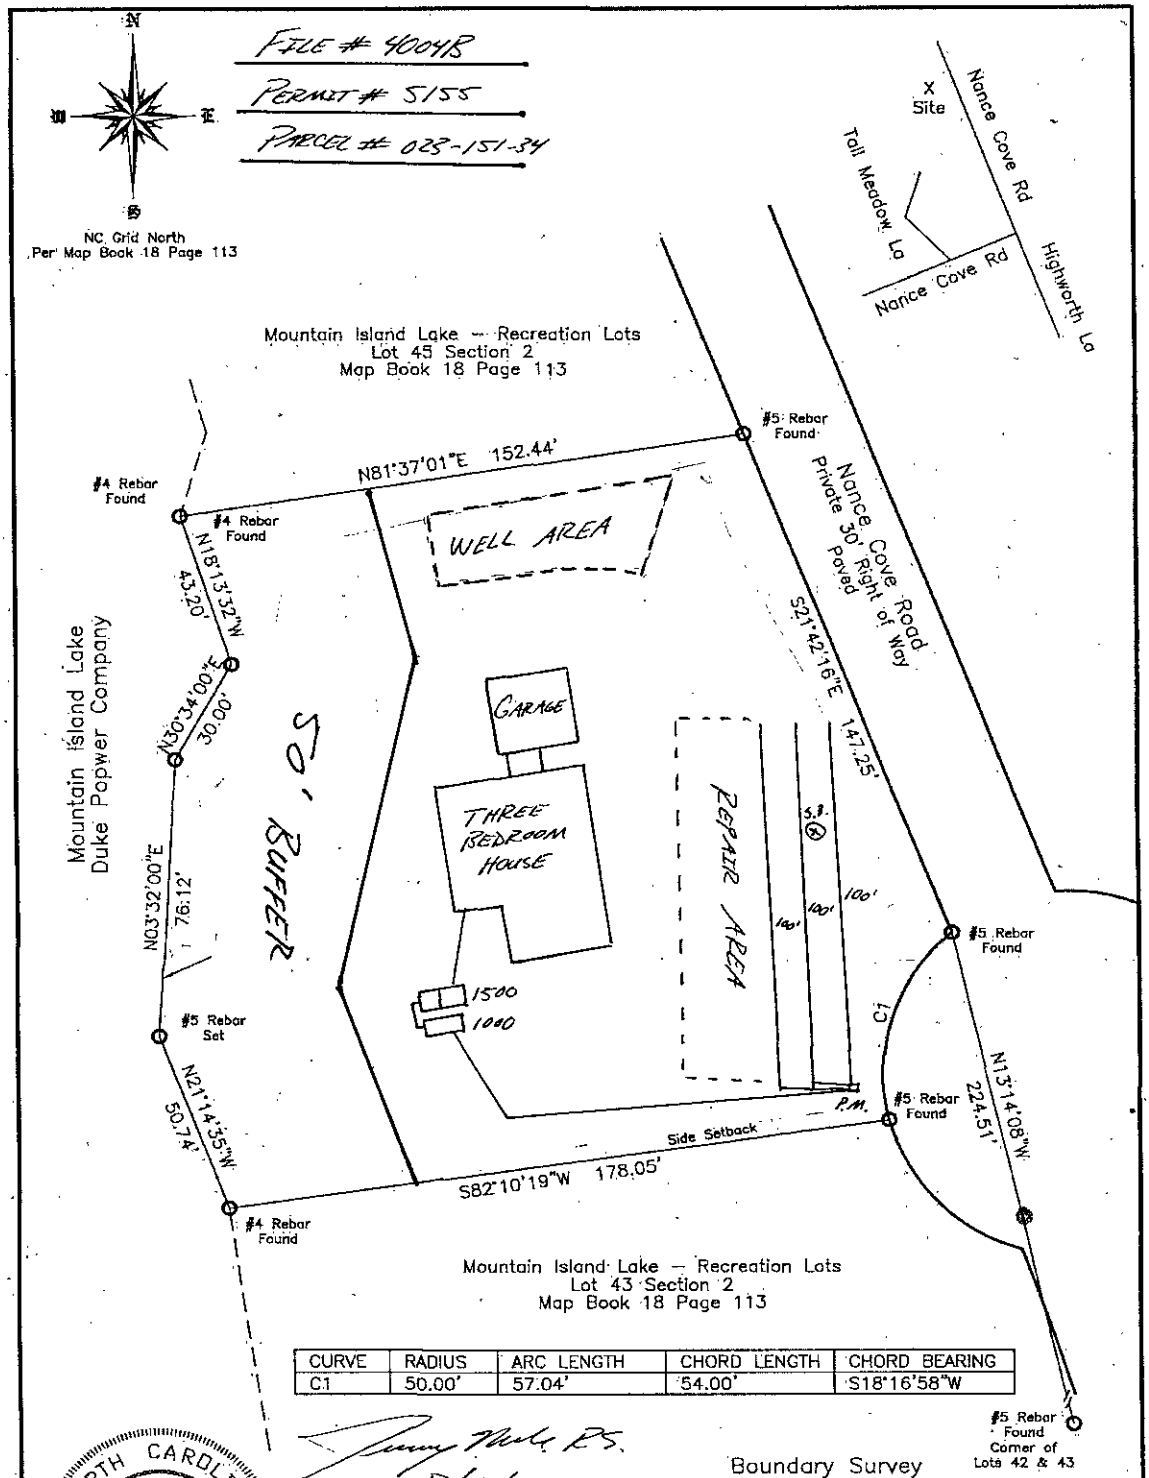

CURVE	RADIUS	ARC LENGTH	CHORD LENGTH	CHORD BEARING
C1	50.00'	57.04'	54.00'	S18°16'58"W

NORTH CAROLINA PROFESSIONAL SEAL L-2593 LAND SURVEYOR THOMAS E. MONTGOMERY

8/2/11

Boundary Survey
3033 Nance Cove Road
Mountain Island Lake — Recreation Lots
Lot 44 Section 2
Map Book 18 Page 113
Shannon N. Jordan — Owner
Paw Creek Township, Mecklenburg County, NC
June 2, 2011 Scale 1" = 40'

0' 40' 80' 120'


NOTE: Ratio of Precision of field survey is 1/15,000. Area computed by DMD method.


NOTE: Zoning is R-5 and setback information was taken for Charlotte Zoning Ordinance page 9-12 & Mountain Island Lake Watershed Overlay District CA4 was taken from page 10-26 Approval from Zoning Board is required before house construction begins.

6/4/11

Thomas E. Montgomery NCPLS L-2593

Thomas E. Montgomery
NC Professional Land Surveyor L-2593
PO Box 2575
Davidson, NC 28036
704/892-9620

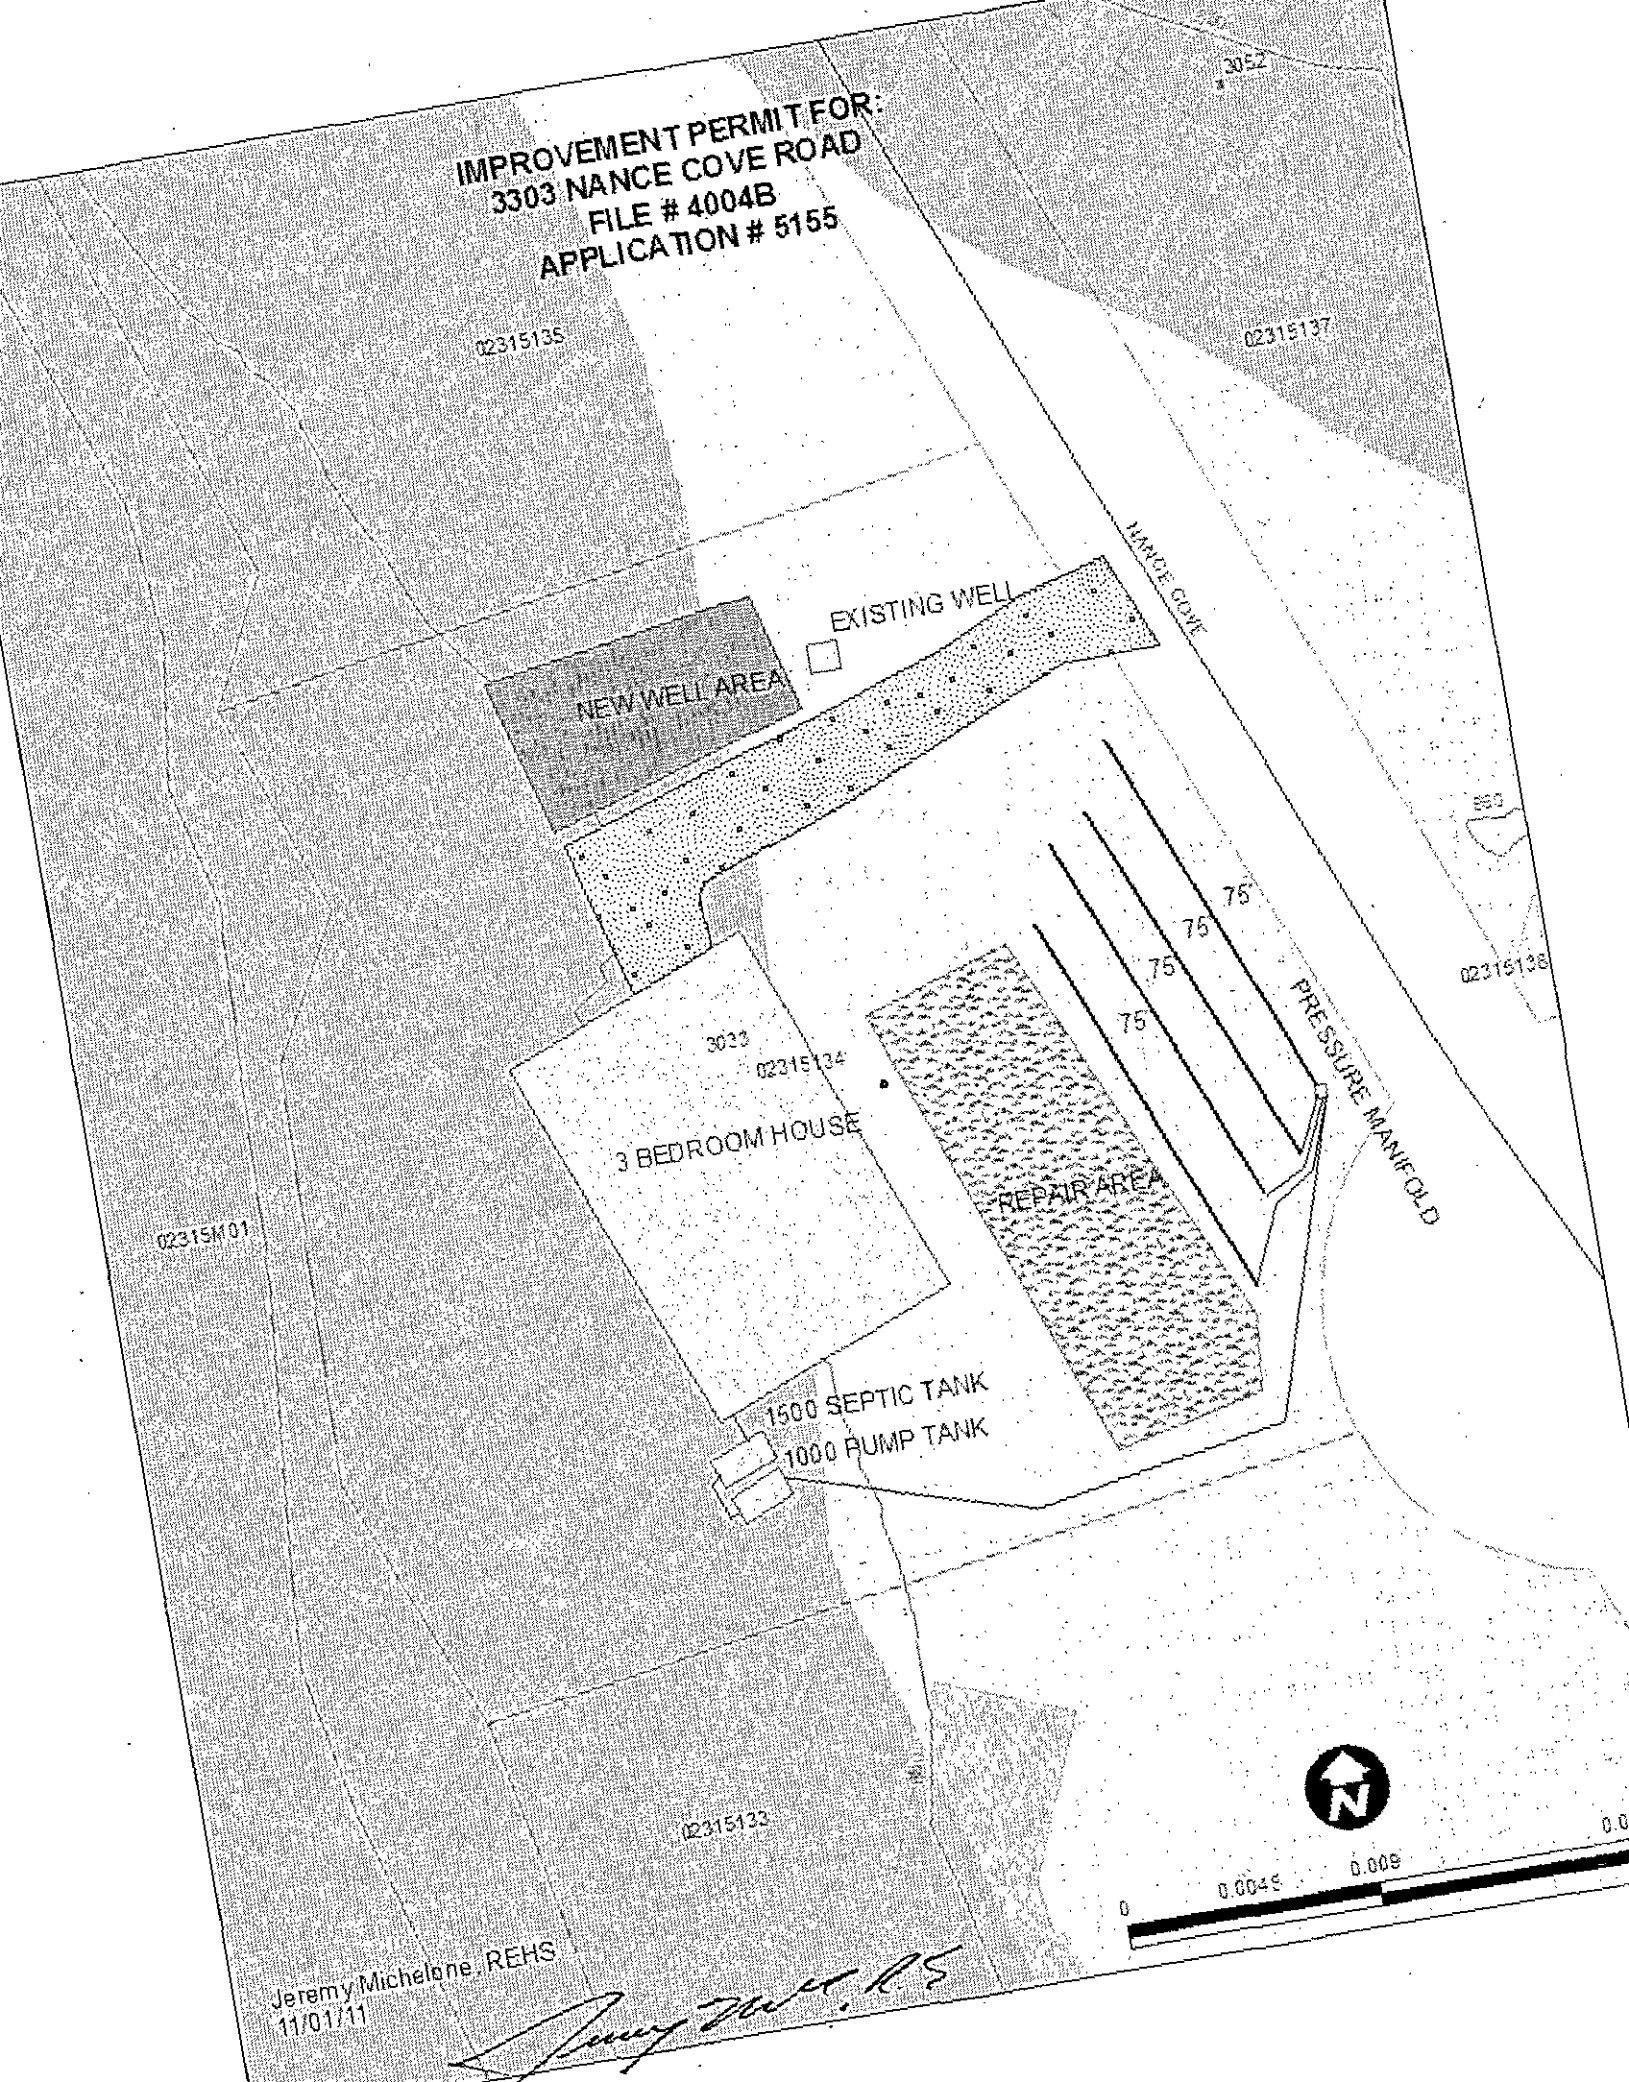
IMPROVEMENT PERMIT FOR:
3303 NANCE COVE ROAD
FILE # 4004B
APPLICATION # 5155
02315135
02315137
3052
NANCE COVE
EXISTING WELL
NEW WELL AREA
75'
75'
75'
PRESSURE MANIFOLD
02315138
3033
02315134
3 BEDROOM HOUSE
REPAIR AREA
02315M01
1500 SEPTIC TANK
1000 PUMP TANK
02315133
N
0
0.0045
0.009
Jeremy Michelone, REHS
11/01/11

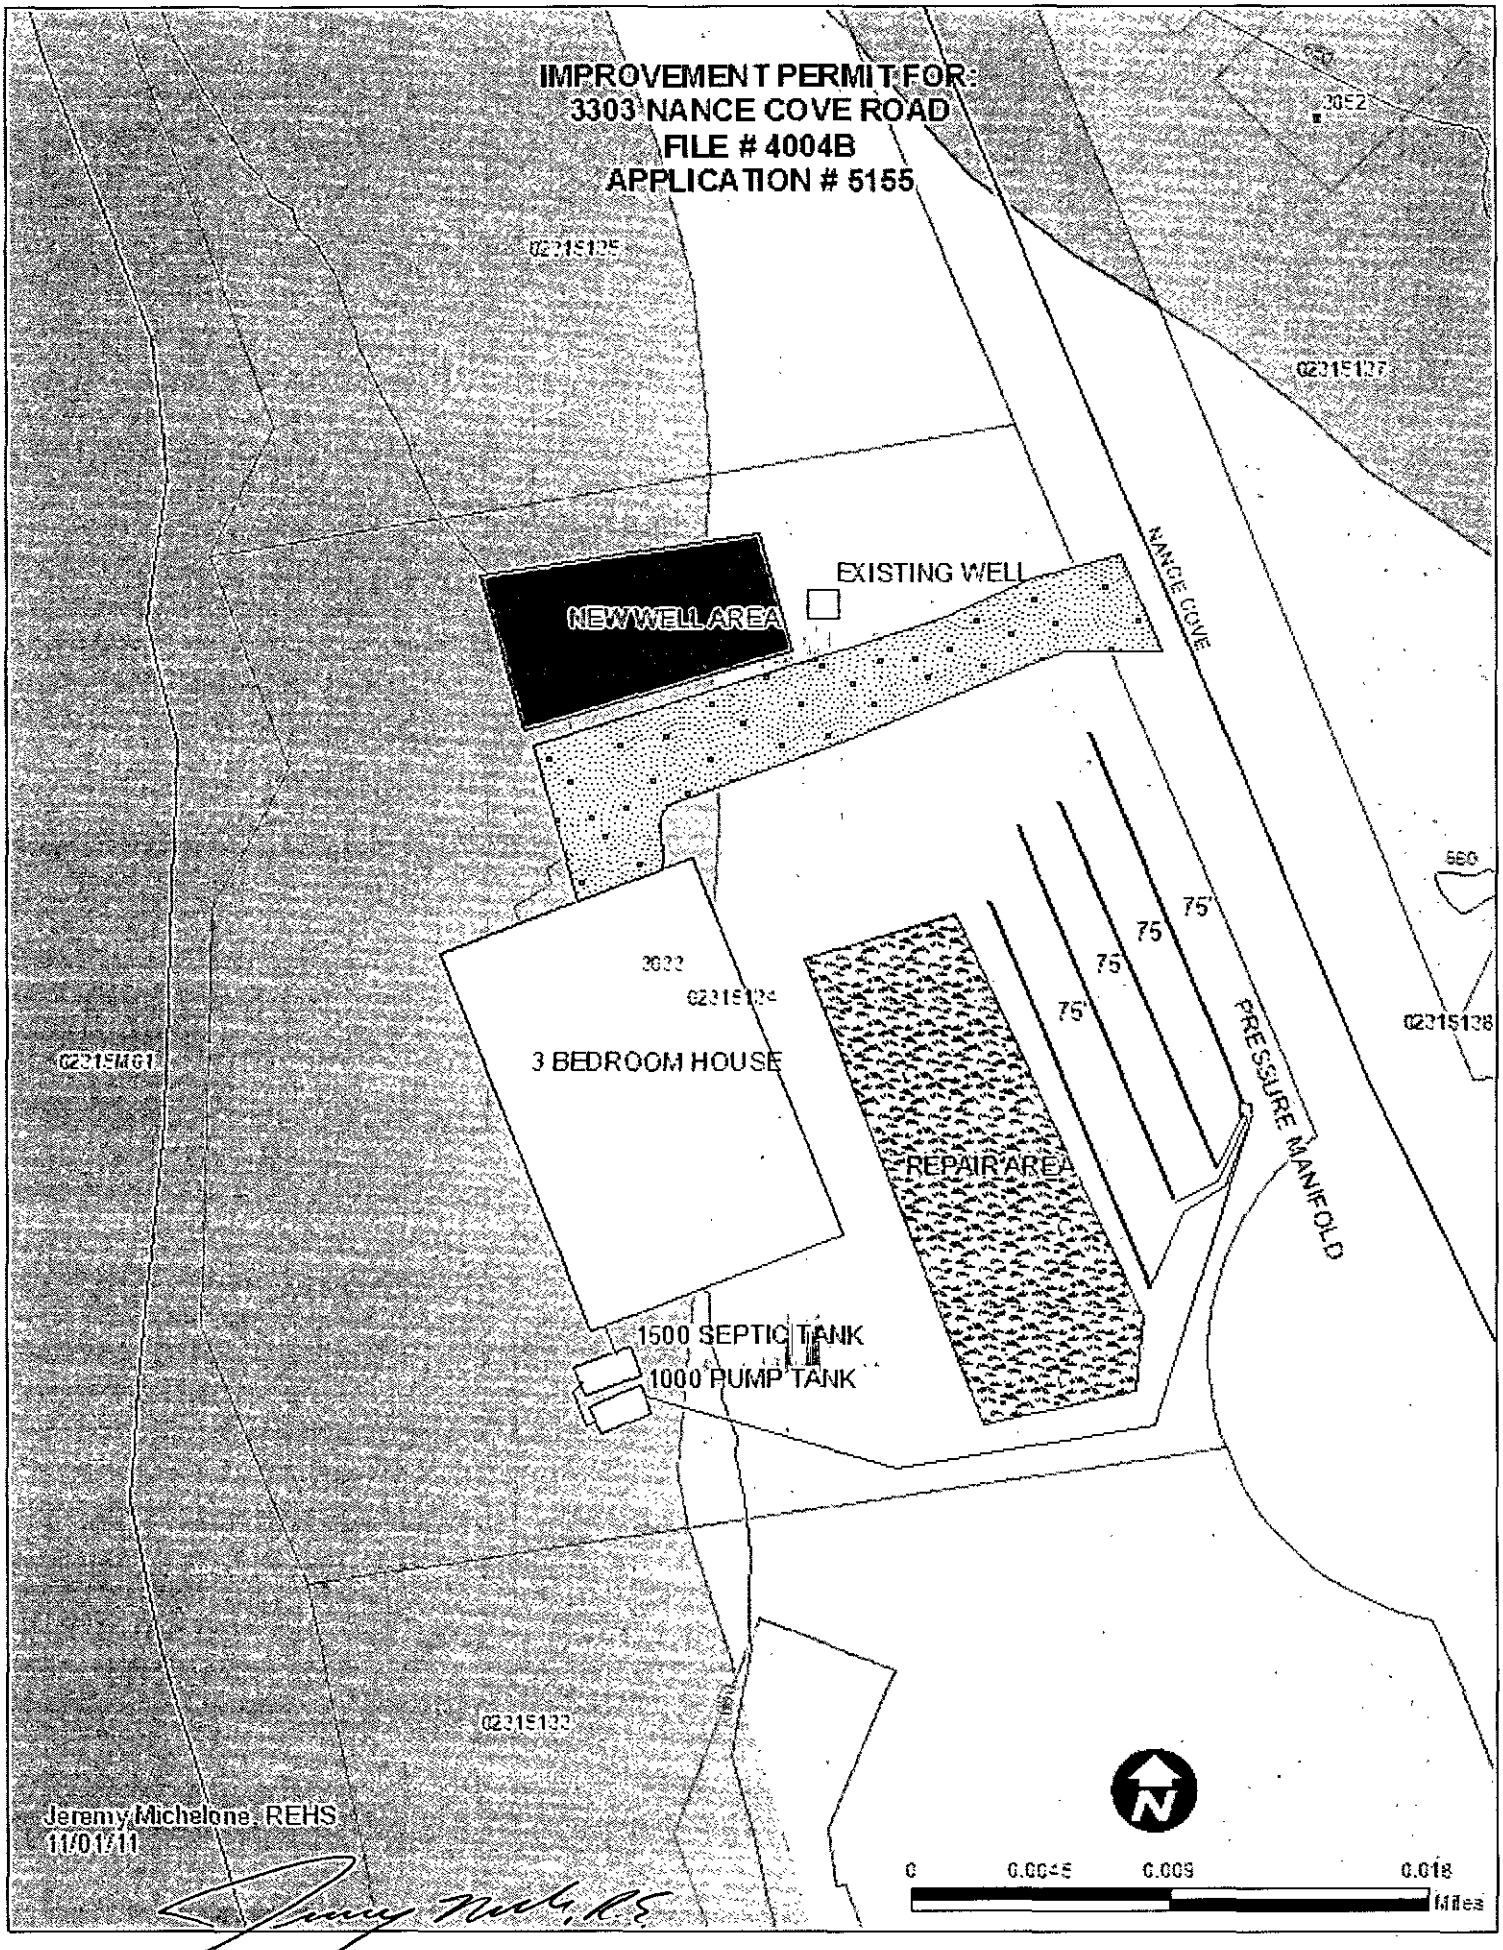
IMPROVEMENT PERMIT FOR:
3303 NANCE COVE ROAD
FILE # 4004B
APPLICATION # 5155
NEW WELL AREA
EXISTING WELL
NANCE COVE
3 BEDROOM HOUSE
1500 SEPTIC TANK
1000 PUMP TANK
REPAIR AREA
PRESSURE MANIFOLD
75'
75'
75'
75'
Jeremy Michelone, REHS
11/01/11
0
0.0045
0.009
0.018
Miles

4004B

MECKLENBURG COUNTY
HEALTH DEPARTMENT

JM

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ◉ NEW SYSTEM ◉ ALTERATION ⊙ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ○ N/A ○ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 02315134A
STREET ADDRESS: 3033 Nance Cove Rd
CITY: Charlotte
STATE: NC **ZIP:** 28277
SUBDIVISION NAME:
LOT #: 44 **LOT SIZE (acres):**
TOWNSHIP: Stc 2

⊙ MECKLENBURG ○ CORNELIUS ○ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:

BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
⊙ HOUSE ○ OTHER

HEATED SQUARE FOOTAGE: 2,907
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2

FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
⊙ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☐ N/A

NUMBER OF BEDROOMS TO BE ADDED: NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE:

6. WATER SUPPLY: ○ MUNICIPAL ⊙ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER

7. PROPOSED USE OF WELL: ○ N/A ○ IRRIGATION ⊙ POTABLE (DRINKING WATER) ○ OTHER

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED):*

☐ N/A ☑ ANY TYPE ☑ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER

8A. RANK: 1 2 3 4 5

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ⊙ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ⊙ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	◉ YES ○ NO	JURISDICTIONAL WETLANDS	○ YES ⊙ NO
WELLS, SPRINGS, OR WATER LINES	⊙ YES ○ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ⊙ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ⊙ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ⊙ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ○ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ⊙ NO
WASTE STORAGE	○ YES ⊙ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	⊙ YES ○ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? 3/4/96 ☐ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? ☑ N/A

12. PROPERTY OWNER:

NAME: Shannon Jordan
ADDRESS: 9315 #C Otter Creek Dr
CITY: Charlotte
STATE: NC ZIP: 28277
WORK PHONE: (864) 517-8933
MOBILE PHONE: (707) 614-0711
FAX:
E-MAIL: shannon.jordan@fedex.com

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME:
ADDRESS:
CITY:
STATE: ZIP:
WORK PHONE:
MOBILE PHONE:
FAX:
E-MAIL:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. *Authorized county and state officials* are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

SNJ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct *necessary inspections to determine compliance* with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

X _____ 5/10/11

Property Owner's or Owner's Legal Representative Signature — Date

---

OFFICE USE ONLY

O SURVEY PLAT TO SCALE SUBMITTED O SCALED SITE PLAN SUBMITTED O UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ 300.00 ck# 467 DATE FEE RECEIVED: 5/16/11

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: JC lws

GWS FILE NUMBER ASSIGNED: 400488

APPLICATION ID NUMBER ASSIGNED: 5050 / 5334

Pd #350 more on 11/9/11 CK#479

COMMENTS:

11/9/11 #50 will be applied to CA + OP – new system needed. L Sader

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10

5050


File #: 4004B

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 3033 Nance Cove Rd Tax Parcel #: 02315134A

Subdivision Name: _____ Lot #: _____

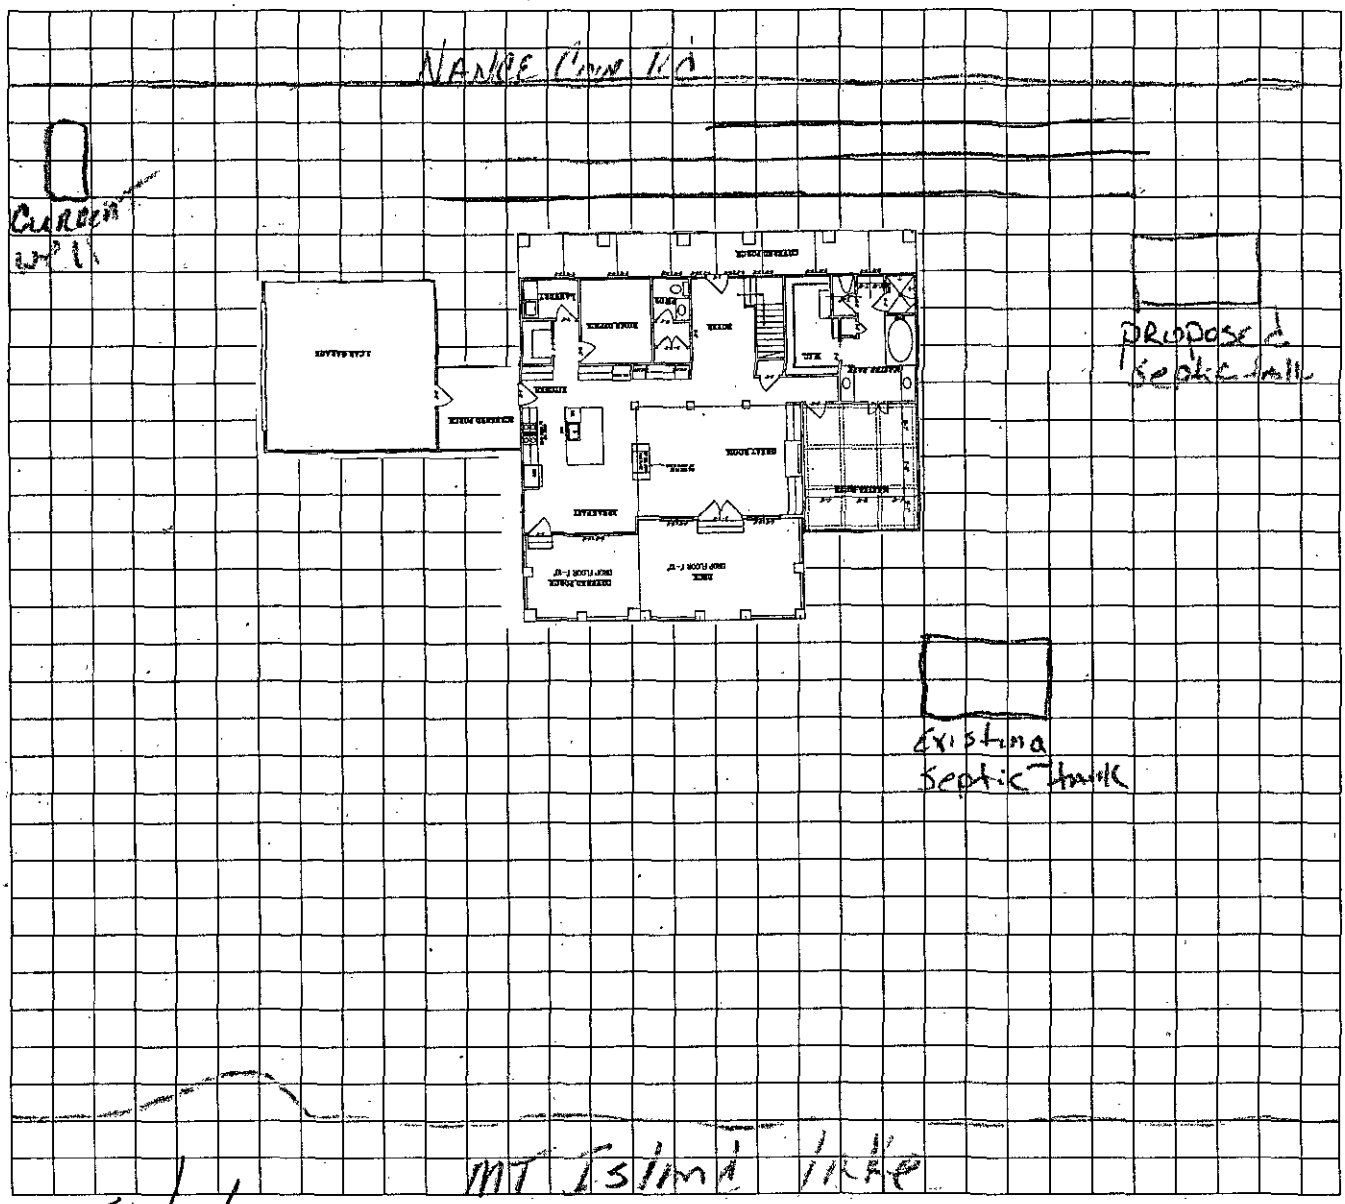

Property Owner's or Owner's Legal Representative Signature

5/10/11
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 12/15/10