

15340 BLACK FARMS RD

01107312

1/10/2008

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 6661 B Permit #: _____ Tax Parcel #: 01107312

Property Owner: The Bainbridge Crew

Job Location Address: 15340 Black Farms Rd.

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: 10/10/06 Contractor Name: _____

pmt 10/16/06

Permitted Design Flow: 360 GPD

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: N/A gallons

Effluent Pump Model: N/A

Drainfield Installation ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 300 feet

# of Lines: 3 @ 100 feet

Depth of Media: N/A inches (Type) EZ-Flow

Depth of Cover: 12 inches

Distribution Device: D-Box

Inspection Dates

Tank(s) Inspected: 10/10/06

Excavation Inspected: 10/10/06

Pump & Controls Inspected: _____

Bed Installation *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet


# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

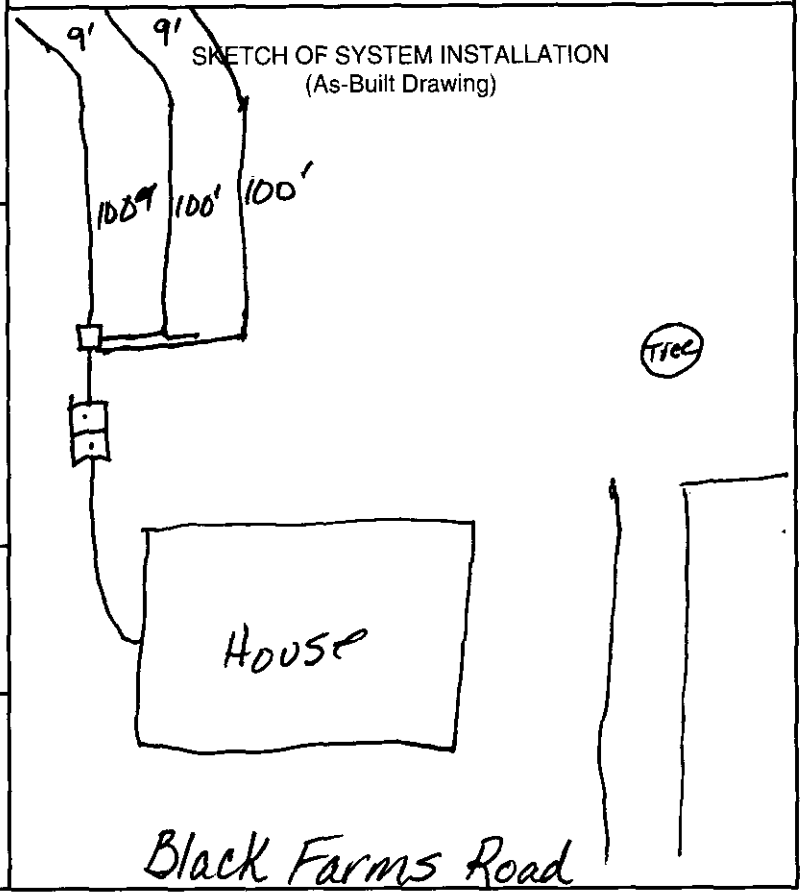

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: >50 feet

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☑ installed ☐ altered ☐ repaired ☑ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: Type III g innovative EZ-Flow septic system designed for a 3 bdrm residence.

DENR Authorized Agent: Gina Buchanan, RS Signature: Gina Buchanan, RS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

INSTALLATION APPROVAL for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 6661 B Permit #: _____ Tax Parcel #: 01107312

Property Owner: The Bainbridge Crew

Job Location Address: 15340 Black Farms Rd

City: Huntersville State: NC Zip Code: 28078

Installation Approval Issuance Date: 7/17/06

Permission is hereby given to ☐ install ☑ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge, as specified herein at the described location. This approval is granted based upon the application information submitted to our office. All work shall be completed on or before 8/17/06, after which date this approval shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of granting this approval. An **Operation Permit** must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now of hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

***NOTICE: This system shall not be installed while soils are in a wet condition.**

Permitted Design Flow: 360 GPD

Site LTAR: .3 GPD/ft² (For new installations only.)

Liquid Capacity of Septic Tank: 1500 gallons

Liquid Capacity of Dosing Tank: N/A gallons

Drainfield Design ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 400 feet

# of Lines: 4 @ 100 feet

Depth of Media: 12 inches (Type) Stone

Distribution Device: D-Box

Bed Design *(For Repair Installations ONLY.)* ☐ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Distribution Device: _____

Water Supply Source

☐ Municipal ☑ Private Well ☐ Community Well

☐ Other _____


Minimum System Setbacks

Distance from Building Foundation: 5 feet

Distance from Property Line: 10 feet

Distance from Water Supply Source: 750 feet

SKETCH OF SYSTEM LAYOUT
(Proposed Layout)

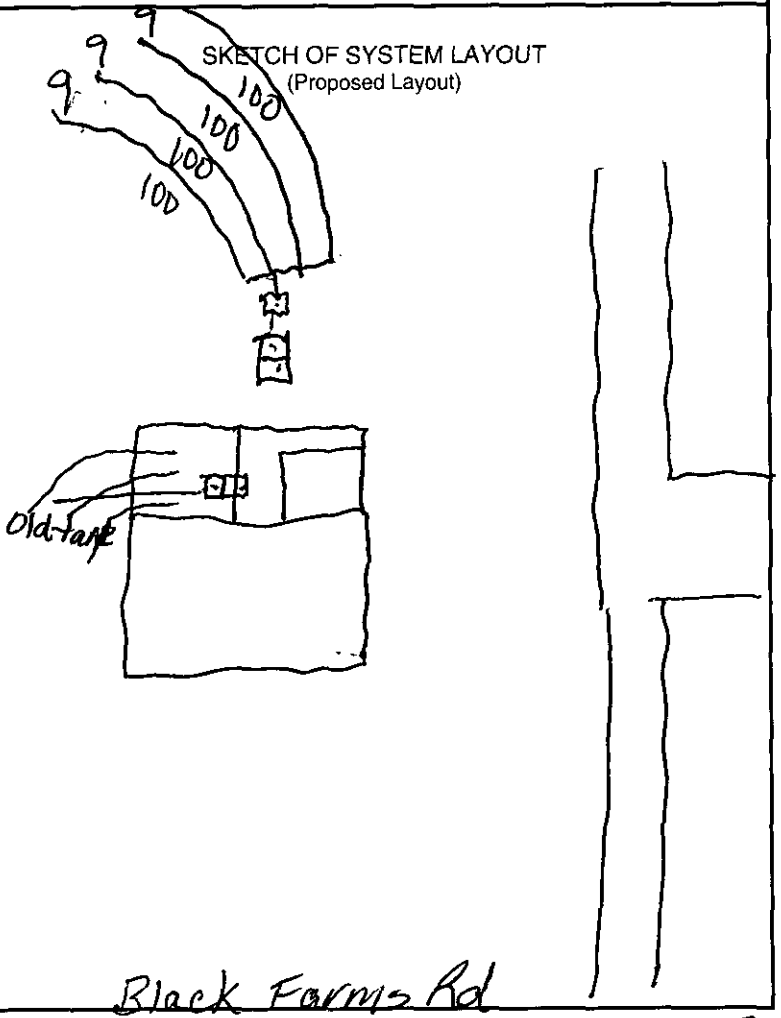

Comments: System Classification & Type: Type II conventional system, 1500 g septic tank w/ 4 lines @ 100' each. Abandon old septic tank after pumping and cut old lines and bentonite 5' from foundation.

DENR Authorized Agent: Gina Buchanan, RS Signature: Gina Buchanan, RS

CONDITIONS OF IMPROVEMENT PERMIT for an ALTERATION TO AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit Number: **6661B** Tax Number: **01107312**

- The IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☐ Yes ☒ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☒ II ☐ III ☐ IV ☐ V ☐ VI

☒ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☐ Innovative or Experimental:

.3 Long-term acceptance rate (GPD/ft^2)	360 Max gallons/day wastewater flow	1200 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☒ Yes ☐ No	1500 Gallon septic tank	400 Total trench length (ft)	30 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
3 Bedrooms in residence	N/A Gallon pump tank	12 Depth of media (in)	

Any surface water present: **No** Type: Minimum separation distance (ft):

Additional conditions: **This alteration requires abandoning the old septic tank and cutting off the existing drain field lines at least 5 ft. from the addition. A new septic tank and D-box with conventional lines equaling 400 linear ft. will be required to be installed. These modifications are due to the addition of one room and the enlargement of a bedroom.**

Repair Area System

Type: ☐ I ☒ II ☐ III ☐ IV ☐ V ☐ VI

☒ Conventional
☐ Prefabricated, permeable block panel system
☐ *Shallow Placed Conventional*
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ *Other*
☐ Innovative or Experimental:

1200 Absorption Area (ft^2) 400 Total trench length (ft)	12 Depth of media (in)	9 Trench spacing (min. on centers) (ft)	30 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage Treatment, and Disposal Systems in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation Approval is granted by this Department.

*** This Improvement permit is transferable.

Cina Buchanan, RS 7/9/08

DENR Authorized Agent Date

Owner/Agent Signature Date

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE: (704) 336-5103
FAX: (704) 336-6894

NC DENR
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

1139 CAB

GWS – RES. APP 07/05

SEPTIC FEE: 300.00
DATE: 7/13/06
CRT [ ] Cash TKF
B97751

PERMIT APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT / CONSTRUCTION AUTHORIZATION FOR ON-SITE WASTEWATER SYSTEM NEW WELL INSTALLATION OR REPAIR OF EXISTING WELL MECKLENBURG COUNTY GROUNDWATER & WASTEWATER SERVICES

WELL FEE: _____
DATE: _____
CRT [ ]

FILE # 66616

SEPTIC / TYPE APPLICATION: ☐ NONE ☐ NEW SYSTEM ☑ ALTERATION ☐ REPAIR ☐ MODIFY PLOT PLAN

WELL / TYPE APPLICATION: ☐ NONE ☐ NEW WELL ☐ MAJOR REPAIR ☐ ABANDONMENT

JOB LOCATION INFORMATION:

TAX/PARCEL #: 01107312
STREET ADDRESS: 15340 Black Farm Rd.
CITY: Huntersville
STATE: NC ZIP: 28078
SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #:
TOWNSHIP:

☐ 0-MECKLENBURG ☐ 4-PINEVILLE
☐ 1-CHARLOTTE ☐ 5-MATTHEWS
☐ 2-DAVIDSON ☑ 6-HUNTERSVILLE
☐ 3-CORNELIUS ☐ 7-MINT HILL

BUILDING INFORMATION:

TYPE OF BUILDING:

☐ SINGLE MOBILE HOME (S) ☐ MODULAR HOME (M)
☐ DOUBLE WIDE (D) ☐ MULTIPLE FAMILY (U)
☑ HOUSE (H) ☐ OTHER

HEATED SQUARE FOOTAGE:
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2

FOUNDATION FOR RESIDENCE:

☐ CONCRETE SLAB ☑ BASEMENT WITH PLUMBING
☐ CRAWLSPACE ☐ BASEMENT WITH NO PLUMBING

IF PLANNING TO EXPAND/ALTER THE EXISTING SYSTEM INDICATE THE FOLLOWING CHANGES:
NUMBER OF BEDROOMS TO BE ADDED: 0 NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE:
WILL THERE BE A HOME BUSINESS IN THE RESIDENCE? ☐ YES ☑ NO TYPE:

WATER SUPPLY:

☐ MUNICIPAL (M) ☑ PUBLIC (C) ☑ PRIVATE WELL (P) ☐ SHARED WELL (S) ☐ OTHER 'SPRINGS' (O)

PROPOSED USE OF WELL: ☐ N/A ☐ IRRIGATION ☑ POTABLE ☐ GEOTHERMAL ☐ OTHER

ARE ANY OF THE FOLLOWING LOCATED ON THE PROPERTY? IF SO, PLEASE SHOW LOCATION ON SITE PLAN/PLAT.

BURIED CABLES, LANDFILLS, STUMPHOLES	☐ YES ☑ NO	WELLS, SPRINGS, OR WATER LINES	☑ YES ☐ NO	RPA
EXISTING WASTEWATER SYSTEMS	☑ YES ☐ NO	DESIGNATED WETLANDS	☐ YES ☑ NO	
EASEMENTS OR RIGHT-OF-WAYS	☐ YES ☑ NO	GRADING/SOIL REMOVAL PERFORMED	☐ YES ☑ NO	

PROPERTY OWNER:

NAME:
ADDRESS:
CITY:
STATE: ZIP:
HOME PHONE: WORK PHONE:
MOBILE PHONE: FAX:

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: The Bainbridge Crew
ADDRESS: 5940 Monroe Rd
CITY: Charlotte
STATE: NC ZIP: 28212
HOME PHONE: WORK PHONE:
MOBILE PHONE: 905.8877 FAX: 569 9664

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED?
WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? DONE already

*An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

RC Bank 7/13/06
Owner's/Agent's Signature Date

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENT & NATURAL RESOURCES DIVISION
OF ENVIRONMENTAL HEALTH ON-SITE
WASTEWATER SECTION

*A Well Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature Date

MECKLENBURG COUNTY HEALTH DEPARTMENT
GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST., SUITE 211
CHARLOTTE, NC 28202 704-336-5103 / FAX: 704-336-6894

file 66661B

STATE ROUTE 363 - 0.52 ±

LOT 1
(AS SHOWN ON M.B. 27, P.736 - NOT SURVEYED)
LOT AREA
19251.26 S.F.±
.442 Ac.±

FRAME STABLE
40.2
20.2

REBAR (F)

N. 87°-28'-24" W.
107.55

(F) REBAR

S. 01°-31'-36" W.
102.34

REBAR (F)

S. 81°-81'-69" E.
10.28

LIGHT POLE

CARPORT

DECK
CONC.
17.5
14.9
41.6
1 STORY BRICK VENEER RESID. WITH BASEMENT COMP. ROOF
ST.# 15340
30.0
60.1
22.1
13.9
CONC.
131.2
63.4
74.9
GRAVEL DRIVE
POLE
169.63

R=350.86
N. 2°-43'-52" W.
A=350.38
336.0

O (C.P.)

TELE BOX

N. 25°-52'-38" E.
85.12

N. 7°-00'-28" W. 153.0

N. 23°-23'-12" E. 195.70

BLACK FARMS ROAD
~ 60' PUBLIC R/W ~

PAVING

30.73

C.P.

6661B

Supervisor/Administrative Professional Checklist

New Septic ☐ **New Well** ☐ **Use Existing** ☑ **Alteration** ☐ **Modified Plot Plan** ☐

New Septic Fees Paid:

IP ($250.00) _____ Initials/Date

CA ($200.00) _____ Initials/Date

OP ($200.00) _____ Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 lwo 6/28/13 Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid)_____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☐ Reviewed ☐ ____

This site is served by septic and well. Verify each is complete before final hold is released. ☐

Septic file completed. ☐ _____ Well file completed. ☐ _____

Send permit for signature. ☐ Signature received. ☐ _____

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

66613

MECKLENBURG COUNTY
HEALTH DEPARTMENT

App# 6278

APPLICATION FOR APPROVAL TO USE AN EXISTING ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM / WATER SUPPLY WELL

APPLICATION TYPE: (●) SEPTIC ONLY ( ) WELL ONLY ( ) SEPTIC & WELL
(●) ADDITION OR RENOVATION WITH OCCUPANCY INCREASE
( ) ADDITION OR RENOVATION WITH NO OCCUPANCY INCREASE
( ) EXCHANGE MOBILE HOME (SAME # BEDROOMS)
( ) COMMERCIAL OR INDUSTRIAL

PERSON FILING APPLICATION:
NAME: Greg Fornelli
ADDRESS: 15340 Black Farms Road
CITY: Huntersville
STATE: NC ZIP: 28078
PHONE: (704) 634-9287
ALTERNATE PHONE: (312) 513-0900
E-MAIL: gfornelli@sri-supplies.com

PROPERTY OWNER: [✓] SAME AS PERSON FILING APPLICATION
NAME:
ADDRESS:
CITY:
STATE: ZIP:
PHONE:
ALTERNATE PHONE:
E-MAIL:

JOB LOCATION INFORMATION
TAX PARCEL #: 01107312
STREET ADDRESS: 15340 Black Farm Road
CITY: Huntersville
STATE: NC **ZIP:** 28078

SUBDIVISION OR MOBILE HOME PARK NAME:
LOT #:

WATER SUPPLY:
( ) MUNICIPAL (●) PRIVATE WELL ( ) PUBLIC WELL ( ) SHARED WELL ( ) OTHER

RESIDENTIAL PROPERTY TYPE: ( ) N/A
(●) HOUSE ( ) MODULAR HOME ( ) MULTIPLE FAMILY
( ) SINGLE MOBILE HOME ( ) DOUBLE WIDE
( ) OTHER

OCCUPANCY (both fields are required):
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 2

COMMERCIAL / INDUSTRIAL PROPERTY TYPE: [✓] N/A
TYPE OF BUSINESS:
EMPLOYEES PER SHIFT:
OF SHIFTS:
INDUSTRIAL WASTES? ( ) YES ( ) NO
UNDERGROUND STORAGE TANKS? ( ) YES ( ) NO

ADDITION/RENOVATION TYPE ATTACHED TO EXISTING STRUCTURE:
[■] BEDROOM [ ] BATHROOM [ ] KITCHEN [ ] DINING ROOM [ ] LIVING ROOM [ ] DEN
[ ] GARAGE [ ] SUNROOM [ ] PORCH [ ] DECK [ ] OTHER

ADDITION/RENOVATION TYPE DETACHED FROM EXISTING STRUCTURE:
[ ] DETACHED GARAGE [ ] DETACHED GARAGE WITH PLUMBING [ ] POOL HOUSE [ ] SHOP [ ] BARN
[ ] STORAGE SHED [ ] DETACHED PORCH / DECK [ ] OTHER

*The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

Owner's/Agent's Signature

6-28-13
Date

A PROPOSED PLOT PLAN (see page 2) is required to be submitted with each application.

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894


Revised on: 01/03/1

File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 15340 Black Farms Rd, Huntersville NC 28078 Tax Parcel #: 01107312

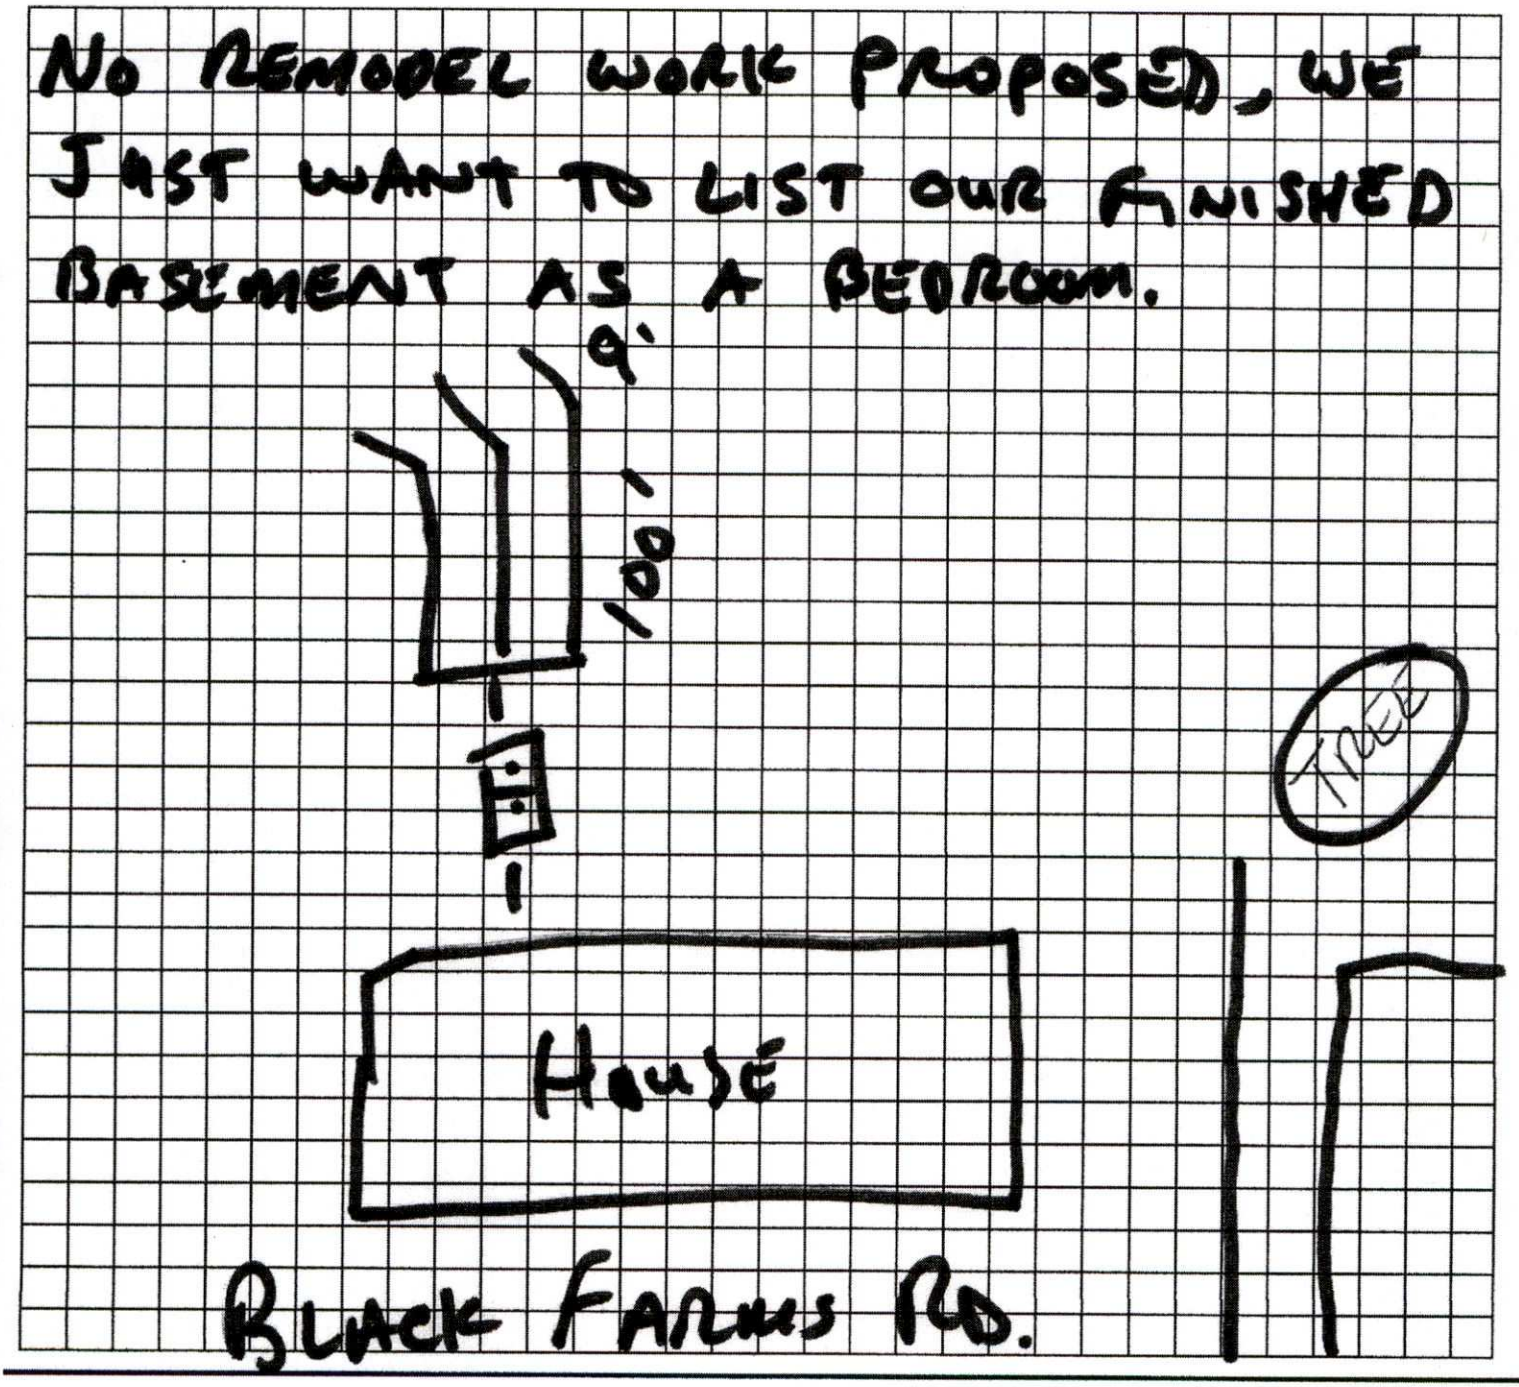

*The undersigned, an authorized agent of the Mecklenburg County Health Department, certifies that the Department has approved the Request for the "Job Location" contained in this document. This approval is granted in accordance with the provisions of Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal and Water Supply Wells in effect at the time of issuance of the permit and is subject to the following provisions:

- No work shall be conducted on the septic tank system until an installation, construction, alteration and/or repair approval is granted by this Department.
- This permit is not transferable.
- Addition/Renovation approval valid 1 year from issuance date
- Mobile home exchange approval valid 6 months from issuance date

Use Existing System denied. Current septic system sized for max. 3 bedroom

REHS Signature RCHS Date 7/11/13

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 704-336-5103, FAX: 704-336-6894

Revised on: 01/03/11

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 06/28/13
Receipt #: 84531
Check / Auth #: VISA 005992
Received By: SADERLW

Amount: 100.00
Tendered: 100.00
Returned: 0.00

Account Information

Account #: 200000
Contractor: FORNELLI GREG
Attn:
Address: 15340 BLACK FARMS RD
Address:
City/State/Zip: HUNTERSVILLE, NC 28078

Item	Description	Permit#	Quantity	Unit Price	Total Price
0705	MH Exc/Add/Repl w/o System Mod		1	100.00	100.00

REV COLLECTION ENVHEALT
700 NORTH TRYON STREET
CHARLOTTE, NC, 28202

TERMINAL I.D.: 00319400008013450476O2

MERCHANT #: 8013450476

VISA
**********5460 K
SALE

RECORD #: 1 INV: 000001
DATE: JUN 28, 13 TIME: 16:09
BATCH: 65
AUTH: 005992
AVS RESPONSE: N
CVV2 RESPONSE: P

TOTAL $100.00

CARD BALANCE: $0.00

I AGREE TO PAY ABOVE TOTAL AMOUNT
ACCORDING TO CARD ISSUER AGREEMENT
(MERCHANT AGREEMENT IF CREDIT VOUCHER)

CUSTOMER COPY

----------**Outstanding Balances**----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days

MECKLENBURG COUNTY
Health Department

July 12, 2013

Greg Fornelli
15340 Black Farms Road
Huntersville, NC 28078

Re: Application for approval to use an existing on-site wastewater treatment & disposal system.
Property Location: 15340 Black Farms Road
Health Department file number: **6661B**

Dear Property Owner or Owner's Agent:

On July 11, 2013 the Mecklenburg County Health Department, Groundwater & Wastewater Services Section, evaluated the above-referenced property to determine if approval to use an existing on-site wastewater treatment & disposal system could be granted for your proposed project. This evaluation was done in accordance with the laws and rules governing wastewater systems in North Carolina General Statute 130A-333 and related statutes, Title 15A, Subchapter 18A, of the North Carolina Administrative Code, Rule .1900 and related rules, and the Mecklenburg County Groundwater Well Regulations.

Based on the information provided in the application, dated June 28, 2013, and findings from the site evaluation conducted by our office, your request for approval to use an existing on-site wastewater treatment & disposal system is **not** being granted. This decision is based on the following conditions that were identified during the site visit:

- ☐ The existing on-site wastewater treatment & disposal system was not functioning properly at the time the site evaluation was conducted.
- ☐ The proposed plans do not meet the required setbacks for the on-site wastewater treatment & disposal system serving the property.
- ☐ The proposed plans do not meet the required setbacks for the reserved repair area for an on-site wastewater treatment & disposal system.
- ☐ The proposed plans do not meet the required setbacks for water supply wells.
- ☒ The proposed project will exceed the permitted daily design flow for the existing on-site wastewater treatment & disposal system. System alteration will be required in order to accommodate your proposed project.

If you need any additional information or assistance please contact our office at (704) 336-5103.

Sincerely,

Kim Garrett, REHS
Environmental Specialist
Mecklenburg County Health Department
Environmental Health Program
980-721-2054

Encl: (1) Application