Date Received 6-13-84

SEE INSTRUCTIONS ON BACK

ICAR(S) Application No 2147

T. C No. 023-052-32

Map Date 6

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

RALPH MILLES

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to COMMODES SHOW TO EMPTY – DRAIN SOIL OVER TANK

1) Install or Construct 2) XX Alter or Repair an individual septic tank wastewater treatment system with a subsurface soil absorption effluent discharge

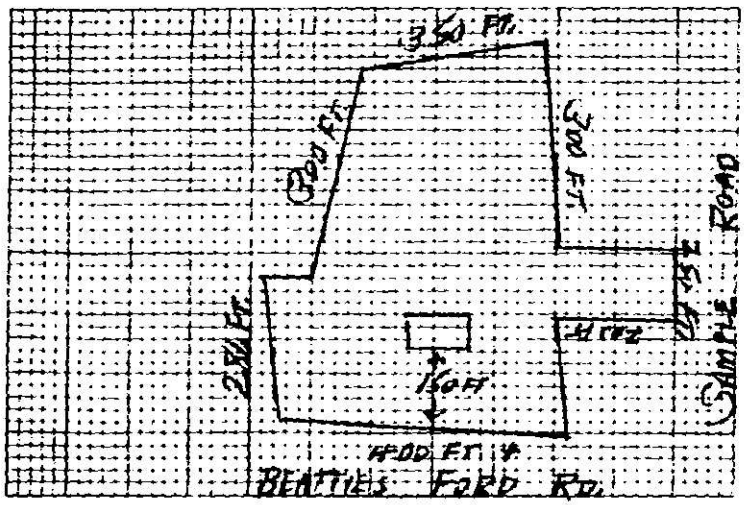

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes X No
Residence X Yes ___ No
4) No. of Bedrooms 2
5) Business Use — Max No. Employees ___
6) Washing Machine X Yes ___ No
7) Garbage Disposal ___ Yes X No
8) Dishwasher X Yes ___ No
9) Water Supply
A Individual Well X
B Governmental System ___
C Community System
1 Well source ___
2 Governmental source ___
10) Sewage System
House located within 200 feet of public sewer ___ Yes X No
House located within 200 feet of community sewer ___ Yes X No
11) FmA Case No ___
12) VA Case No ___

13) NAME OF OWNER Moss (LAST) John Parks (FIRST MIDDLE)

14) ADDRESS OF OWNER Rt. 3, Box ,890, Huntersville, N. C. 28078

15) PHONE NO Home 875-2183 Office ___

16) LOCATION OF SYSTEM 10331 Beatties Ford Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION ___ Lot No. ___ Block No. ___

Map Book No 4313 Page No. 0053

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ___ YES X NO DATE RUN ___

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

6-13-84
DATE OF APPLICATION

John P. Moss
OWNER

EHD-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Serial No. 07321

Date Issued 6-19-84

ICAR(S) Permit No. 21147

T C No. 023-052-32

Map Date L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct, X Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 21147, dated 6-13-84 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before JULY 30th 1984, after which date this permit shall be null and void.

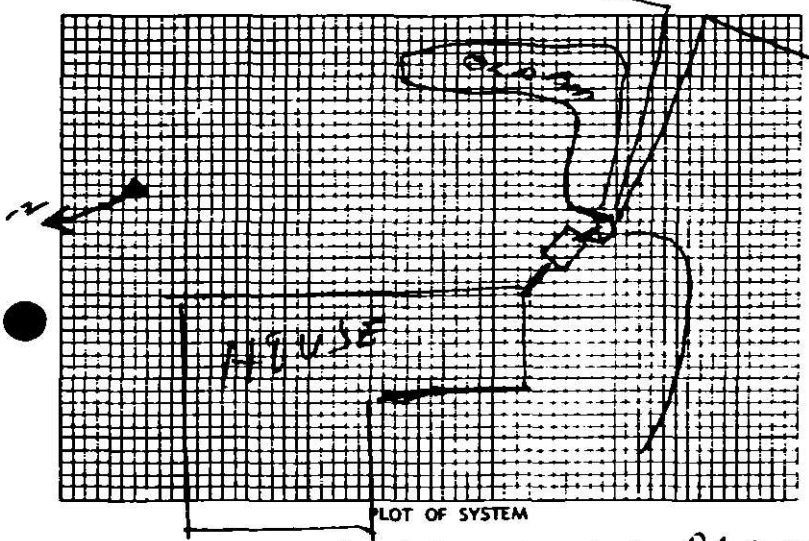

PLOT OF SYSTEM

Permeability Rate PS LWA

Liquid Capacity of Tank

Tank Construction Repair

Absorption and/or Nitrification Lines.

Total Line Length 300 lin. FT

Number of Lines THREE

Distance from House 25 FT

Distance from Property Line 40 FT.

Distance from Well 125 FT

NAME OF OWNER MOSS, JOHN PARKS

LOCATION OF PROPERTY 10331 Beatties Ford Rd Huntersville

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

Comments: Three Trenches to be 100 FT x 3 FT x 12 inches stone-hay or straw cover - grade Bds - let 1st flow to new lines use existing system - new Dist Box

Division or Section Head

Environmentalist Ralph Nelles

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

BHD-5-76

Environmental Health Department Copy

C of A (s) No. 21147

Date Issued 7-13-84 **Serial** 6787 T C No. 023-052-32 L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

CERTIFICATE OF COMPLETION

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner MOSS, JOHN PARKS
LAST FIRST MIDDLE

Location of Property 10331 BEATTIES FORD RD

Application Number 21147 Permit Number 21147

Inspection Data:

Liquid Capacity of Tank Repair Tank Material Repair

Total Length of Drain Tile 200 lin FT Number of Lines Two

Depth of Filter Material 12 inches Cover Depth 12 inches

Water Supply Source well Distance from Water Source 125 FT

Excavation Inspected 7-13-84 DATE Tank Inspected 7-13-84 DATE

Nitrification Field Inspected 7-13-84 DATE

Washing Machine Line Inspected If Applicable — DATE

The undersigned has inspected the Individual Septic Tank System with subsurface soil absorption, effluent discharge as described above and it has been installed or constructed, X altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments Permit changed to 200 lin FT due to Bed was dry + one outlet piped to Bed + two outlets piped to two Trenches

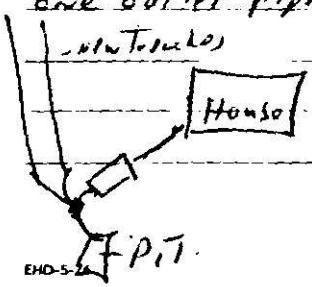

Environmentalist Ralph Nelle

EHD-5-26

ENVIRONMENTAL HEALTH [illegible]