

1/9/2008

duponbj

Groundwater and Wastewater Services File Imaging Project

May 2007

Barcode Font = IDAutomationHC39M

CONDITIONS OF IMPROVEMENT PERMIT

Permit Number: **5760B** Tax Number: **199-371-03**

- The IMPROVEMNET PERMIT is subject to revocation if site plans or the intended use change. There is to be **NO** grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

Basement: ☒ Yes ☐ No ☐ Partial Basement

Primary Wastewater System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

0.3 Long-term acceptance rate (GPD/ft^2)	600 Max gallons/day wastewater flow	1500 Absorption Area (ft^2)	9 Trench spacing (min. on centers) (ft)
Serviced by private well: ☐ Yes ☒ No	1500 Gallon septic tank	500 Total trench length (ft)	25 Maximum trench depth (in) (At least 12" of provisionally suitable soil must remain between trench bottom and unsuitable soil conditions.)
5 Bedrooms in residence	1500 Gallon pump tank	na Depth of stone (in)	

Any surface water present: **No** Type: Minimum separation distance (ft):

Additional conditions: **Install according to plans on file submitted by Toney Jacobs and Associates, 6/13/05. Lot #168**

Repair Area System

Type: ☐ I ☐ II ☒ III ☐ IV ☐ V ☐ VI

☐ Conventional
☐ Prefabricated, permeable block panel system
☐ Shallow Placed Conventional
☐ Low Pressure Pipe
☐ Large Diameter Pipe
☐ Fill
☐ Other
☒ Innovative or Experimental:

1500 Absorption Area (ft^2) 530 Total trench length (ft)	na Depth of stone (in)	9 Trench spacing (min. on centers) (ft)	24 Maximum trench depth (in)

The undersigned, an authorized agent of the MECKLENBURG COUNTY HELTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. The approval is granted in accordance with the provisions of Laws and Rules For Sewage, Treatment and Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

*** No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair Approval is granted by this Department.

*** This Improvement permit is transferable.

DENR Authorized Agent — Date 6/22/05

Owner/Agent Signature — Date 6-23-05

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR.
SUITE 211
700 N. TRYON ST.
CHARLOTTE, NC 28202
(704) 336-5103

NORTH CAROLINA DEPARTMENT OF
ENVIRONMENTAL, HEALTH, AND
NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

S&ME

Date: June 13, 2005

To: Mr. David Cornelius, R.S.
Mecklenburg County Env. Health Dept.

From: Paul G. Penninger, LSS
Toney C. Jacobs, LSS

RE: Request for an Improvement Permit for Lot 168 at The Sanctuary:
MCHD File #5760B

The Sanctuary at Lake Wylie is requesting an Improvement Permit for the above referenced lot. **This lot will utilize an off-site septic area for the septic system drainfield.** Mr. Bill Marlin has evaluated the soils (see attached MCHD soil sheets) and S&ME, Inc. has flagged the system and repair on the septic area. The septic lines have been located by the surveyor and are shown on the attached maps. The attached sketch and specifications are not an Improvement Permit and are intended only to assist the MCHD in permitting the referenced lot at The Sanctuary.

We understand that a building permit cannot be issued until your office issues an Authorization to Construct (ATC). The buyer will apply for the ATC. If the buyer's house pad does not fit in the "building envelope" shown on the Improvement Permit, we understand that the proposed system may have to be modified prior to your office issuing the ATC. **No grading shall take place on the lot prior to obtaining the ATC from the MCHD.**

Tri-County Wastewater (TCWW) is under contract to supply maintenance services for each septic system installed at The Sanctuary. TCWW will have a list of preferred septic contractors for the subdivision and will also have requirements for septic system installation that are greater than the MCHD and State requirements. It will be the responsibility of TCWW to enforce any requirements above State requirements or the MCHD conditions on the Improvement Permit.

Please review the attached system sketch and design specifications for the Improvement Permit. Any additions or revisions you feel are necessary can be made on the Improvement Permit. Please call in you have and questions or comments.


S&ME, Inc.
105-D Denver Business Park Dr.
Mooresville, North Carolina 28115-7926

(704) 662-8625
(704) 662-8735 fax
www.smeinc.com

Design Specifications for Lot 168 at The Sanctuary
MCHD File # 5760B

Daily Design Flow:	600 gpd
Number Bedrooms:	5 bedroom
Basement or Crawl Space:	Basement
Septic Tank Size:	1500 gal
Pump Tank Size:	1500 gal
Primary System Loading Rate:	**0.3 gpd/ft^2**
Primary System:	**25% reduction**
Number and length of laterals:	5 @ 100 ft.
Total ft. of primary system:	500 ft.
Flow Rate through system:	27.5 gpm – use ½ in. SCH 80 taps with 2 ft. head pressure on pressure manifold (5.5 gpm per tap)
Pump Requirements:	to be calculated by installer when specific house and pump tank locations are available
Dosing Volume:	approx. 270 gal. – 2.2 doses/day at design flow
Depth of effluent pumped per dose:	calculated to specific tank by measure or dealer engineering specifications (1 cubic ft. of water equals 7.48 gal.)
Check Valve:	yes
Siphon break hole:	no
Repair System Loading Rate:	**0.3 gpd/ft^2**
Repair System:	**25% reduction**
Total ft. of repair	530 ft.

Notes: This lot utilizes an off-site septic area for the drainfield.

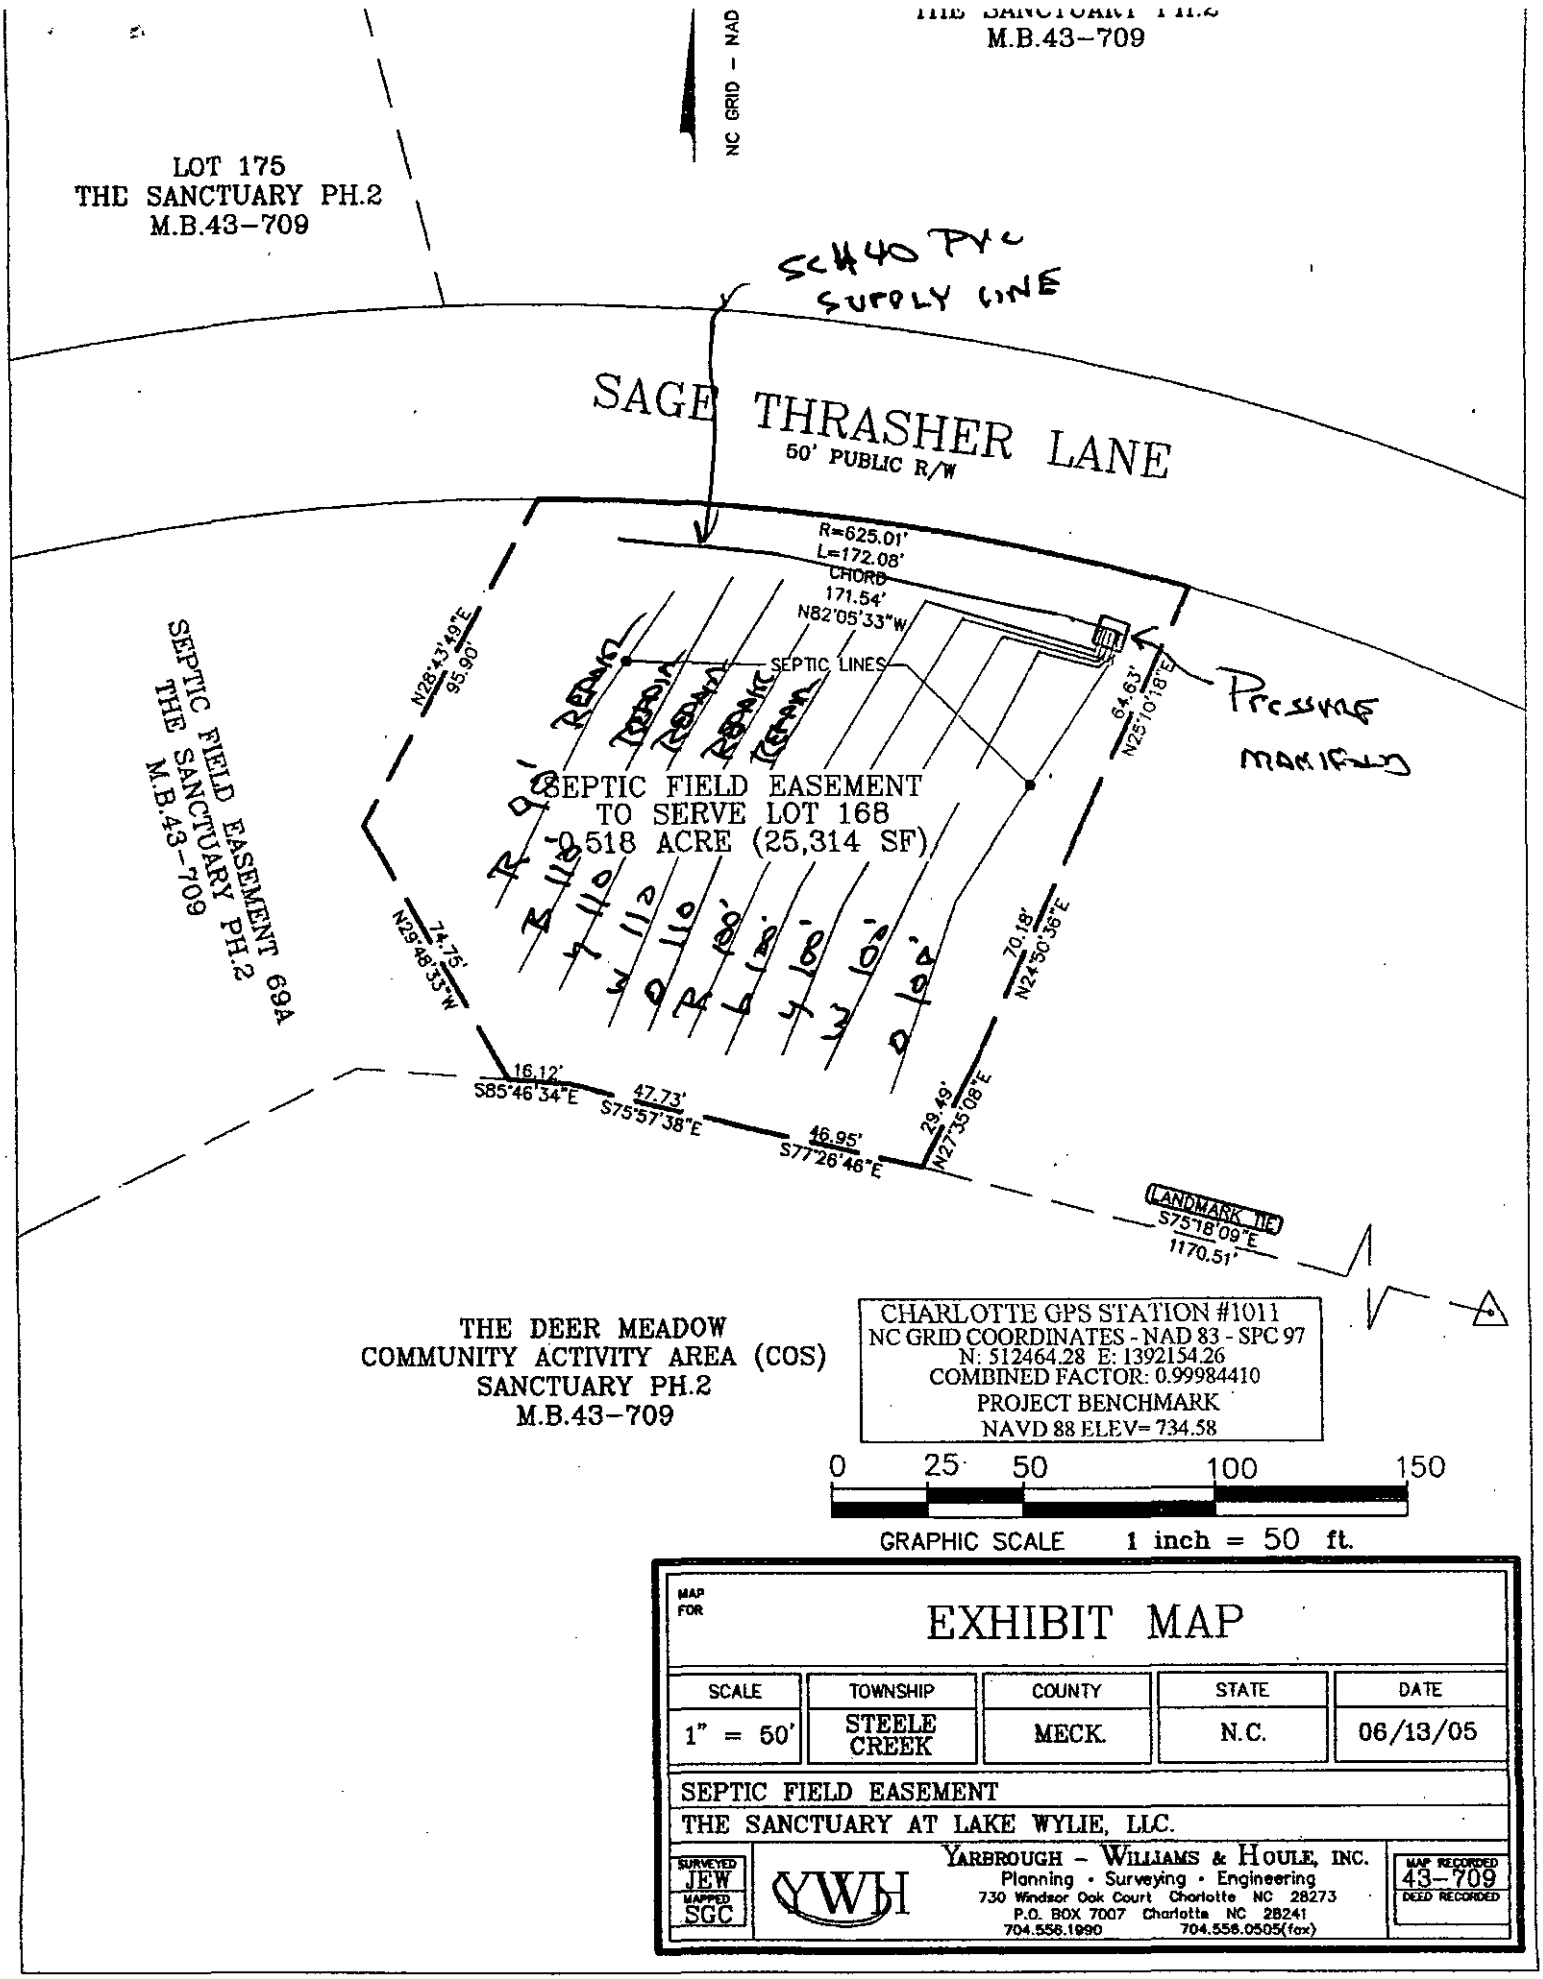

MAP FOR

EXHIBIT MAP

SCALE	TOWNSHIP	COUNTY	STATE	DATE
1" = 50'	STEELE CREEK	MECK.	N.C.	06/13/05


SEPTIC FIELD EASEMENT

THE SANCTUARY AT LAKE WYLIE, LLC.

SURVEYED JEW
MAPPED SGC

YARBROUGH - WILLIAMS & HOULE, INC.
Planning • Surveying • Engineering
730 Windsor Oak Court Charlotte NC 28273
P.O. BOX 7007 Charlotte NC 28241
704.556.1990 704.556.0505(fax)

MAP RECORDED 43-709
DEED RECORDED

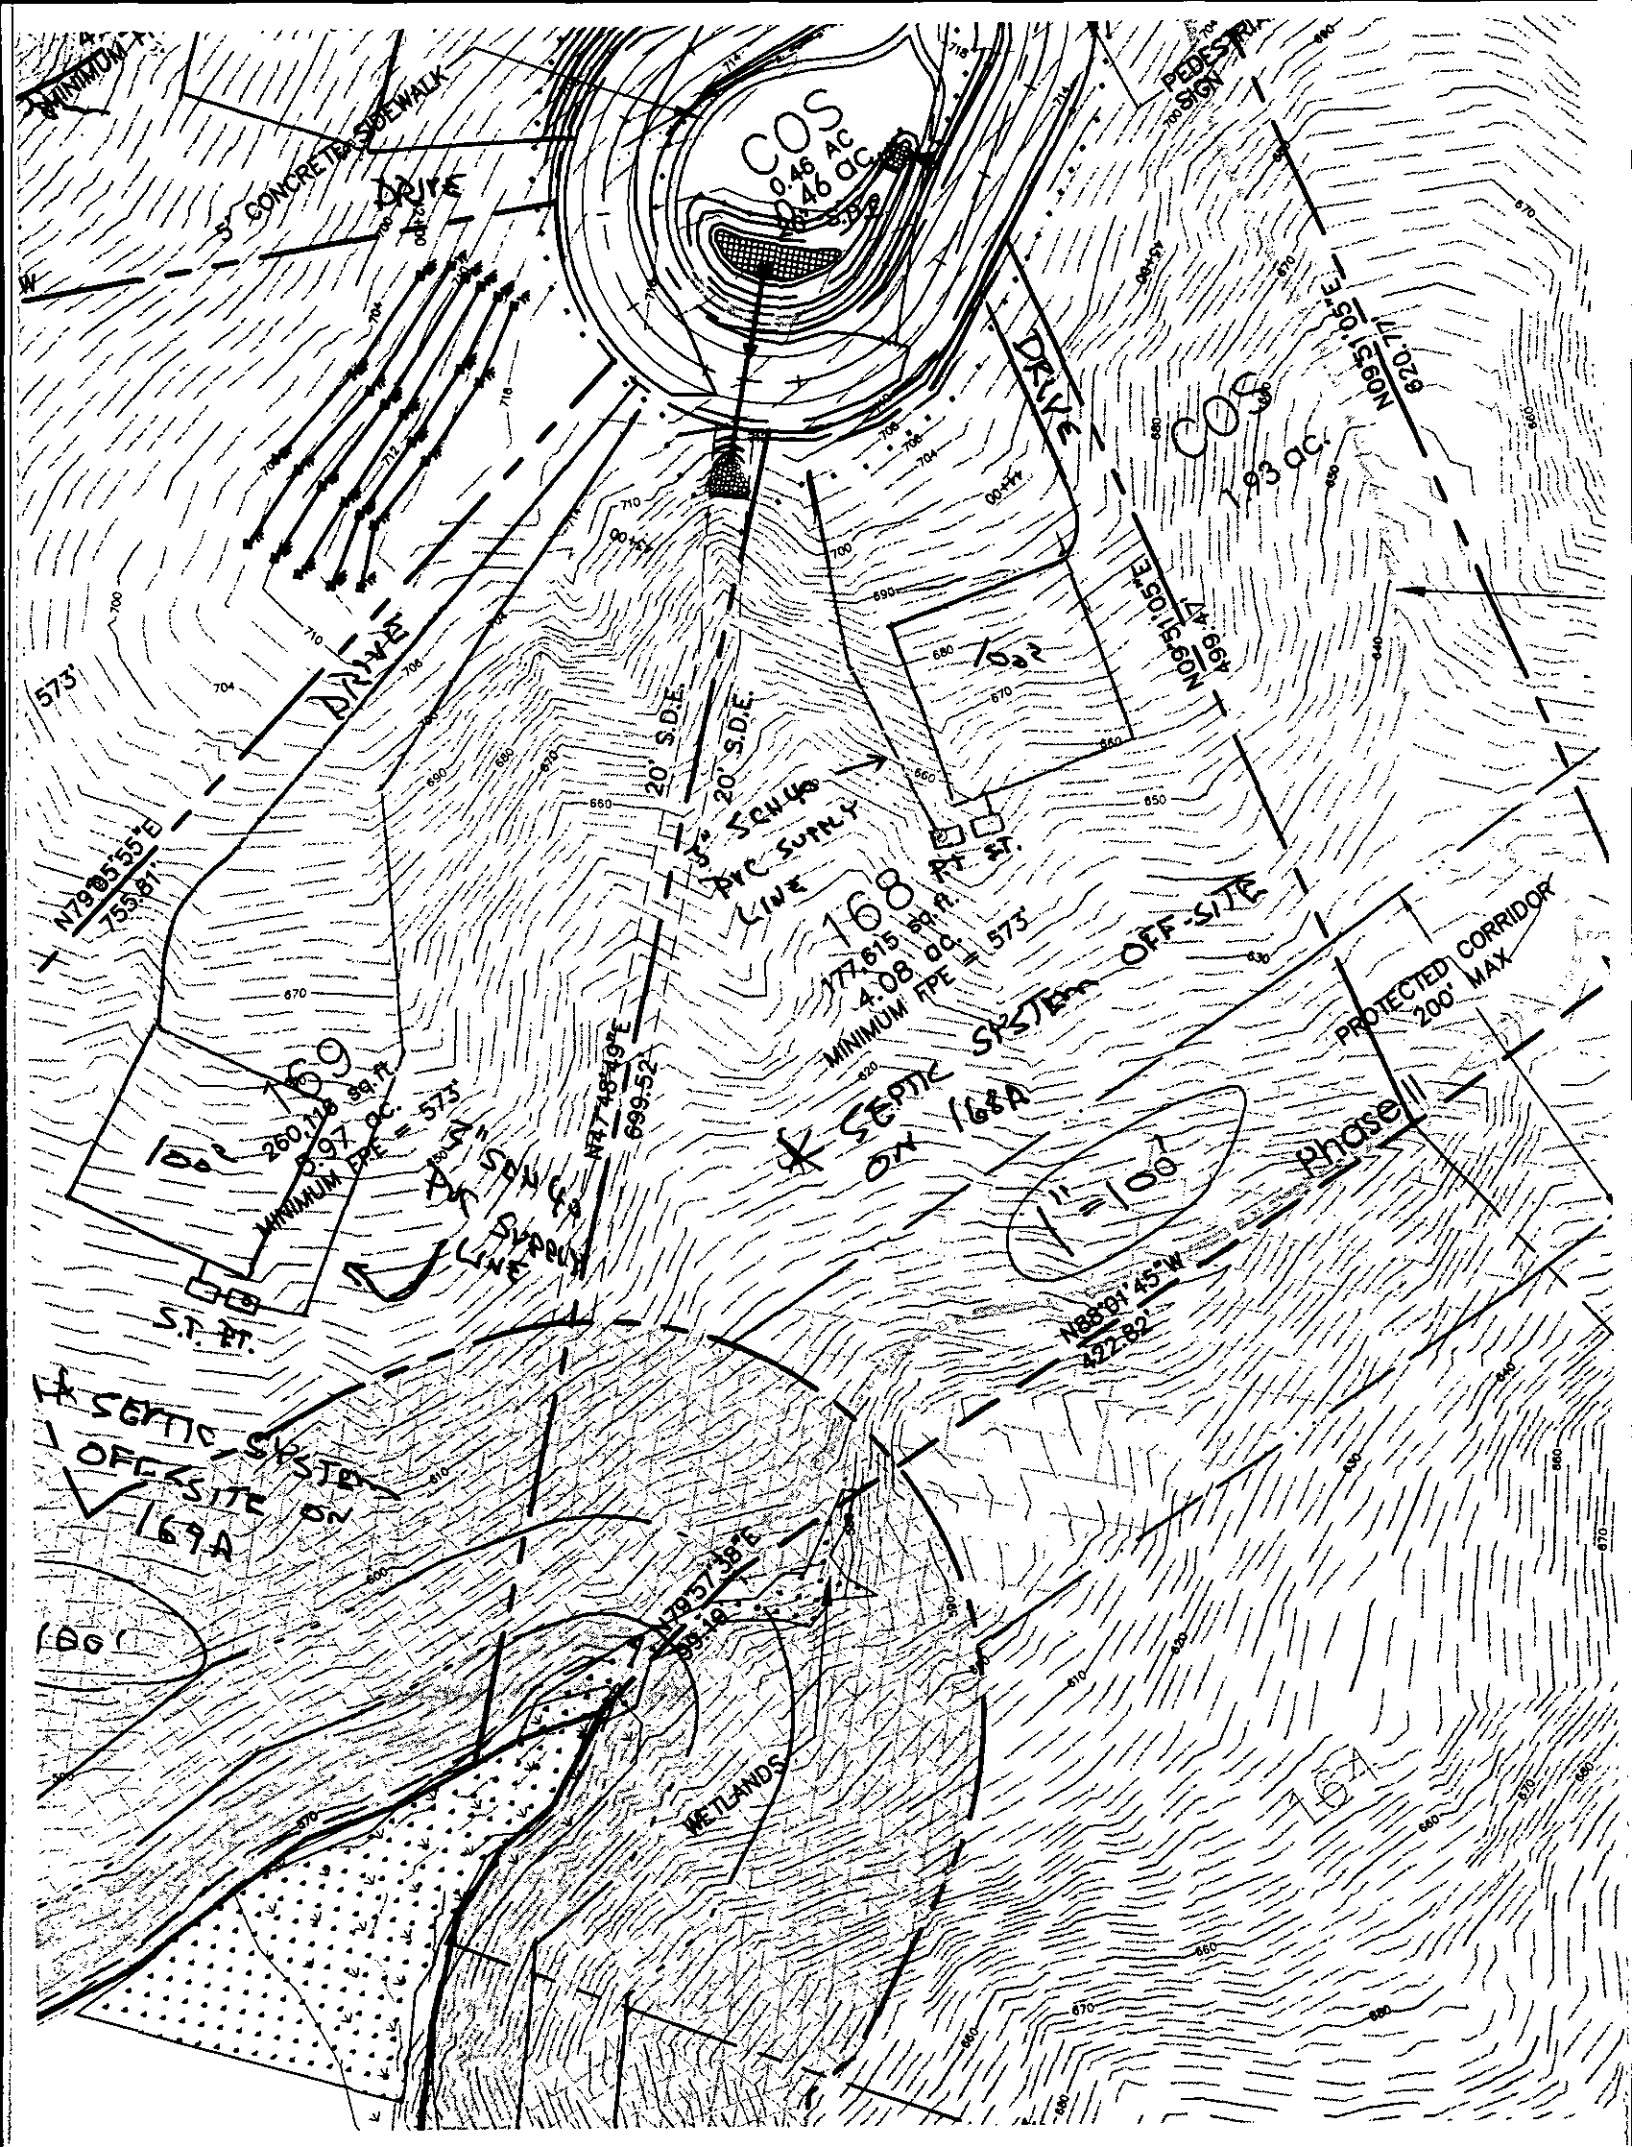
MINIMUM
5' CONCRETE SIDEWALK
DRIVE
COS
0.46 AC.
0.46 ac.
PEDESTRIAN SIGN
DRIVE
COS
1.93 ac.
N09°51'05"E
620.77'
N09°51'05"E
499.47'
573'
DRIVE
20' S.D.E.
20' S.D.E.
5" SCH 40 PVC SUPPLY LINE
168
177,615 SQ. FT.
4.08 AC.
MINIMUM FPE = 573'
PT ST.
N79°05'55"E
755.81'
169
260,118 SQ. FT.
5.97 AC.
MINIMUM FPE = 573'
S.T. PT.
5" SCH 40 PVC SUPPLY LINE
N47°48'49"E
699.52
SEPTIC SYSTEM OFF-SITE ON 168A
PROTECTED CORRIDOR 200' MAX
Phase III
1" = 100'
N88°01'45"W
422.82'
SEPTIC SYSTEM OFF-SITE ON 169A
N79°57'38"E
355.19'
WETLANDS
16A

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Property ID: PO 199-371-03
Lot #: 168
File #: 5760B
Code: 1

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM

Owner: The Sanctuary at Lake Wylie
Address: 10933 Ballantyne Crossing Ave., Charlotte, N. C. 28277
Proposed Facility: Residence Design Flow (.1949): 600gpd
Location of Site: Sage Thrasher Lane, system site in Deer Meadow
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

Applicant:
Date Evaluated: 3/11/2005
Property Size: .35+/-a. inv.
Property Recorded:

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapric Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 5	0-9	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	N/A	NONE	PS, IV
		9-48	SBK/C	FI/SEXP/S/P					.3GPD/FT^2
2	"	0-10	GR/CL	FR/SEXP/SS/SP	"	"	"	"	"
		10-48	SBK/C	FI/SEXP/S/P					
3	"	0-9	GR/CL	FR/SEXP/SS/SP	"	"	"	"	"
		9-48	SBK/C	FI/SEXP/S/P					
4	"	0-12	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	"	"	"	"
		12-40	SBK/C	FI/SEXP/S/P					
		40-48	SBK/CL	FR/SEXP/SS/SP					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)		
Site LTAR	.3GPD/FT^2	.3GPD/FT^2

Other Factors (.1946):
Site Classification (.1948): PROVISIONALLY SUITABLE
Evaluated By: W. R. Marlin, LSS, 3/14/2005
Others Present:

FILE #: 5760B

COMMENTS:

100% repair, drainfield area in Deer Meadow COS

Landscape Position	Group	Texture	1955 LTAR
R-Ridge	I	S-Sand	1.2 - 0.8
SS-Shoulder Slope		LS-Loamy Sand	
LS-Linear Slope			
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6
NS-Nose Slope		L-Loam	
HS-Head Slope			
CC-Concave Slope	III	SI-Silt	0.6 - 0.3
CV-Convex Slope		SICL-Silty Clay Loam	
T-Terrace		CL-Clay Loam	
FP-Flood Plain		SCL-Sandy Clay Loam	
	IV	SC-Sandy Clay	0.4 - 0.1
		SIC-Silty Clay	
		C-Clay	

Structure

SG-Single Grain
M-Massive
CR-Crumb
GR-Granular
SBK-Subangular Blocky
ABK-Angular Blocky
PL-Platy
PR-Prismatic

Consistence
Moist

VFR-Very Friable
FR-Friable
FI-Firm
VFI-Very Firm
EFI-Extremely Firm


Consistence
Wet

NS-Non-Sticky
SS-Slightly Sticky
S-Sticky
VS-Very Sticky
NP-Non-Plastic
SP-Slightly Plastic
P-Plastic
VP-Very Plastic

Mineralogy

SEXP-Slightly Expansive
EXP-Expansive

Sketch of Soil Evaluation Locations

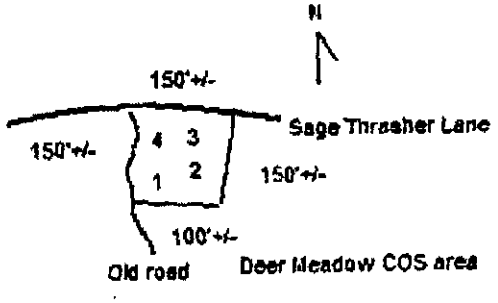

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: PO 199-371-03
Lot #: 168
File #: 5760B
Code: 1

ACS

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: The Sanctuary at Lake Wylie
Applicant:
Address: 10933 Ballantyne Crossing Ave., Charlotte, N. C. 28277
Date Evaluated: 3/11/2005
Proposed Facility: Residence
Design Flow (.1949): 600gpd
Property Size: .35+/-a. inv.
Location of Site: Sage Thrasher Lane, system site in Deer Meadow
Property Recorded:
Water Supply: [x] Public [ ] Individual [ ] Well [ ] Spring [ ] Other
Evaluation Method: [x] Auger boring [ ] Pit [ ] Cut
Type of Wastewater: [x] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	SOIL MORPHOLOGY .1941 .1941 Consistence Mineralogy	OTHER PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	Profile Class & LTAR
1	LS, 5	0-9	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	48	N/A	NONE	PS, IV
		9-48	SBK/C	FI/SEXP/S/P					.3GPD/FT^2
2	"	0-10	GR/CL	FR/SEXP/SS/SP	"	"	"	"	"
		10-48	SBK/C	FI/SEXP/S/P					
3	"	0-9	GR/CL	FR/SEXP/SS/SP	"	"	"	"	"
		9-48	SBK/C	FI/SEXP/S/P					
4	"	0-12	GR/CL	FR/SEXP/SS/SP	>48" TO SOIL WETNESS	"	"	"	"
		12-40	SBK/C	FI/SEXP/S/P					
		40-48	SBK/CL	FR/SEXP/SS/SP					

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)		
Site LTAR	.3GPD/FT^2	.3GPD/FT^2

Other Factors (.1946):
Site Classification (.1948): PROVISIONALLY SUITABLE
Evaluated By: W. R. Marlin, LSS, 3/14/2005, W. R. Marlin
Others Present:


COMMENTS:

100% repair, drainfield area in Deer Meadow COS

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	SG-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		M-Massive
LS-Linear Slope				CR-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	GR-Granular
NS-Nose Slope		L-Loam		SBK-Subangular Blocky
HS-Head Slope				ABK-Angular Blocky
CC-Concave Slope	III	SI-Silt	0.6 - 0.3	PL-Platy
CV-Convex Slope		SICL-Silty Clay Loam		PR-Prismatic
T-Terrace		CL-Clay Loam		
FP-Flood Plain		SCL-Sandy Clay Loam		
	IV	SC-Sandy Clay	0.4 - 0.1	
		SIC-Silty Clay		
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	NS-Non-Sticky	SEXP-Slightly Expansive
FR-Friable	SS-Slightly Sticky	EXP-Expansive
FI-Firm	S-Sticky	
VFI-Very Firm	VS-Very Sticky	
EFI-Extremely Firm	NP-Non-Plastic	
	SP-Slightly Plastic	
	P-Plastic	
	VP-Very Plastic	

Sketch of Soil Evaluation Locations

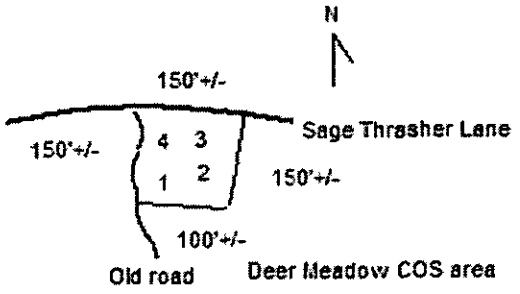

FEE: 200.00 CK 1996

DATE: 11/3/04

APPLICATION FOR IMPROVEMENT PERMIT FOR RESIDENTIAL SITE INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM

I CRT

TYPE APPLICATION: ___ NEW SYSTEM ___ EXPANSION/ ALTERATION OF EXISTING SYSTEM ___ REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 5760B

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 199-371-03 [illegible]

STREET ADDRESS: Island Point Rd

SUBDIVISION OR MOBILE HOME PARK NAME: The Sanctuary At Lake Wylie, LLC

LOT NUMBER: 168

TYPE OF BUILDING (CHECK ONE):

___ SINGLE MOBILE HOME(S)
___ DOUBLE WIDE (D)
___ HOUSE (H)
___ MODULAR HOME (M)
___ MULTIPLE FAMILY (U)
___ OTHER (O)

TOWNSHIP (CHECK ONE):

✓ 0 MECKLENBURG
___ 1 CHARLOTTE
___ 2 DAVIDSON
___ 3 CORNELIUS
___ 4 PINEVILLE
___ 5 MATTHEWS
___ 6 HUNTERSVILLE
___ 7 MINT HILL

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS:

NUMBER OF OCCUPANTS:

CLOSING DATE_____

FOUNDATION FOR RESIDENCE:

___ WITHOUT BASEMENT
___ ON SLAB
___ CRAWL SPACE
___ WITH BASEMENT /PLUMBING
___ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: ___ YES ✓ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

___ COMMUNITY (C)
✓ MUNICIPAL (M)
___ PRIVATE WELL (P)
___ SHARED WELL (S)
___ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES	___ YES ✓ NO	WELL, SPRINGS OR WATERLINES	___ YES ✓ NO
EXISTING WASTEWATER SYSTEMS	___ YES ✓ NO	DESIGNATED WETLANDS	___ YES ✓ NO
EASTMENTS OR RIGHT-OF-WAYS	✓ YES ___ NO		

PROPERTY OWNER:

NAME: (LAST) The Sanctuary At Lake Wylie, LLC (FIRST) (MI)

ADDRESS: 10933 Ballantyne Commons Pkwy

CITY: Charlotte STATE: NC ZIP: 28277

DAYTIME PHONE: (704) 544-0201 ext 226

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) Jacobs (FIRST) Tony (MI) C

DAYTIME PHONE: 704 663-6905

m 704 582 9219

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Tony C Jacobs, CPSS (AGENT) DATE: 11/4/04

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102