215-123-03

Mecklenburg County
Health Department

August 10, 1993

Betty S. Snow, R.N., M.A.
Health Director

Mr. Donald Hudson
2832 Mt. Harmony Road
Matthews, NC 28105

Re: 2832 Mt Harmony Road, Matthews, NC
File: 219A

Dear Mr. Hudson:

At your request an inspection was made at the above referenced property to facilitate the issuance of an Operation Permit for the On-Site Sanitary System of Sewage Treatment and Disposal. During the inspection it was found that the following items did not meet the regulations set fourth in the "Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal 15A NCAC 18A .1900; .1952 Septic Tank, Dosing Tank and Lift Station Design." Our comments follow:

1). (6) Pump and control circuits shall be provided with manual circuit disconnects within a watertight, corrosion-resistant, outside enclosure (NEMA 4X or equivalent) adjacent to the pump tank, securely mounted at least 12 inches above the finished grade. The pump(s) shall be manually operable without requiring the use of special tools or entrance into the tank for testing purposes. Conductors shall be conveyed to the disconnect enclosure through water proof, gasproof, and corrosion-resistant conduits, with no splices or junction boxes provided inside the tank. Wire grips, duct seal, or other suitable material shall be used to seal around wire and wire conduit openings inside the pump tank and disconnect enclosure.

2). (9) The pump tank shall have a properly functioning high-water alarm. The alarm circuit shall be supplied ahead of any pump overload and short circuit protective devices. The alarm shall be audible and visible by system users and weatherproof if installed outdoors in an enclosure (NEMA 4X or equivalent)


The above mentioned items must be installed and inspected prior to the Operation Permit being issued. The Operation Permit is <u>required</u> for the Certificate of Occupancy and the permanent electric hook-ups. Please schedule the inspections at least five (5) working days in advance to ensure no delays in the Operation Permit issuance.

Please call me at 336-5572 to discuss any question you may have concerning this matter.

Sincerely,

Toni H Newell, R.S.

Toni Newell, R.S.
Individual Water and Wastewater Systems Program

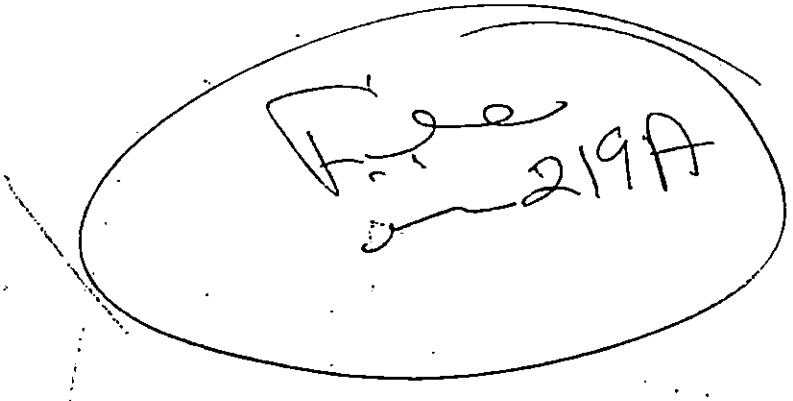

N. C. Department of Environment, Health, and Natural Resources/Division of Environmental Health

ON-SITE WASTEWATER VIOLATION NOTICE

TC # 215-121-13

OWNER D. L. HUDSON

MAILING ADDRESS 4000 STUART ANDREWS BOULEVARD, CHARLOTTE NC 28207

OCCUPANT _____

LOCATION 2832 MT. HARMONY ROAD, MATTHEWS, NC 282(

☒ RESIDENCE ☐ BUSINESS ☐ OTHER _____

You are hereby notified that you are violating the Rules adopted by the North Carolina Commission for Health Services or Article 11 of Chapter 130A of the General Statutes of North Carolina by owning or controlling a residence, place of business, or place of public assembly which is not provided with an approved wastewater system. Your wastewater system is not in compliance; the following corrections must be made. Consult your Local Health Department for advice and required permits by calling telephone number 336-5572.

☒ Install/Repair wastewater system. You must obtain an Improvement Permit from the local health department prior to repairing your system.

☐ Other Repairs (*specify*) _____

☐ Eliminate wastewater discharge and connect to an approved wastewater system.

☐ Perform Maintenance (*specify*) _____


☐ Pit Privy must be repaired/constructed.


If the wastewater violation is not brought into compliance by JUNE 21, 1993, appropriate legal action will be taken.

Notice Issued JUNE 9, 1993 (Date) Signed TONI H. NEWELL, R.S. (Agent) Division of Environmental Health

Compliance _____ (Date) Signed _____ (Agent) Division of Environmental Health

DEHNR 1108 (Revised 9/92)
On-Site Wastewater Section (Review 10/94)

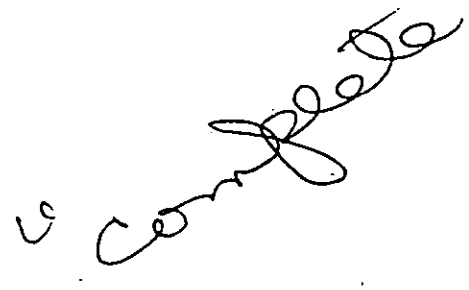

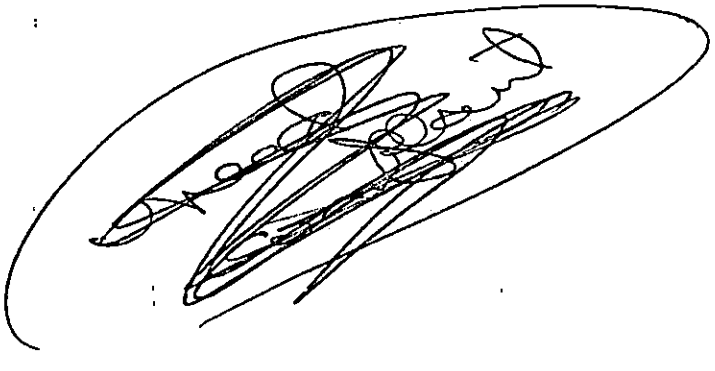

Mecklenburg County

Health Department

Betty S. Snow, R.N., M.A.
Health Director

March 26, 1993

D. L. Hudson
4000 Stuart Andrew Boulevard
Charlotte, NC 28217

Fee 219A 215-121-13

Dear Mr. Hudson:

At your request, an investigation was made of the septic tank system and a well water sample was collected on the property located at 2832 Mt Harmony Road, Matthews, North Carolina, on March 19, 1993.

During a recent investigation of your property at 2832 Mt Harmony Road, Matthews, North Carolina, it was found that the septic tank system was not functioning properly and that sewage was leaking to the surface of the ground, creating a public health hazard. This is in violation of Article 11 of Chapter 130A of the General Statutes of the State of North Carolina.

An application to repair is enclosed for your convenience. You must fill out the application to repair and contact me to arrange an appointment immediately. I can be reached at 336-~~5570~~.5572.

The laboratory analysis of the well wa[illegible] was reported to be negative for coliform bacter[illegible]

If you have any questions co[illegible] please contact me at 336-5572.

Sincerely,

Toni H. Newell, R.S.
Individual Water and Wastewater Systems

TN:lw