Date Received 4-27-84

MECK. COUNTY DEPARTMENT OF
RECEIVED
APR 27 1984
ENVIRONMENTAL HEALTH

SIR No. 20928

T. C. No. 131-216-02

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

APPLICATION FOR SOIL INVESTIGATION

1) NAME OF OWNER LILES (LAST) JOHNNY (FIRST) WESLEY (MIDDLE)

2) ADDRESS OF OWNER RT 14 Box 585 CHARLOTTE ZIP 28208

3) PHONE NO. Home 399-3910 Office —

4) LOCATION OF PROPERTY HART RD - IN SHUFFLE TOWN (STREET OR COUNTY ROAD)

5) SUBDIVISION _____ LOT NO. _____ BLOCK NO. _____

MAP BOOK NO. 8 PAGE NO. 405

6) DEED REFERENCE: DEED BOOK 2012 (2153) PAGE NO. 165 (585)

Application is hereby made to the Mecklenburg County Department of Environmental Health for the conduct of a soil investigation and an on site inspection of the lot hereinabove described for the purpose of determining if the lot is suitable for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge.

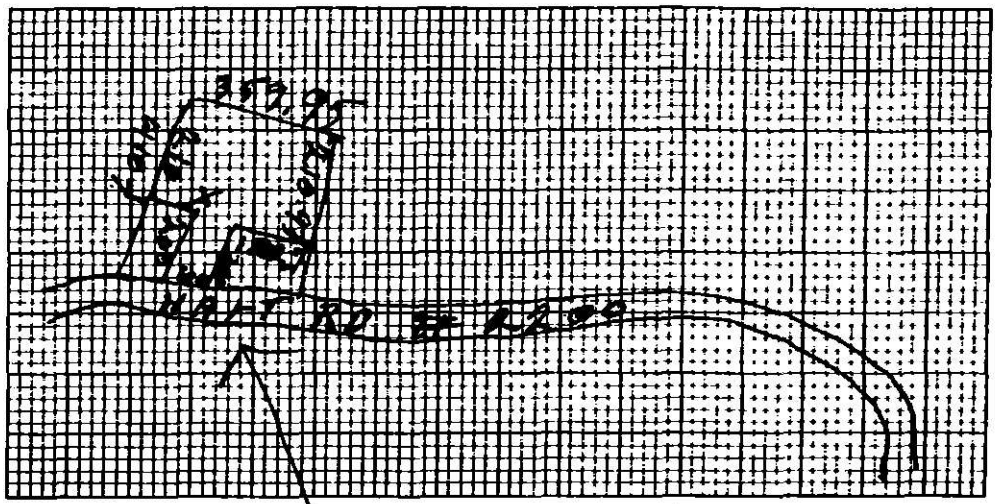

7) ACCURATELY DIAGRAM & DIMENSION LOT

PERK TEST X

Johnny Wesley Liles
OWNER

EHD-S-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Serial No. 5652

SIR No. 20928

Date Issued 5-25-84

T. C. No. 131-216-02

Map Date L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
SOIL INVESTIGATION REPORT

NAME OF OWNER Liles, (LAST) Johnny (FIRST) W. (MIDDLE)

ADDRESS OF OWNER Rt. 14, Box 585, Charlotte, NC ZIP 28208

LOCATION OF PROPERTY Hart Road (STREET OR COUNTY ROAD)

SUBDIVISION _____ LOT NO. _____ BLOCK NO. _____

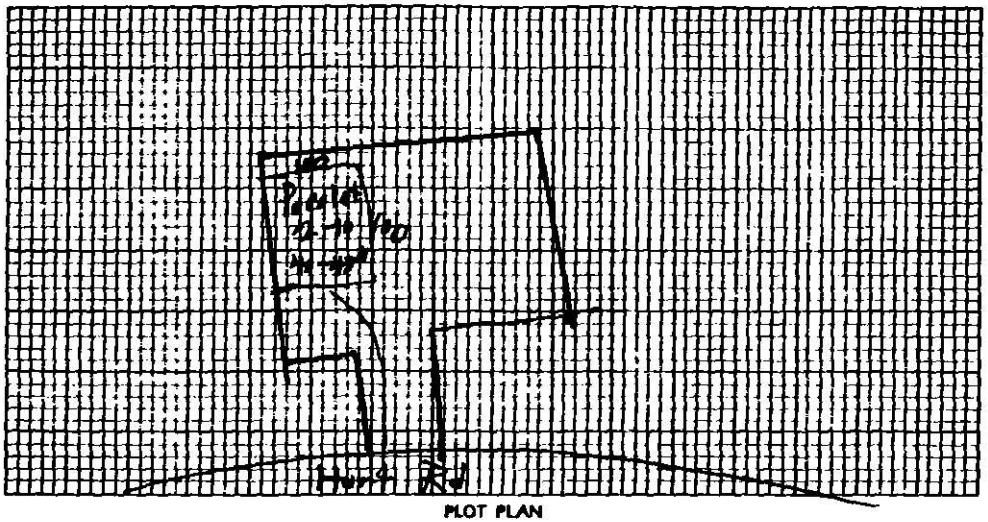

PLOT PLAN

This is to certify that a soil investigation and on-site investigation was made by the Mecklenburg County Department of Environmental Health on the lot described above. The said investigation was conducted on that portion of the lot as indicated on the above plot. **PROVISIONALLY SUITABLE**

The permeability rate determined by the investigation was _____. The said lot is approved for the installation of an individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge subject to the following terms and conditions:

1. A permit to install, construct, alter, or repair the specific system shall be obtained from the Mecklenburg County Department of Environmental Health prior to the beginning of any construction of buildings, or of the wastewater treatment system on the said lot.
2. The size of the septic tank wastewater treatment system which must be installed will be determined by the Mecklenburg County Department of Environmental Health prior to installation based on the permeability rate obtained above, and on the size and type of building constructed thereon.
3. This approval is valid only if the system is installed in the immediate area indicated as acceptable for system installation on the above plot.
4. This approval is void if any grading, filling, or construction (including the drilling of a well) is performed on the lot which, in the opinion of the Mecklenburg County Department of Environmental Health, renders the area indicated as acceptable for system installation unsuitable for installation, construction, alteration, and/or repair of such a system.

This approval is granted based on the laws of the State of North Carolina and the rules and regulations of the North Carolina Department of Human Resources, Division of Health Services and the Mecklenburg County Health Commission which were in effect on the date of issuance and is void if at any time in the future, prior to completion of the system, these laws, rules and regulations are changed such that this approval would not have been granted had the new or revised laws, rules, and regulations been in effect on the issue date.

Wilbur Ramsey
Soil Scientist

Eric D. Harbster Jr.
Environmental Health Director or Authorized Section Head

EHD-5-76

Environmental Health Department's Copy

DEPARTMENT OF ENVIRONMENTAL HEALTH
MECKLENBURG COUNTY, NORTH CAROLINA

SITE EVALUATION

S.I.R. NO. 20928

T.C. NO. 131-216-02

(Ground Absorption Sewage Disposal)

OWNER: Johnny W. Liles
ADDRESS: R-14 Box 575 Charlotte 28209
LOCATION OF SITE: Hart Rd

PLAT NO:
LOT SIZE: 1A

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4
1. SLOPE (%)	S (PS) 2-10 U	S PS U	S PS U	S PS U
2. SOIL TEXTURE (12-36 inches) Sandy, Loamy, Clayey (Note 2-1 Clay)	S (PS) Clayey U	S PS U	S PS U	S PS U
3. SOIL STRUCTURE (12-36 inches)	S (PS) Blocky U	S PS U	S PS U	S PS U
4. SOIL DEPTH (inches)	S (PS) 40-48" U	S PS U	S PS U	S PS U
5. RESTRICTIVE HORIZONS (Inches) (Impervious strata, Rock)	S (PS) None U	S PS U	S PS U	S PS U
6. SOIL DRAINAGE/GROUNDWATER (external and internal)	S (PS) Adequate U	S PS U	S PS U	S PS U
7. OTHER (Specify)	S PS U	S PS U	S PS U	S PS U
8. SOIL GROUP	IVa			
9. SITE CLASSIFICATION	P, Suitable			
10. SOIL SERIES	Pacolet			

S - Suitable PS - Provisionally Suitable U - Unsuitable

**See Diagram on Back (includes: soil areas, property lines, roads, streams, gullies, wet areas, fill areas, wells, water bodies, slopes)

Recommendations/Comments:

Described by: W. B. Ramsey
Title: Soil Scientist

Date: 5-24-84

#

Part of 2.23 A

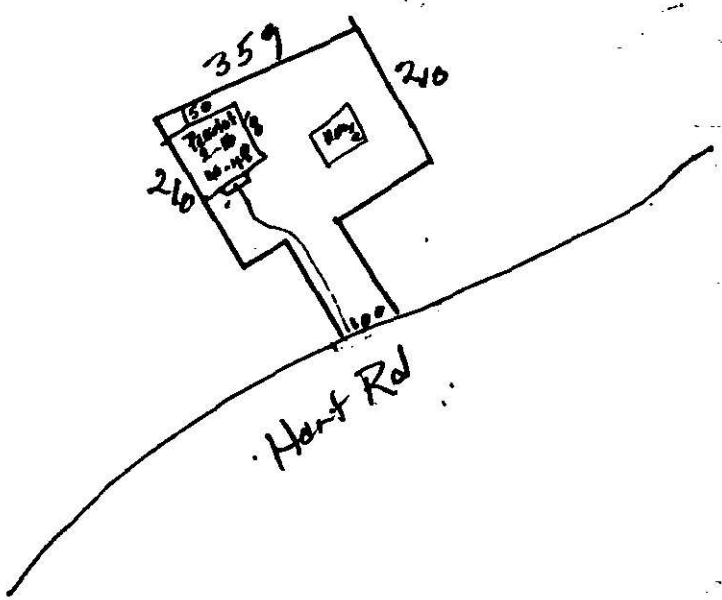

4

SEE INSTRUCTIONS ON BACK

Date Received 8/28/84

MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH
RECEIVED
AUG 29 1984
ENVIRONMENTAL HEALTH

(CAR (S) Application No. 20928

T. C. No. 131-216-02

Map Date 1

MECKLENBURG COUNTY DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an Installation, Construction, Alteration, and/or Repair Permit (Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) ___ Install or Construct 2) ___ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

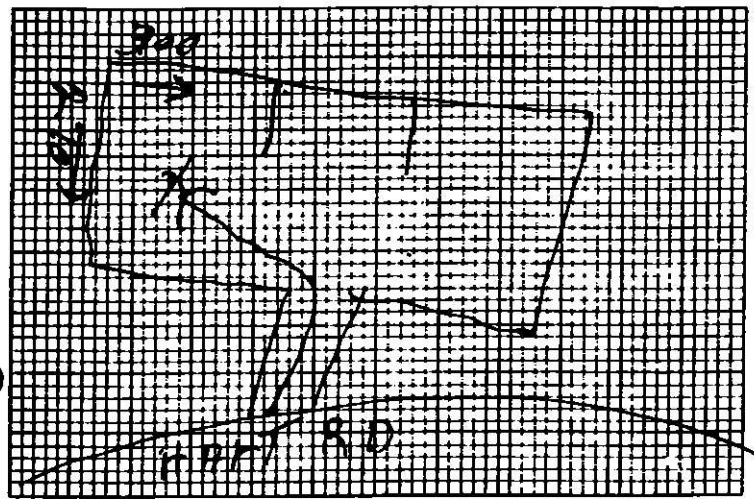

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ✓ Yes ___ No
Residence ___ Yes ___ No

4) No. of Bedrooms 1
5) Business Use — Max No Employees ___
6) Washing Machine ___ Yes ✓ No
7) Garbage Disposal ___ Yes ✓ No
8) Dishwasher ___ Yes ✓ No
9) Water Supply:
A) Individual Well ___
B) Governmental System ___
C) Community System:
1. Well source ✓
2 Governmental source ___
10) Sewage System:
House located within 200 feet of public sewer ___ Yes ✓ No
House located within 200 feet of community sewer ___ Yes ✓ No
11) FHA Case No. ___
12) VA Case No. ___

13) NAME OF OWNER LILES (LAST) JOHNNY (FIRST) W. (MIDDLE)

14) ADDRESS OF OWNER RT 14 BOX 585 CHARLOTTE NC

15) PHONE NO. Home 399-3910 Office ___

16) LOCATION OF SYSTEM [redacted] (STREET OR COUNTY ROAD)

17) SUBDIVISION 1915 HAPT RD Lot No. ___ Block No. ___

Map Book No. ___ Page No. ___

18) DEED REFERENCE — DEED BOOK ___ AT PAGE ___

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES ___ NO DATE RUN 5-25-84

20) PTR NUMBER (See Instructions) ___

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for hereinshall be void and of no effect if any of the above facts are not true.

8-20-84
DATE OF APPLICATION

Johnny W Liles
SIGNATURE

EHD-8-76

Environmental Health Department's Copy

Date Issued 8-22-84

Serial No. 07458

ICAR(S) Permit No. 20928

T. C. No. 131-216-01

Map Date L

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ✓ Install or Construct, ____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 20928, dated 8-20-84 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 9-22-84, after which date this permit shall be null and void.

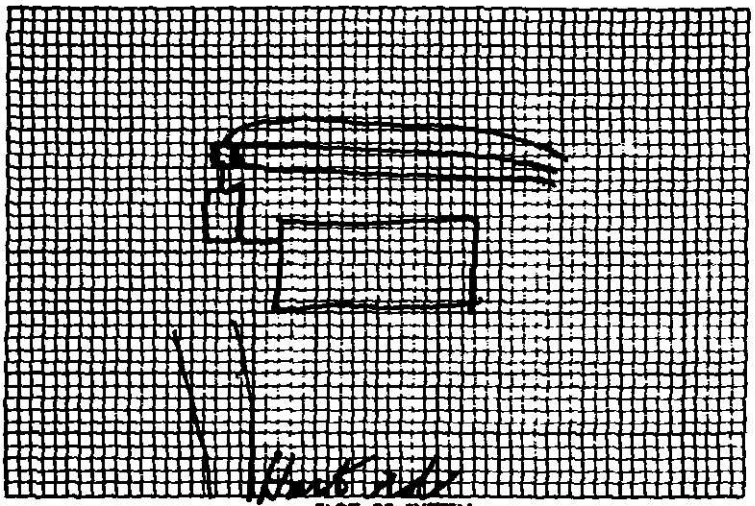

PLOT OF SYSTEM

Permeability Rate RL

Liquid Capacity of Tank 1500

Tank Construction PCC

Absorption and/or Nitrification Lines:

Total Line Length 200'

Number of Lines 3

Distance from House 5'

Distance from Property Line 10'

Distance from Well Not known yet

NAME OF OWNER Johnny Liles

LOCATION OF PROPERTY 1915 Hank Rd

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Health Commission which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered uninspectable or can be used. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

3 line 3 X 67 X 12 stone, straw cover, grade bds on 9' centers

Comments: ____

W. B. Ramsey
Division or Section Head

B. R. Ferguson
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

BHB-5-76

Environmental Health Department's Copy