

BALMORAL DRIVE
001-382-37

5/31/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 5266A DATE: 5/19/89

TC: 001-382.37 ☒ L ☐ CRT

SERIAL № 11879

Name of Owner: Burnette, Thomas E Juris.:

Address of Property: 16313 Balmoral Dr

Inspection Data:

Tank Material: PCC

Total Length of Drainfield: 133'

Number of Lines: 2 @ 66.5'

Cover Depth: 18"

Water Supply Source: Well

Distance to Water Source: > 50'

Excavation Inspected: 5/19/89

Tank(s) Inspected:

Wash Line Inspected: 5/19/89

High Water Alarm Inspected:

PLOT

Design: 1989 Repair CTR# 165

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☒ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 10 NCAC 10A .1900, "Laws And Rules For Sanitary Sewage Collection, Treatment, And Disposal" in effect on the date of issuance of the permit. The issuance of this

☒ Certificate of Completion ☐ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 10 NCAC 10A .1900 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

COMMENTS:

Judy J. Kaier R.S.
Environmentalist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR PERMIT


MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 5266 A DATE: 12/12/88

TC: 001138237 ☐ L

SERIAL Nº 12378

Permission is hereby given to ____ Install or Construct, ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 12/7/88. All work shall be completed on or before 1/12/89, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 10 NCAC 10A .1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Department of Environmental Health before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

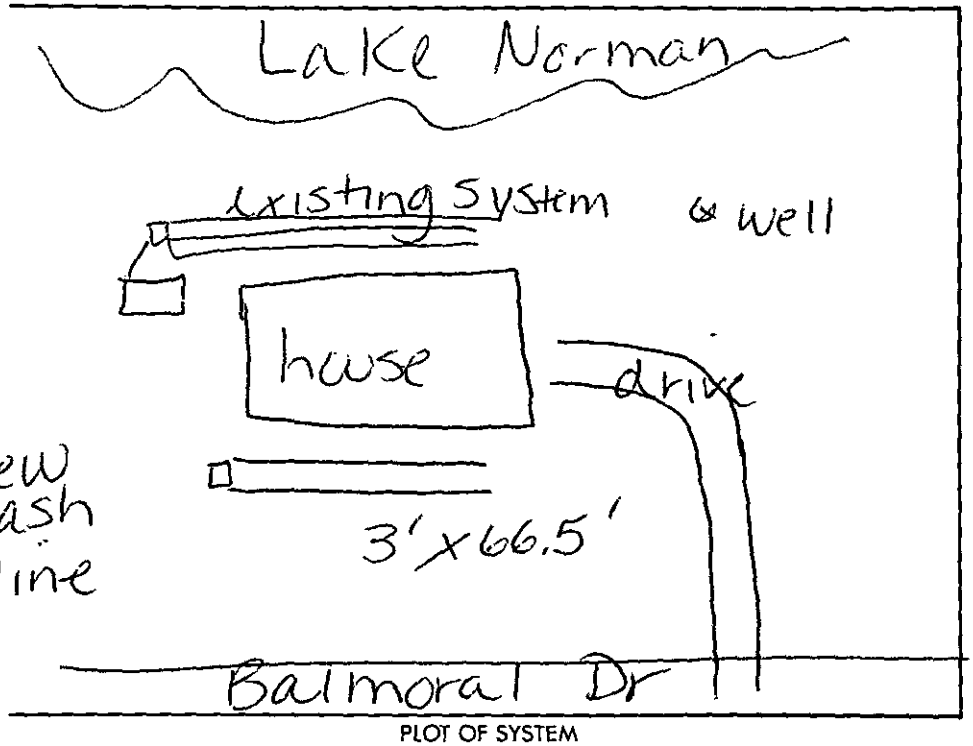

PLOT OF SYSTEM

Liquid Capacity of Septic Tank ____ gallons

Liquid Capacity of Dosing Tank ____ gallons

Tank Construction ____

Absorption and/or Nitrification Lines:

Trench Width 3 feet

Total Line Length 133 feet

Number of Lines 2

Depth of Stone 12 inches

Distance from House >5 feet

Distance from Property Line >10 feet

Distance from Well >50 feet

NAME OF OWNER Thomas E. Bunette

LOCATION OF PROPERTY 16313 Balmoral Dr

Comments: Install 2 trenches 3'x66.5'x12" stone for washing machine line (to accumulate addition of a bedroom)

S. Daniel, RS
Division or Section Head

Karla W. Johnson
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

WHITE - ENVIRONMENTAL HEALTH DEPARTMENT'S COPY ● CANARY - ENVIRONMENTALIST'S COPY ● PINK - OWNER OR AGENTS COPY

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION

CHARGE SLIP

Date 12/8/88

Name/Company Thomas E. Burnette

Sanitation _____

Vector Control _____

O.P.W.D. ✓

Service: Imp - Addition
#526674

MECKLENBURG COUNTY
HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
PAID

DEC 8 1988

Fee: $ 95 —

Completed by

Collected by

APPLICATION FOR AN IMPROVEMENT PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

(OFFICE USE ONLY)
FILE: 52666A
TC: _____
SERIAL: № 17395 ☐ L ☒ CRT

JOB LOCATION

① ADDRESS: 16313 BALMORAL DRIVE (STREET NO. / STREET) ② FILE: _____
③ JURISDICTION: _____ ④ TAX PARCEL NO.: 00138237
⑤ SUBDIVISION: _____ ⑥ LOT: _____ ⑦ BLOCK: _____

OWNER

⑧ NAME: THOMAS (FIRST) EMMITT (MIDDLE) BURNETTE (LAST)
⑨ MAILING ADDRESS: RT 6 Box 619A
⑩ CITY: MOORESVILLE ⑪ STATE: N.C. ⑫ ZIP: 28115
⑬ PHONE: (WORK) 333-4181 ⑭ (HOME) 664-2024

REQUEST

This request is for a(n):

⑮ ☐ New permit
⑯ ☐ Repair or alteration permit
⑰ ☐ Authorization for mobile home exchange
⑱ ☒ Other (specify) REPLACE MOBILE HOME W/ HOUSE

DESIGN CRITERIA

System will serve:

⑲ ☒ Residence ⑳ ☐ Mobile home ㉑ ☐ Business or place of public assembly
㉒ Number of bedrooms? THREE ㉕ Type? _____
㉓ Maximum occupancy? TWO ㉖ Maximum number of employees? _____
㉔ Basement? ☐ yes ☒ no ㉗ Maximum number of seats? _____

WATER SUPPLY

㉘ Water supply from (present or proposed):

A ☒ Individual well
B ☐ Municipal system
C ☐ Community well
D ☐ Community system

㉙ The undersigned, owner of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: X Thomas E. Burnette
Date: 7 DEC 88

IMPROVEMENT PERMIT

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

... No work shall be conducted on the septic tank system until an Installation, Construction, Alteration and/or Repair permit is issued by this Department.

... This permit is not transferable, and shall become null and void 36 months from the date of issuance.

Karla W. Johnson RS 12/13/88
Environmentalist Date

Director or Authorized Section Head RS 12/13/88 Date

*This permit must be signed by the Director of Mecklenburg County Health Department or an authorized section head in order to be valid.

PROPOSED PLOT PLAN


MECKLENBURG COUNTY · ENVIRONMENTAL HEALTH

1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 52166A

TC: _____

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

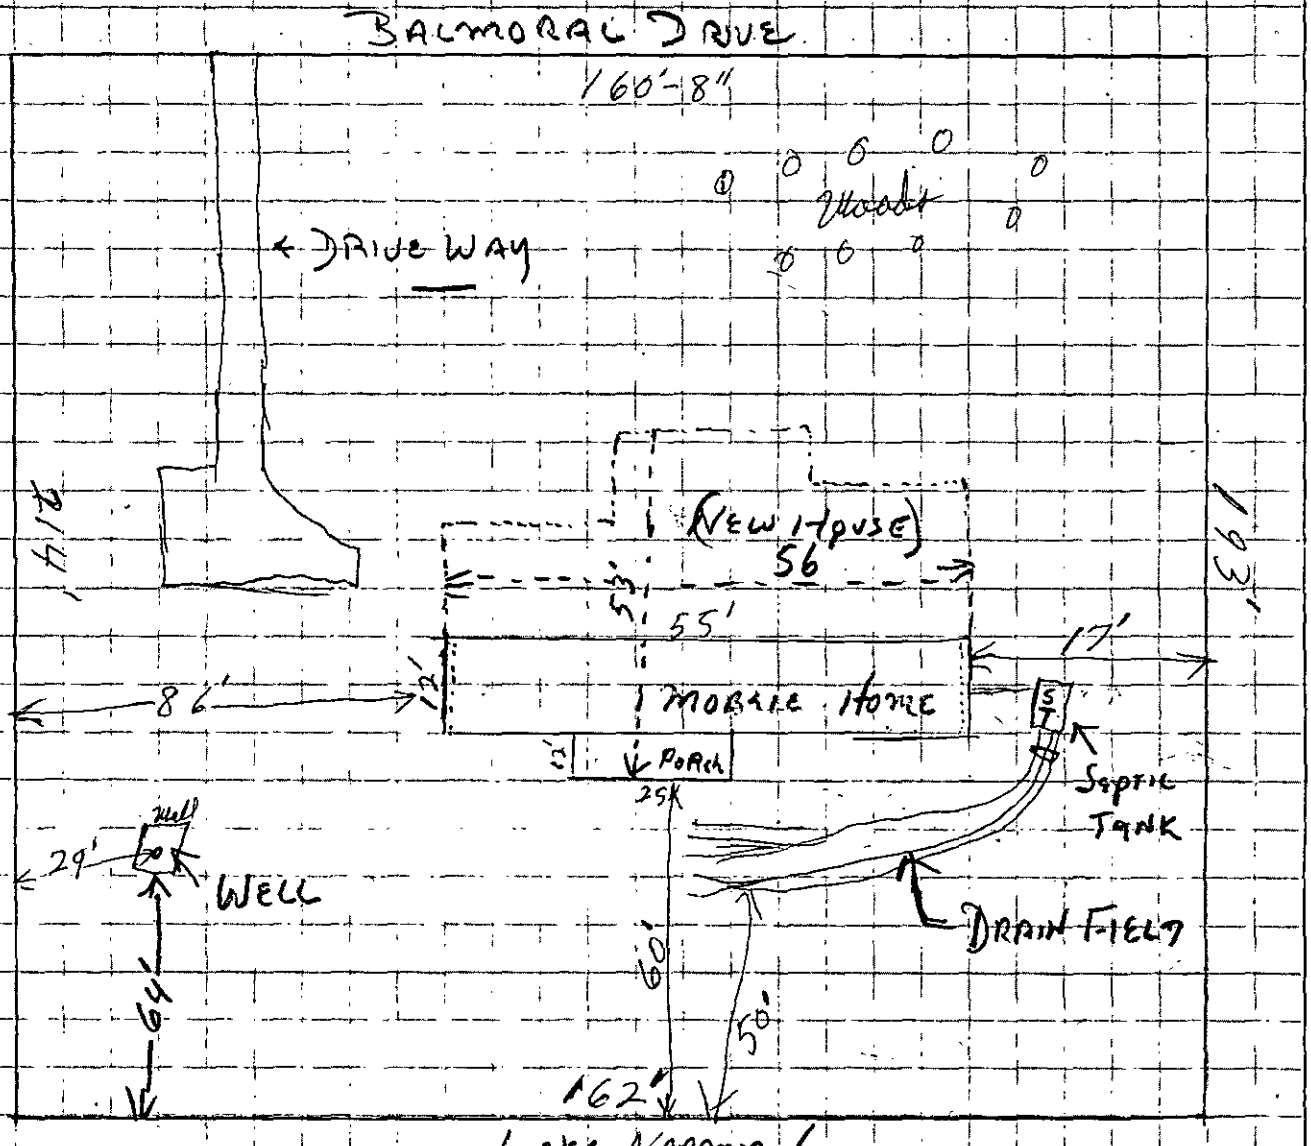

NOTE: THE EXISTING MOBILE HOME IS IN PEN AND THE PROPOSED NEW HOUSE IS DRAWN IN PENCIL.

Signed: Thomas E. Burnett

Date: 7 Dec 88