Supervisor/Administrative Professional Checklist

New Septic ☒ New Well ☐ Use Existing ☐ Alteration ☐ Modified Plot Plan ☐

New Septic Fees Paid

IP ($250.00) LE 11/20/17 ___ Initials/Date

CA ($200.00) LE 2/9/18 ___ Initials/Date

OP ($200.00) LE 2/9/18 ___ Initials/Date

File Complete

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 _____ Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid) _____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. ☑ Reviewed ☑ SAM
OK TO ISSUE CA 2-9-18

This site is served by septic and well. Verify each is complete before final hold is released. ☑

Septic file completed. ☑ JAM 1-30-19 Well file completed. ☐ _____

Send permit for signature. ☑ Signature received. ☑ _____

This septic system requires a certified operator contract before final hold is released. ☐

Certified operator contract is on file. ☐ _____

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	02/09/18	**Amount:**	200.00
Receipt #:	109313	**Tendered:**	200.00
Check / Auth #:	VISA 07536G	**Returned:**	0.00
Received By:	ELLISLW		

Account Information

Account #: 200000
Contractor: HARDY, DAWN
Attn:
Address: 127 PROMENADE DR
Address:
City/State/Zip: MOORESVILLE, NC 28117

Item	Description	Permit#	Quantity	Unit Price	Total Price
0703	Septic Operational Permit 8115 MCILWAINE ROAD		1	200.00	200.00

----------**Outstanding Balances**----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date:	02/09/18	**Amount:**	200.00
Receipt #:	109314	**Tendered:**	200.00
Check / Auth #:	VISA 07536G	**Returned:**	0.00
Received By:	ELLISLW		

Account Information

Account #: 200000
Contractor: HARDY, DAWN
Attn:
Address: 127 PROMENADE DR
Address:
City/State/Zip: MOORESVILLE, NC 28117

Item	Description	Permit#	Quantity	Unit Price	Total Price
0734	Septic Construction Authorizat 8115 MCILWAINE ROAD		1	200.00	200.00

----------Outstanding Balances----------

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

Payment Receipt

Mecklenburg County POS

Environmental Health
700 N. Tryon Street
Charlotte, NC 28202
Phone: 704-336-5100

Enter Account # or Customer Name Here: DAWN HARDY

Bill To:

DAWN HARDY
127 PROMENADE DR

Mooresville, NC 28117

Single Payment

Transaction Date:	02/09/2018 5:22 AM Pacific Time
Pay Method:	VISA **********5983
Approval #:	07536G
Trace Number:	8ba6b263-c506-4d7e-a482-0c86e60fd5b3
Amount:	$400.00

Payment Amount:	$400.00
Total:	**$400.00**

Thank you for your payment.

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt


Receipt Information

Date:	11/16/17	**Amount:**	250.00
Receipt #:	108231	**Tendered:**	250.00
Check / Auth #:	VISA 98021G	**Returned:**	0.00
Received By:	ELLISLW		

Account Information

Account #: 200000
Contractor: HOCHSTETLER, LINSEY
Attn:
Address: 127 PROMENADE DR
Address:
City/State/Zip: MOORESVILLE, NC 28117

Item	Description	Permit#	Quantity	Unit Price	Total Price
0701	Improvment Permit App-Residen 8115 MCILWAINE RD		1	250.00	250.00

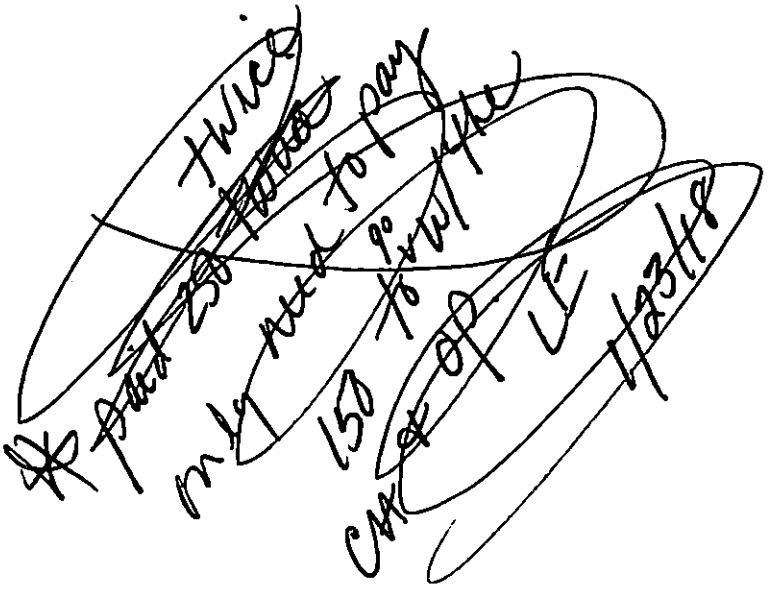

---Outstanding Balances---

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance

Payment Receipt

Mecklenburg County POS

Environmental Health
700 N. Tryon Street
Charlotte, NC 28202
Phone: 704-336-5100

Enter Account # or Customer Name Here: LINSEY HOCHSTETLER

Bill To:

LINSEY HOCHSTETLER
127 PROMENADE DR

Mooresville, NC 28117

Single Payment

Transaction Date: 11/16/2017 9:09 AM Pacific Time
Pay Method: VISA **********9178
Approval #: 98021G
Trace Number: a4afb581-2b84-4075-b5b7-eee5b1f5b033
Amount: $250.00

Payment Amount: $250.00

Total: $250.00

Thank you for your payment.

Groundwater & Wastewater Services: Septic Project File & D

GWS File #:	95248
WASPS App #:	9307
Primary ES assigned to project:	Jeremy Michelone
Secondary ES assigned to project:	
Project Type:	New System
Site Evaluation Information: .1939(a)(1) - Topography and Landscape Position Recorded?	Yes
Site Evaluation Information: .1940(a-g) - Slope % Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Texture Class Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Structure Type Recorded?	Yes
Site Evaluation Information: .1939 (a)(2) - Consistence Recorded?	Yes
Site Evaluation Information: .1939(a)(2) - Mineralogy Recorded?	Yes
Site Evaluation Information: .1939(a)(3) - Soil Wetness Condition Recorded?	Yes
Site Evaluation Information: .1939(a)(4) - Soil Depth to Rock or Parent Material Recorded when Encountered?	Yes
Site Evaluation Information: .1939(a)(5) - Depth to Restrictive Horizons Recorded when Encountered?	Yes
Site Evaluation Information: .1939(a)(6) - Sufficient Available Space Recorded?	Yes
Site Evaluation Information: .1937(m) - Are the Profile Locations Shown?	Yes
Site Evaluation Information: .1939(a) - Are the S/PS Profiles in system & in repair area?	Yes
Site Evaluation Information: .1939(d), .1955, .1956, .1957 - LTAR	Yes
Improvement Permit/Construction Authorization: .1937(g), 130A-336(a) - Proposed System Type stated - Initial	Yes
Improvement Permit/Construction Authorization: .1945(b) - Proposed System Type stated - Repair	Yes
Improvement Permit/Construction Authorization: 130A-336(a)(3) - System location identifiable by setbacks - Initial	Yes
Improvement Permit/Construction Authorization: .1937(g), .1945(b) - System components shown - Initial	Yes
Information Permit/Construction Authorization: .1945(b) - Repair area shown	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Does System design match facility, flow & WW characteristics?	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Is System design consistent with soil/site conditions?	Yes
Improvement Permit/Construction Authorization: .1937(f)(g) - Is the System located in the approved area?	Yes
Improvement Permit/Construction Authorization: 130A-336(a) - Number of Bedrooms, employees, seats, etc. indicated?	Yes
Improvement Permit/Construction Authorization: .1937 (g) - Trench depth correct?	Yes
Improvement Permit/Construction Authorization: .1937(g) - Trench width correct?	Yes
Improvement Permit/Construction Authorization: .19379(g) - Trench length correct?	Yes
Improvement Permit/Construction Authorization: 130A-336(a)(1) - Proposed/existing well shown?	Yes

Improvement Permit/Construction Authorization: 130A-336(a)(1) - Property line lengths shown?	Yes
Improvement Permit/Construction Authorization: 130A-336(a) - Facility/appurtenance setbacks shown from fixed points?	Yes
Corrections/modifications needed?	No
Comments:	
IA issued date:	
OP issued date:	1-28-19
Review performed by:	Jeremy Michael
Date performed:	1/16/2018

Created at 1/16/2018 4:06 PM by Michael, Jeremy
Last modified at 1/16/2018 4:06 PM by Michael, Jeremy

Close

9880B Vineyard

13 NOV '17 PM12:11

MECKLENBURG COUNTY
HEALTH DEPARTMENT

#937

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION
FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ☒ NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ○ N/A ☒ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:
TAX PARCEL NUMBER: 01543104
STREET ADDRESS: 8115 McIlwaine Rd
CITY: Huntersville
STATE: NC ZIP: 28078
SUBDIVISION NAME: _____
LOT #: 2 LOT SIZE (acres): 4
TOWNSHIP:
○ MECKLENBURG ○ CORNELIUS ☒ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:
BUILDING TYPE:
○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
☒ HOUSE ○ OTHER _____
HEATED SQUARE FOOTAGE: 2694
NUMBER OF BEDROOMS: 3
NUMBER OF OCCUPANTS: 4
FOUNDATION TYPE:
○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
☒ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☒ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ○ MUNICIPAL ☒ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ○ N/A ○ IRRIGATION ☒ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☒ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ☒ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ☒ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ☒ NO	JURISDICTIONAL WETLANDS	○ YES ☒ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ☒ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ☒ NO
EASEMENTS OR RIGHT-OF-WAYS	○ YES ☒ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ☒ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ☒ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ☒ NO
WASTE STORAGE	○ YES ☒ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ☒ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☒ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? 10/23/17 ☐ N/A

12. PROPERTY OWNER:
NAME: Cory Vineyard
ADDRESS: 2628 J. Brady Beach Lane
CITY: Charlotte
STATE: NC ZIP: 28214
WORK PHONE: _____
MOBILE PHONE: 612-750-3153
FAX: _____
E-MAIL: Cory.Vineyard@gmail.com

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:
NAME: TOM Arndt Bluefield Builders, LLC
ADDRESS: 127 Promenade Dr.
CITY: Mooresville
STATE: NC ZIP: 28117
WORK PHONE: 704 746 3536
MOBILE PHONE: 704-658-7674
FAX: _____
E-MAIL: Tarndt@arhomes.com
Dawn Hardy Dhardy@

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1660, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

_____ 11/13/17

Property Owner's or Owner's Legal Representative Signature — Date

---

OFFICE USE ONLY

O SURVEY PLAT TO SCALE SUBMITTED O SCALED SITE PLAN SUBMITTED O UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

MECKLENBURG COUNTY
Public Health

Gibbie Harris, MSPH, BSN
Health Director

(704) 336-4700

Addendum to Application for
New Well or Septic System Installation
Abandonment or Repair of Existing Well or Septic System

Your signature below confirms the following:

1. The information on the application is true, complete and accurate.

2. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliances with applicable laws and rules.

3. I acknowledge that Dawn Hardy is acting as my legal representative (agent) in the submittal of the application for a water supply well or septic permit located at

8115 Mcilwaine Huntersville
Number Street Town
(Or parcel Number)

Corey L. Vineyard
Property Owner (print name)

Corey L. Vineyard
Property Owner (signature)

11/16/17
Date


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: 8115 McIlwaine Rd Tax Parcel #: _____

Subdivision Name: _____ Lot #: 2

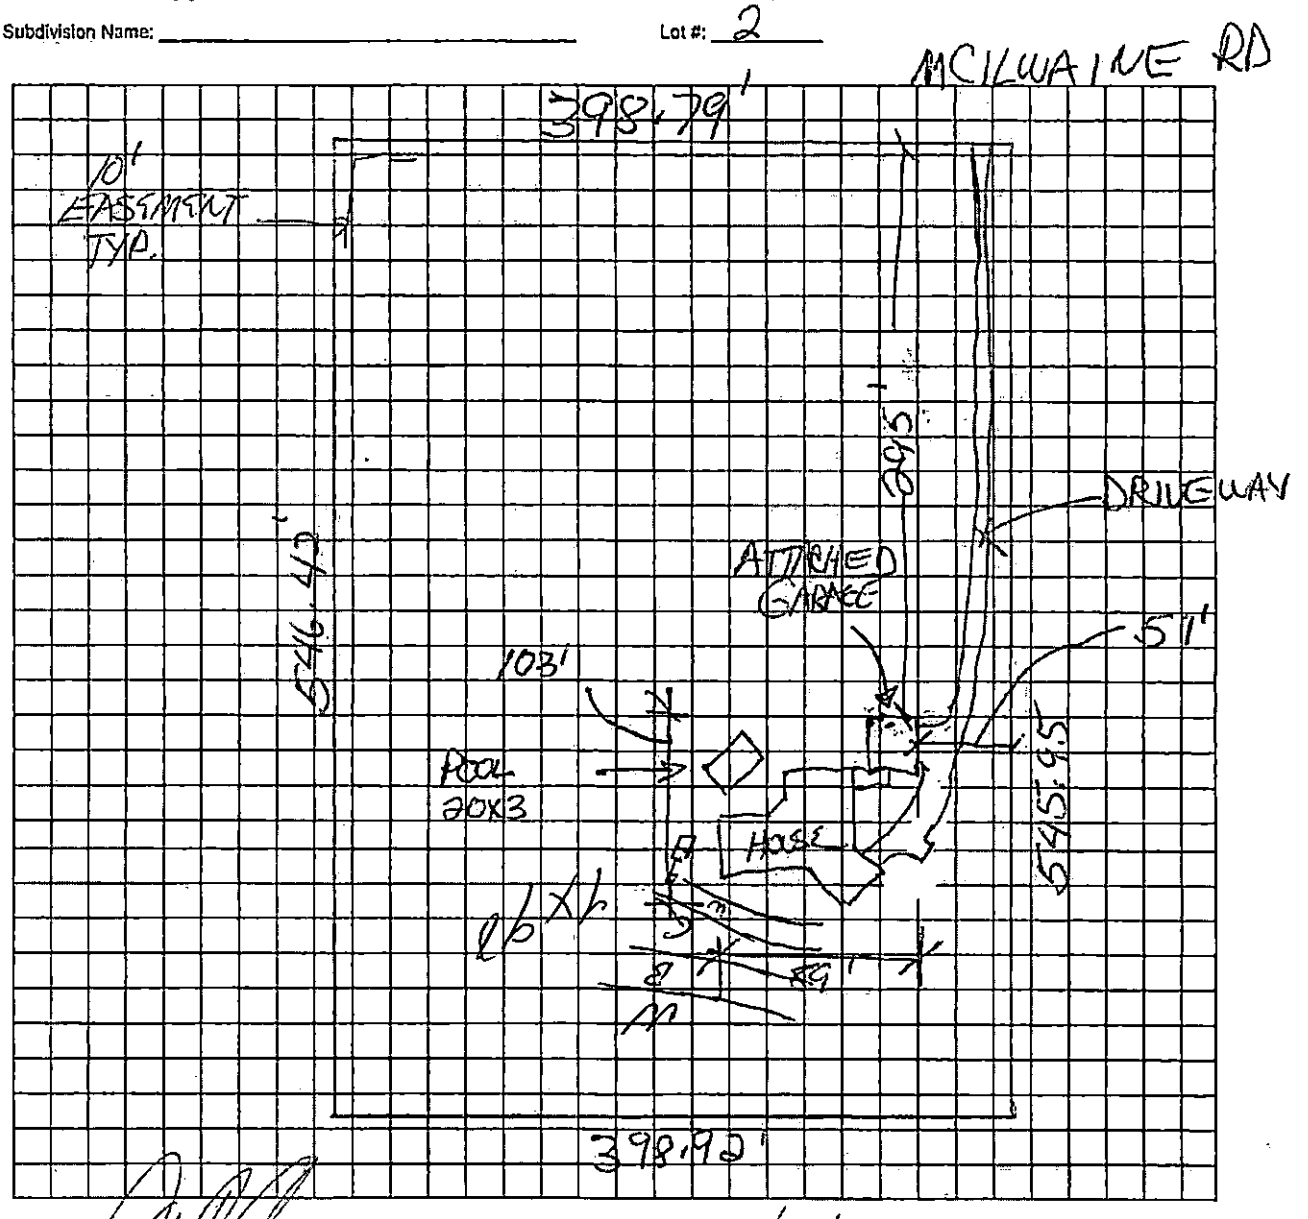


Property Owner's or Owner's Legal Representative Signature

11/13/17
Date

MECKLENBURG COUNTY – GROUNDWATER & WASTEWATER SERVICES
700 N. TRYON ST. SUITE 211 CHARLOTTE, NC 28202, OFFICE: 980-314-1680, FAX: 704-336-6894
Email: Wellreg@MecklenburgCountyNC.gov

Revised on: 4/20/17

Arthur Rutenberg Homes

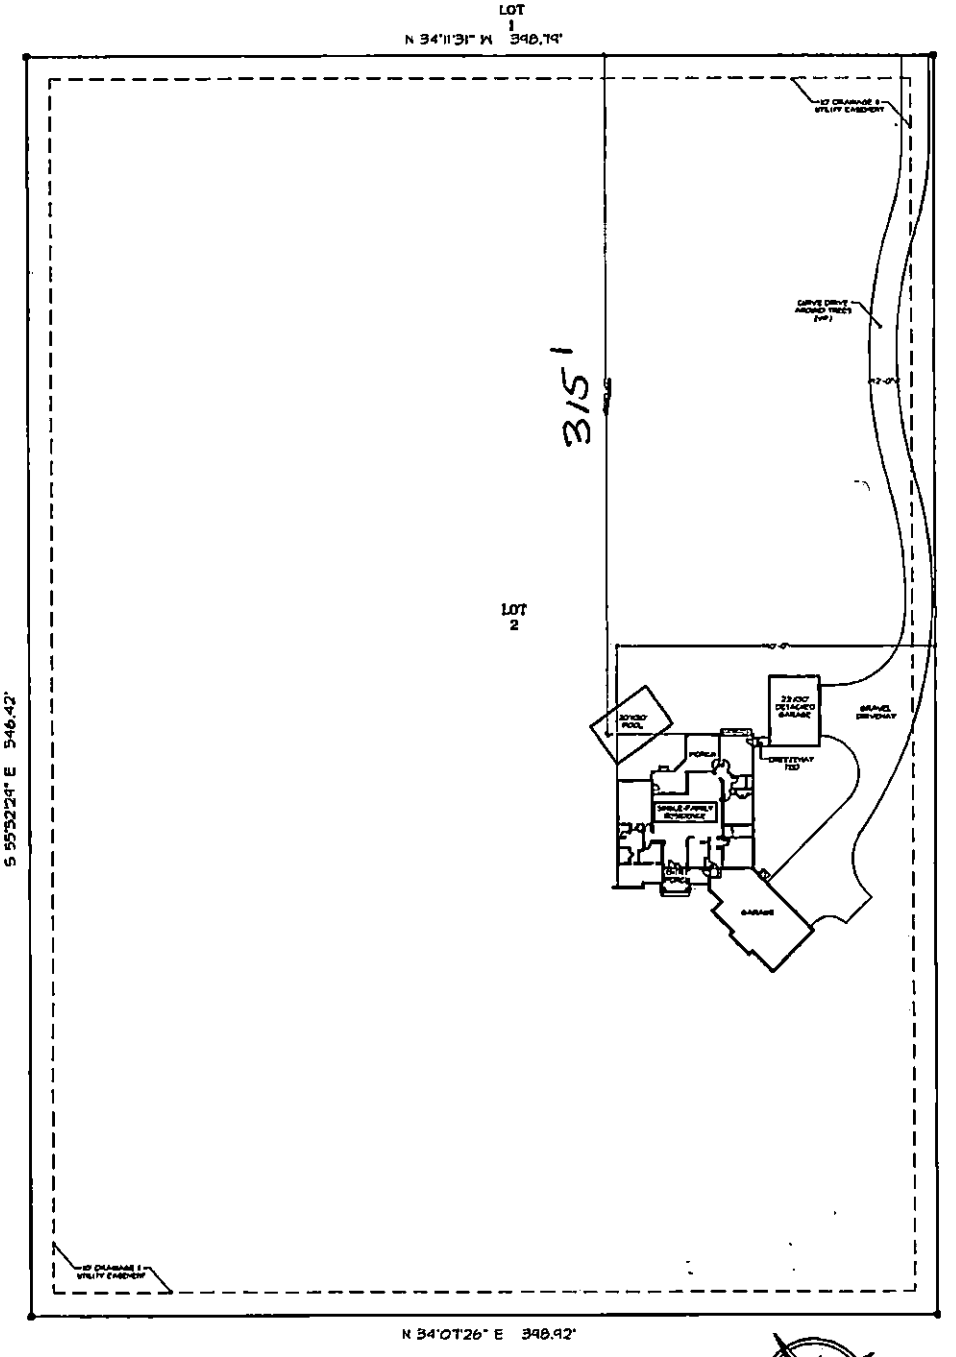

LOT AREAS:		
HOUSE	4314	SQ. FT.
DRIVEWAY (TO PROPERTY LINE)	6066	SQ. FT.
BREEZEWAY	18	SQ. FT.
CONCRETE PAD	12	SQ. FT.
POOL (TBD)	600	SQ. FT.
DETACHED GARAGE (TBD)	660	SQ. FT.
PERVIOUS	205,411	SQ. FT.
TOTAL	217,041	SQ. FT.

0 25 50 75 100 125

SCALE: 1" = 50'

This plan is the sole and exclusive property of Arthur Rutenberg Homes, Inc.
The reproduction, use or modification of this plan, for any purpose other than building a home with Arthur Rutenberg Homes or its authorized franchisees, is strictly prohibited.

Note: Plan information is conceptual only. Certain items may be changed at production stage.

Franchise: #98 Bluefield Builders, LLC
File #: Vineyard-B
Drawn By: MDF
Date: July 3, 2017

1406F-R-01-3S-"B"

A Custom Residence for:
Mr. and Mrs. Vineyard
Lot 2

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 3
Property ID: 015-431-04
Lot #: NA
File #: 9524B
AppID: 9307

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Cory Vineyard
Address: 2628 Shady Reach Ln, Charlotte, NC 28214
Proposed Facility: 3BR House
Design Flow (.1949): 360 GPD
Location of Site: 8115 McIlwaine Rd, Huntersville, NC 28078
Water Supply: [ ] Public [ ] Individual [X] Well [ ] Spring [ ] Municipal
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

Applicant: Tom Arndt Bluefield Builders
Date Evaluated: 7/14/2016 & 1/5/2018
Property Size: 4 ac
Property Recorded: Unknown

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
Boring #1	LS 9%	0 - 15	gr SCL	SS SP FR SEXP	>51"	51	NA	NA	saprolite inclusions 40 - 51"	PS IV 0.275	36"
		15 - 40	sbk C	S P FI SEXP							
		40 - 51	sbk CL	SS P FI SEXP							
Boring #2	LS 5%	0 - 7	gr SL	SS SP FR SEXP	>51"	51	NA	NA		PS IV 0.25	36"
		7 - 28	gr/sbk SCL	SS SP FR SEXP							
		28 - 51	sbk C	S P FI SEXP							
Boring #3	LS 5%	0 - 4	gr SL	SS SP FR SEXP	>50"	50	NA	NA	saprolite inclusions 24 - 50"	PS IV 0.275	36"
		4 - 24	sbk C	S P FI SEXP							
		24 - 36	sbk CL	SS SP FR SEXP							
		36 - 50	sbk SCL	SS SP FR SEXP							
Boring #4	LS 5%	0 - 12	gr SCL	SS SP FR SEXP	>50"	50	NA	NA	saprolite inclusions 32 - 50"	PS IV 0.25	36"
		12 - 32	sbk/abk C	S P FI SEXP							
		32 - 50	sbk CL	SS P FI SEXP							
		50	Saprolite								
Boring #5	LS 5%	0 - 5	gr SL	SS SP FR SEXP	>50"	50	NA	NA	saprolite and weathered rock inclusions 35 - 50"	PS IV 0.25	36"
		5 - 14	gr SCL	SS SP FR SEXP							
		14 - 35	sbk C	S P FI SEXP							
		35 - 50	sbk CL	SS SP FR SEXP							

Description	Initial System	Repair System
Available Space (.1945)		
System Type(s)		
Site LTAR (gpd/sq ft)	0.25	0.25

Other Factors (.1946):
Soil Evaluation By: Jacob Presley, LSS, REHS
Others Present:
Site Classification (.1948):
Site Evaluation By:
Others Present:

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM
CONTINUED


PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY .1941 .1941 Structure/ Texture	.1941 Consistence Mineralogy	b PROFILE FACTORS .1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
Boring #6	LS 6%	0 - 6	sbk SCL	SS SP FR SEXP	>50"	50	NA	NA	saprolite inclusions 36 - 50"	**PS IV 0.275**	**36"**
		6 - 25	sbk SC	S P FI SEXP							
		25 - 50	sbk SCL	SS P FI SEXP							
Boring #7	LS 5%	0 - 20	gr/sbk SCL	SS SP FR SEXP	>50"	50	NA	NA		**PS IV 0.25**	**36"**
		20 - 50	sbk C	S P FR SEXP							
Boring #8	LS 12%	0 - 17	sbk SCL	SS SP FR SEXP	>52"	52	NA	NA	saprolite inclusions 36 - 52"	**PS IV 0.275**	**36"**
		17 - 42	sbk C	S P FI SEXP							
		42 - 52	sbk CL	SS P FR SEXP							

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	sg-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		mass-Massive
LS-Linear Slope				cr-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	gr-Granular
NS-Nose Slope		L-Loam		sbk-Subangular Blocky
HS-Head Slope				abk-Angular Blocky
CC-Concave Slope	III	Si-Silt	0.6 - 0.3	pl-Platy
CV-Convex Slope		SiCL-Silty Clay Loam		pr-Prismatic
T-Terrace				Sap-Saprolite
FP-Flood Plain		CL-Clay Loam		**Structure Prefixes**
D-Drainage Way		SCL-Sandy Clay Loam		w-weak
				m-moderate
		SiL-Silt Loam		s-strong
				f-fine
	IV	SC-Sandy Clay	0.4 - 0.1	m-medium
		SiC-Silty Clay		c-coarse
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	SS-Slightly Sticky	SEXP-Slightly Expansive
FR-Friable	S-Sticky	EXP-Expansive
FI-Firm	VS-Very Sticky	
VFI-Very Firm	NP-Non-Plastic	**Classification**
EFI-Extremely Firm	SP-Slightly Plastic	US-Unsuitable
	P-Plastic	PS-Provisionally Suitable
	VP-Very Plastic	S-Suitable
		NA-Not Applicable

Sketch of Soil Evaluation Locations

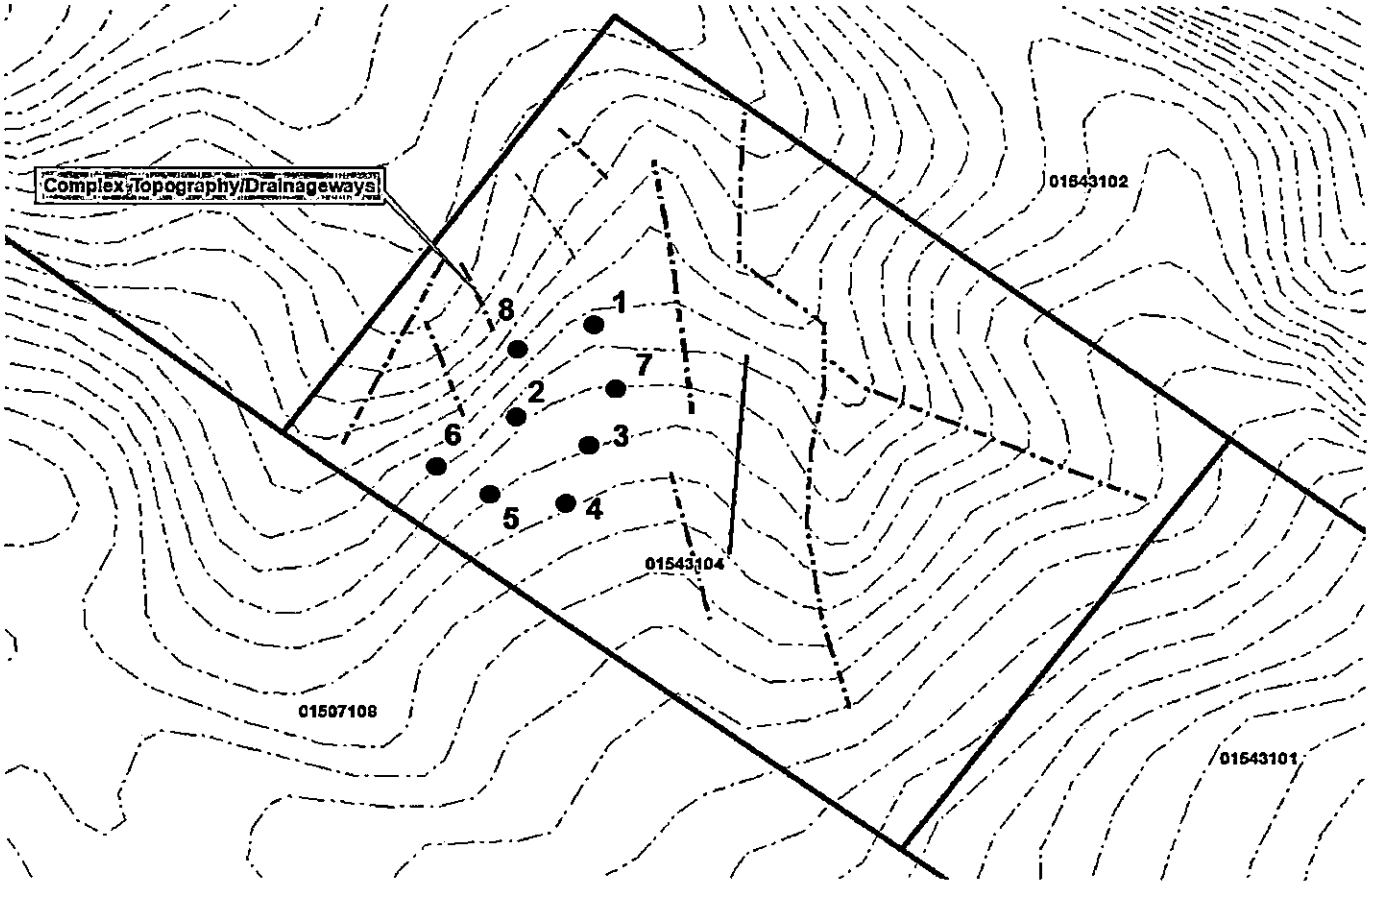

Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: 1 of 2
Property ID: 015-431-04
Lot #: NA
File #: 9524B
AppID: 9307

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: Cory Vineyard
Address: 2628 Shady Reach Ln, Charlotte, NC 28214
Proposed Facility: 3BR House
Design Flow (.1949): 360 GPD
Location of Site: 8115 McIlwaine Rd, Huntersville, NC 28078
Water Supply: [ ] Public [ ] Individual [X] Well
Evaluation Method: [X] Auger Boring [ ] Pit
Type of Wastewater: [X] Sewage [ ] Industrial Process

Applicant: Tom Arndt Bluefield Builders
Date Evaluated: 7/14/2016 & 1/5/2018
Property Size: 4 ac
Property Recorded: Unknown
[ ] Spring [ ] Municipal
[ ] Cut
[ ] Mixed

PROFILE #	1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		PROFILE FACTORS[b]				General Comments	Profile Class & LTAR	Maximum Trench Bottom Depth for 3' Wide Conventional Trench
			1941 Structure/ Texture	1941 Consistence Mineralogy	1942 Soil Wetness/ Color	1943 Soil Depth (IN.)	1956 Sapro Class	1944 Restr Horiz			
Boring #1	LS 9%	0 - 15	gr SCL	SS SP FR SEXP	>51"	51	NA	NA	saprolite inclusions 40 - 51"	PS IV 0.275	36"
		15 - 40	sbk C	S P FI SEXP							
		40 - 51	sbk CL	SS P FI SEXP							
Boring #2	LS 5%	0 - 7	gr SL	SS SP FR SEXP	>51"	51	NA	NA		PS IV 0.25	36"
		7 - 28	gr/sbk SCL	SS SP FR SEXP							
		28 - 51	sbk C	S P FI SEXP							
Boring #3	LS 5%	0 - 4	gr SL	SS SP FR SEXP	>50"	50	NA	NA	saprolite inclusions 24 - 50"	PS IV 0.275	36"
		4 - 24	sbk C	S P FI SEXP							
		24 - 36	sbk CL	SS SP FR SEXP							
		36 - 50	sbk SCL	SS SP FR SEXP							
Boring #4	LS 5%	0 - 12	gr SCL	SS SP FR SEXP	>50"	50	NA	NA	saprolite inclusions 32 - 50"	PS IV 0.25	36"
		12 - 32	sbk/abk C	S P FI SEXP							
		32 - 50	sbk CL	SS P FI SEXP							
		50	Saprolite								
Boring #5	LS 5%	0 - 5	gr SL	SS SP FR SEXP	>50"	50	NA	NA	saprolite and weathered rock inclusions 35 - 50"	PS IV 0.25	36"
		5 - 14	gr SCL	SS SP FR SEXP							
		14 - 35	sbk C	S P FI SEXP							
		35 - 50	sbk CL	SS SP FR SEXP							

Description	Initial System	Repair System
Available Space (.1945)	PS	ps
System Type(s)	III g	III g
Site LTAR (gpd/sq ft)	0.25	0.25


Other Factors (.1946):
Soil Evaluation By: Jacob Presley, LSS, REHS
Others Present:
Site Classification (.1948): Provisionally Suitable
Site Evaluation By: Jeremy Michelone, REHS
Others Present:

COMMENTS:

Landscape Position	Group	Texture	.1955 LTAR	Structure
R-Ridge	I	S-Sand	1.2 - 0.8	sg-Single Grain
SS-Shoulder Slope		LS-Loamy Sand		mass-Massive
LS-Linear Slope				cr-Crumb
FS-Foot Slope	II	SL-Sandy Loam	0.8 - 0.6	gr-Granular
NS-Nose Slope		L-Loam		sbk-Subangular Blocky
HS-Head Slope				abk-Angular Blocky
CC-Concave Slope	III	Si-Silt	0.6 - 0.3	pl-Platy
CV-Convex Slope		SiCL-Silty Clay Loam		pr-Prismatic
T-Terrace				Sap-Saprolite
FP-Flood Plain		CL-Clay Loam		**Structure Prefixes**
D-Drainage Way		SCL-Sandy Clay Loam		w-weak
				m-moderate
		SiL-Silt Loam		s-strong
				f-fine
	IV	SC-Sandy Clay	0.4 - 0.1	m-medium
		SiC-Silty Clay		c-coarse
		C-Clay		

Consistence Moist	Consistence Wet	Mineralogy
VFR-Very Friable	SS-Slightly Sticky	SEXP-Slightly Expansive
FR-Friable	S-Sticky	EXP-Expansive
FI-Firm	VS-Very Sticky	
VFI-Very Firm	NP-Non-Plastic	**Classification**
EFI-Extremely Firm	SP-Slightly Plastic	US-Unsuitable
	P-Plastic	PS-Provisionally Suitable
	VP-Very Plastic	S-Suitable
		NA-Not Applicable

Sketch of Soil Evaluation Locations

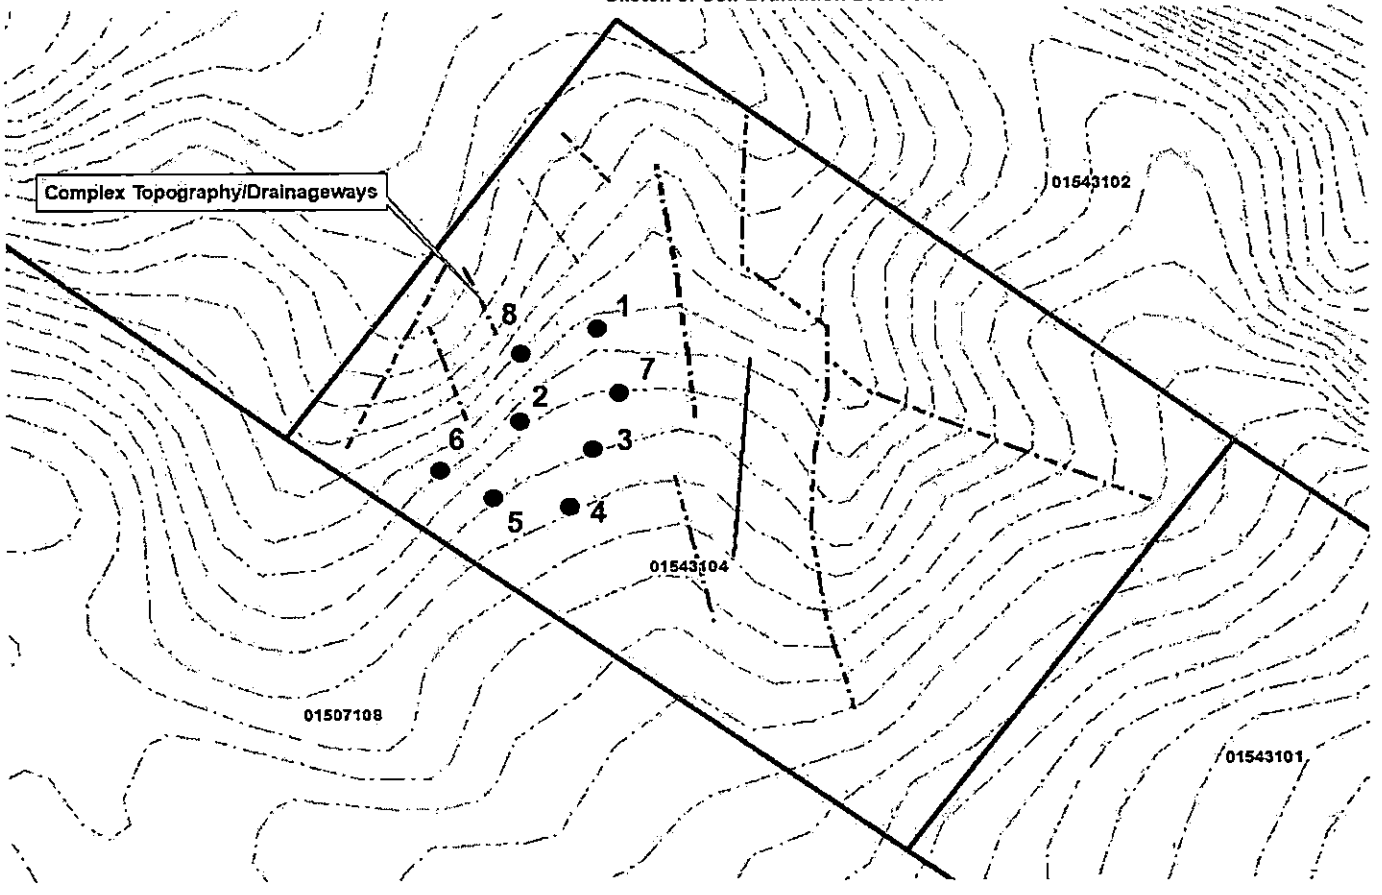

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30009307 GWS File #: 9524B Tax Parcel #: 015-431-04

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is NOT transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 1/16/2023

Type of Installation: Residential - New System Lot Number: 2

Structure Type: HOUSE Size (ft^2): 2694 # Bedrooms: 3 Max. Occup.: 6

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Accepted **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd): 360 LTAR (gpd/ft^2): 0.25 Septic Tank Size (gal): 1000 Pump Tank Size (gal): N/A

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 1080 Total Trench Length (ft): 360

Maximum Trench Depth (in): 30 Depth of Media (in): 12 Distribution Device: Distribution Box

III. Repair System Type: Accepted **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd): 360 LTAR (gpd/ft^2): 0.25 Septic Tank Size (gal): 1000 Pump Tank Size (gal): N/A

Trench Width (ft): 3 Trench Spacing (ft): 9 Absorption Area (ft^2): 1080 Total Trench Length (ft): 360

Maximum Trench Depth (in): 30 Depth of Media (in): 12 Distribution Device: Distribution Box

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone

Signature: Jeremy Michelone

Date Issued: 1/16/2018

Owner/Legal Agent: Tony Arndt

Print Name

Signature: Tony Arndt

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St. Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: 30009307 GWS File #: 9524B

IV. Permit Conditions/Comments:

- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.


Authorized Agent: Jeremy Michelone

Signature: Jeremy Mark Wells

Date Issued: 1/16/2018

Owner/Legal Agent: Tom Arndt
Print Name

Signature: Tom Arndt

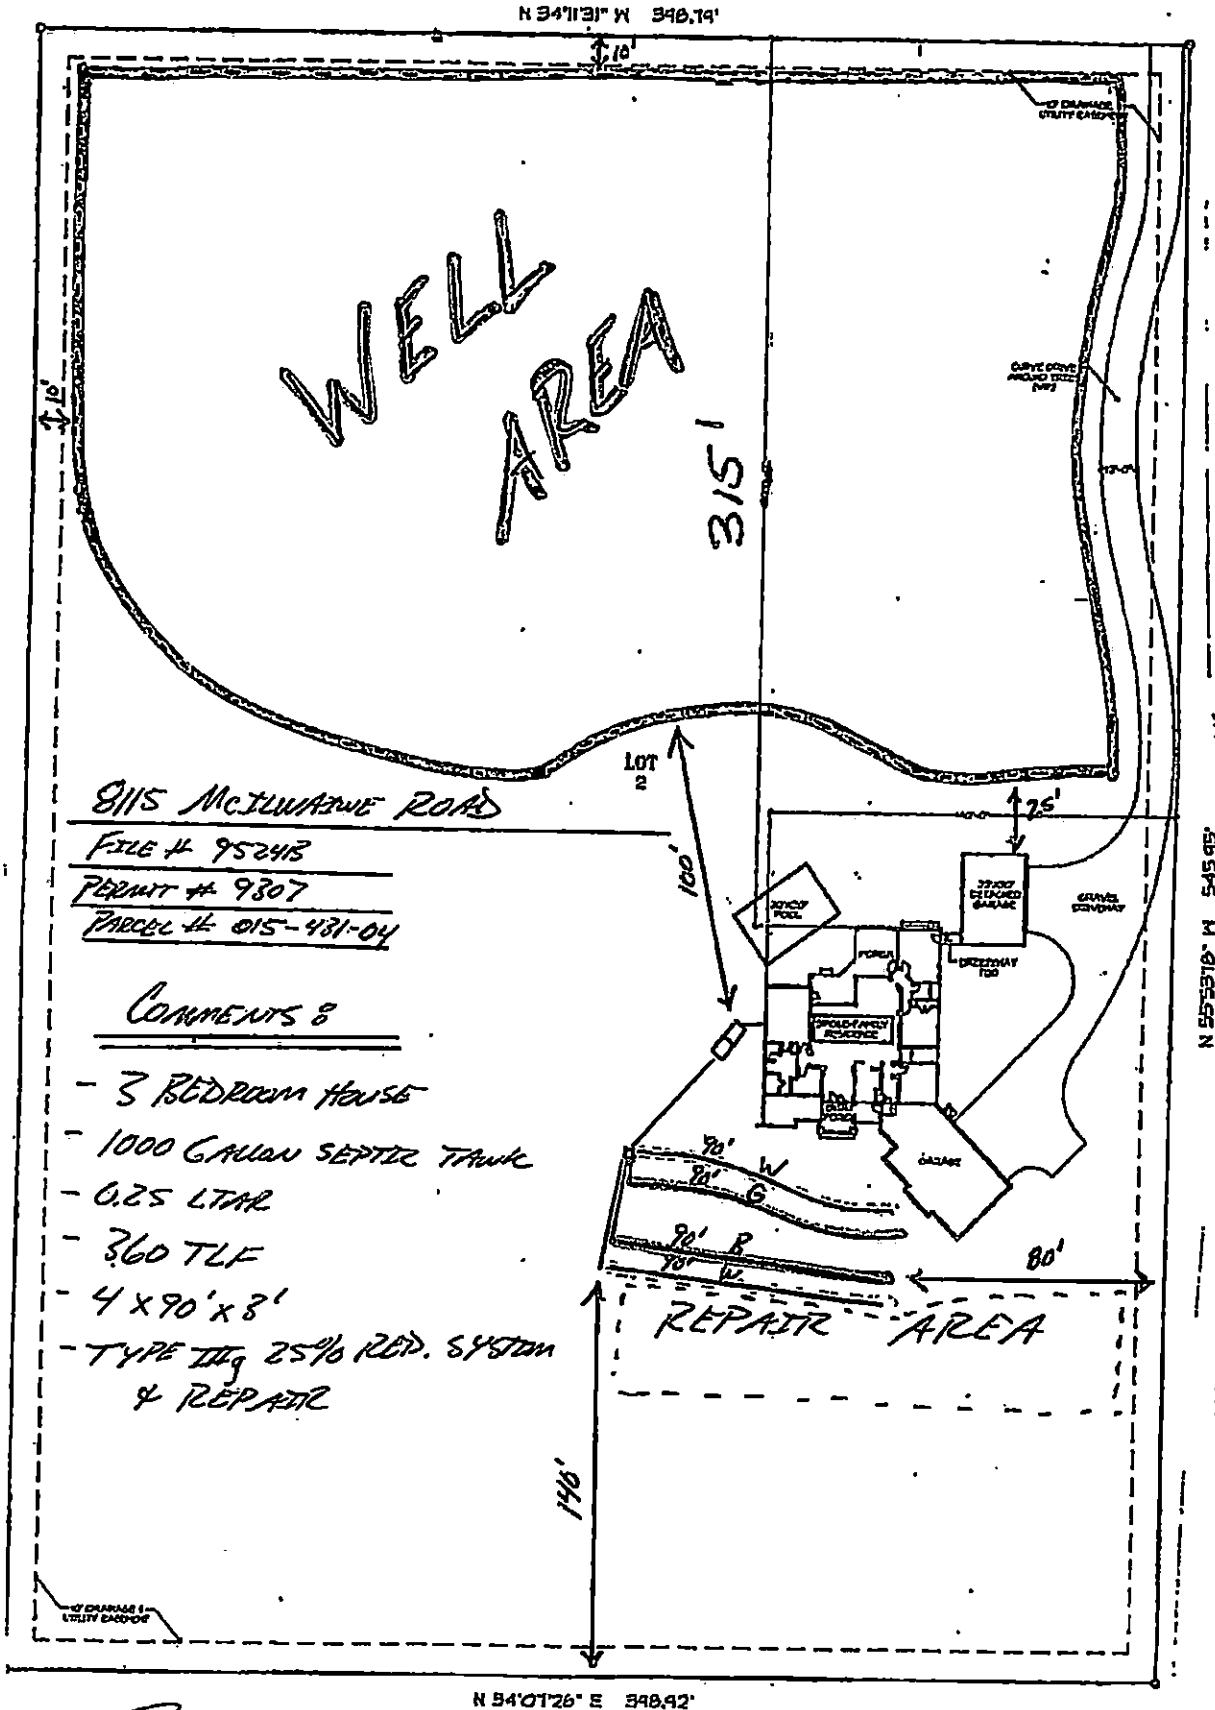

Well shall be sited according to Mecklenburg County Groundwater Well Regulations including but not limited to:
10' from property boundaries (unless otherwise noted)
25' from building perimeters, including any attached sturctures
50' from other potential source of contamination
50' from private lateral sewer lines
50' from surface water bodies
100' from sanitary sewer lines, septic tanks, drainfields and repair and shall not be located in any easement
or right-of-way (unless otherwise permitted)

Jimmy Nobles, 2018
1/16/18

X Signature

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30009307** GWS File #: **9524B** Tax Parcel #: **015-431-04**

- This IMPROVEMENT PERMIT is subject to revocation if site plans or the intended use change. There is to be NO grading, filling, or disturbance of the soil in the area of the septic tank system or repair area.
- CONSTRUCTION AUTHORIZATION must be obtained prior to receiving a Building Permit. The Construction Authorization is **NOT** transferable. Do not clear, grade, fill or disturb soil prior to obtaining a Construction Authorization.
- Domestic-type wastewater only. No industrial process wastewater may be discharged into the system.

I. This Improvement Permit Shall: Expire in Five (5) Years **Expiration Date (If Applicable):** 1/16/2023

Type of Installation: Residential - New System Lot Number: 2

Structure Type: HOUSE Size (ft^2): 2694 # Bedrooms: 3 Max. Occup.: 6

Building Foundation: Crawl Space Water Supply: Private Well

II. Initial System Type: Accepted **System Classification:** IIIg

Initial System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1080	Total Trench Length (ft):	360
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Distribution Box		

III. Repair System Type: Accepted **System Classification:** IIIg

Repair System Specifications:

Design Flow (gpd):	360	LTAR (gpd/ft^2):	0.25	Septic Tank Size (gal):	1000	Pump Tank Size (gal):	N/A
Trench Width (ft):	3	Trench Spacing (ft):	9	Absorption Area (ft^2):	1080	Total Trench Length (ft):	360
Maximum Trench Depth (in):	30	Depth of Media (in):	12	Distribution Device:	Distribution Box		

IV. Permit Conditions/Comments:

(Please See the Following Page for Permit Conditions.)

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment, and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.

Authorized Agent: Jeremy Michelone Owner/Legal Agent: _____ Print Name

Signature: _____ Signature: _____

Date Issued: 1/16/2018

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St, Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

IMPROVEMENT PERMIT for a RESIDENTIAL ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

Permit #: **30009307** GWS File #: **9524B**

IV. Permit Conditions/Comments:

- All components of the septic system must be installed in accordance with the required setbacks listed on the corresponding plot plan.
- All components of the septic system must be located at least 100 ft. (50 ft. minimum) from all private wells.
- Flow from all gutters and downspouts shall be directed not to discharge water onto or across any part of the septic system.
- Foundation drains shall be constructed not to discharge water onto or across any part of the septic system.

The undersigned, an authorized agent of the STATE OF NORTH CAROLINA, certifies that the Department is issuing an IMPROVEMENT PERMIT for the above referenced property. This permit is being issued in accordance with the *Laws and Rules For Sewage Treatment and Disposal Systems* and is subject to the following provisions:

- No work shall be conducted on the septic system until a Pre-Construction meeting has been completed by the Department.
- The septic system installer shall be a licensed septic contractor with the North Carolina Wastewater Contractor Inspector Certification Board.
- The permitted system shall be installed in accordance with the included PLOT PLAN.
- This IMPROVEMENT PERMIT is transferable.


Authorized Agent: Jeremy Michelone

Signature: [signature]

Date Issued: 1/16/2018

Owner/Legal Agent: _____
Print Name

Signature: _____

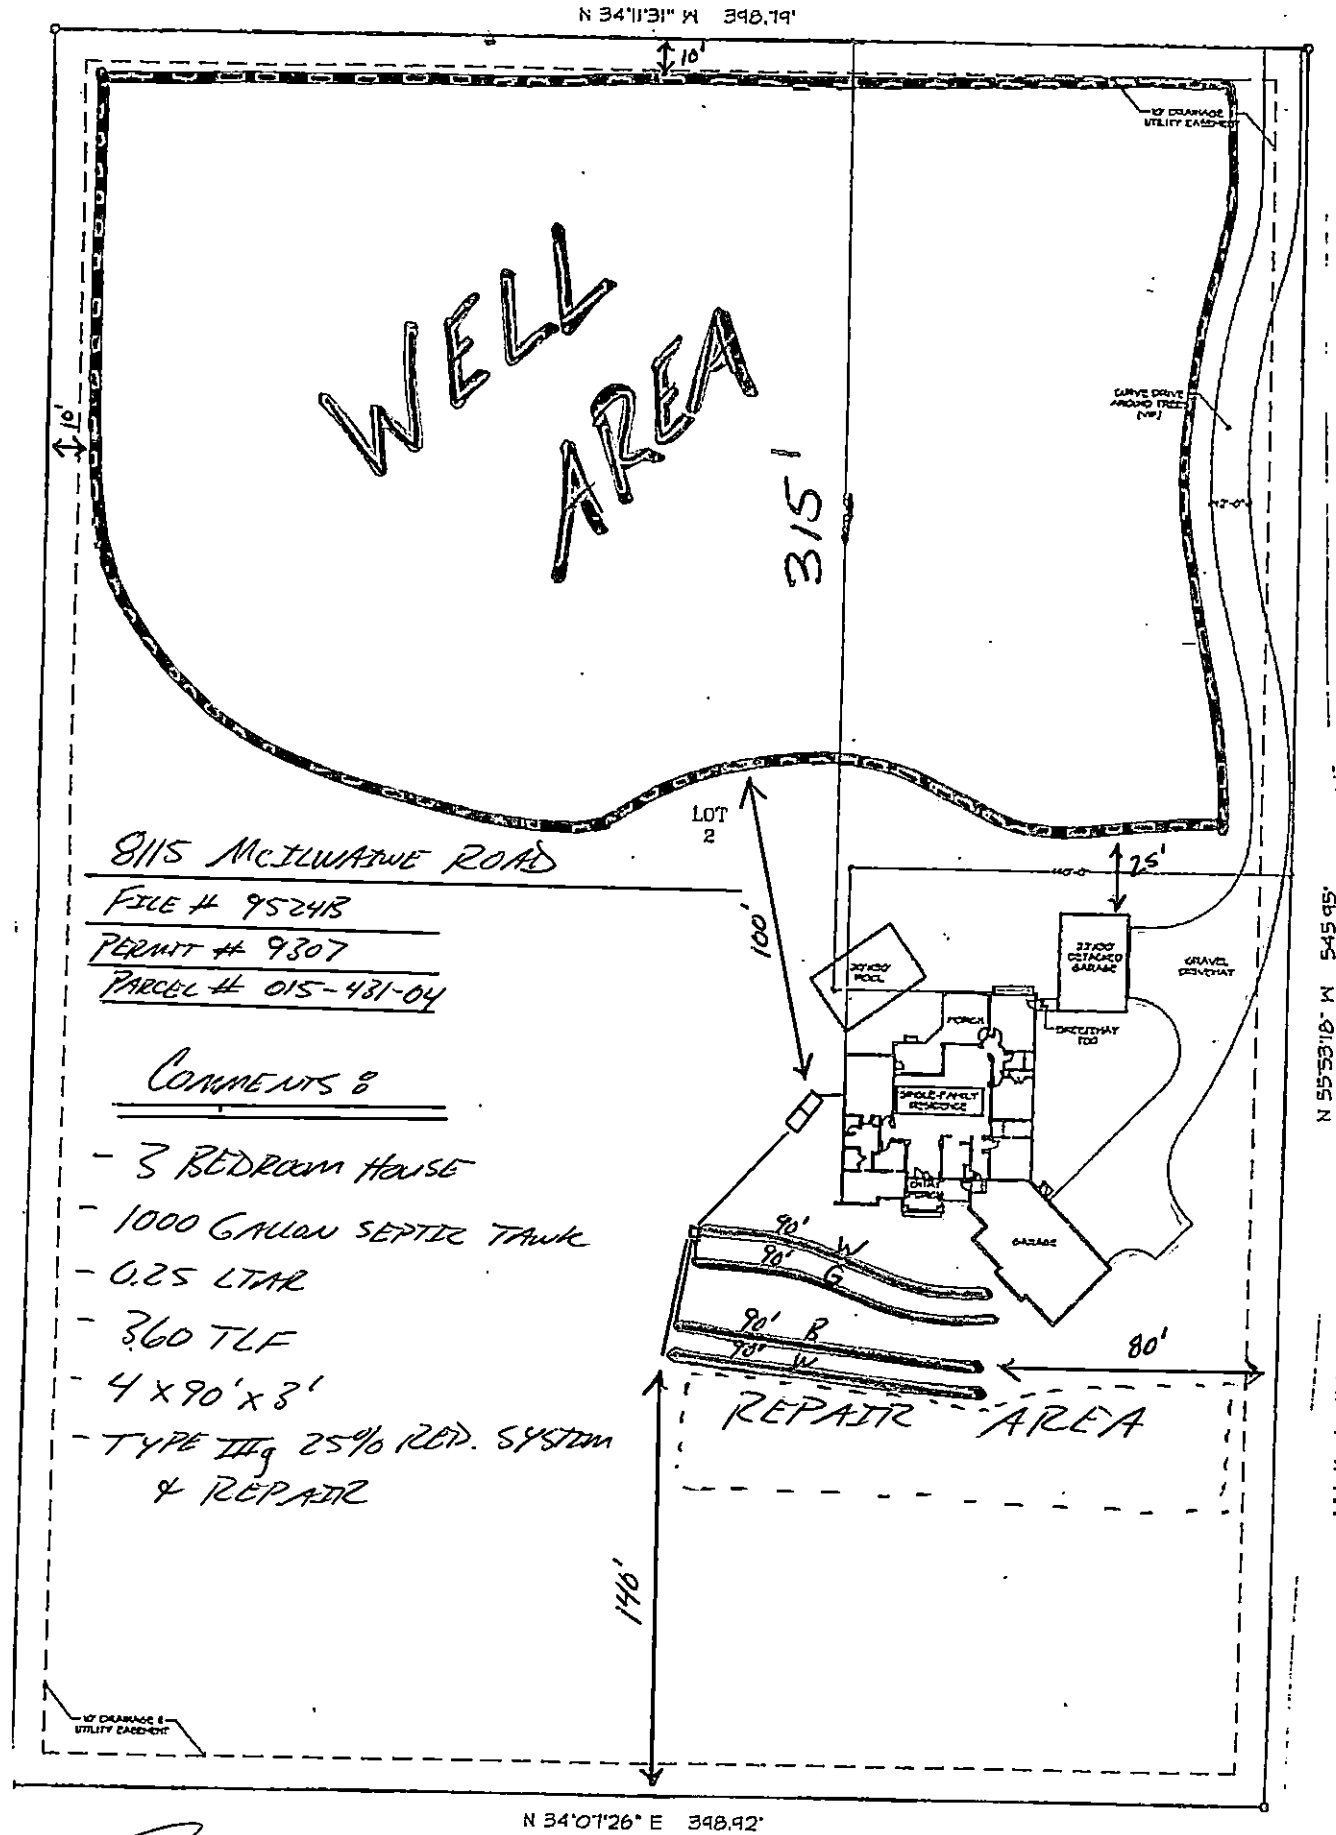

Well shall be sited according to Mecklenburg County Groundwater Well Regulations including but not limited to:
10' from property boundaries (unless otherwise noted)
25' from building perimeters, including any attached sturctures
50' from other potential source of contamination
50' from private lateral sewer lines
50' from surface water bodies
100' from sanitary sewer lines, septic tanks, drainfields and repair and shall not be located in any easement

Jimmy Nichols, REHS

1/16/18

X Signature

FEE: 200.00
DATE: 2/9/2018

CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

MECKLENBURG COUNTY
GROUNDWATER & WASTEWATER SERVICES

FILE NUMBER: 9524B

PERMIT NUMBER: 30009307

PARCEL NUMBER: 01543104

JOB LOCATION INFORMATION

ADDRESS: 8115 MCILWAINE RD

CITY: HUNTERSVILLE **STATE: NC** **ZIP:** 28078

ISSUED TO: CORY VINEYARD

CONSTRUCTION AUTHORIZATION ISSUANCE DATE: 2/9/2018

CONSTRUCTION AUTHORIZATION CONDITIONS

1. WASTEWATER SYSTEM CONSTRUCTION AND INSTALLATION MUST MEET ALL CONDITIONS AND SPECIFICATIONS AS SET FORTH IN IMPROVEMENT PERMIT NUMBER 30009307, AND THE ATTACHED SITE PLAN WITH SYSTEM DETAILS. CONSTRUCTION AND INSTALLATION MUST ALSO MEET ALL REQUIREMENTS SET FORTH IN THE RULES GOVERNING SANITARY SEWAGE COLLECTION, TREATMENT, AND DISPOSAL AND ANY OTHER APPLICABLE RULES AND LAWS.

2. A PRE-CONSTRUCTION MEETING MUST BE SECURED PRIOR TO INSTALLATION OF THE SEPTIC TANK SYSTEM. THE INSTALLER OF THE SYSTEM SHALL BE A LICENSED SEPTIC TANK CONTRACTOR WITH THE NORTH CAROLINA ONSITE WASTEWATER CONTRACTOR INSPECTOR CERTIFICATION BOARD.

3. ANY ALTERATION IN SITE OR SOIL CONDITIONS (INCLUDING LOCATION OF STRUCTURES AND APPURTENANCES) OR MODIFICATION IN USE, DESIGN WASTEWATER FLOW, OR WASTEWATER CHARACTERISTICS AS SPECIFIED IN THE ASSOCIATED IMPROVEMENT PERMIT AND APPLICATION, MAY SUBJECT THIS CONSTRUCTION AUTHORIZATION AND ASSOCIATED PERMIT(S) TO REVOCATION.

4. THIS CONSTRUCTION AUTHORIZATION AS PROVIDED IN G.S. 130A-335(f) AND G.S. 130A-336(b) SHALL BE VALID FOR A PERIOD EQUAL TO THE VALIDITY OF THE IMPROVEMENT PERMIT, AND MAY BE ISSUED AT THE SAME TIME THE IMPROVEMENT PERMIT IS ISSUED.

Authorized Agent Signature _____

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (704) 336-5103 Fax: (704) 336-6894

Septic System Pre-Construction Meeting Checklist

File # 95048 App # 9307 Tax Parcel # 015-431-04

Property Owner: Cory Vineyard

Job Location Address: 2115 McClure Road

City: Huntersville State: NC Zip Code: 28078

1. **Does System design match facility, flow & wastewater characteristics?**

   ☒ YES ☐ NO

   Comments: _____

2. **Is there sufficient available space for the septic systems initial and repair areas?**

   ☒ YES ☐ NO

   Comments: _____

3. **Can the septic system be installed per the permit conditions and drawing on file?**

   ☒ YES ☐ NO

   Comments: _____

*** If "NO" is checked for any of the above the existing permit may need to be revoked.**

Permission is hereby given to ☐ install ☐ alter ☐ repair an on-site wastewater treatment & and disposal system, with subsurface soil absorption and effluent discharge meeting all of the construction requirements of 15A NCAC 18A .1900 which are in effect on the date of granting this approval. System shall not be installed while soils are in wet condition.

Authorized Agent — Date: 1/28/19

Others Present: Richard Abernathy

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211, Charlotte, NC 28202
Phone: (980) 314-1680 • Fax (704) 336-6894

NC DHHS
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 95248 Permit #: 9307 Tax Parcel #: 015-431-04

Property Owner: Cory Vineyard

Job Location Address: 8115 McIlwaine Road

City: Huntersville State: NC Zip Code: 28078

Operation Permit Issuance Date: 1/28/19 **Contractor Name:** Richard Abernathy

Permitted Design Flow: 360 GPD Liquid Capacity of Dosing Tank: — gallons

Liquid Capacity of Septic Tank: 1000 gallons Manufacture Rotonic Effluent Pump Model: —

Drainfield Installation ☐ N/A

Trench Depth: 30 inches

Trench Width: 3 feet

Line Spacing: 9 feet (O.C.)

Total line length: 360 feet

# of Lines: 4 @ 90 feet

Depth of Media: 12 inches (Type) IQ4W

Depth of Cover: 12 inches

Distribution Device: END-CAP

Bed Installation (For Repair Installations ONLY) ☒ N/A

Bed Depth: _____ inches

Bed Width: _____ feet

Total line length: _____ feet

# of Lines: _____ @ _____ feet

Depth of Media: _____ inches (Type) _____

Depth of Cover: _____ inches

Distribution Device: _____

Water Supply Source

☐ Municipal ☒ Private Well ☐ Community Well

☐ Other _____

System Installation Setbacks

Distance from Building Foundation: 15 feet

Distance from Property Line: 100' feet

Distance from Water Supply Source: >100' feet


Inspection Dates

Tank(s) Inspected: 1/28/19

Excavation Inspected: 1/28/19

Pump & Controls Inspected: —

SKETCH OF SYSTEM INSTALLATION
(As-Built Drawing)

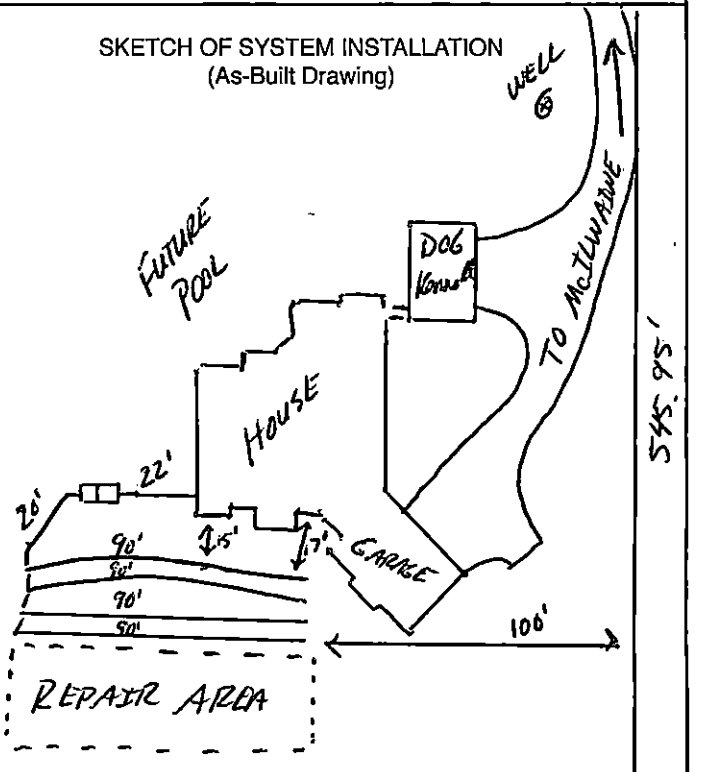

The undersigned has inspected the Septic Tank System described above, and certifies it has been ☒ installed ☐ altered ☐ repaired ☒ as detailed in the plot above ☐ in accordance with the permit issued and meets the provisions of 15A NCAC 18A. 1900, "Laws and Rules for Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. The issuance of this Operation Permit does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operated properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1900 in addition to those listed below under "Comments" This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the Suspension or Revocation of this permit.

Comments: System Classification & Type: Mtg, Gravity, IQ4W, NA, NA

DENR Authorized Agent: Jeremy Medley REHS Signature: Jeremy Medley, REHS

Mecklenburg County Groundwater & Wastewater Services
700 N. Tryon St., Suite 211 Charlotte, NC 28202
Phone: (980) 314-1680 Fax: (704) 336-6894

NC DENR
Division of Environmental Health
On-Site Wastewater Section

OPERATION PERMIT for an
ON-SITE WASTEWATER TREATMENT & DISPOSAL SYSTEM

File #: 9524B Permit #: 9307 Tax Parcel #: 015-431-04

Property Owner: Cary Vineyard

Job Location Address: 8115 McTheniel Road

City: Hendersonville State: NC Zip Code: 28078

OPERATION PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with 15A NCAC 18A .1961.

II. Monitoring: System shall be monitored as required by 15A NCAC 18A .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

IV. Operation: System shall be operated in accordance with 15A NCAC 18A .1961.

System Classification: IIIg

*Operation Permits for Type V and VI systems expire five (5) years from the date of issuance (in accordance with Table V(a)). The system owner must contact GWS six (6) months prior to expiration for permit renewal.

Subsurface system operator required: Yes ☐ No ☒

☐ This type of system requires the system owner to maintain a contract with a certified operator to perform system inspection, maintenance, and reporting as required in 15A NCAC 18A .1961. and Table V(a). The system owner is responsible for all fees associated with these services.

☒ System does not require inspection by GWS on a routine frequency.

☐ System requires inspection by GWS once every five (5) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every three (3) years. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every twelve (12) months. The system owner is responsible for all fees associated with the inspection.

☐ System requires inspection by GWS once every six (6) months. The system owner is responsible for all fees associated with the inspection.

V. Other:

DENR Authorized Agent: Jeremy Nicholson REHS Date: 1/22/19

Signature: Jeremy Nicholson REHS

Supervisor/Administrative Professional Checklist

New Septic [X] New Well [ ] Use Existing [ ] Alteration [ ] Modified Plot Plan [ ]

New Septic Fees Paid:

IP ($250.00) 7/12/16 RE Initials/Date

CA ($200.00) _____ Initials/Date

OP ($200.00) _____ Initials/Date

(CA and OP fees need to be paid before a building permit can be issued)

New Well Fee Paid: $550.00 _____ Initials/Date

Use Existing Fee Paid: $100.00 _____ Initials/Date

Alteration Fee Paid: $300.00 (Total) $200 (If use existing was paid)_____ Initials/Date

Modified Plot Plan Fee Paid: $100.00 _____ Initials/Date

Floor plans need to be submitted and reviewed before CA can be issued. [ ] Reviewed [ ] ____

This site is served by septic and well. Verify each is complete before final hold is released. [ ]

Septic file completed. [ ] _____ Well file completed. [ ] _____

Send permit for signature. [ ] Signature received. [ ] _____

This septic system requires a certified operator contract before final hold is released. [ ]

Certified operator contract is on file. [ ] _____

DocuSign Envelope ID: B40F92BF-27CC-4378-AF86-6F8C4526CB81

9524B #835 MECKLENBURG COUNTY HEALTH DEPARTMENT X44974

8 JUL '16 AM10:37

APPLICATION FOR A RESIDENTIAL SITE IMPROVEMENT PERMIT/ CONSTRUCTION AUTHORIZATION FOR AN ON-SITE WASTEWATER SYSTEM, NEW WELL INSTALLATION, OR REPAIR OF EXISTING WELL

1. SEPTIC / TYPE APPLICATION: ○ N/A ◉ NEW SYSTEM ○ ALTERATION ○ REPAIR ○ MODIFIED PLOT PLAN

2. WELL / TYPE APPLICATION: ○ N/A ◉ NEW WELL ○ MAJOR REPAIR ○ ABANDONMENT

3. JOB LOCATION INFORMATION:

TAX PARCEL NUMBER: 01543101 WCI

STREET ADDRESS: 8117 McIlwaine Road

CITY: Huntersville

STATE: NC ZIP: 28078

SUBDIVISION NAME: _____

LOT #: _____ LOT SIZE (acres): _____

TOWNSHIP:

○ MECKLENBURG ○ CORNELIUS ◉ HUNTERSVILLE
○ DAVIDSON ○ CHARLOTTE ○ PINEVILLE
○ MATTHEWS ○ MINT HILL

4. BUILDING INFORMATION:

BUILDING TYPE:

○ SINGLE MOBILE HOME ○ MODULAR HOME
○ DOUBLE WIDE ○ MULTIPLE FAMILY
◉ HOUSE ◉ OTHER none

HEATED SQUARE FOOTAGE: 2500

NUMBER OF BEDROOMS: 4

NUMBER OF OCCUPANTS: 2

FOUNDATION TYPE:

○ CONCRETE SLAB ○ BASEMENT WITH PLUMBING
◉ CRAWL SPACE ○ BASEMENT WITH NO PLUMBING

5. IF PLANNING TO EXPAND OR ALTER THE EXISTING SEPTIC SYSTEM PLEASE COMPLETE THE FOLLOWING SECTION: ☑ N/A

NUMBER OF BEDROOMS TO BE ADDED: _____ NUMBER OF ADDITIONAL OCCUPANTS IN THE RESIDENCE: _____

6. WATER SUPPLY: ○ MUNICIPAL ◉ PRIVATE WELL ○ PUBLIC WELL ○ SHARED WELL ○ OTHER _____

7. PROPOSED USE OF WELL: ○ N/A ○ IRRIGATION ◉ POTABLE (DRINKING WATER) ○ OTHER _____

8. PLEASE INDICATE AND RANK DESIRED SEPTIC SYSTEM TYPE(S) IN ORDER OF PREFERENCE *(1-MOST DESIRED 5-LEAST DESIRED)*:

☐ N/A ☐ ANY TYPE ☐ CONVENTIONAL ☐ ACCEPTED ☐ INNOVATIVE ☐ ALTERNATIVE ☐ OTHER _____

8A. RANK: ____ ____ ____ ____ ____

9. DO ANY OF THE FOLLOWING APPLY TO THE PROPERTY IN QUESTION? IF "YES" PLEASE ATTACH SUPPORTING DOCUMENTATION.

BURIED CABLES, LANDFILLS, STUMPHOLES	○ YES ◉ NO	GRADING/SOIL REMOVAL PERFORMED	○ YES ◉ NO
EXISTING WASTEWATER (SEPTIC) SYSTEMS	○ YES ◉ NO	JURISDICTIONAL WETLANDS	○ YES ◉ NO
WELLS, SPRINGS, OR WATER LINES	○ YES ◉ NO	APPROVAL REQUIRED BY ANY OTHER PUBLIC AGENCY	○ YES ◉ NO
EASEMENTS OR RIGHT-OF-WAYS	◉ YES ○ NO	WASTEWATER OTHER THAN DOMESTIC SEWAGE	○ YES ◉ NO
CHEMICAL/PETROLEUM STORAGE TANKS	○ YES ◉ NO	KNOWN UNDERGROUND CONTAMINATION	○ YES ◉ NO
WASTE STORAGE	○ YES ◉ NO	GROUNDWATER USE RESTRICTIONS/VARIANCES	○ YES ◉ NO

10. WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____ ☑ UNKNOWN

11. WHAT IS THE ANTICIPATED CLOSING DATE FOR THIS PROPERTY? _____ ☑ N/A

12. PROPERTY OWNER:

NAME: Kenny A. Hendrick

ADDRESS: 8117 McIlwaine Road

CITY: Huntersville

STATE: NC ZIP: 28078

WORK PHONE: _____

MOBILE PHONE: _____

FAX: _____

E-MAIL: _____

13. OWNER'S LEGAL REPRESENTATIVE, IF APPLICABLE:

NAME: WAC Contracting, Inc.

ADDRESS: 127 E. Promenade Drive

CITY: Mooresville,

STATE: NC ZIP: 28117

WORK PHONE: (704) 799-1752

MOBILE PHONE: _____

FAX: _____

E-MAIL: info@waccontracting.com

14. SEPTIC SYSTEM PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Improvement Permit and Authorization to Construct shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for either sixty (60) months or is non-expiring depending upon the documentation submitted: complete site plan = 60 months, complete plat = non-expiring.

_____ (Initial here for septic system applications)

15. WELL PERMIT APPLICATION:

If the information in this application is falsified, changed, or the site is altered, then the Well Permit shall become invalid. I have read this application and certify that the information provided herein is true, complete and correct. Authorized county and state officials are granted right of entry to conduct necessary inspections to determine compliance with applicable laws and rules. I understand that I am solely responsible for the proper identification and labeling of all property lines and corners and making the site accessible so that a complete site evaluation can be performed. The permit is valid for a period of twelve (12) months from the date of issuance.

_____ (Initial here for well applications)

16. APPLICATION SIGNATURE SECTION:

ONLY COMPLETE APPLICATIONS WILL BE PROCESSED. A proper signature is required in order to process your application. Please review the application carefully and sign in the space provided below. A PROPOSED PLOT PLAN is required to be submitted with each application.

DocuSigned by:
Kenny Hendrick
Property Owner's or Owner's Legal Representative Signature

6/30/2016
Date

OFFICE USE ONLY

○ SURVEY PLAT TO SCALE SUBMITTED ○ SCALED SITE PLAN SUBMITTED ○ UN-SCALED SITE PLAN SUBMITTED

SEPTIC APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

WELL APPLICATION FEE RECEIVED: $ _____ DATE FEE RECEIVED: _____

APPLICATION PROCESSED BY: _____

GWS FILE NUMBER ASSIGNED: _____

APPLICATION ID NUMBER ASSIGNED: _____

COMMENTS:

DocuSign Envelope ID: B40F92BF-27CC-4378-AF86-6F8C4526CB81


File #: _____

PROPOSED PLOT PLAN

A drawing showing the locations of the following items is required: existing and proposed property lines with dimensions, easements or right-of-ways, proposed building pad(s) or existing building footprint(s), all appurtenances (garage, driveway, deck, pool, etc.), location of existing or proposed well(s), location of existing or proposed sewer lines and sewage disposal systems, surface water bodies, and any aboveground or underground storage tanks. Provide names for all roads that adjoin the property.

Street Address: _____ Tax Parcel #: _____

Subdivision Name: _____ Lot #: _____

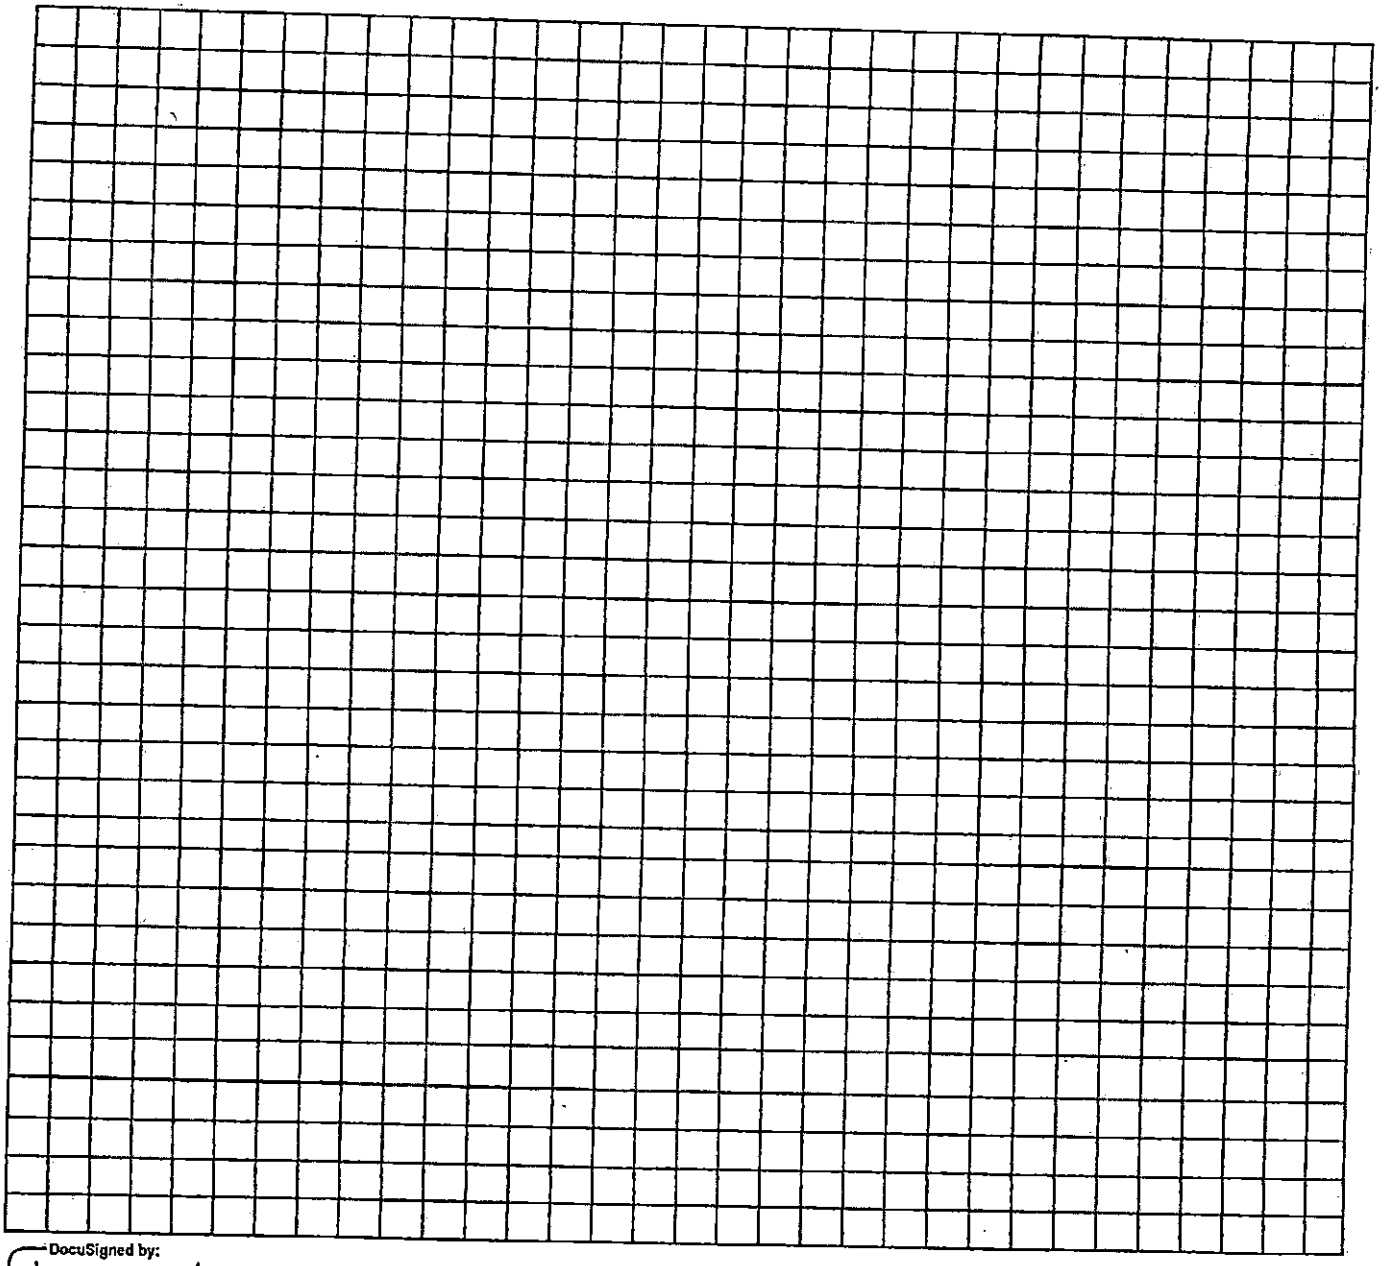

DocuSigned by:
Kenny Hendrick
Property Owner's or Owner's Legal Representative Signature

6/30/2016
Date

MECKLENBURG COUNTY
LAND USE AND ENVIRONMENTAL SERVICES
Payment Receipt

Receipt Information

Date: 07/12/16
Receipt #: 101068
Check / Auth #: CHARGE
Received By: ELLISLW

Amount: 250.00
Tendered: 250.00
Returned: 0.00

Account Information

Account #: X44974
Contractor: WAC CONTRACTING INC
Attn:
Address: 127 E PROMENADE DR
Address:
City/State/Zip: MOORESVILLE, NC 28117

Item	Description	Permit#	Quantity	Unit Price	Total Price
0701	Improvment Permit App-Residen 8117 MCLIWAINE ROAD		1	250.00	250.00

Outstanding Balances

Month-To-Date	Prior Month	30 Days	60 Days	90 Days	Balance
1,132.60					