

14035 CLARENDON POINTE CT

00101473

12/19/2007

duponbj

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 285 B/866 A DATE: 8-25-95

TC: 001-014-23 ☐ L ~~☐ CRT~~

SERIAL Nº 16011

of Owner JAG BUILDERS Juris.:

Address of Property 14035 CLARENDON POINTE CT

Inspection Data:

Tank Material PCC

Total Length of Drainfield 270

Number of Lines 6 @ 45

Cover Depth 6"

Water Supply Source CMUD

Distance to Water Source

Excavation Inspected 8-25-95

Tank(s) Inspected 8-25-95

Wash Line Inspected

High Water Alarm Inspected

PLOT

Design 1995 1500 ST PIPPS TYPE III CTR# Bobby McCarver 117

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☑ installed or constructed ☐ altered or repaired

☑ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☑ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS:

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 785 B DATE: 8 25 95

TC: 001-014-73 ☐ L

SERIAL Nº 16365

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 3-20-95. All work shall be completed *on or before* 8-23-95, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

INSTALL W/ PLAN ON FILE

PLOT OF SYSTEM

Liquid Capacity of Septic Tank 1500 gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction PC

Trench Depth 30"

Absorption and/or Nitrification Lines:

Trench Width 2' feet

Trench Walls Scored and Porous YES

Total Line Length 270 feet

Number of Lines 6 X 45

~~Depth of Stone~~ 24 inches

Distance from House 5' IT feet

Distance from Property Line 10' feet

Distance from Well CMUD feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER JAG BUILDERS

LOCATION OF PROPERTY 14035 CLARENDON POINT CT

Comments: —

Spokesman for S. Carrick, Program Chief 9-8-95

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

4402

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

File 7858/8656A 9/15 CRT

7858/8656A Cash 12032 $150.00

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

9/26/95

Date: 3/20/95

PERSON FILING APPLICATION:
NAME: JAG Builders (last) (first) (mi)
ADDRESS: Box 23202 PHONE: (__) 597-9700
CITY: Charlotte STATE: NC ZIPCODE: 28227

PROPERTY OWNER:
NAME: Crescent Resources Inc (last) (first) (mi)
ADDRESS: PO Box 1003 PHONE: (__) Tracy 663-6905
CITY: Charlotte STATE: NC ZIPCODE: 28201

PROPERTY INFORMATION (FROM ENGINEERING FORM):
TAX/PARCEL NUMBER: 001-014-73
STREET ADDRESS: 14035 Clarendon Rd
ZONING:

Township (check one):
[x] 0 Mecklenburg County [ ] 2 Davidson [ ] 4 Pineville [ ] 6 Huntersville
[ ] 1 Charlotte [ ] 3 Cornelius [ ] 5 Matthews [ ] 7 Mint Hill

SUBDIVISION OR MOBILE HOME PARK NAME: The Cape

LOT NUMBER: 7 The Cape LOT SIZE (in acres): 0.584

TYPE APPLICATION (check one):
[ ] SOIL TEST - INDIVIDUAL LOT (D)
[ ] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[ ] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[ ] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[ ] COMMERCIAL OR INDUSTRIAL (N)
[ ] SOIL TEST DEVELOPMENT (P)
[ ] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[x] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[ ] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[ ] SINGLE MOBILE HOME (S) [x] HOUSE (H) [ ] MULTIPLE FAMILY (U)
[ ] DOUBLE WIDE (D) [ ] MODULAR HOME (M) [ ] OTHER _____ (O)

NUMBER BEDROOMS: 4 NUMBER OCCUPANTS: 8

SYSTEM CLASSIFICATION: III-C

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business N/A # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) N/A
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[ ] Community (C) [ ] Shared Well (S)
[x] Municipal (M) [ ] Other 'spring' (O)
[ ] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[ ] Swimming Pool [ ] Jacuzzi [ ] Stable/Barn [ ] Workshop [x] None
[ ] Garage [ ] Storage Building [ ] Deck/Patio [ ] Bedrooms [ ] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Tracy C. Smith Date: 3/20/95

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

... PRBBS TYPE III AGREEMENT FORM ON FILE

[x] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[ ] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[ ] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date 4-7-95

Director or Authorized Section Head Date

WATER : 12279

JAG BUILDERS, LTD.

DATE	INVOICE NO.	DESCRIPTION	INVOICE AMOUNT	DEDUCTION	BALANCE
9-18-95	16011	TC7 RE: FILE #785B	150.00	.00	150.00

785B (8656A)

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

PERSON FILING APPLICATION:

NAME: Jacobs (last) Toney (first) C (mi)

ADDRESS: Rt 9 Box 164-1 PHONE: (704) 664-6687

CITY: Mooresville STATE: N.C. ZIPCODE: 28115

Date: 11/30/92

PROPERTY OWNER:

NAME: Crescent Resources Inc. (last) (first) (mi)

ADDRESS: P O Box 1003 PHONE: (__) 382-2410

CITY: Charlotte, STATE: N.C. ZIPCODE: 28201-1003

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 00 001-014-12

STREET ADDRESS: off Hagers Ferry

ZONING:

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

LOT NUMBER: 7 LOT SIZE (in acres):

TYPE APPLICATION (check one):

[X] SOIL TEST - INDIVIDUAL LOT (D)
[] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR RENOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [X] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [X] Bedrooms 4 [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Tony C Jacobs, CPSS Date: 11/30/92

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules for Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WWATER : 122791


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 795B (8656A)

TC: 001-014-12po.

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

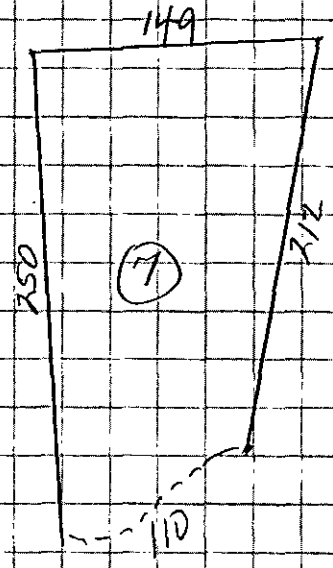

APPROVAL DATE _____

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's Copy

PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON STREET
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 785B/8656A

TC: 001-014-12P0

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

" See Attached PLAN "

OWNER/AGENT SIGNATURE

DATE 3/20/25

APPROVAL DATE _____

White - Health Department's Copy Canary - E.H.S. Copy Pink - Owner's Copy

JAG BUILDERS, INC.

THE CAPE SUBDIVISION -LOT # 7

14035 CLARENDON POINTE COURT

MECKLENBURG COUNTY-NORTH CAROLINA

MCHD FILE #785B/8656A

by

Toney C. Jacobs
Consulting Soil Scientist
168 Broadbill Drive
Mooresville, N. C. 28115

March 20, 1995

To: Mr. Kelly Randall, R.S.
Mecklenburg County Health Dept. - IWWS
Charlotte, N. C.

Mr. Jan Griffin
JAG Builders, Inc.
Box 23202
Charlotte, N. C. 28227



Toney C. Jacobs, CPSS

14035 Clarendon Pointe Court - Lot #7 The Cape

Gravity Distribution T & J Panel System

Design Considerations

This system is proposed for a single residential lot of 0.584 acres in a newly developed rural community of single family homes in northern Mecklenburg County along Lake Norman. This is a waterview lot in a community of waterview and waterfront lots. The system is designed for a 4 bedroom home, presently to be served by CMUD water. Because the property was platted in 1993, the proposed drainfield does require a 100% repair area. The requirement to preserve this repair area along with the possible consequences of failure have been discussed with the builder. The soil on most of the lot, as well as most of the tract, is of a suitable quality (provisionally suitable) for ground absorption, except where it was cut or gullied from road building in the past. This is one small area of complex topography. Overall, the soil has a light clay texture.

Because of limited space, the panel block system with gravity distribution is considered best suited and permittable. The use of a panel system will also allow a very beautiful stand of mixed hardwood and pine trees to remain in the front and also to provide privacy in the rear. Neither a French drain nor a surface swail is indicated for this lot.

Location

The approximately ½ Ac building lot is on the left at the beginning of Clarendon Pointe Ct., off Hager's Ferry Road.

Reference Material

(1) *Laws and Rules for Ground Absorption Sewage Disposal Systems 15A NCAC 18A. 1900,* NCDEHNR-DEH.

(2) *Design, Installation and Maintenance of the T & J Panel Wastewater Treatment System for Sanitarians and Septic Tank Installers*, 1988.

Recommendation

Two hundred and seventy (270) lineal feet of gravity T & J lines with equal repair. Lines to be center fed so maximum run is 45 feet.

Ownership Responsibility for a T & J System

1. Two compartment septic tank - 1500 gal.
2. Supply pipe

3. D box with speed levels
4. 3 each Tyson flow dividers
5. Lateral T & J Panels in ground absorption trenches, 2 feet wide, level end to end. If the installer does not understand this or its importance, he should call either the designer or sanitarian. He should not begin construction until certain of all requirements.

Construction Sequence

1. Lines have been flagged as noted on drawing and in specifications.
2. Clear the area of all organic material with minimum soil disturbance (do not grade). Backfill low area(s) from tree removal with clean imported loam from off-site and tamp to surrounding compaction and look.
3. After fill is placed, install trenches per cited reference material and this plan.
4. The installation contractor shall stabilize the area of construction by planting with Kentucky 31 tall Fescue and mulching. Area to be limed and fertilized with 0.5 tons lime, 75 units of N, 150 units P, and 100 units of K per disturbed acre.
5. The septic tank shall consist of a 1500 gallon capacity reinforced, precast concrete tank with full baffle and shall have easy access to each chamber from ground level for inspection. The first chamber of the septic tank shall consist of 2/3 to 3/4 of the volume of the total tank and the baffle shall contain a horizontal opening across the tank at about midway its height. Locate the septic tank at such height as to provide approximately 8" of cover soil over top of the tank.
6. Final landscaping: After the system is installed, the distribution field should be shaped to shed rainwater and be free of low areas to insure that the system will not be overloaded with excess rainwater and runoff.


Concluding Note:


This plan was done to facilitate permitting by the Mecklenburg County Health Department by an agent of the property owner. Any additions, or additional requirement(s), or deletions to enhance design or workability which will facilitate a permit are welcomed and may be made by note on this plan without returning entire design. The designer realizes that a plan with as many details as this can be changed and/or improved upon. The installer must realize that this is an exact plan and must be installed with exacting measurements. Should the installer desire a change, it must be approved by the health department. Final inspection will also require more time and detail than a conventional system. If there are questions, please give me a call.

Design Specifications

14035 Clarendon Pointe Ct. - Lot #7 The Cape

Daily design flow:	480 gpd - 4 bedroom house
Septic tank size:	1500 gal (2 compartments)
Effluent loading rate:	0.3 gpd/sf conventional
Number and length of laterals:	3 lines of 90' each center fed. Repair same amount and nearly same configuration
Total number of panels:	63

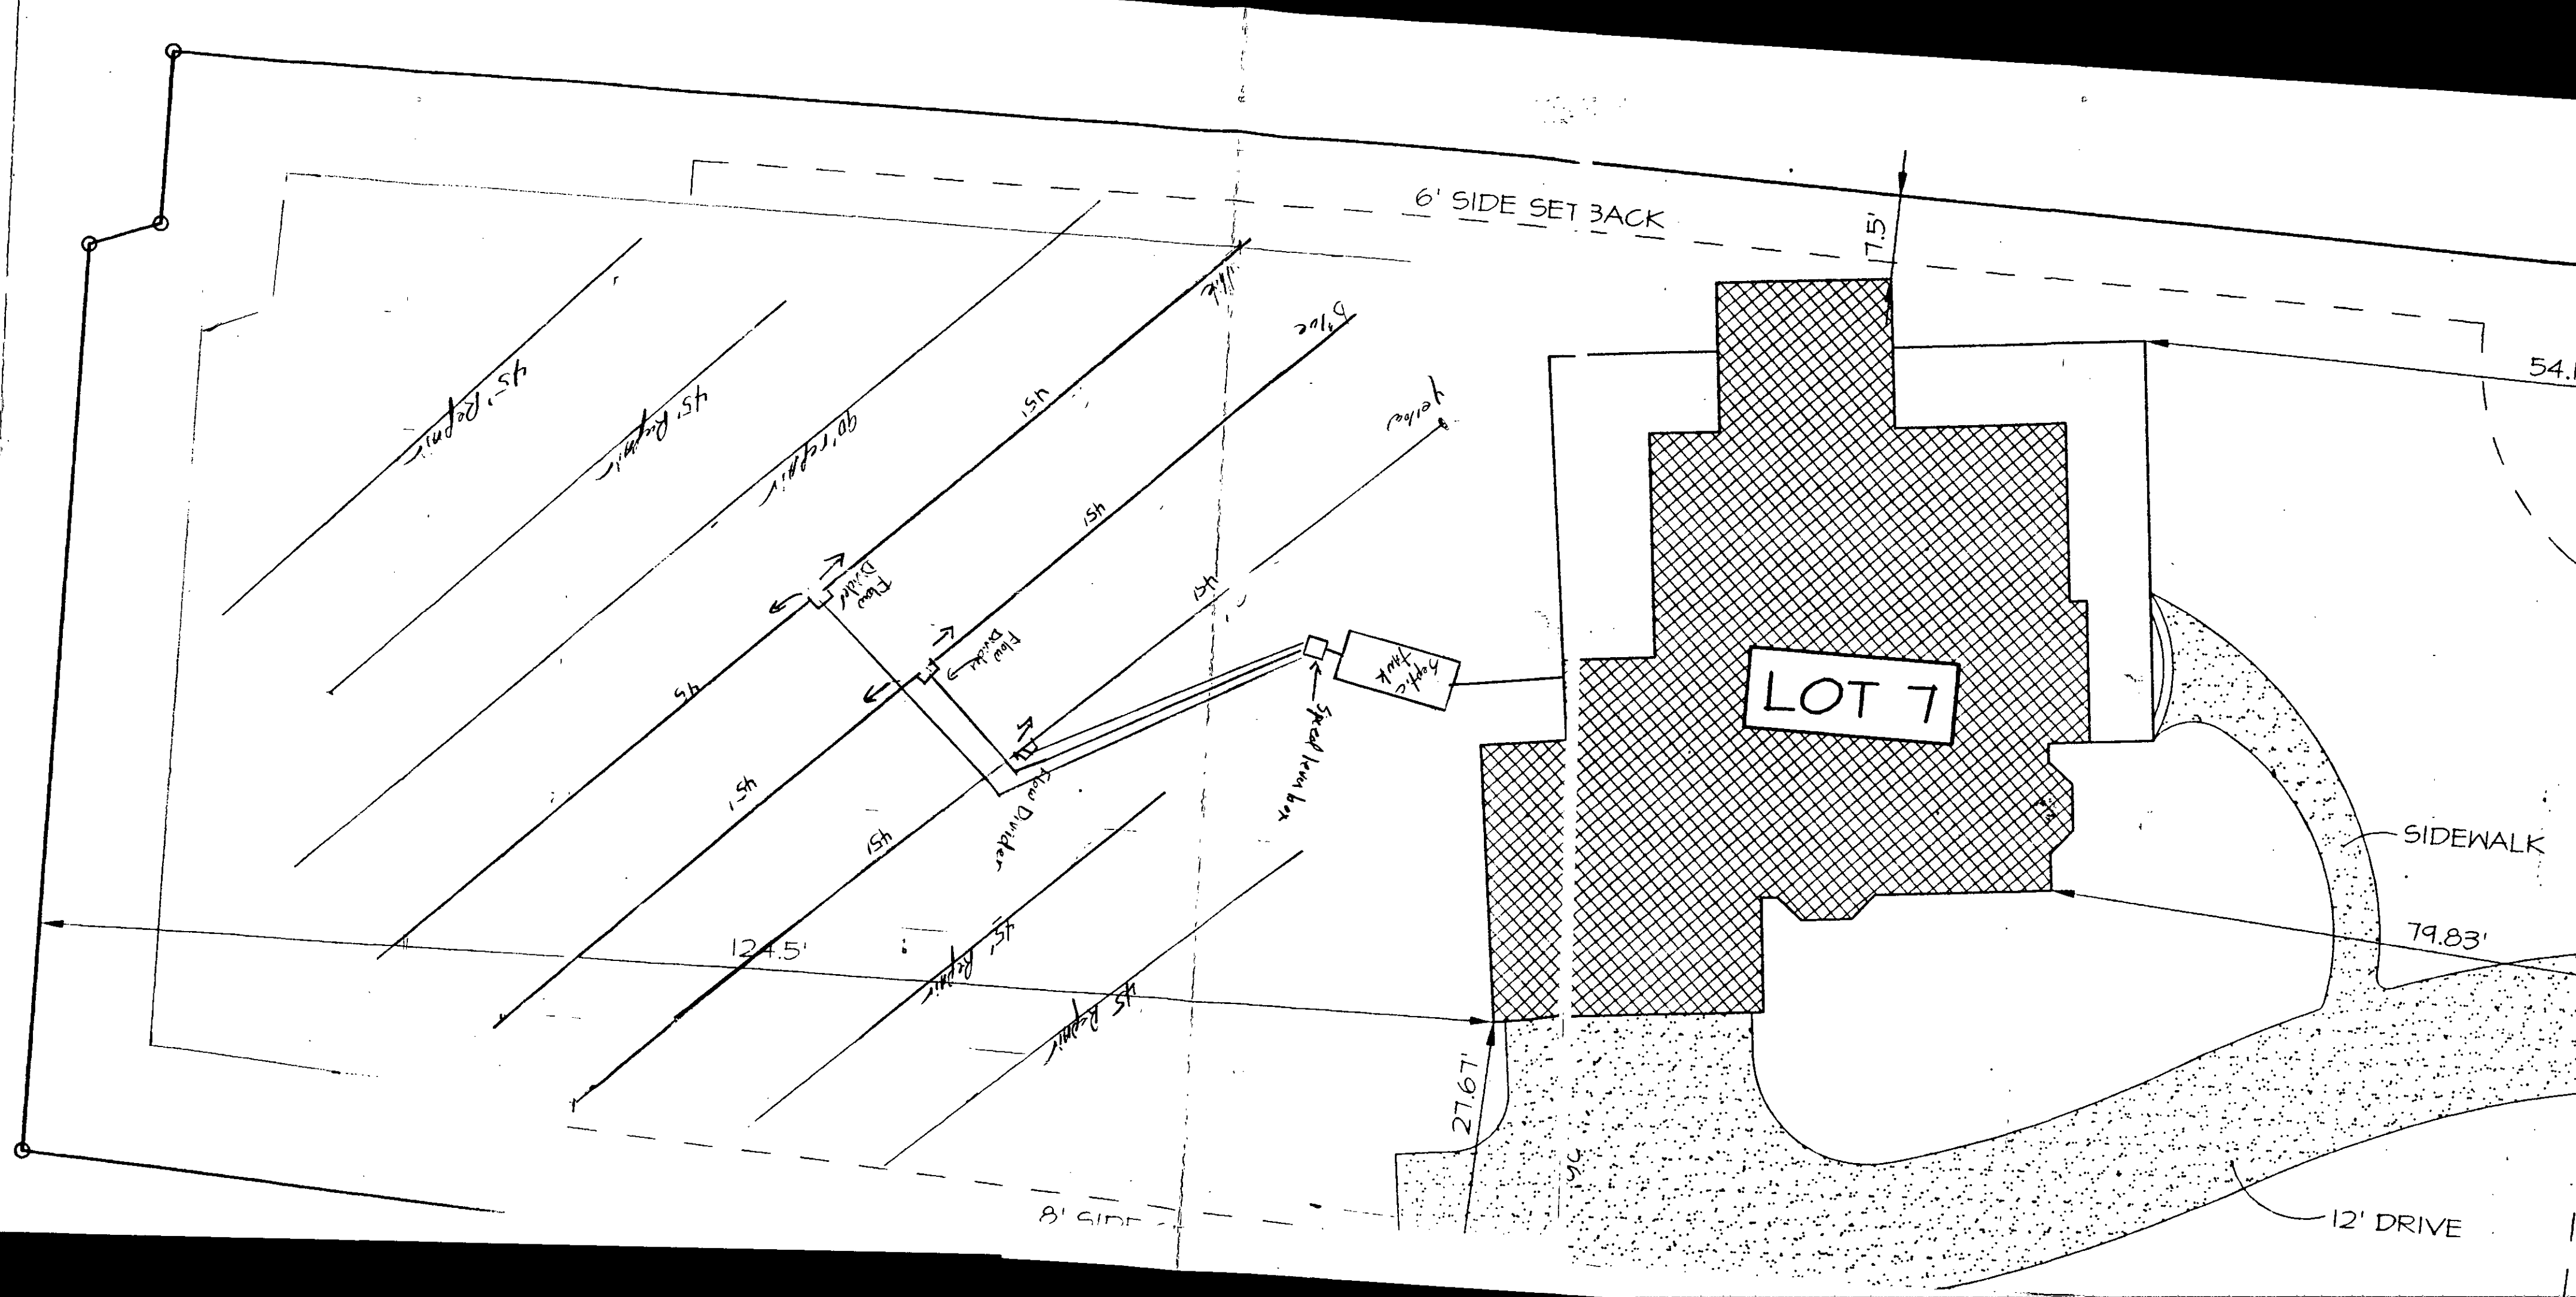
6' SIDE SET BACK
17.5'
LOT 7
SIDEWALK
79.83'
12' DRIVE
27.67'
124.5'
8' SIDE
Flow Divider
Flow Divider
Flow Divider
Spread Footing
Footing
Footing

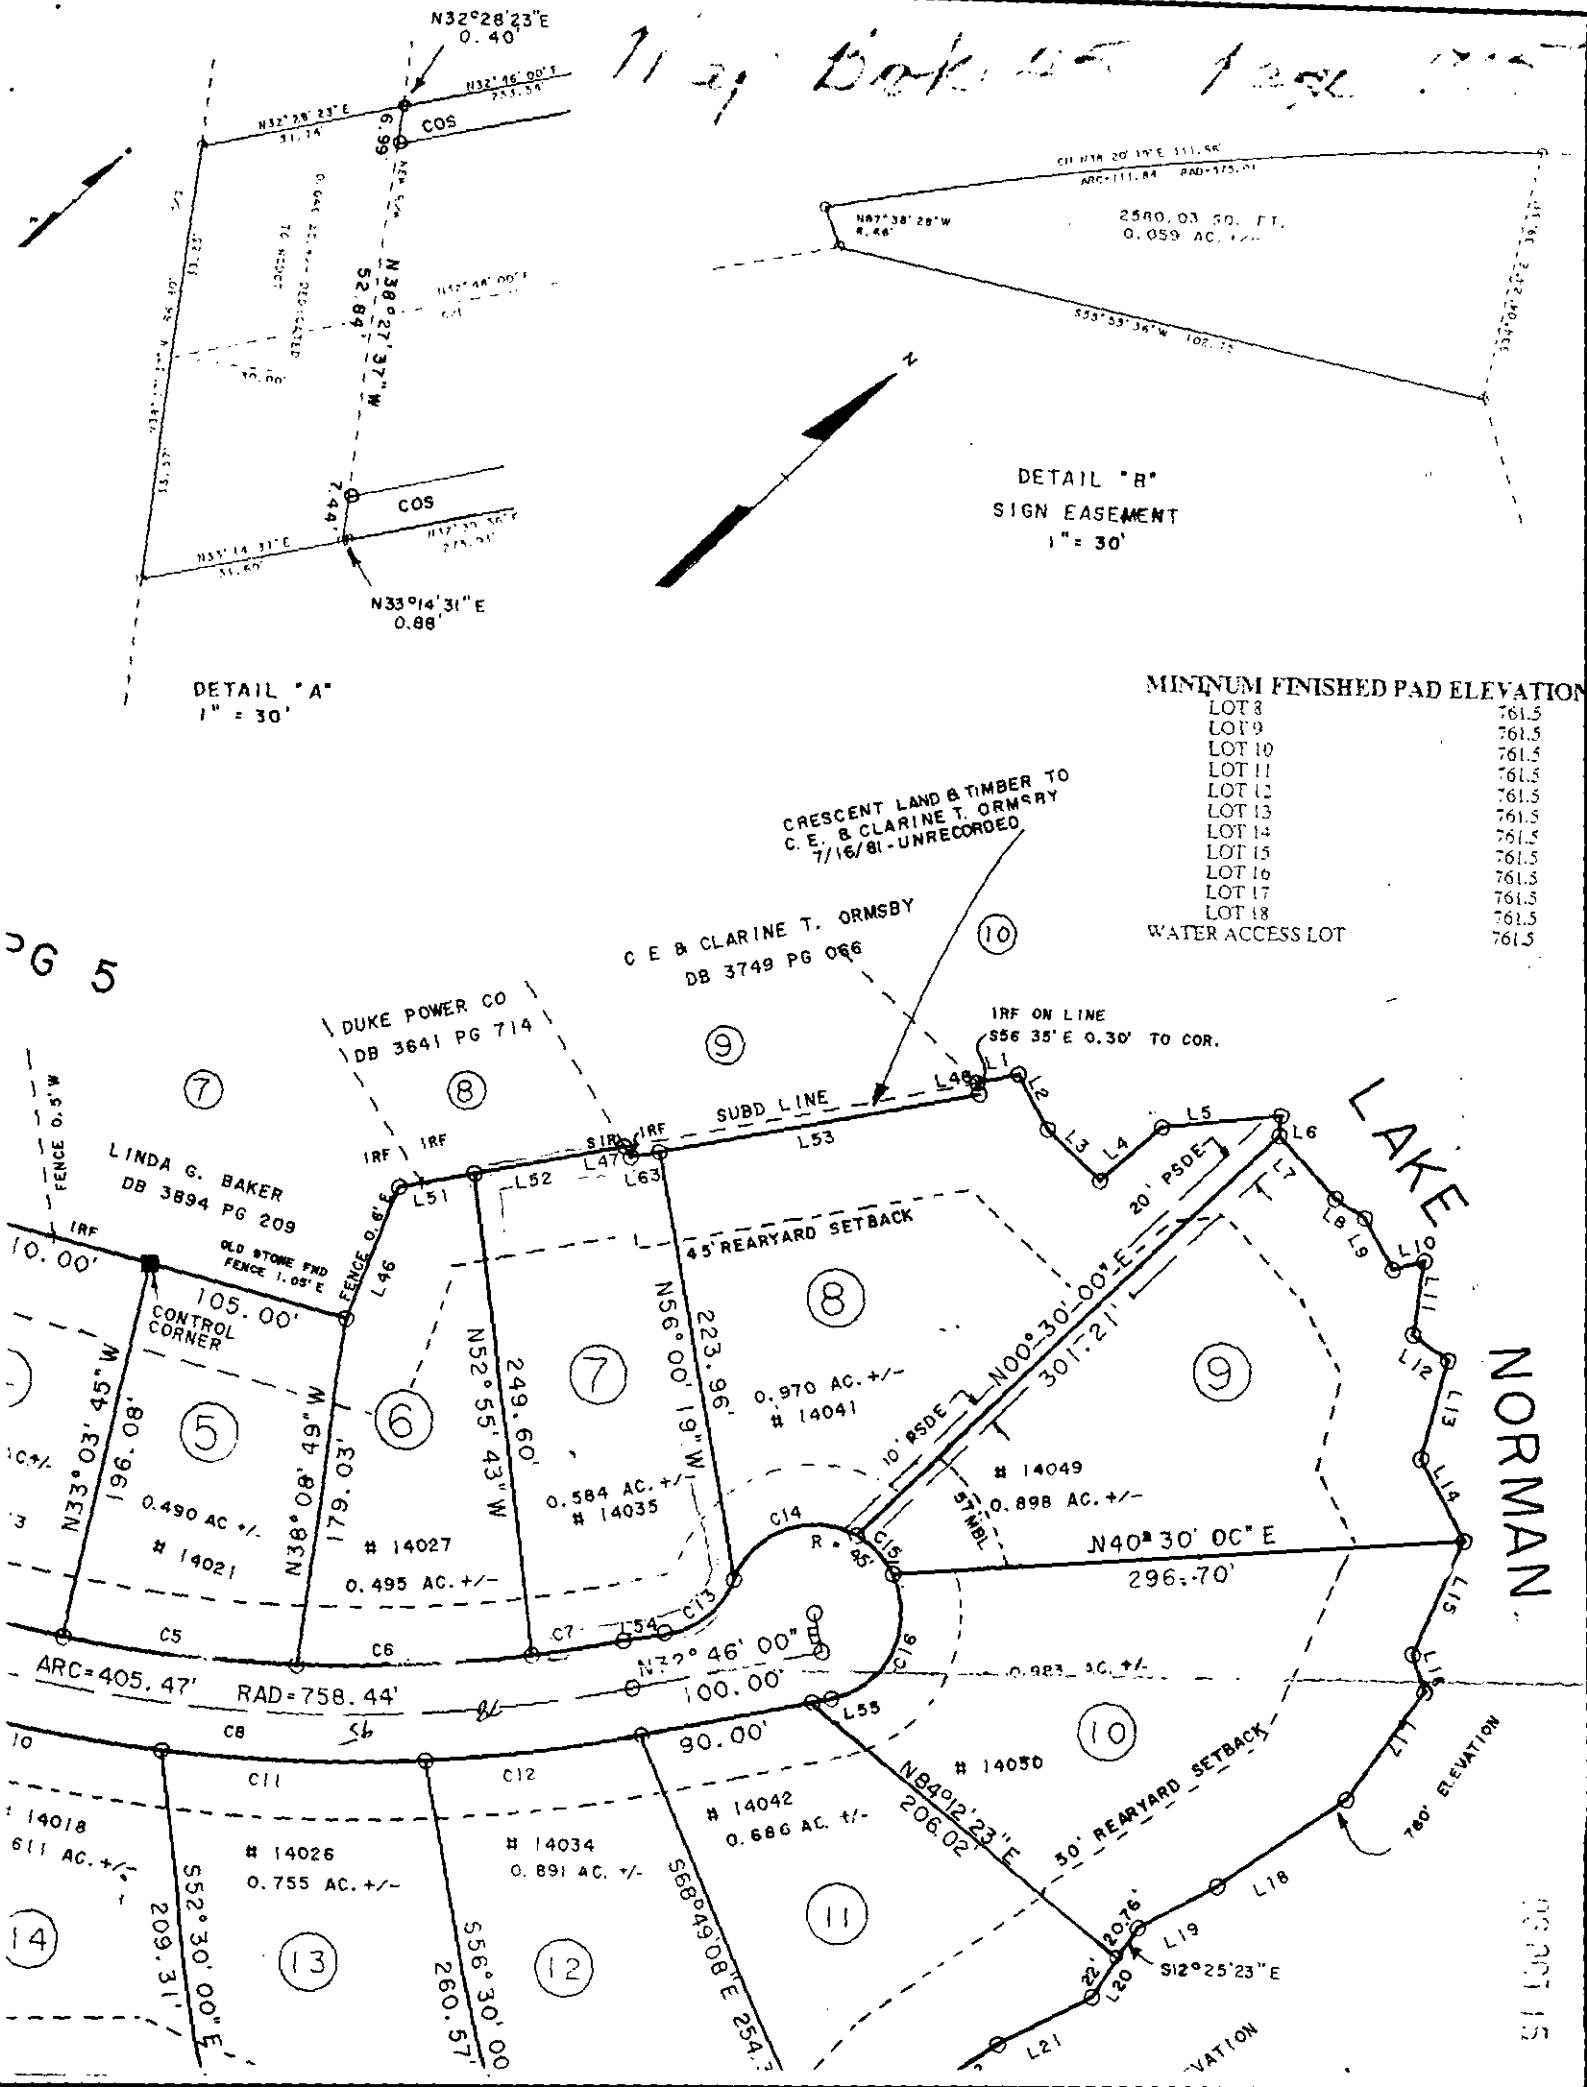
N32°28'23"E
0.40
N32°46'00"E
253.54
N32°28'23"E
31.14
66.9
COS
N30°27'37"W
52.89
COS
74.4
N33°14'31"E
0.88
DETAIL "A"
1" = 30'
2580.03 SQ. FT.
0.059 AC. +/-
N87°38'28"W
8.46
S33°53'36"W
102.75
DETAIL "B"
SIGN EASEMENT
1" = 30'
MINIMUM FINISHED PAD ELEVATION
LOT 8 761.5
LOT 9 761.5
LOT 10 761.5
LOT 11 761.5
LOT 12 761.5
LOT 13 761.5
LOT 14 761.5
LOT 15 761.5
LOT 16 761.5
LOT 17 761.5
LOT 18 761.5
WATER ACCESS LOT 761.5
CRESCENT LAND & TIMBER TO C. E. & CLARINE T. ORMSBY 7/16/81 - UNRECORDED
C E & CLARINE T. ORMSBY DB 3749 PG 066
DUKE POWER CO DB 3641 PG 714
LINDA G. BAKER DB 3894 PG 209
IRF ON LINE S56 35' E 0.30' TO COR.
SUBD LINE
FENCE 0.5' W
OLD STONE END FENCE 1.05' E
FENCE 0.6' E
10.00'
105.00'
CONTROL CORNER
N33°03'45"W
196.08'
N36°08'49"W
179.03'
N52°55'43"W
249.60'
N56°00'19"W
223.96'
45' REARYARD SETBACK
20' PSDE
10' PSDE
N00°30'00"E
301.21'
0.490 AC +/-
14021
14027
0.495 AC. +/-
0.584 AC. +/-
14035
0.970 AC. +/-
14041
14049
0.898 AC. +/-
57' MBL
N40°30'00"E
296.70'
LAKE NORMAN
ARC=405.47'
RAD=758.44'
N32°46'00"W
100.00'
90.00'
0.983 AC. +/-
14050
N84°12'23"E
206.02
50' REARYARD SETBACK
760' ELEVATION
14018
611 AC. +/-
14026
0.755 AC. +/-
14034
0.891 AC. +/-
14042
0.686 AC. +/-
S52°30'00"E
209.31'
S56°30'00"E
260.57'
S68°49'08"E
254.3
S12°25'23"E
20.76'
22'
PG 5

THE T.&J. PANEL
WASTEWATER TREATMENT SYSTEM

PATENT NUMBER 4013559

P.O. Box 288 • Statesville, North Carolina 28677
N.C. WATS 1-800-222-2577 • (704) 872-9566

There are many new developments in ground absorption sewage disposal system on the market today. The T&J Panel System is designed to make the most out of the least amount of space possible. This is made possible by the fuller use of the more porous top soil and the limited effect of evapotranspiration and the wicking action of the block as the effluent is kept close to the surface of the ground and fused through the pores of the block to the sidewall area of the drainfield lines. This more general distribution and wicking allows for the use of the entire sidewall area and helps prevent the sealing off of the bottom and lower sidewalls that often occurs in a conventional system.

A 16 inch high panel is 46 inches long, 8 inches wide, and weighs about 155 pounds. There is a 6 inch by 6 inch air chamber at each end of the panel which extends from top to bottom to ensure aerobic action in each level of the field lines. Each panel has a storage chamber just below the top chamber for storage during peak use periods. A 24 inch panel is also available for use in repair or specially engineered systems.

* *

Limited Warranty

The structural integrity of each T&J Panel, when installed in accordance with manufacturer's instructions, is warranted against defective materials and workmanship for one year from date of manufacture. Should a defect appear within the warranty period, purchaser must inform T&J Panel System of the defect before the warranty expires. T&J Panel System will supply a replacement unit. T&J Panel System's liability specifically excludes the cost of removal and/or installation of the panels. There are no other warranties with respect to the units, including no warranties of merchantability or of fitness for a particular purpose. The warranty does not extend to incidental, consequential, special or indirect damages. The company shall not be liable for penalties or liquidated damages, including loss of production and profits, labor and materials, overhead costs, or other loss or expense incurred by buyer. Specifically excluded from warranty coverage are: Damage to the panels due to ordinary wear and tear; alteration, accident, misuse, abuse or neglect of the panels; the panels being subjected to stresses greater than those prescribed in the installation instructions; the placement by buyer of improper materials into buyer's system; or any other event not caused by the company. Furthermore, in no event shall the company be responsible for any loss or damage to the buyer, the panels or any third party resulting from its installation or shipment. Buyer shall be solely responsible for ensuring that installation of the system is completed in accordance with all applicable laws, codes, rules and regulations. Any alteration of this warranty must be noted as "Warranty" in writing by the company.

Engineering and Test Data by Law Environmental Services and Ayers and Associates is available from the manufacturer at the address below.

THE T&J PANEL
WASTEWATER TREATMENT SYSTEM
PATENT NUMBER 4013559

P.O. Box 288 • Statesville, North Carolina 28677
N.C. WATS 1-800-222-2577 • (704) 872-9566

Distributed by

Serving people with a better quality system


When Your Problem in On-site Waste Is:



Topography and Vegetation



Special Landscaping Needs

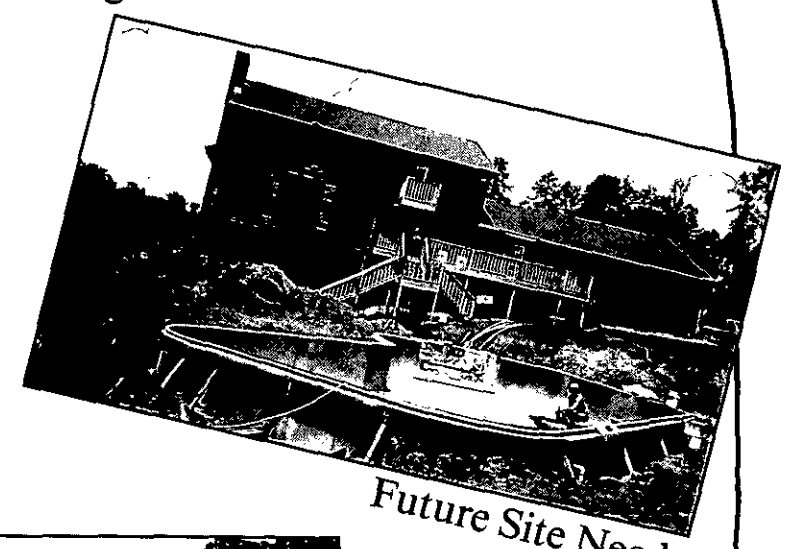

Future Site Needs




Limited Suitable Area

Then consider the

T&J Panel Wastewater Treatment System


A Better Quality Effluent Than With Conventional Systems

Isometric Drawing of A Segment of 16" T&J Panel System Drainfield

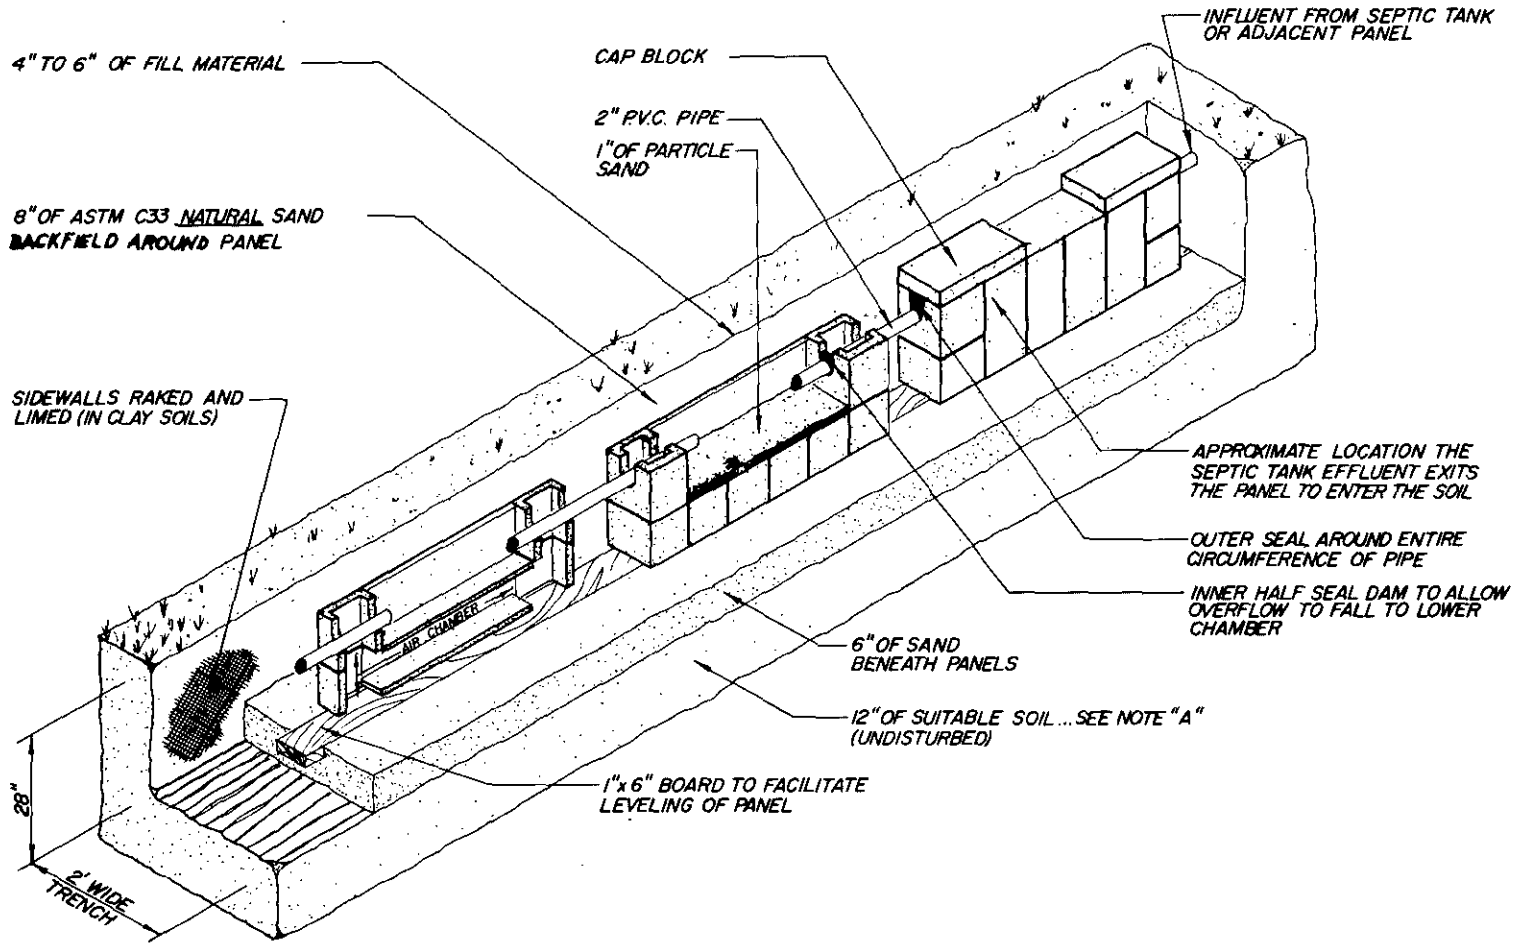


See the difference in a real space needed with the T&J Panel System Wastewater Treatment System when compared to a conventional tile/stone nitrification system.

Conventional System

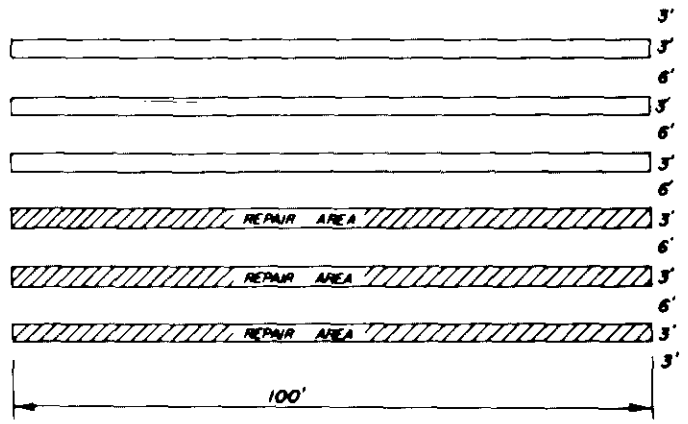

A total suitable and usable area of 5400 square feet is needed for a conventional system.

T & J Panel System

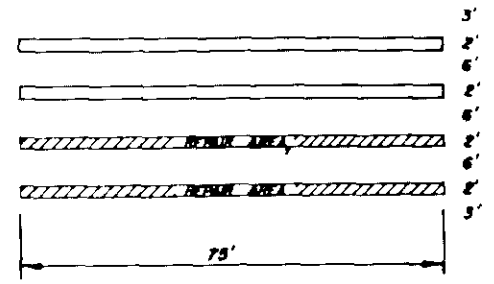

A total suitable and usable area of 2400 square feet is needed for the T & J Panel System**.

*Typical 3 bedroom house in a clay soil with 0.4 gallon per day per foot square application rate with a design flow on 120 gallons per day per bedroom.


**The T & J Panel Wastewater Treatment System is included in the North Carolina Sewage regulations as a PPBPS as of August 1, 1988. This allows for a 50% reduction in lineal footage of trench with the 16 inch panel as illustrated above. (See note "A")
Note A - This reflects North Carolina Codes. Please check local codes and practices for your area.

Advantages of the T&J Panel System

- Effluent discharged closer to the ground surface
- Each panel works as individual unit
- Panel may be grouped where best soils are found
- Less soil distributed during installation
- Less catch basin effect
- Lines only 24" wide — more landscape flexibility
- Aerobic bacterial activity
- Easily installed — similar to conventional system
- Can be installed as modified mound system
- Lines can be inspected or serviced through lids
- Prefabricated panels delivered to job site

Environmentally Superior Effluent With The T&J Panel System

In a side by side test, both total suspended solids and chemical oxygen demand was reduced with the Panel System. The panels were loaded at 3.4 times that of the conventional system.

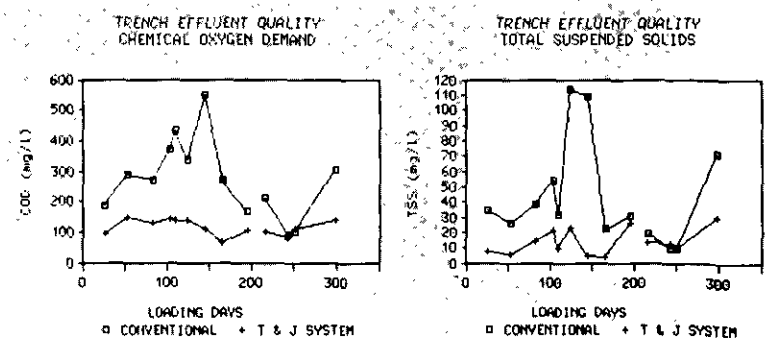


Total Suspended Solids Concentration for Effluent from Simulated Conventional and T&J System Trenches. (Note: Hydraulic Loading Rate for Conventional = 1.53 ca/day, for T&J = 5.27 ca/day.)

Chemical Oxygen Demand Concentration for Effluent from Simulated Conventional and T&J System Trenches. (Note: Hydraulic Loading Rate for Conventional = 1.53 ca/day, for T&J = 5.27 ca/day.)

Low Pressure Panels (LP Panel) - Alternative installation for the T&J Panel System.

The LP offers a high quality effluent with a uniform distribution of wastewater throughout the entire system.

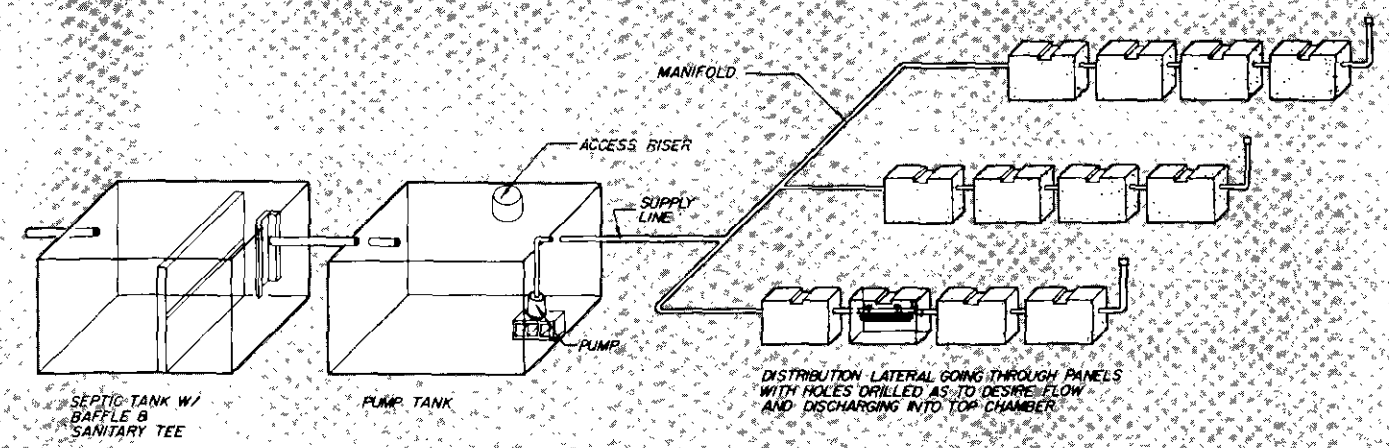

- Uniform distribution of the effuent.
- Elimination of localized overloading.
- Works with 2-4 feet of pressure head.
- Dosing and resting cycles.
- Placing of the effluent into the sidewall near the surface—where the more porous soils are found.
- The aerobic action of the T&J Panel's design.
- The filtration of the effluent through the T&J Panel System and its sand backfill.

DESIGN, INSTALLATION AND MAINTENANCE

OF THE

T & J PANEL WASTEWATER TREATMENT SYSTEM

FOR

SANITARIANS

AND

SEPTIC TANK INSTALLERS

Although this manual is sectioned for specific user groups, we at T & J Panel suggest that you familiarize yourself with the complete manual.

Sanitarians

In the early days of the T & J Panel System, when it was still considered an experimental system, the primary reason for permitting the Panel System was because of insufficient space for a conventional system. Now with inclusion in the Sewage Regulations(10NCAC 10A .1956(3)(a)(ii)), the Panel System should be considered when a quality effluent may be needed, space is limited, usable soil is limited, or there are indications that at some future time, space may be needed for other uses. When there is a trend for added development such as additions to homes, pools, or other special landscaping development the T & J Panel System may prevent insufficient space later. As an example, there was a subdivision where three of five homes in the same block added in-ground pools. Each of these pools impacted the existing nitrification lines. As a sanitarian, if you can foresee such a trend developing, discuss the Panel System with the home owner.

As noted in the regulations, the PPBPS is only permitted where soils are suitable for a conventional system, however, only one-half of the space is needed. The Panel System will allow the use of the best soils on the lot. This system may be gravity fed or pumped using the LP Panel System as described. Most of the concepts for a T & J Panel layout are the same as for a conventional system. The biggest differences are areal area needs and quality of effluent being introduced into the soil.

Conversion

A three bedroom house with a 0.4 gpd application rate. (First three steps are the same as the conventional line)

1) 120 gallons per bedroom x 3 bedrooms = 360 gallons per day design flow rate.

2) 360 flow rate/0.4 application rate = 900 sq. ft. of trench bottom.

3) 900 sq. ft./3 ft. wide trench = 300 lineal feet of conventional system.


This conventional layout requires 2700 sq. ft. of area on the lot and equal space for repair for a total of 5400 sq. ft. of suitable and usable area. To calculate the T & J Panel System size, the above calculations must be made with an additional fourth step as described in 10NCAC 10A .1956 (3)(a)(ii)(B) for a PPBPS (the T & J Panel System)

4) 300 lineal feet of conventional system x 0.5 for a 16 inch high Panel System = 150 lineal feet of T & J Panel trench.


A Panel System requires only a 1200 sq. ft area on the lot for the system and equal area for repair. With the Panel System the installation and repair can go into the same space as the initial area required by a conventional gravel trench system.

Window Effect

Areal space should always be a consideration for any system, however, it is especially notable with the Panel System as with any system that reduces the size of the areal area drainfield. The following is a simplistic example of this concept.

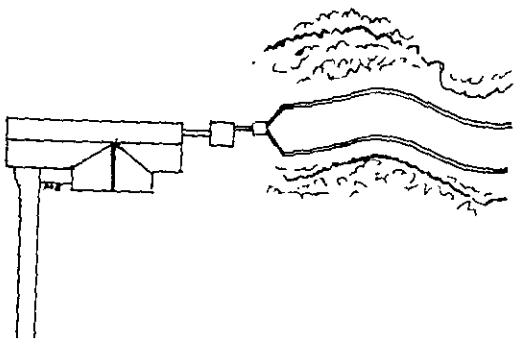

RIGHT

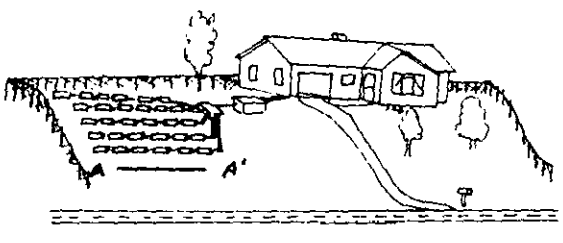


WRONG


While both systems have the same lineal footage of trench the lower diagram is not a desireable design. The effluent must pass through the area A-A' which can cause a strain on that area and even a failure because of hydraulic overloading.

Distribution

Another extreme would be the use of a long single trench fed from only one end. In the first example, below the areal space is good and the chance of hydraulic overloading is greatly reduced. However downline distribution in the panel line will not give optimum treatment.

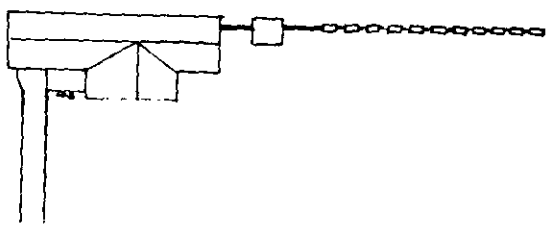

WRONG

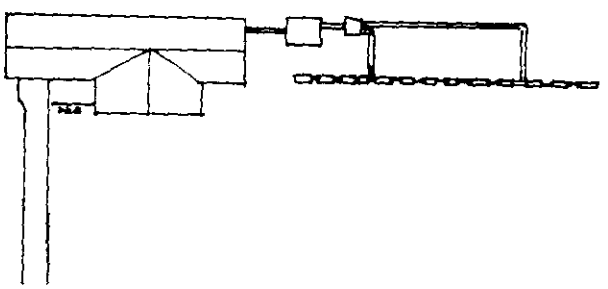

RIGHT

In the lower example we see that the trench has been feed from multiple points. Because the Panel lines are put in as level as possible, never exceeding 1/4 inch of fall in 10 feet of run, they feed both ways equally. T & J recommends that no gravity line exceed 50 feet, unless it is fed from multiple points. In both of these examples, we are specifying the Panel System, but the logic applies to the conventional system as well.

COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-A Article 11)

OWNER OR CONTRACTOR _____ DATE _____ PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION _____

_____ S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2½

Garbage Disposal Unit N/A Yes ( ) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil clay loam over clay
Percolation Rate 0.4 gal/ft²/day
Topography 6% slope
Depth to Water Table > 60"
Rock or other impervious formations none

Lot Area _____

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

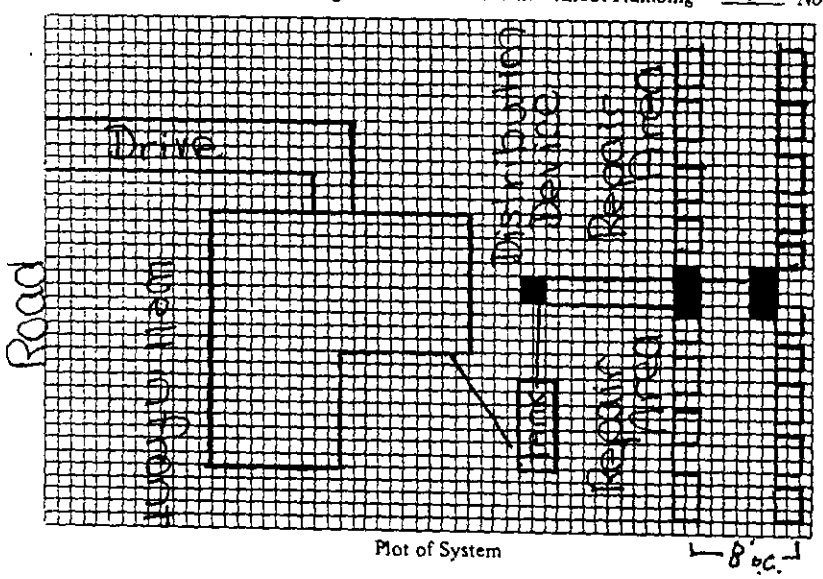

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines (2) 75' lines of
Sq. Ft. 900 Linear Ft. 150 panels
Depth of Stone in Lines 24" of Sand
Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: 2 lines with 17 panels each line. flow split by flow divider. 2' wide and 75' long each split in middle by D-box. 25 tons sand

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-A-Article 11)

OWNER OR CONTRACTOR _____ DATE _____ PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION _____

_____ S. R. No. _____


SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2½
Garbage Disposal Unit N/A Yes ( ) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )
Lot Area 20,000

Character & Porosity of Soil clay loam over clay
Percolation Rate 0.4 gal/ft²/day
Topography gently sloping
Depth to Water Table >60"
Rock or other impervious formations _____

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement Pressure Distributn

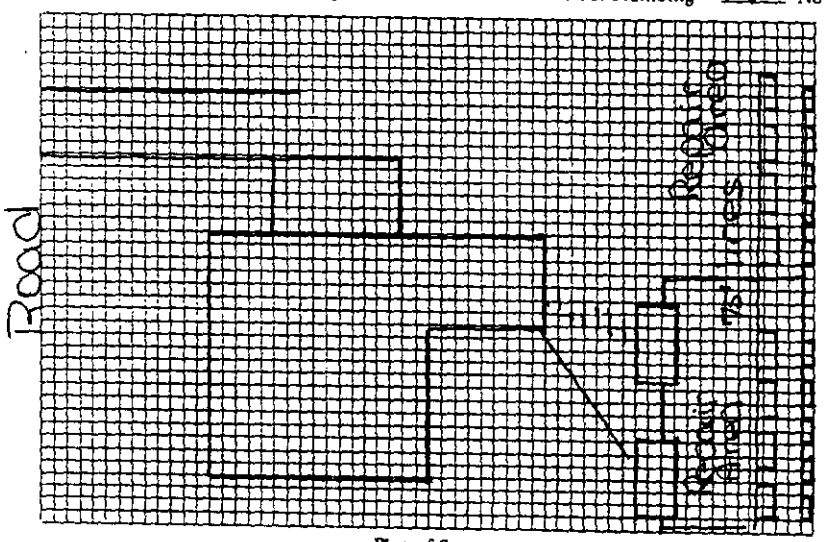

Plot of System

Size of Tank 1,000 septic/1600 pump Gals.
Nitrification Field:
No. of Lines 2@5' lines of T&J
Sq. Ft. 900 Linear Ft. 150
Depth of Stone in Lines 24" sand
Water Supply: Individual ( )
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: pump sized by head 2-4' at turn up

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

How Many Panels Do You Need?

To calculate the number of 16 inch high panels needed for a 150 foot line, multiply 150'x 12" = 1800" then divide by 52" which is 46 inches for the panel and 6 inches for the space between the panels in the trench. 1800" /52" = 34.6 panels, so you would call for 34 panels. (A material order chart is included in the installer section of this manual.) If there is to be more than one trench, the sizing of the lines should be as equal as possible with as close to the same number of panels in each trench as is practical. A permit will normally show the panel as small blocks on the line. The following two pages are sample copies of permits for Panel systems.

Gravity or Pressure


The T & J Panel System can be installed as either gravity or a low pressure distribution system. When designing a pressure system the principles of low pressure distribution are as described in the LPP manual. There is further discussion on pressure systems in the installer section of this manual. One of the attached permits is for a LP Panel drainfield.

Backfill

Backfill sand shall be a clean, washed, medium sand that is naturally occurring and falls within the gradation of ASTM C-33 specification. This specification is one that is used in the ready mix industry and is readily available in all areas. The second type of sand that you will need is a clean particle sand to coat the bottom of each panel's top chamber with a bed of sand one inch thick. This sand is a medium grade of sand blasting sand. Each one hundred pound bag should cover eight panels. Backfill sand calculations should be taken from the material sheet.

Tar Seals

The two drawings below illustrate the inner and outer seal. Note that while the outer seal is a complete seal, the inner seal is only up to the top of the connecting pipe. This is to allow for over flow of the effluent at peak use periods into the lower air chambers. At this point the air chambers become additional storage chambers for the effluent.

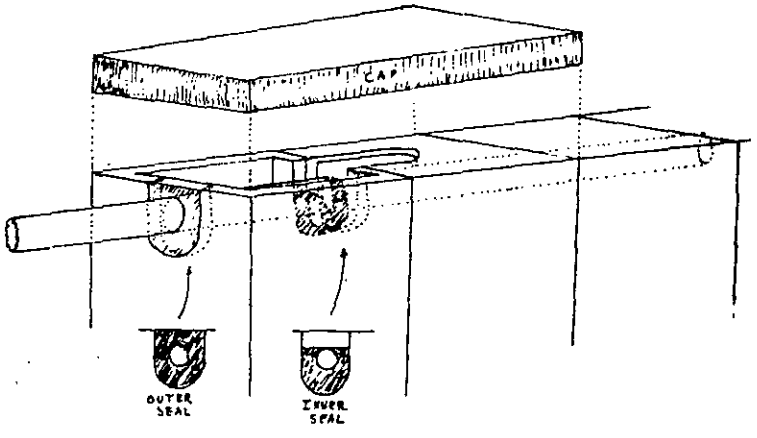

Trench Preparation

Trench grade should be established so that backfill cover will be four to six inches over the tops of the panels. (Note on severe slopes system depth should be adjusted to protect against brakeout of effluent) In clay type soils the trench side walls should be raked to bring slicked over areas back as near to original structure as possible. A light dusting of lime on the side walls is required to promote the soil structure.

Final Inspection

The following list of points are things that an inspector should look for before issuing an completion permit.

1) Is depth of the panels within guidelines?

2) Are drain lines level or less than 1/4 inch fall in ten feet?

3) Have seals been properly constructed?

4) Was the proper sand used in the trench backfill?

5) If in clay type soils were the side walls raked and limed?

(For Pumped Systems)

6) Have pump size, head pressure, and dose cycle been properly sized and set?

(Set dose cycle for 3.6 gallons per 16 inch high panel.)

Installer


Generally, on level open land, a Panel System can be installed in about the same time as a conventional system; however, traditionally, Panel Systems have been installed where space and topography have restricted use of a conventional system. For this reason Panel System installations have required more time. Many installers enjoy the change of working with panels, not handling gravel, and the satisfaction of knowing a system is being installed where previously a conventional system was not possible.

Ordering Materials

Enclosed on following two pages you will find an order sheet for the T & J Panel System and a materials chart for 16 inch high Panel System. The distributor in your area will lead you through these sheets when ordering or pricing the system. For information on the distributor located closest to you call 1-800-222-2577 (inside N.C.) or 704-872-9566. After ordering, your panels will be shipped to the job site banded together on pallets.


Installation Tips

Installation for multiple line systems should begin in the most confining area and be worked to the more open areas.

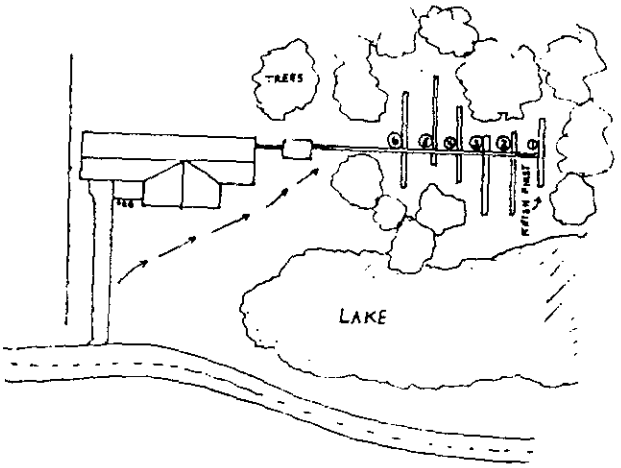


Above is an example of a multiple line installation. As you can see the installation should begin with the line marked 1 and proceed to 2, 3, then 4. This procedure will greatly ease material handling and backfilling. (Note sections of the drainlines should be left uncovered to allow for inspection of lines when area is confined and return access to lines is limited.)

On the following page are two examples of drain lines on sloping lots. The first drawing shows the drainline going through a slope making the center of the line deeper in the ground. This is not a desirable situation. The second drawing shows the drainline going around the slope keeping the trench depth and cover uniform for the entire length of the line. On slopes care should be given to avoid cutting away valuable top soil in an effort to make straight lines. Panel lines can be curved to almost any degree.

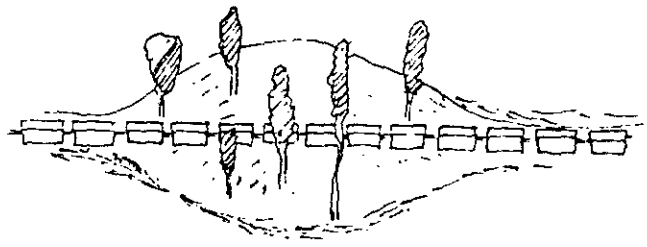

Wrong

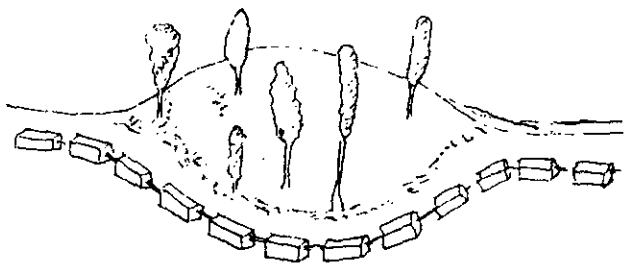

Right

Digging The Trench

Start by shooting the grade and marking the contour. Then for a 16 inch panel add 28 inches to the shallowest or lowest grade that the trench must cross to obtain the trench bottom grade. Now dig the trench at the elevation derived, checking the grade frequently. The trench should be a minimum of two feet wide. With the trench open all sidewalls shall be raked to bring smeared areas back to their original structure before a light dusting of lime is applied. Now place a 6 inch layer of backfill sand in the trench and level to grade, then place a 1 x 4 or 6 inch board flat on it's side on top of the 6 inch layer of sand. Once more check the grade of the trench by shooting the top of the board. Once the grade boards have been set, the panels may be set into the ditch by hand or using the backhoe. Each panel weights about 155 pounds and placement by hand goes quickly. The panels should be placed about 6 inches apart in the trench to obtain equal spacing. Now place 10 to 12 pounds of clean particle sand (medium sand blasting sand) in the top chamber of each panel to form a bed of sand about one inch thick. Tar seal rope should be placed in the U outs to form seals as shown in earlier drawings. Once the tar rope is in place, a 24 inch section of two inch PR160 pipe is cut to span from the upper middle top chamber of the first panel to the upper middle chamber of the next panel. The tar seal rope that is used should be of tar or butyl that is soft and pliable to obtain a water tight seal. Now that the connection and sealing is complete a block cap is placed on each end of the panel covering all openings.(These will be delivered with the panels.) The cap block may well serve as an inspection port at some future date. The trench is ready to be backfilled to the top of the panel with the same backfill sand used in the trench bottom. With the sand to the top of the panel, trenches should be left for the sanitarian to inspect. Soil cover should be added after the final inspection.

Most Panel Systems are currently used due to space considerations and caution should be taken to preserve suitable soil structure and site conditions.

Materials Chart For 16 Inch Panels

Materials needed per panel:

- Three feet of half inch tar seal rope per panel.
- Two feet of two inch PR160 pipe per panel or same linear feet as line layout of pressure system of one and a quarter inch pipe. Add pipe for tie in of lines to tank and house.
- One hundred pounds of partical sand (sand blasting sand fine texture) per eight panels.
- Same linear feet of one by six boards as line length.
- Bag powder lime when in clay soils.

Panel and C-33 Sand fill

50 LF - 11 panels
8¼ tons sand

60 LF - 14 panels
10 tons sand

70 LF - 16 panels
11½ tons sand

80 LF - 18 panels
13¼ tons sand

90 LF - 21 panels
15 tons sand

100 LF - 23 panels
16½ tons sand

110 LF - 25 panels
18¼ tons sand

120 LF - 27 panels
20 tons sand

130 LF - 30 panels
21½ tons sand

140 LF - 32 panels
23 tons sand

150 LF - 34 panels
25 tons sand

160 LF - 37 panels
26½ tons sand

170 LF - 39 panels
28 tons sand

180 LF - 41 panels
30 tons sand

190 LF - 43 panels
31½ tons sand

200 LF - 46 panels
33 tons sand

T & J Panel Material Worksheet

Homeowner _____ County _____

Address _____

_____

Description of System _____

_____

_____


_____	T & J Panels _____ Inch (caps N/C)	_____
_____	2" Pipe	_____
_____	1 1/4" Pipe	_____
_____	Fittings for Pipe	_____
_____	Tar Seal Rope (3' per Panel)	_____
_____	Bag Partical Sand (100 lbs per 8 Panels)	_____
_____	Pallets (Returnable)	_____
_____	Screened Creek Sand (FM 2.3 to 3.0)	_____
_____	1x4 or 1x6 Boards	_____
_____	Power Lime	_____
_____	Sep Tank _____ Gallon	_____
_____	Tar Seal for Tank	_____
_____	4" PVC Pipe Schedule 40	_____
_____	Distrobution Box	_____
_____	_____	_____
_____	_____	_____
_____	_____	_____
	Sub-total	_____
	Delivery Charge	_____
	Tax	_____
	Total	_____

Panels With Pressure Distribution


The LP Panel uses Technology similar to that of Low Pressure Pipe (LPP) System. The tables and distribution design described in the LPP manual are applicable to the pressure Panel System. The system should be used with two to four feet of head. In many respects an LP Panel is similar to an LPP with the holes discharging into the panels.

The dosing cycle for the Panel System is designed to pump enough effluent to fill the top chambers of all the panels in the system. The top chamber of a 16 inch panel holds 3.6 gallons. When the system has 34 panels and all the holes are the same size, then you would multiply 34 X 3.6 to get 122 gallon per dose cycle. The holes are drilled in the distribution pipe at the 10 and the 2 o'clock position. These are then placed so that the effluent is pumped into the top center chamber of the panel. If the hole sizing changes then the pump cycle is set by the hole that is discharging the fastest.

All valves and turn ups should be neatly capped, covered, and labled for future service. Pump tanks should be constructed as shown in drawing as to allow for service and or repairs.

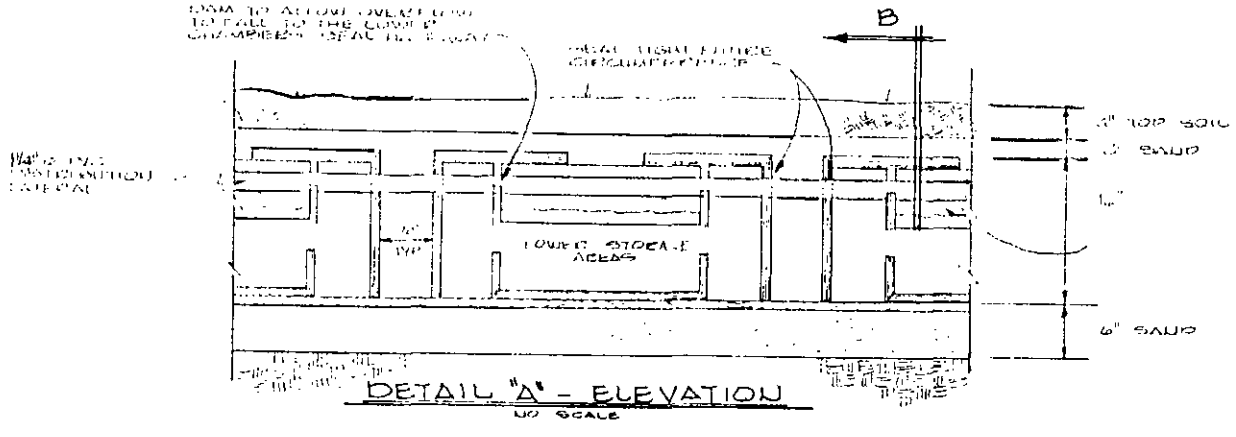


DETAIL "A" - ELEVATION

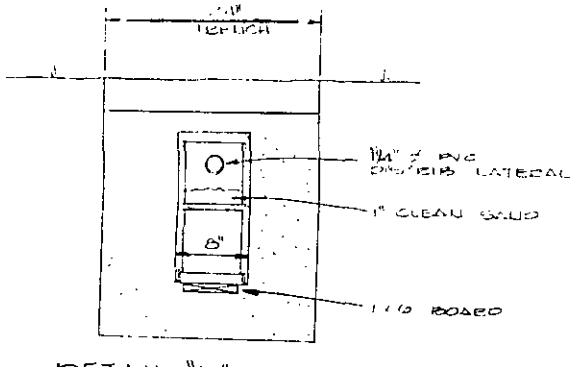


DETAIL "B" - SECTION

Pump Tank Drawing

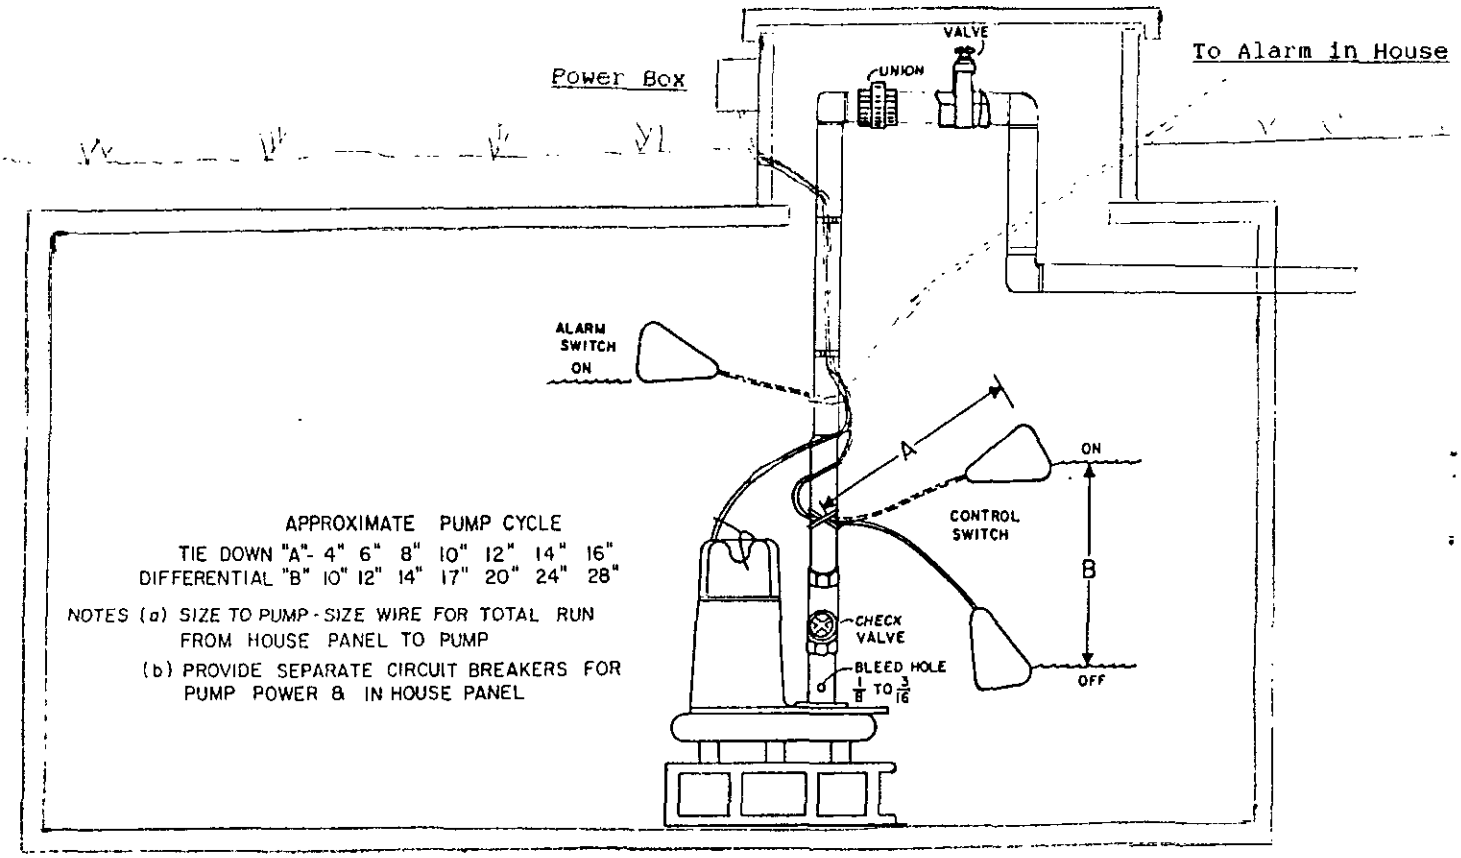


Isometric Drawing of a Segment of 16" T&J Panel Drainfield

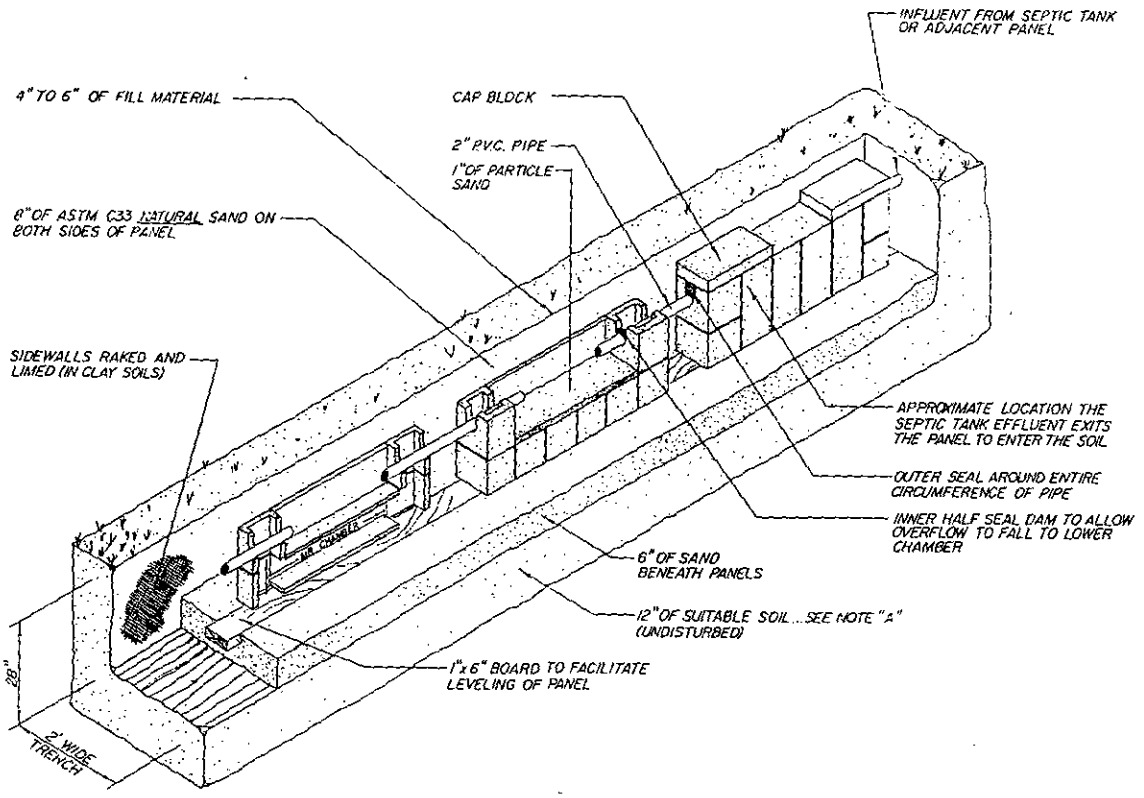


THE T. & J. PANEL
WASTE WATER TREATMENT SYSTEM
PATENT NUMBER 4013559

P.O. Box 288 • Statesville, North Carolina 28677
N.C. WATS 1-800-222-2577 • (704) 872-9566

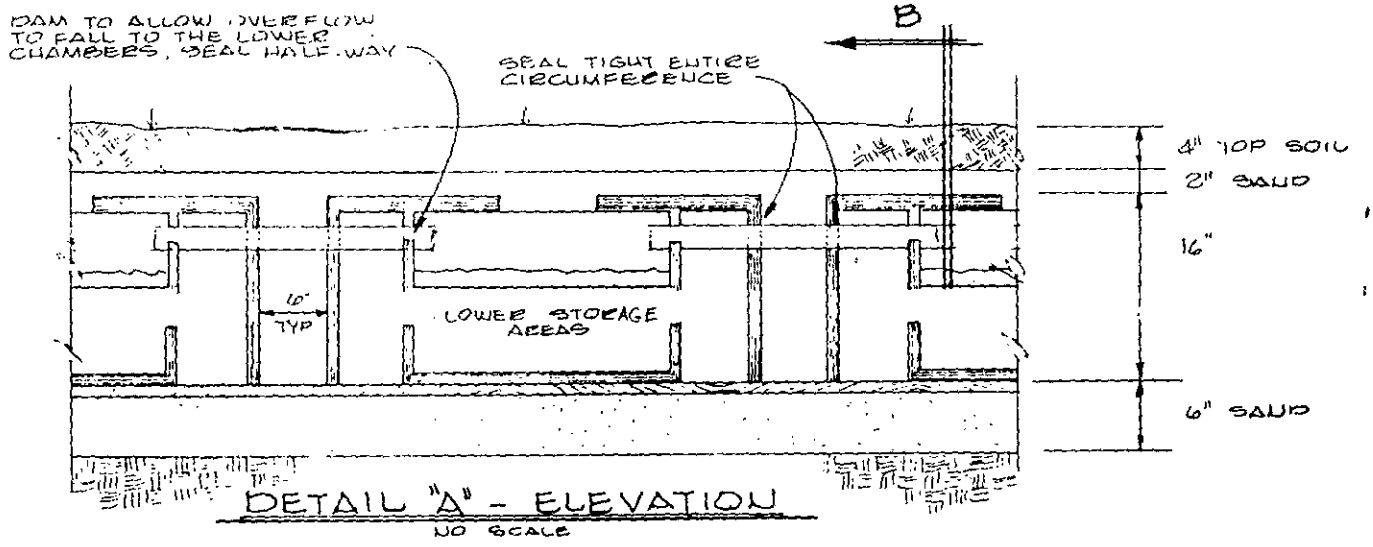

DETAIL "A" - ELEVATION
NO SCALE

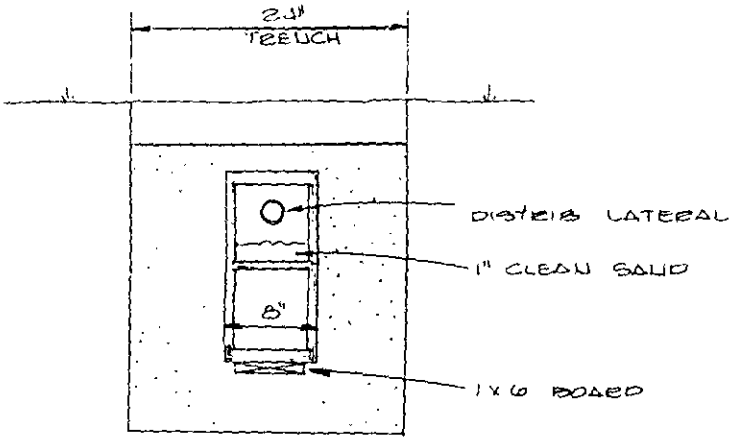

DETAIL "B" - SECTION
NO SCALE

Prepared By & Please Mail To: PURSER & ASSOCIATES (Box 90)

JUDITH A GIBSON REG OF DEEDS MECK NC
FILED FOR REGISTRATION 04/06/95 13:28
BK: 08108 PG: 0574/0577 #:0226 14.00

STATE OF NORTH CAROLINA

COUNTY OF MECKLENBURG

CERTIFIED TO BE A TRUE COPY

ACKNOWLEDGEMENT OF REQUEST BY OWNER FOR RECLASSIFICATION OF SITE FROM *"UNSUITABLE" TO "PROVISIONALLY SUITABLE"* UNDER 15A NCAC 18A .1948 AND ANY OF THE FOLLOWING RULES: .1956; .1957(a); .1957(b); or .1957(c)

Lot 7, The Cape
MB 25/705

FILE # 785B/8656A (Lot 7)
PARCEL # 001-014-73

The undersigned, MOGO, Limited, owner of property located at 14035 Clarendon Pointe Court, Huntersville, NC 28078 (the "site") and described in an instrument recorded in Book 8108 at Page 572, Mecklenburg Public Registry, hereby acknowledges that the undersigned applied to the Mecklenburg County Health Department (the "Department") for a permit to install a septic tank sewage disposal system on the site; that the Department evaluated the site for suitability for such a system in accordance with the regulations promulgated by the North Carolina Commission for Health Services as 15A NCAC 18A .1900 et seq.; that the Department originally classified the site as "unsuitable" pursuant to the standards set forth in the regulations; that the undersigned requested that the Department reclassify the site as "provisionally suitable" in light of the particular septic tank system proposed by the undersigned; that the Department considered various studies, data, and other information which indicate to the Department that the septic tank system proposed by the undersigned is allowed by the rules; and that the Department therefore reclassified the site as "provisionally suitable" and issued an appropriate permit for such proposed septic tank system.

The undersigned further acknowledges that the proper design, construction, operation and maintenance of such septic tank system is his responsibility and that neither the Department nor its officials, employees, or agents warrant or guarantee that the said system installed pursuant to the permit issued by the Department will function in a satisfactory manner for any given period of time or that the Department, its officials, employees or agents assume any liability for any damages of any kind which are caused, or which may be caused, by a malfunction of such system.

The undersigned further acknowledges that the following conditions will apply to the site:

- Any changes on the property may make the Improvement Permit Null and void and may make the Improvement Permit subject to revocation.

This instrument was prepared by: Rodney L. Purser & Associates
Mail after recording to: Rodney L. Purser & Associates (Box 90)

RBCWM:2662_1/3-14-94

- Do not grade, cut, fill, pave, construct a building or deck, dig a well, install a swimming pool or otherwise cover or disturb the soil (except for planting and maintaining grass or other ground covers) in a manner which will adversely affect the repair area or area where the septic tank system is located.

- When a private certified operator is required, no improvement permit for the designated repair shall be issued unless there is a private certified operator to carry out this management program in the service area where the proposed system is to be located. (Refer to Rule .1961, "Maintenance of Sewage Systems," for further information.)

- Additional fees will be required according to the Mecklenburg County user fee schedule applicable at the time for the issuance of a repair permit for any subsequent repairs to the sewage treatment and disposal system or for installation of a replacement system.

- At the time repairs to the sewage treatment and disposal system are to be made or a replacement system installed, the regulations in effect at that time will govern the repairs or installation of a replacement system.

The undersigned further agrees for himself, his heirs and assigns that he shall indemnify and hold harmless the Department, its employees, and officials, as well as Mecklenburg County and its employees and officials, for any damages or other claims of any person or persons whatsoever arising out of the installation, operation, or failure of said septic tank system.

The undersigned further agrees for his heirs and assigns that, in the event any septic tank system installed under authority of the aforesaid permit fails to perform adequately in any respect, he will take whatever measures are required to correct same; or if such is impossible he will discontinue use of said system immediately.

Use of the singular masculine pronoun forms herein shall be deemed to also include the plural and feminine forms as the context may require.

This document shall be placed on the public records of the Register of Deeds of Mecklenburg County and indexed therein under the Grantor Index in the name or names of the undersigned, and the foregoing acknowledgements shall henceforth be binding on all persons claiming any right, title, or interest in the site.

IN WITNESS WHEREOF, the undersigned has hereunto set his hand and seal, or if corporate, has caused this instrument to be signed in its corporate name by its duly authorized officers and its seal to be hereunto affixed by authority of its Board of Directors, this 6th day of April, 199 5.

MOGO, Limited
a North Carolina corporation

(Corporate Name)

By: _____

Vice President

ATTEST:

_____

Assistant Secretary

(Corporate Seal)

_____ (SEAL)

_____ (SEAL)

_____ (SEAL)

_____ (SEAL)

STATE OF NORTH CAROLINA
COUNTY OF Mecklenburg

I, Sybil Burleson, a Notary Public for said County and State, do hereby certify that _____ personally appeared before me this date and acknowledged the due execution of the foregoing instrument.

WITNESS my hand and notarial seal, this _____ day of _____, 199__.

_____
Notary Public

My Commission Expires:

_____

RBCWM:2662_1/3-14-94

STATE OF NORTH CAROLINA
COUNTY OF Mecklenburg

I, Sybil Burleson, a Notary Public for said County and State, do hereby certify that Brenda R. Litaker personally came before me this day and acknowledged that she is Assistant Secretary of MOGO, Limited, a North Carolina corporation, and that by authority duly given and as the act and deed of said corporation, the foregoing instrument was signed in its name by its Vice President, sealed with its corporate seal and attested by her as its Assistant Secretary.

WITNESS my hand and notarial seal, this 6th day of April, 1995.

Sybil Burleson
Notary Public

My Commission Expires:
August 25, 1998

Mecklenburg County
Health Department

March 23, 1995

Jan Griffin
Jag Builders
P.O. Box 23202
Charlotte, NC 28227

Dear Mr. Griffin:

Re: 14035 Clarendon Pointe Court
File: 785B

Receipt of your plans for a modified waste disposal system for the above referenced property is acknowledged.

The plans as submitted are approved with the following comments:

-Water saving plumbing devices and low flush toilets should be installed when constructing the residence.

-Effectively rake and lime all trench sidewalls.

-Landscaping of original system area and the repair area is prohibited. No grading, shaping, or altering in any way.

-The well should be located 100 feet, but in no case less than 50 feet from the sewage system and repair area.

Upon execution and recording of the enclosed "Septic Tank Agreement Form" an improvement permit can be issued by this Department.

If you have any questions concerning this matter, please contact me at 336-5575.

Sincerely,

Kelly Randall, R.S.
Individual Water and Wastewater Systems

Enclosure(s)

TO: ENVIRONMENTAL HEALTH DEPT.
BUILDING STANDARDS DEPT.
DEPT. OF ENVIRONMENTAL PROTECTION/
SOLID AND HAZARDOUS WASTE

DATE: 3/20/95

FROM: COUNTY ENGINEERING DEPARTMENT

EHD FILE _____ JURISDICTION CODE Meck

PARCEL NUMBER # 001-014-73

ASSIGNED ADDRESS 14035 Clarendon Pointe Ct

EXISTING ADDRESS Unit 7

PROJECT NAME CLARENDON

THE ABOVE DESCRIBED LOCATION HAS BEEN CHECKED CONCERNING:

		APPROVED	DISAPPROVED
1.	SUBDIVISION REGULATIONS		*
2.	FLOODWAY REGULATIONS		*
3.	EROSION CONTROL REGULATIONS		*
4.	PUBLIC UTILITY EASEMENT		*

		PRESENT	NOT PRESENT
5.	PUBLIC UTILITY EASEMENT	*	
6.	PROPERTY FRONTS ON THOROUGHFARE	*	
7.	DRIVEWAY PERMIT REQUIRED	*	

*If checked, further investigation will be required to determine whether a building permit can be issued by Building Standards for the site.

REMARKS: Septic Tank

NOTE: THIS FORM MUST BE TURNED IN AT THE CASHIER'S OFFICE AT BUILDING STANDARDS WHEN PAYING PERMIT FEES.

A CERTIFICATE OF OCCUPANCY WILL NOT BE GRANTED UNTIL THE TRANSPORTATION DIVISION GRANTS FINAL APPROVAL ON DRIVEWAYS.

SIGNED: _____

OPWEAR 06-88

NEW ADDRESS _____*

FORM 100

Mecklenburg County

Health Department

Betty S. Snow, R.N., M.A.
Health Director

December 30, 1992

400 ☑

Crescent Resources, Inc.
P.O Box 1003
Charlotte, NC 28201-1003

RE: Property located off Hager Ferry Road, Lot 7
FILE: 785B/8656A
PARCEL: 001-014-12po

Dear Sirs:

At your request, a field investigation was conducted on the property designated above for the purpose of determining site suitability for the installation of a ground absorption sewage disposal system. The property was found to contain a limited area of soils which were classified as PROVISIONALLY SUITABLE for such an installation. A copy of the Site Evaluation Report (Serial Number 12957) is enclosed for your information.

While this classification indicates the site is acceptable for the installation of a septic tank system, no specific system or plans have been approved. The area available for such an installation may impose limitations on the size and/or type construction permitted on the lot. Our review process begins upon receipt of an Application for an Improvement Permit accompanied by a plot plan **drawn to scale with accurate dimensions indicated** detailing the location of existing well or type sewage disposal systems (if applicable), setbacks, and utility easements. Proposed buildings, etc. must be drawn on the plot plan to allow sufficient remaining space for the sewage disposal system and well. The well should be located 100 feet from any part of any sewage disposal system (including those located on adjacent properties).

Please note that this classification may be changed if any filling, grading or construction (including the drilling of a well) is performed on the lot which without **prior** approval from this Department. Current regulations in effect are "Laws and Rules for Sanitary Sewage Collection, Treatment, and Disposal: 15A NCAC 18A .1900, August, 1991". Changes in regulations may impact future approvals on this lot.

If there are any questions concerning this matter, please contact Bill Marlin at 336-5574.

Sincerely,

Kelly Randall, R.S., Soil Scientist
Individual Water and Wastewater Systems
KR/wpg

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH File: 785B/865A Action 1

SITE EVALUATION REPORT

SERIAL NUMBER 12957 Parcel: PO 001-014-12 ☐ PC

Location: off Hoger Ferry Road

Subdivision: Clarendon

Lot: 7 Block: Acres: .7


Owner: Crescent Resources, Inc.

Address: PO Box 1003
Charlotte, N.C. 28201-1003

Comments: 100% Repair, .3 gal/Ft2/day

Described by: William R. Marlin

Date: 12-24-92

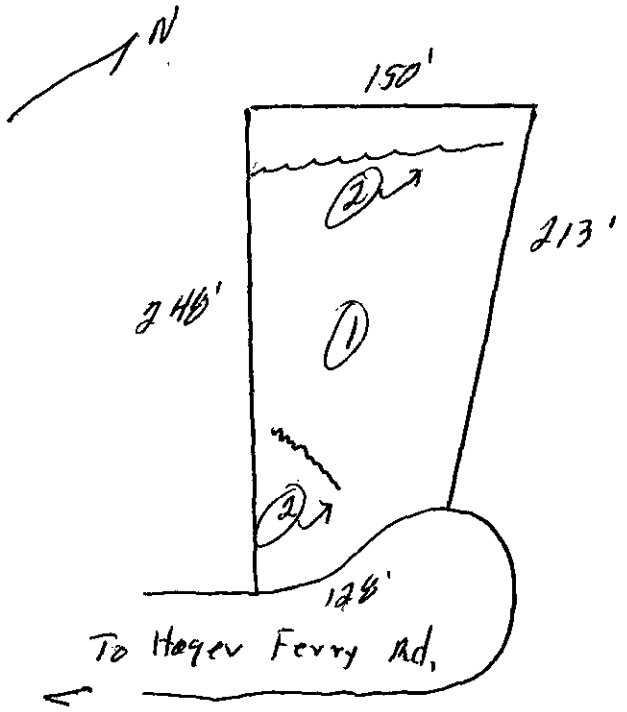

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	(S) PS U 2-12%	S PS (U) Complex Slopes	S PS U	S PS U	S PS U	S PS U
Texture	S (PS) U Slightly Expansive clay	S PS U —	S PS U	S PS U	S PS U	S PS U
Structure	S (PS) U Blocky	S PS U —	S PS U	S PS U	S PS U	S PS U
Drainage	(S) PS U 748'	S PS U —	S PS U	S PS U	S PS U	S PS U
Depth	(S) PS U 749"	S PS U —	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	(S) PS U 748'	S PS U —	S PS U	S PS U	S PS U	S PS U
Available Space	S (PS) U limited	S PS U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	IV Cecil-Like	Complex Slopes				
Area Classification	S (PS) U	S PS (U)	S PS U	S PS U	S PS U	S PS U

MECKLENBURG COUNTY ENVIRONMENTAL HEALTH
SITE EVALUATION REPORT
SERIAL NUMBER № 12957

File: [illegible] Action: 1

Parcel: [illegible] ☐ PC

Location: [illegible] Hopes Ferry Road

Subdivision: [illegible]


Lot: 1 Block: Acres: .1

Owner: [illegible]
Address: [illegible]

Comments: North Access Easement

Described by: [illegible]

Date: 12-7-12

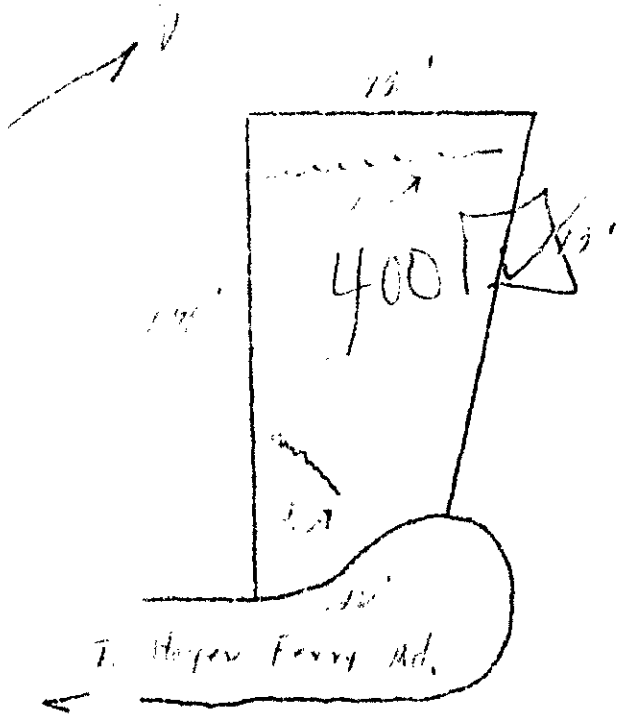

***** EVALUATION KEY *****

S = Suitable U = Unsuitable
PS = Provisionally Suitable
The "Area Classification" below indicates the suitability of areas in the diagram.

FACTORS	AREA 1	AREA 2	AREA 3	AREA 4	AREA 5	AREA 6
Topography	S PS U 2 12 %	S PS U [illegible]	S PS U	S PS U	S PS U	S PS U
Texture	S PS U slightly [illegible] clay	S PS U	S PS U	S PS U	S PS U	S PS U
Structure	S PS U Blocky	S PS U —	S PS U	S PS U	S PS U	S PS U
Drainage	S PS U 24"	S PS U —	S PS U	S PS U	S PS U	S PS U
Depth	S PS U 24"	S PS U —	S PS U	S PS U	S PS U	S PS U
Restrictive Horizons	S PS U 24"	S PS U —	S PS U	S PS U	S PS U	S PS U
Available Space	S PS U limited	S PS U	S PS U	S PS U	S PS U	S PS U
Other (specify)	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U
Soil Group/Series	12 Cecil	[illegible]				
Area Classification	S PS U	S PS U	S PS U	S PS U	S PS U	S PS U

7858 (8656A)

INDIVIDUAL WATER AND WASTEWATER SYSTEMS PROGRAM
APPLICATION FOR SERVICES

[] CRT

Mecklenburg County Health Dept.
Environmental Health Division
c/o Hal Marshall Ctr., Suite 211
700 N. Tryon St.
Charlotte, NC 28202

(704)336-5102

COPY

Date: 11/30/92

PERSON FILING APPLICATION:

NAME: Jacobs (last) Toney (first) C (mi)

ADDRESS: Rt 9 Box 164-1 PHONE: (704) 664-6687

CITY: Mooresville STATE: N.C. ZIPCODE: 28115

PROPERTY INFORMATION (FROM ENGINEERING FORM):

TAX/PARCEL NUMBER: 00 001-014-12

STREET ADDRESS: off Harris Ferry

ZONING:

PROPERTY OWNER:

NAME: Crescent Resources Inc. (last) (first) (mi)

ADDRESS: PO Box 1003 PHONE: (__) 382-2410

CITY: Charlotte, STATE: N.C. ZIPCODE: 28201-1003

SUBDIVISION OR MOBILE HOME PARK NAME:

Township (check one):
[] 0 Mecklenburg County [] 2 Davidson [] 4 Pineville [] 6 Huntersville
[] 1 Charlotte [] 3 Cornelius [] 5 Matthews [] 7 Mint Hill

LOT NUMBER: 7 LOT SIZE (in acres):

TYPE APPLICATION (check one):

[X] SOIL TEST - INDIVIDUAL LOT (D)
[] NEW CONSTRUCTION ON VACANT LOT - 4 BEDROOMS OR LESS (N)
[] EXCHANGE MOBILE HOME - SAME # BEDROOMS (Y)
[] ADDITION - INCREASE ROOMS/OCCUPANCY/MOBILE HOME SIZE (A or M)
[] COMMERCIAL OR INDUSTRIAL (N)
[] SOIL TEST DEVELOPMENT (P)
[] ADDITION - GARAGE OR REKOVATION/NO MAJOR CHANGES (X)
[] MODIFIED /ALTERNATIVE/ OR RESIDENCE > 4 BEDROOMS (Z)
[] REPAIR TO SYSTEM (R)

RESIDENTIAL PROPERTY (Type Building, check one):
[] SINGLE MOBILE HOME (S) [X] HOUSE (H) [] MULTIPLE FAMILY (U)
[] DOUBLE WIDE (D) [] MODULAR HOME (M) [] OTHER _____ (O)

NUMBER BEDROOMS: NUMBER OCCUPANTS:

SYSTEM CLASSIFICATION:

COMMERCIAL/INDUSTRIAL PROPERTY:
Type Business _____ # Employees ___ Per Shift ___ ___ ___
Industrial Wastes (Y/N) ___
Underground Storage Tanks On Property (Y/N) ___ Type _____

WATER SUPPLY (check one):
[] Community (C) [] Shared Well (S)
[] Municipal (M) [] Other 'spring' (O)
[] Private Well (P)

FUTURE ADDITIONS - ALL PLANNED ADDITIONS MUST BE ENTERED (check all that apply):
[] Swimming Pool [] Jacuzzi [] Stable/Barn [] Workshop [] None
[] Garage [] Storage Building [] Deck/Patio [X] Bedrooms 4 [] Other

The undersigned, owner, or legal agent for the owner, of the property described above as the "JOB LOCATION" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the MECKLENBURG COUNTY HEALTH DEPARTMENT to enter onto the property for the purpose of processing this request.

Signed: Jerry C Jacobs, PPSS Date: 11/30/92

NOTICE:

The undersigned, an authorized agent of the MECKLENBURG COUNTY HEALTH DEPARTMENT, certifies that the Department has approved the the Request for the Job Location contained in this document. This approval is granted in accordance with the provisions of Laws And Rules For Sanitary Sewage Collection, Treatment And Disposal in effect at the time of issuance of the permit and is subject to the following provisions:

...No work shall be conducted on the septic tank system until an installation, Construction, Alteration and/or Repair approval is granted by this Department.

...This permit is not transferable.

...

[] IMPROVEMENT PERMIT - VALID 60 MONTHS FROM ISSUANCE
[] MOBILE HOME EXCHANGE APPROVAL - VALID 6 MONTHS FROM ISSUANCE
[] ADDITION/RENOVATION APPROVAL - VALID 1 YEAR FROM ISSUANCE

Environmentalist Date

Director or Authorized Section Head Date

WATER : 122791

124

24 22 17 6 17


PROPOSED PLOT PLAN

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
1200 BLYTHE BOULEVARD
CHARLOTTE, NC 28203
PHONE (704) 376-4603

FILE: 795B (4656A)

TC: 061-014-12,00.

Draw in and name all roads adjoining the property. Draw in and accurately dimension the lot concerned. Accurately indicate property boundaries, proposed and/or existing structures and driveways, underground utilities, and wells and springs within 100 feet of the proposed building or drainfield.

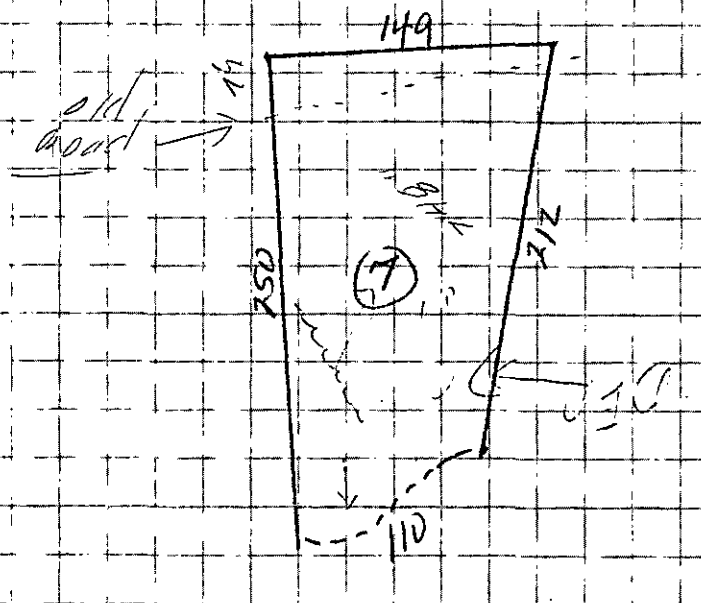

APPROVAL DATE _____

White - Health Department's Copy Canary - Environmentalist's Copy Pink - Owner's