SEE INSTRUCTIONS ON BACK

Date Received 10-2-78

ICAR(S) Application No. 145386

T. C. No. 107-314-09


Map Date 8-7-78

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to

1) Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

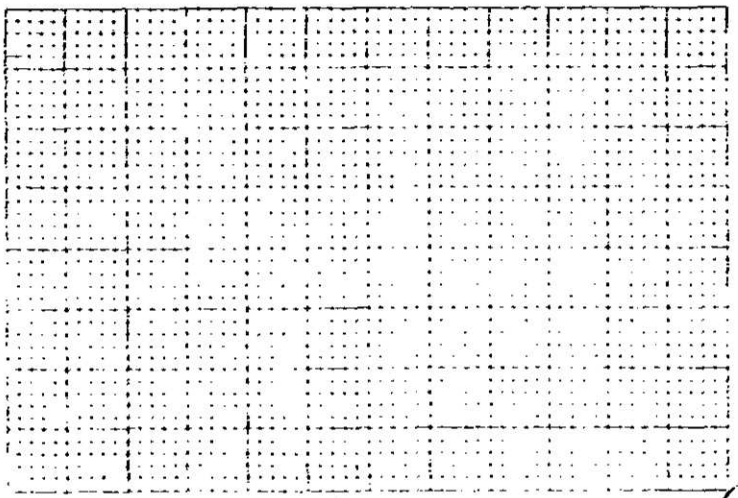

3) PLOT PLAN (ACCURATELY DIMENSIONED)

4) Mobile Home ___Yes ___No
Residence Yes ___No
5) No. of Bedrooms ___
6) Business Use Max No restaurant
Employees ___
7) Washing Machine ___Yes ___No
8) Garbage Disposal ___Yes ___No
9) Dishwasher ___Yes ___No
10) Water Supply
A) Individual Well ___
B) Governmental System ___
C) Community System ___
1) Well source ✓
2) Governmental source ___
11) Sewage System
A) Property is/is not within 200 feet of public sewer ___Yes ___No
B) Property is/is not within 200 feet of community sewer ___Yes ___No
12) For Agent Use Only ___
13) Agent Code No ___

13) NAME OF OWNER Douglas / Moody (LAST) Douglas (FIRST) L J (MIDDLE)

14) ADDRESS OF OWNER 2442 Shelburne Dr

15) PHONE NO Home 545-6644 Office 537-0133

16) LOCATION OF SYSTEM 6816 Mount Holly Stowe Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION Holly Stowe Shopping Center Lot No 7 Block No ___

Map Book No 7 Page No 227

18) DEED REFERENCE — DEED BOOK 7 AT PAGE 227

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES ___NO DATE RUN

20) PTR NUMBER (See Instructions)

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

DATE OF APPLICATION 10-1-78

OWNER Douglas L Moody Jr

EHC-5-76

Environmental Health Department's Copy

SEE INSTRUCTIONS ON BACK

Date Received 5 March 1979

ICAR(S) Application No. 14586

T. C. No. 107-314-09


Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Department of Environmental Health for a permit to:

1) Install or Construct 2) ✓ Alter or Repair an individual septic tank wastewater treatment system with a subsurface, soil absorption, effluent discharge.

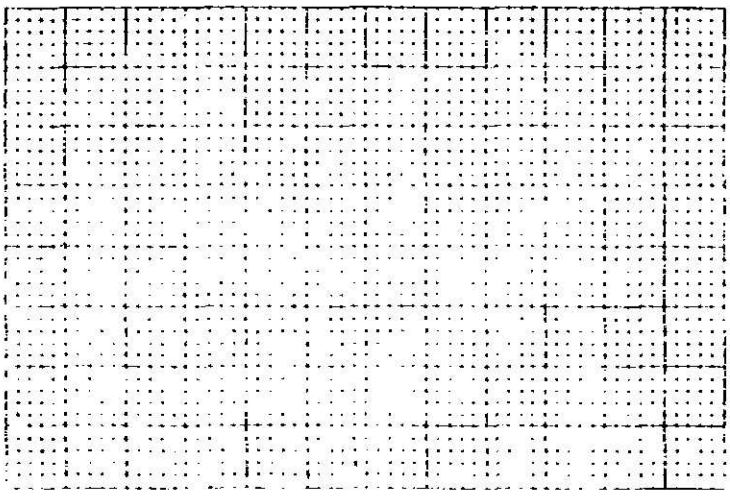

3) PLOT PLAN (ACCURATELY DIMENSIONED)

Mobile Home ___ Yes ___ No
Residence ___ Yes ___ No

4) No. of Bedrooms _____
5) Business Use -- Max No. 2 1/5 of Flr. Area
Employees 2
6) Washing Machine ___ Yes ___ No
7) Garbage Disposal ___ Yes ___ No
8) Dishwasher ___ Yes ___ No
9) Water Supply
A) Individual Well _____
B) Governmental System _____
C) Community System
1 Well Source _____
2 Governmental source _____
10) Sewage System
House located within 200 feet of public sewer ___ Yes ___ No
House located within 200 feet of community sewer ___ Yes ___ No
11) EHA Sewer Permit _____
12) EHA Septic Tank Permit _____

13) NAME OF OWNER Moody (LAST) Dwight (FIRST) A Jr (MIDDLE)

14) ADDRESS OF OWNER 612 Sutherland NC 28212

15) PHONE NO Home 545-6864 Office 537-0133

16) LOCATION OF SYSTEM 6826 Harrell Hickory Grove Rd (STREET OR COUNTY ROAD)

17) SUBDIVISION Hickory Grove Lot No _____ Block No. _____

Map Book No. _____ Page No. _____

18) DEED REFERENCE -- DEED BOOK _____ AT PAGE _____

19) HAS A SOIL INVESTIGATION BEEN RUN? ✓ YES NO DATE RUN _____

20) PTP NUMBER (See Instructions) 14586

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

3-5-79
DATE OF APPLICATION

Dwight A Moody Jr
OWNER

EHC-5-76

ENVIRONMENTAL HEALTH DEPARTMENT'S COPY

Date Issued 29 March 1979

Serial No. 2458

ICAR (S) Permit No. 14586


T C. No. _____

Map Date _____

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ~~Install~~ or Construct, ~~Alter~~ or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 14586, dated _____ and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before _____, after which date this permit shall be null and void.

addition to system

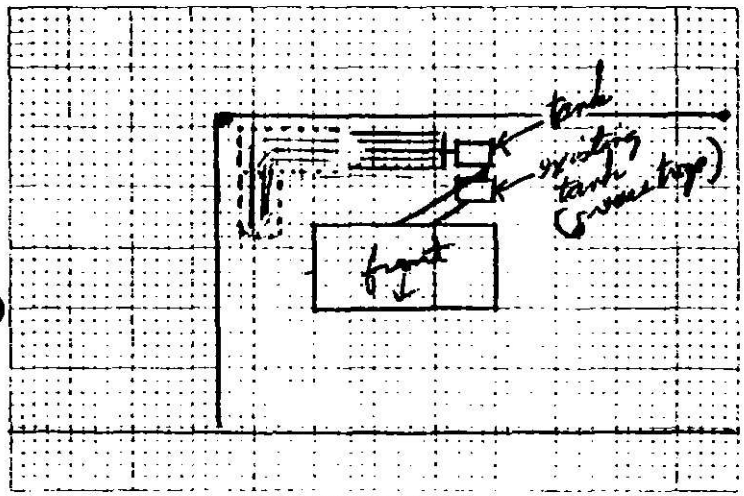

PLOT OF SYSTEM

Permeability Rate _____

Liquid Capacity of Tank 1500

Tank Construction precast

Absorption and or Nitrification Lines

Total Line Length 300'

Number of Lines 5

Distance from House 5'

Distance from Property Line 5'

Distance from Well NA

NAME OF OWNER Moody, D.

LOCATION OF PROPERTY Newell Hickory Grove Rd

The system shall conform to the requirements as set forth in the Regulations of the Mecklenburg County Health Commissioner which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Environmental Health Director before any system can be covered up or otherwise rendered unacceptable or can be used. **The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.**

Common use existing tank for grease trap, add two "tees"

Division or Section Head

John P. Atkisson
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Department of Environmental Health in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

EHD-5-76

Environmental Health Department's Copy

Date Issued 6-26-79 Serial No. 2775 C of A (s) No. 14586

T C. No. 107-314-09

MECKLENBURG COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Moody (LAST), D. (FIRST) (MIDDLE)

Location of Property Newell-Hickory Grove Road

Application Number 14586 Permit Number 14586

Inspection Date:

Liquid Capacity of Tank 1500 gallons Tank Material precast conc.

Total Length of Drain Tile 300' Number of Lines 4

Depth of Filter Material 17" Cover Depth 24"-36"

Water Supply Source city Distance from Water Source —

Excavation Inspected — (DATE) Tank Inspected 6-26-79 (DATE)

Nitrification Field Inspected 6-26-79 (DATE)

Washing Machine Line Inspected, If Applicable — (DATE)

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption effluent discharge as described above and it has been ✓ installed or constructed, altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Health Commission in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit, in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments: Installed as permitted.
Used old septic tank for grease trap + installed a clean-out over it.

Michael A. Sexton
Environmentalist

EHD-S-76

Environmental Health Department's Copy