

5104 N GRAHAM ST

04509110

7/8/08

marliwr

Groundwater and Wastewater Services File Imaging Project
May 2007
Barcode Font = IDAutomationHC39M

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 13806 DATE: 5-25-01

TC: 045-09-10 ☒ L ☐ CRT

SERIAL Nº 18643

Name of Owner CUSTOM PALLET COMPANY Juris.: _____

Address of Property 5104 N. GRAHAM STREET

Inspection Data:

Tank Material —

Total Length of Drainfield 200'

Number of Lines 1 @ 9'x67'

Cover Depth 12"

Water Supply Source MUNICIPAL

Distance to Water Source —

Excavation Inspected 5-25-01

Tank(s) Inspected PUMPED —

Wash Line Inspected —

High Water Alarm Inspected —

SEE INSTALLATION

PLOT

Design REPAIR 67'x9', EXISTING LINE TIED IN CTR# STEVE DUNCAN

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☐ altered or repaired

☒ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of 15A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of 15A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: TYPE II

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

CERTIFICATE OF COMPLETION/OPERATION PERMIT

HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 13806 DATE: 5-25-01

TC: 045-09/-10 ☒ L ☐ CRT

SERIAL Nº 18643

Name of Owner CUSTOM PALLET COMPANY Juris.: _____

Address of Property 5104 N. GRAHAM STREET

Inspection Data:

Tank Material —

Total Length of Drainfield 200'

Number of Lines 1 @ 9'x67'

Cover Depth 12"

Water Supply Source MUNICIPAL

Distance to Water Source 50' —

Excavation Inspected 5-25-01

Tank(s) Inspected PUMPED —

Wash Line Inspected —

High Water Alarm Inspected —

SEE INSTALLATION

PLOT

Design REPAIR 67'x9', EXISTING LINE TIED IN CTR# STEVE MUDRY

The undersigned has inspected the Septic Tank System described above, and certifies it has been

☐ installed or constructed ☐ altered or repaired

☐ in accordance with the permit issued ☐ as detailed in the plot above

and meets the provisions of I5A NCAC 18A. 1900, "Laws And Rules For Sewage Treatment and Disposal Systems" in effect on the date of issuance of the permit. This issuance of this

☐ Certificate of Completion ☒ Operation Permit

does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This document is issued subject to those restrictions and conditions shown on the permit(s) and the provisions of I5A NCAC 18A. 1990 in addition to those listed below under "COMMENTS." This document shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Notice: Disturbance of the designated repair area may result in the suspension/revocation of this permit.

COMMENTS: TYPE II

Environmental Health Specialist

Mecklenburg County services are available without regard to ethnic origin, sex, or disability.

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 13806 DATE: 5-24-01

TC: 045-09/10 IL

SERIAL Nº 18611

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 5-24-01. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

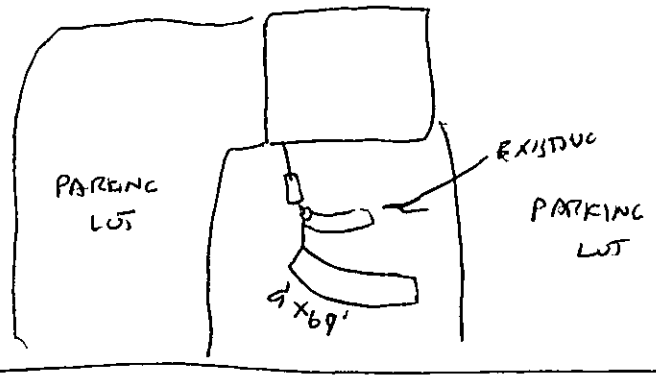

504 N. GRAHAM ST

PLOT OF SYSTEM

Liquid Capacity of Septic Tank EXISTING gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction —

Trench Depth 32"

Absorption and/or Nitrification Lines:

Trench Width 9' feet

Trench Walls Scored and Porous YES

Total Line Length 200 feet

Number of Lines 1

Depth of Stone 18" inches

Distance from House — feet

Distance from Property Line 10' feet

Distance from Well 50 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER CUSTOM PALLET COMPANY

LOCATION OF PROPERTY 5104 N. GRAHAM STREET

Comments: (1) TIE IN EXISTING DRAINFIELD.

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 13.8106 DATE: 5-24-01

TC: 0415-0311-10 ☐ L

SERIAL Nº 18611

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 5-24-01. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of I5A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

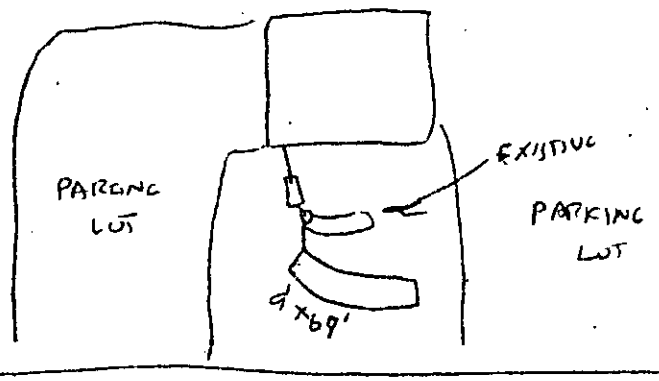

504 N. GRAHAM ST

PLOT OF SYSTEM

Liquid Capacity of Septic Tank EXISTING gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction N/W

Trench Depth 32"

Absorption and/or Nitrification Lines:

Trench Width 9' feet

Trench Walls Scored and Porous SCR

Total Line Length 200 feet

Number of Lines 1

Depth of Stone 18" inches

Distance from House — feet

Distance from Property Line 10' feet

Distance from Well 30 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER CUSTOM PALLET COMPANY

LOCATION OF PROPERTY 5104 N. GRAHAM STREET

Comments: (1) TIE IN EXISTING DRAINFIELD.

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

INSTALLATION, CONSTRUCTION, ALTERATION, AND/OR REPAIR APPROVAL


HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
700 NORTH TRYON ST., SUITE 211
CHARLOTTE, NC 28202
PHONE (704) 336-5102

FILE: 13806 DATE: 5-24-01

TC: 105-051-10 ☒ L

SERIAL No 18611

Permission is hereby given to _____ Install or Construct, _____ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption, effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in the application dated 5-24-01. All work shall be completed on or before _____, after which date this permit shall be null and void. The system shall meet all of the construction requirements of 15A NCAC 18A. 1900 which are in effect on the date of the granting of this permit. A Certificate of Completion or an Operation Permit must be obtained from the Mecklenburg County Health Department before any system can be covered up or placed into service. The issuance of this permit does not in any way guarantee that the system anticipated to be constructed will operate properly, or relieve any person now or hereafter owning, controlling or using such system from any liability resulting from the failure of the system to operate properly.

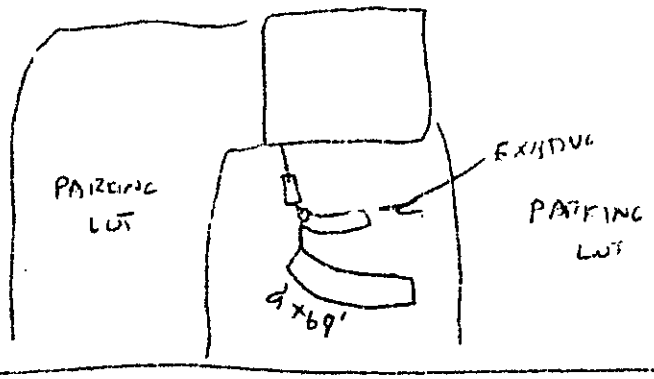

504 N. GRAHAM ST

PLOT OF SYSTEM

Liquid Capacity of Septic Tank EXISTING gallons

Liquid Capacity of Dosing Tank — gallons

Tank Construction —

Trench Depth 3-2'

Absorption and/or Nitrification Lines:

Trench Width 9' feet

Trench Walls Scored and Porous 6FT

Total Line Length 200 feet

Number of Lines 1

Depth of Stone 18' inches

Distance from House — feet

Distance from Property Line 10' feet

Distance from Well 50 feet

NOTICE: This system shall not be installed while soils are in a wet condition.

NAME OF OWNER CLASSIC PALLET COMPANY

LOCATION OF PROPERTY 5104 N. GRAHAM STREET

Comments: (1) TIE IN EXISTING DRAINFIELD.

Environmental Health Specialist

WHITE - HEALTH DEPARTMENT's COPY • CANARY - E.H.S. COPY • PINK - OWNER OR AGENT's COPY

FEE: _____

DATE: _____

APPLICATION FOR IMPROVEMENT PERMIT
FOR RESIDENTIAL SITE
INDIVIDUAL WATER AND WASTEWATER
SYSTEMS PROGRAM

[ ] CRT

TYPE APPLICATION: __ NEW SYSTEM __ EXPANSION/ ALTERATION OF EXISTING SYSTEM L REPAIR OF EXISTING SYSTEM

NORTH CAROLINA
DEPARTMENT OF ENVIRONMENT,
HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

FILE #: 13806

PROPERTY INFORMATION (FROM ENGINEERING FORM) FOR JOB LOCATION:

TAX/PARCEL NUMBER: 045-091-10

STREET ADDRESS: 5104 N. Graham St

SUBDIVISION OR MOBILE HOME PARK NAME:

LOT NUMBER: 1956 Lot 1

TYPE OF BUILDING (CHECK ONE):

__ SINGLE MOBILE HOME(S)
__ DOUBLE WIDE (D)
__ HOUSE (H)
__ MODULAR HOME (M)
__ MULTIPLE FAMILY (U)
__ OTHER (O)

TOWNSHIP (CHECK ONE):

__ 0 MECKLENBURG
__ 1 CHARLOTTE
__ 2 DAVIDSON
__ 3 CORNELIUS
__ 4 PINEVILLE
__ 5 MATTHEWS
__ 6 HUNTERSVILLE
__ 7 MINT HILL

HEATED SQUARE FOOTAGE:

NUMBER OF BEDROOMS:

NUMBER OF OCCUPANTS:

CLOSING DATE _____

FOUNDATION FOR RESIDENCE:

__ WITHOUT BASEMENT
__ ON SLAB
__ CRAWL SPACE
__ WITH BASEMENT /PLUMBING
__ WITH BASEMENT /NO PLUMBING

IF EXPANSION/ALTERATION OF EXISTING SYSTEM, DESCRIBE THE PROPOSED BUILDING ADDITION:

BUSINESS FOR MANUFACTURING PALLETS 60-65 EMPLOYEES, 1 SHIFT

WILL THERE BE A HOME BUSINESS IN THE RESIDENCE: __ YES __ NO TYPE: _____

WATER SUPPLY (CHECK ONE):

__ COMMUNITY (C)
__ MUNICIPAL (M)
__ PRIVATE WELL (P)
__ SHARED WELL (S)
__ OTHER 'SPRINGS' (O)

IF ANY OF THE FOLLOWING ARE LOCATED ON THE PROPERTY, PLEASE SHOW LOCATION ON PLAT:

BURIED CABLES, LANDFILLS, STUMPHOLES __ YES __ NO
EXISTING WASTEWATER SYSTEMS __ YES __ NO
EASTMENTS OR RIGHT-OF-WAYS __ YES __ NO
WELL, SPRINGS OR WATERLINES __ YES __ NO
DESIGNATED WETLANDS __ YES __ NO

PROPERTY OWNER: CUSTOM PALLET COMP.

NAME: GILBERT (LAST) JAMES (FIRST) M. (MI)

ADDRESS: 5104 N. GRAHAM ST

CITY: CHARLOTTE STATE: NC ZIP: 28269

DAYTIME PHONE: (704) 521 - 1100

LEGAL AGENT FOR PROPERTY OWNER, IF APPLICABLE:

NAME: (LAST) (FIRST) (MI)

DAYTIME PHONE: ( ) —

WHAT DATE WAS THE PROPERTY ORIGINALLY DEEDED AND RECORDED? _____

An Improvement Permit is subject to suspension or revocation if site plans or the intended use change or if information submitted in this application is falsified or changed. The undersigned, owner, or legal agent for the owner, of the property described above as the "Job Location" has read the foregoing application, acknowledges that the contents of same are true, and authorizes agents of the Mecklenburg County Health Department to enter onto the property for the purpose of processing this request.

SIGNED: Douglas C. Rimes DATE:

MECKLENBURG COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH DIVISION
c/o HAL MARSHALL CTR., SUITE 211, 700 N. TRYON ST., CHARLOTTE, N.C. 28202., (704) 336-5102