Date Received 3-8-73

ICAR(S) Application No 5716

T. C. No 261-[illegible]
181-06

Map Date 7-1-70


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

Application for an
Installation, Construction, Alteration, and/or Repair Permit
(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

The owner of that property described hereinafter hereby applies to the Mecklenburg County Health Department for a permit to

( ) Install a [illegible] ( ) Alter or Repair an individual septic tank wastewater treatment system with [illegible] effluent discharge

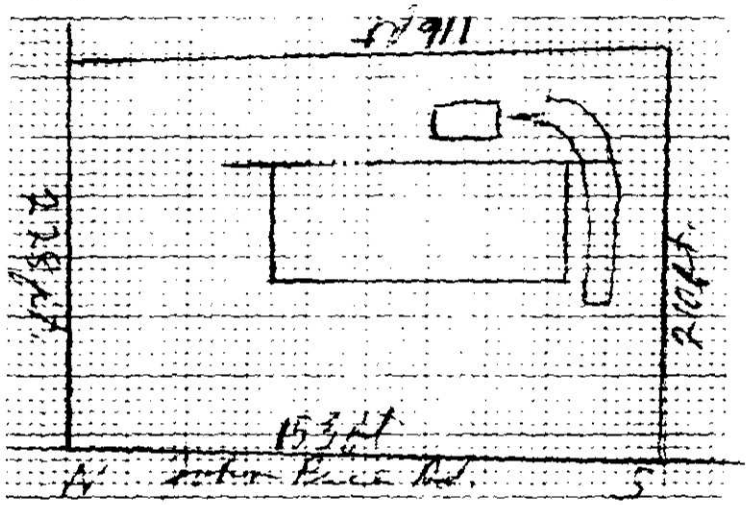

3 Bedrooms
Water Supply: Public No
Garbage Disposal No
Dishwasher No
Water Softener
Automatic Washer
Septic Tank System
Size
Distribution System
Trench located within 25' from
Trench located within 25' from
Pump Yes No
Effluent Discharge

3) PLOT PLAN ACCURATELY DIMENSIONED

13) NAME OF OWNER [illegible] (LAST) [illegible] (FIRST) [illegible] (MIDDLE)

14) ADDRESS OF OWNER [illegible]

15) PHONE NO Home 535-5285 Office

16) LOCATION OF SYSTEM John Price Rd. (STREET OR COUNTY ROAD)

17) SUBDIVISION _____ Lot No _____ Block No _____

Map Book No _____ Page No. _____

18) DEED REFERENCE — DEED BOOK _____ AT PAGE _____

19) HAS A PERCOLATION TEST BEEN RUN? _____ YES _____ NO DATE RUN _____

20) PTR NUMBER See Instructions _____

The undersigned person hereby agrees that he has read the foregoing application and that the contents of same are true. It is understood that any permit applied for herein shall be void and of no effect if any of the above facts are not true.

Mar 6, 73
DATE OF APPLICATION

A. M. Price
OWNER

FORM NO. [illegible]

HEALTH DEPARTMENT'S COPY

Serial No 2321 ICARUS Permit No 5716

Date Issued 15 March 1973 T. C No 201-181-06

Map Date


MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

INSTALLATION, CONSTUCTION, ALTERATION, AND/OR REPAIR PERMIT

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Permission is hereby given to ___ Install or Construct ✓ Alter or Repair the individual septic tank wastewater treatment system with subsurface, soil absorption effluent discharge as specified herein at the described location. This permit is granted based upon the information supplied in application 5716, dated 3-8-73 and this permit shall be void and of no effect if the information provided in the application is not true or is erroneous. All work shall be completed on or before 2 April 1973 after which date this permit shall be null and void.

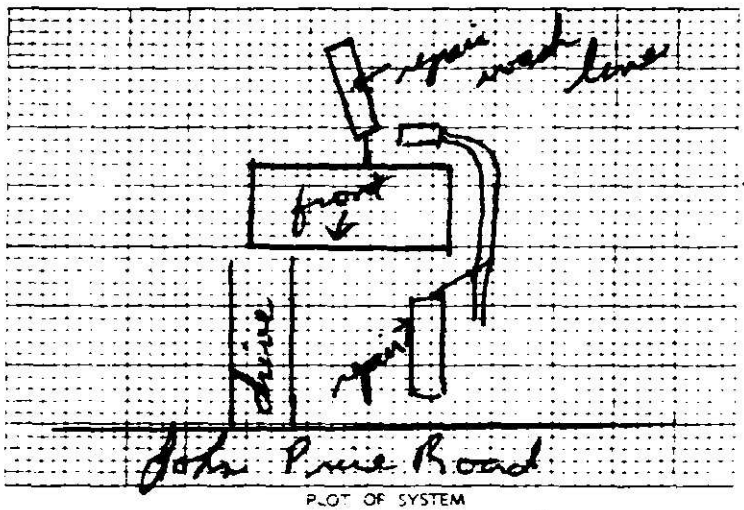

PLOT OF SYSTEM

Repair Data

Percolation Rate

Liquid Capacity of Tank

Tank Construction

septic system

Absorption and/or Nitrification Lines

Total Line Length 100 Lf

Number of Lines 3 (7½ X 33 X 17")

Distance from House 10' +

Distance from Property Line 10' +

Distance from Well 50' +

NAME OF OWNER Prince, Arthur G.

LOCATION OF PROPERTY John Price Road

The system shall meet all of the construction requirements as set forth in the Regulations of the Mecklenburg County Board of Health which are in effect on the date of the granting of this permit. A certificate of approval must be issued by the Health Director before any system can be covered up or otherwise rendered unacceptable or can be used.

Comments: place washing machine discharge in bed 7½ X 33' X 17" #1 washed stone

Division or Section Head

John R Atkinson
Environmentalist

* If this permit is for the installation or construction of a new system, it must be signed by the division or a section head of the Environmental Health Division in order to be valid. Only the signature of the Environmentalist is required where an existing system is being altered or repaired.

FORM NO E-5-4 1-71

HEALTH DEPARTMENT'S COPY

Date Issued 17 April 1973 Serial No. 3202

C of A (s) No. 5716

T. C. No. 201-181-06

Map Date

MECKLENBURG COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

CERTIFICATE OF APPROVAL

(Individual Septic Tank System with Subsurface, Soil Absorption, Effluent Discharge)

Name of Owner Price, Arthur G.
LAST FIRST MIDDLE

Location of Property John Price Rd

Application Number 5716 Permit Number

Repair Data
Inspection Date:

Liquid Capacity of Tank Tank Material

Total Length of Drain Tile 1000 ft Number of Lines 3 (3½ x 33)

Depth of Filter Material 17" Cover Depth 14"

Water Supply Source well Distance from Water Source 100'

Excavation Inspected 4-17-73 DATE Tank Inspected DATE

Nitrification Field Inspected 4-17-73 DATE

Washing Machine Line Inspected, If Applicable 4-17-73 DATE

The undersigned has inspected the Individual Septic Tank System with subsurface, soil absorption, effluent discharge as described above and it has been _____ installed or constructed, _____ altered or repaired in accordance with the permit issued and the regulations of the Mecklenburg County Board of Health in effect on the date of issuance of the permit. The issuance of this Certificate of Approval does not in any way guarantee that the system will operate properly or relieve any person now or hereafter owning, controlling, or using such system from any liability resulting from the failure of the system to operate properly. This Certificate of Approval is issued subject to those restrictions and conditions shown on the permit(s) in addition to those listed below under comments. This Certificate of Approval shall be null and void if any information contained in the application is untrue or if any additions are made to the property which would increase the requirements for said system.

Comments wash line in bed 7½ x 33' x 17"

John R. Johnson
Environmentalist

FORM NO E-6-4-1-71

HEALTH DEPARTMENT'S COPY